State of California

AIR RESOURCES BOARD

Executive Order G-70-14

Relating to the Certification of the
Red Jacket Aspirator Assist Service Station
Phase II Vapor Recovery System

Pursuant to the authority vested in the Air Resources Board (ARB) by Health and Safety Code Section 41954; and

Pursuant to the authority vested in the undersigned by Health and Safety Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: That the Red Jacket aspirator assist, Phase II vapor collection and disposal system licensed to and marketed by Wylain, Incorporated, Red Jacket Pumps Division, is hereby certified for attendant and/or self-serve use at gasoline service stations in conjunction with Phase I vapor recovery systems which have been certified by the Air Resources Board. The system certified hereby is described in Exhibits 1 and 2 attached hereto.

IT IS FURTHER ORDERED AND RESOLVED: That compliance with the applicable certification requirements and rules and regulations of the Division of Measurement Standards, the State Fire Marshal's Office, and the Division of Industrial Safety of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That the system certified hereby shall perform in actual use with the same effectiveness as the certification test system. Compliance with this performance criterion shall be a condition of this certification, and failure to meet this criterion shall constitute grounds for revocation, suspension, or modification of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That any alteration to the equipment, parts, design, or operation of the system certified hereby, is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the undersigned.

IT IS FURTHER ORDERED AND RESOLVED: That in the event the Air Resources Board or the undersigned establishes a requirement which limits or prohibits the use of nozzle extenders, the system shall be modified within thirty (30) days and shall demonstrate such compliance to the satisfaction of the undersigned.

Executed at Sacramento, California, this 29th day of November, 1977.

William H. Lewis, Jr.
Executive Officer

EXHIBIT 1

Executive Order G-70-14

Red Jacket Aspirator Assist Service Station
Phase II Vapor Recovery System

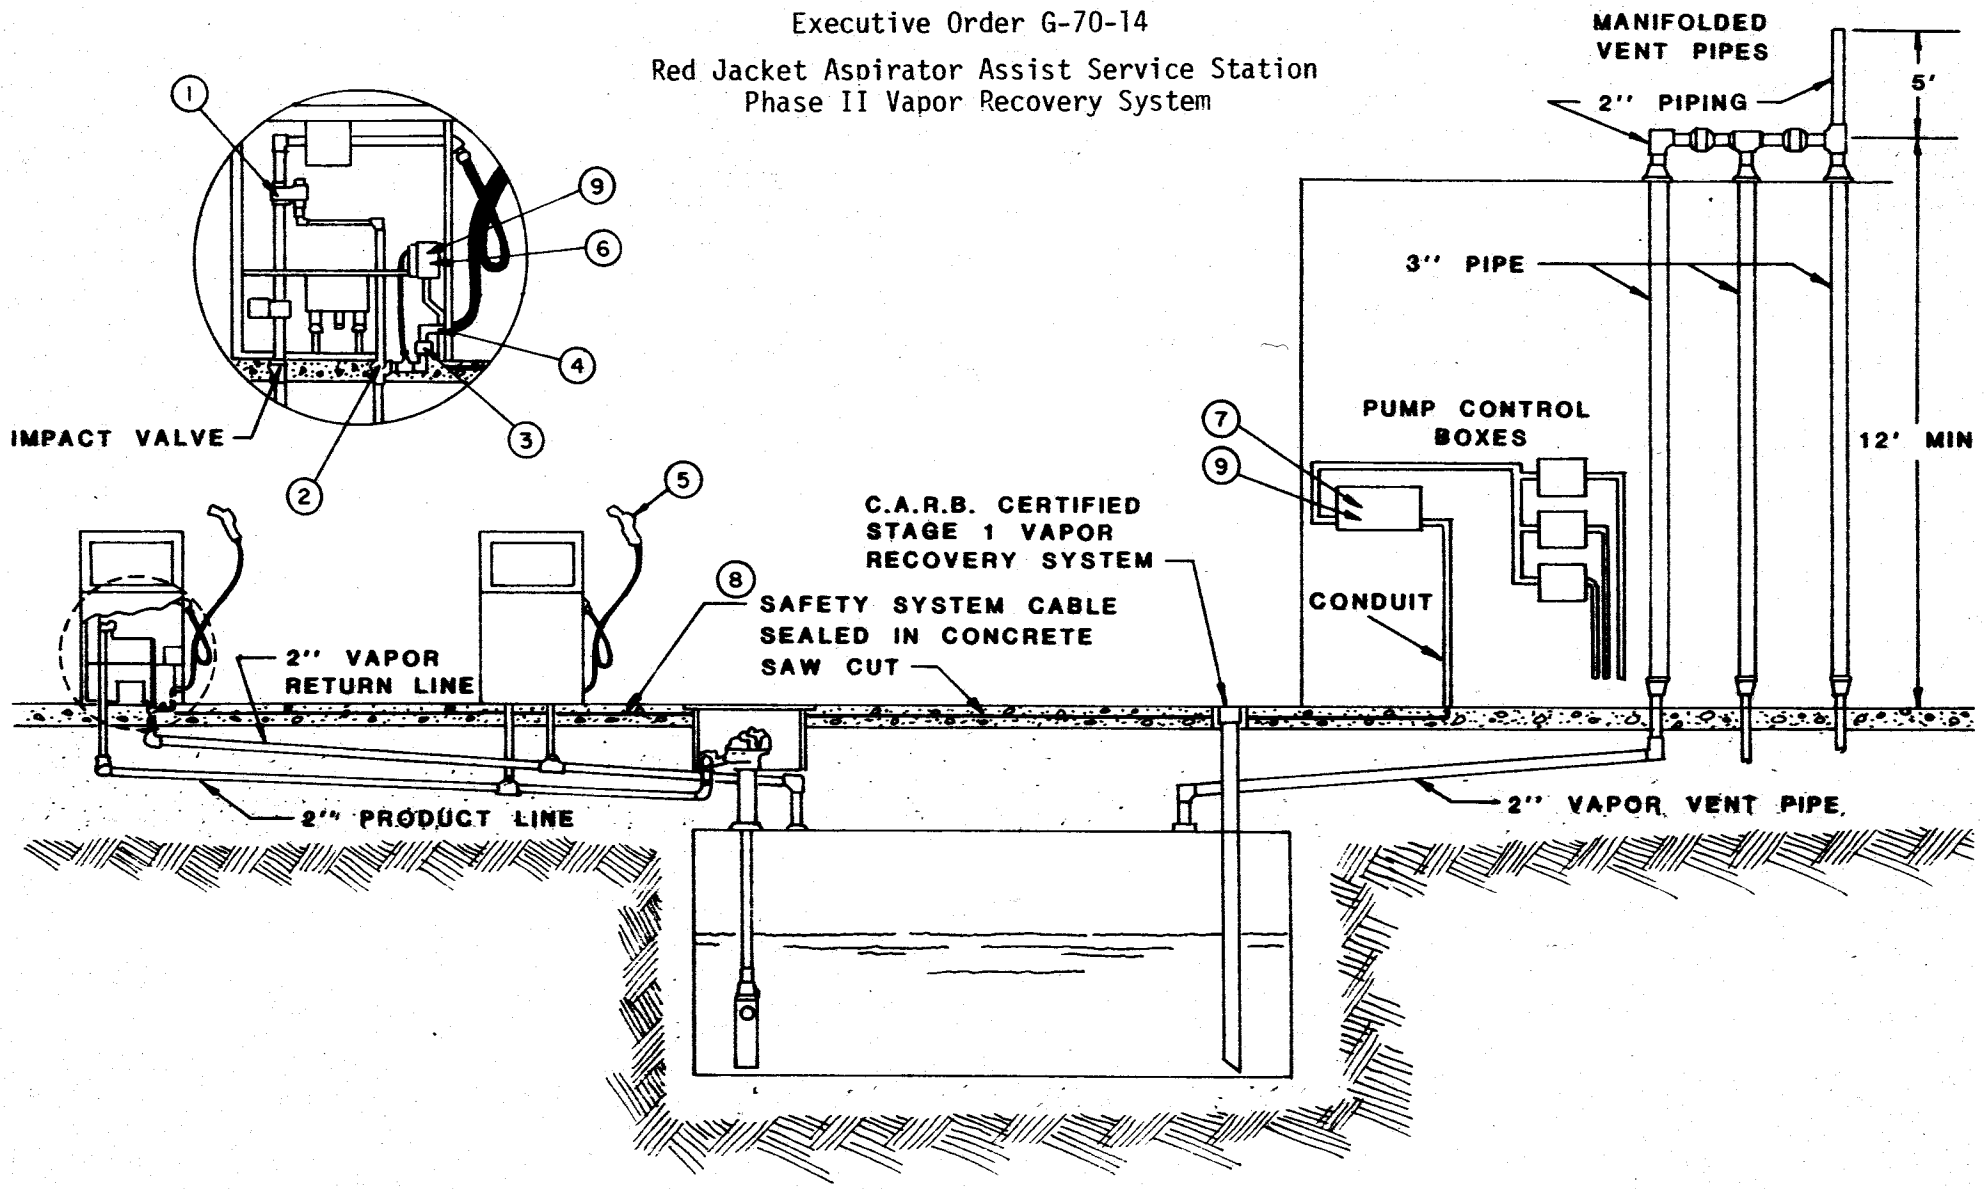

EXHIBIT 2

Executive Order G-70-14 A

Red Jacket Aspirator Assist Service Station

Phase II Vapor Recovery System

Component List

| Item | Manufacturer and Model | State Fire Marshal Identification Number | Substitute Equipment | |
|---|---|---|---|---|
| | | | Manufacturer and Model | State Fire Marshal Identification Number |
| 1. Modulating Valve | Red Jacket 188 - 185 | GVRS002:001:1 188 - 185 | | |
| 2. Aspirator | Red Jacket 104 - 016 | GVRS002:001:1 104 - 016 | | |
| 3. Vapor Check Valve | Red Jacket 188 - 184 | GVRS002:001:1 188 - 184 | | |
| 4. Vapor Screen | Red Jacket 176 - 032 | GVRS002:001:1 176 - 032 | | |
| 5. Nozzle, unleaded | OPW 158 - 013 or 158 - 014 | GVRS002:001:1 158 - 013 or 158 - 014 | | |
| Nozzle, leaded | OPW 158 - 012 | GVRS002:001:1 158 - 012 | | |
| 6. Transducer Package | Red Jacket 001 - 001 - K | GVRS002:001:1 001 - 001 - K | | |
| 7. Safety System Control | Red Jacket 002 - 002 - K | GVRS002:001:1 002 - 002 - K | | |
| 7 Conductor Flat | Spectra Strip 001 - 002 - F | -- | | |
| Connector (inside box) | Alpha 009 - 001 - D | -- | | |