ExecutiveOrderG-70-188

Exhibit 2

Figure2C-5

Typical Installation o f the
Catlow ICVN Nozzle withSpecifiedPhaseII
VaporRecovery System
with Two-Point Phase I System

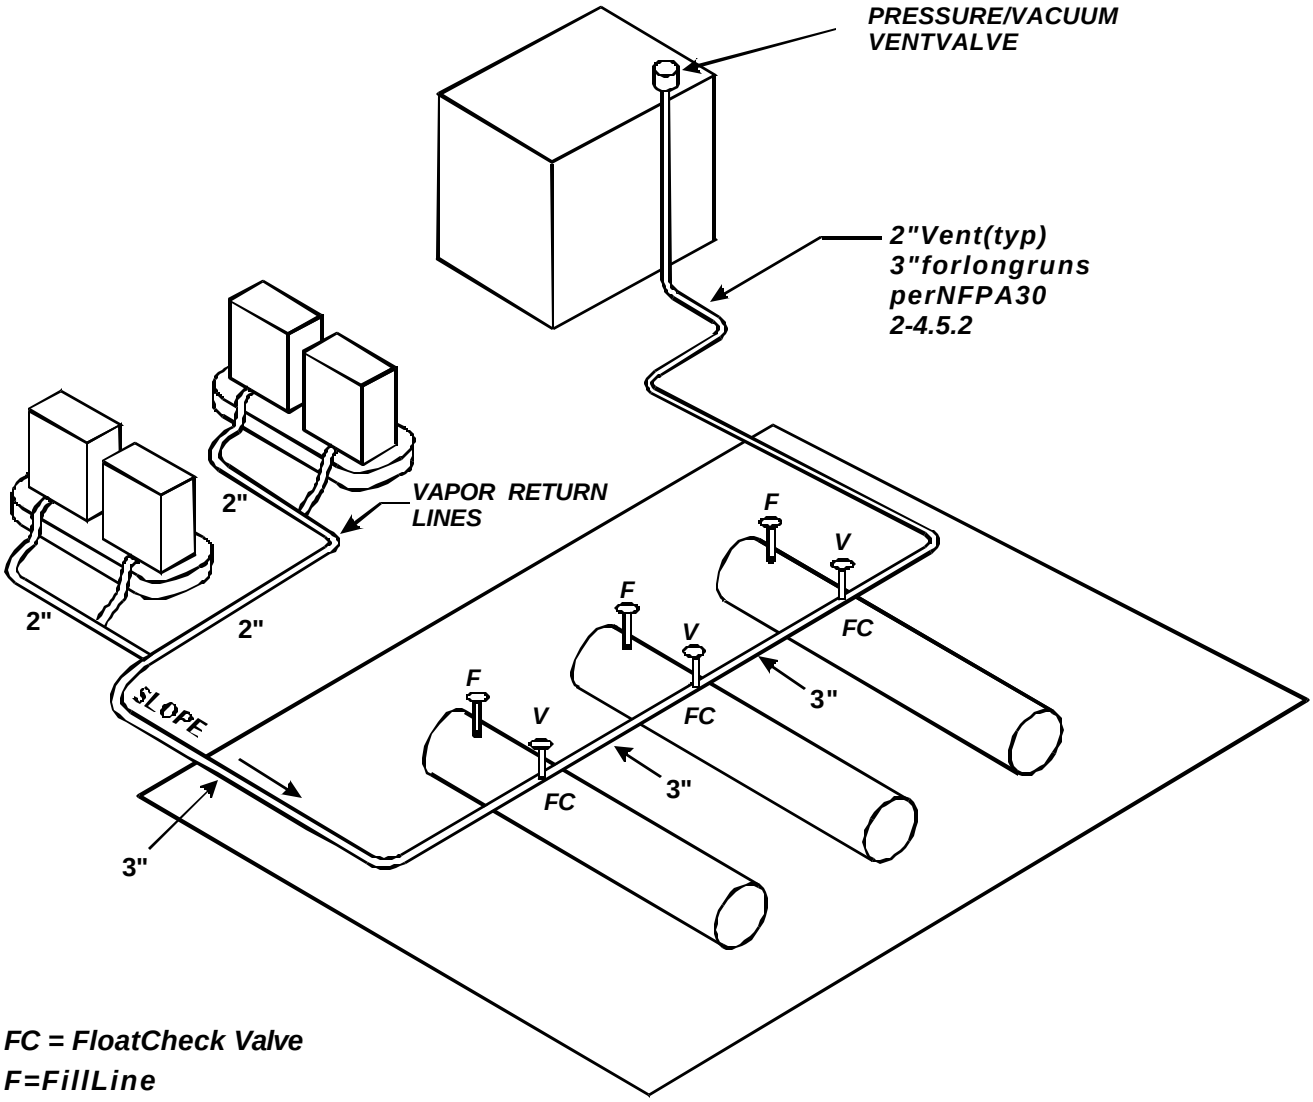

FC = FloatCheck Valve
F=FillLine
V = Phase I Vapor Recovery

Note:1.AllVapor/VentLines are3"NominalIDMinimumExceptasNoted
2.Slope:1/8"perfootMin.
1/4"perFootPrefered
3.Maintain2'0"Clearance BetweenFillLineand
PhaseIVaporReturnLinetoDeliveryTruck