

**Inventory of Direct and Indirect GHG Emissions
from Stationary Air Conditioning and Refrigeration Sources,
with Special Emphasis on Retail Food Refrigeration and
Unitary Air Conditioning**

CARB Agreement No. 06-325

Prepared for

**State of California Air Resources Board
Research Division
PO Box 2815
Sacramento, CA 95812**

Final Report

Prepared by:

Sabine SABA, Rayan SLIM, Lionel PALANDRE, Denis CLODIC

and the participation of
Aline GARNIER for documentation
Simon CLODIC and Martin LANSARD for surveys in California
ARMINES
Center for Energy and Processes
60, boulevard Saint-Michel
F – 75272 PARIS Cedex 06

March 2009

DISCLAIMER

The statements and conclusions in this Report are those of the CEP-Armines and not necessarily those of the California Air Resources Board. The mention of commercial products, their source, or their use in connection with material reported herein is not to be construed as actual or implied endorsement of such products.

TABLE OF CONTENTS

| | |
|--|----------|
| LIST OF FIGURES | I |
| LIST OF TABLES | IV |
| ABSTRACT..... | i |
| EXECUTIVE SUMMARY | ii |
| INTRODUCTION | 5 |
| Part 1 - REFRIGERANT INVENTORY AND EMISSIONS FOR CALIFORNIAN STATIONARY REFRIGERATION SYSTEMS..... | 7 |
| 1 Method of calculation..... | 7 |
| 2 Database for commercial refrigeration in California | 7 |
| 2.1 Grocery supermarkets | 7 |
| 2.1.1 Number of stores in California | 7 |
| 2.1.2 Average area and refrigerant charge..... | 9 |
| 2.1.3 Refrigerant emission rates..... | 11 |
| 2.1.4 Refrigerants in use..... | 12 |
| 2.2 Small stores | 12 |
| 2.2.1 Number of stores in California | 12 |
| 2.2.2 Refrigerant charge and type of refrigerant | 13 |
| 2.2.3 Refrigerant emission rate | 14 |
| 2.3 Refrigerant inventory from 1990 to 2004 | 14 |
| 2.3.1 Refrigerant demand..... | 14 |
| 2.3.2 Refrigerant bank charged in refrigeration equipment..... | 15 |
| 2.3.3 Refrigerant emissions..... | 16 |
| 2.3.4 CO ₂ equivalent emissions of refrigerants | 17 |
| 2.4 Scenarios and projections to 2020 | 18 |
| 2.4.1 Assumptions for scenarios | 18 |
| 2.4.1.1 Scenario 1: business as usual (BAU)..... | 18 |
| 2.4.1.2 Scenario 2: large introduction of secondary loop systems | 18 |
| 2.4.1.3 Scenario 3: introduction of low GWP refrigerants, reduction in cooling capacity and refrigerant charge | 19 |
| 2.4.2 Refrigerant bank filled in refrigeration equipment..... | 19 |
| 2.4.2.1 Case of centralized systems in supermarket only | 19 |
| 2.4.2.2 Commercial refrigeration sector, including small stores..... | 20 |
| 2.4.3 Refrigerant emissions..... | 21 |
| 2.4.3.1 Centralized systems in supermarkets only | 21 |
| 2.4.3.2 Commercial refrigeration sector, including small stores..... | 21 |
| 2.4.4 Refrigerant CO ₂ equivalent emissions..... | 22 |
| 2.4.4.1 Centralized system in supermarkets only..... | 22 |
| 2.4.4.2 Commercial refrigeration sector, including small stores..... | 22 |
| 2.4.5 HCFC recovery and refrigerant demand | 23 |
| 3 Unitary Air Conditioning and chillers | 23 |
| 3.1 Air-to-air systems..... | 24 |
| 3.1.1 Data sources and detailed calculation method..... | 24 |
| 3.1.2 Installed base of AC unitary systems | 24 |
| 3.1.3 Analysis of the uptake of R-410A | 26 |
| 3.1.4 Fugitive emission rate and recovery efficiency..... | 26 |
| 3.2 Chillers..... | 27 |
| 3.2.1 Data sources and calculation method | 27 |
| 3.2.2 Installed base of chillers | 27 |
| 3.2.3 Analysis of the R-123 uptake..... | 28 |
| 3.2.4 Refrigerant charge, emission factor, and recovery efficiency | 28 |
| 3.3 Results of calculations: refrigerant bank and emissions | 29 |
| 3.3.1 Refrigerant bank | 29 |
| 3.3.2 Refrigerant emissions..... | 30 |

| | | |
|---------|---|----|
| 3.3.3 | Refrigerant CO ₂ equivalent emissions..... | 30 |
| 3.4 | Scenarios to forecast refrigerant emission from unitary air conditioners and chillers | 31 |
| 3.4.1 | Scenarios assumptions | 31 |
| 3.4.1.1 | Business as usual scenario (scenario 1): Scenario 1: Business As Usual | 31 |
| 3.4.1.2 | Scenario 2..... | 31 |
| 3.4.1.3 | Scenario 3: Partial phase-out of high GWP HFCs | 31 |
| 3.4.2 | Refrigerant bank | 32 |
| 3.4.3 | Refrigerant emissions | 33 |
| 3.4.4 | Refrigerant CO ₂ equivalent emissions..... | 34 |
| 3.5 | Refrigerant demand and recovery | 35 |
| 4 | Refrigerant emissions from the industrial sector | 36 |
| 4.1 | Food industry and cold storage | 37 |
| 4.1.1 | Calculation method - RIEP | 37 |
| 4.1.2 | Calculation of the cooling capacity and the refrigerant charge | 38 |
| 4.1.2.1 | The cooling capacity per mass of product and by level of temperature | 39 |
| 4.1.2.2 | The Cooling capacity of indirect systems | 39 |
| 4.1.2.3 | The refrigerant charge | 40 |
| 4.1.3 | Type of refrigerants..... | 40 |
| 4.1.4 | Other characteristics..... | 40 |
| 4.1.5 | Production data for food products | 41 |
| 4.1.5.1 | Production data is available for the following sub-domains. | 41 |
| 4.1.6 | Milk tanks..... | 43 |
| 4.1.6.1 | Average refrigerant charge..... | 43 |
| 4.1.6.2 | Characteristics | 43 |
| 4.1.6.3 | Refrigerant type | 44 |
| 4.2 | Industrial processes (other than food industry) | 44 |
| 4.2.1 | Data sources and detailed calculations | 44 |
| 4.2.2 | Results of calculations: refrigerant banks, and emissions..... | 46 |
| 4.3 | Overall refrigerant bank and emissions | 46 |
| 4.3.1 | Refrigerant bank | 46 |
| 4.4 | Refrigerant emissions..... | 47 |
| 4.5 | CO ₂ Equivalent emissions | 48 |
| 4.6 | Refrigerant recovery | 49 |

Part 2 – ENERGY CONSUMPTION OF THE COMMERCIAL REFRIGERATION SECTOR IN CALIFORNIA..... 50

| | | |
|--------|---|----|
| 1 | Description of commercial refrigeration and stores..... | 50 |
| 1.1 | Store categories using refrigeration equipment..... | 50 |
| 1.1.1 | Grocery stores or grocery supermarkets..... | 51 |
| 1.1.2 | Minimarkets | 51 |
| 1.1.3 | Convenience stores..... | 51 |
| 1.1.4 | Liquor stores | 51 |
| 1.1.5 | Pharmacies..... | 51 |
| 1.1.6 | Gas stations..... | 51 |
| 1.1.7 | Hotels..... | 51 |
| 1.1.8 | Motels | 52 |
| 1.1.9 | Bars and restaurants | 52 |
| 1.1.10 | Bakeries..... | 52 |
| 1.1.11 | Butcheries..... | 52 |
| 1.1.12 | Fishmonger Stores | 52 |
| 1.1.13 | Vending machines | 52 |
| 1.1.14 | Carbonated Soda Fountains (CSD Fountains)..... | 52 |
| 1.2 | Identification of refrigeration systems..... | 53 |
| 1.2.1 | Refrigeration systems | 53 |
| 1.2.2 | Refrigerated cabinets and rooms | 53 |
| 1.3 | Survey of current refrigeration cases..... | 53 |

| | | |
|---------|--|-----|
| 1.3.1 | Survey contents and data collection..... | 54 |
| 1.3.2 | Stand-alone equipment | 55 |
| 1.3.3 | Display cases..... | 55 |
| 1.3.4 | Walk-ins | 55 |
| 1.4 | Typical grocery store lay-out | 57 |
| 1.5 | Typical layout of small stores | 59 |
| 2 | Energy consumption of refrigerating systems in California | 60 |
| 2.1 | Method for energy consumption calculation..... | 60 |
| 2.1.1 | Energy consumption calculation..... | 61 |
| 2.1.2 | Heat load, refrigeration capacity..... | 62 |
| 2.1.2.1 | Conduction..... | 62 |
| 2.1.2.2 | Radiation..... | 62 |
| 2.1.2.3 | Convection (air entrainment) | 62 |
| 2.1.2.4 | Internal loads | 62 |
| 2.1.2.5 | Off-Cycle defrosting | 63 |
| 2.1.2.6 | Electric defrosting | 63 |
| 2.1.3 | Thermal modeling of display cases | 63 |
| 2.1.4 | Thermal modeling of cold storage room..... | 65 |
| 2.1.5 | Coefficient of performance | 66 |
| 2.1.6 | Store distribution in climatic zones | 68 |
| 2.2 | Energy Savings..... | 69 |
| 2.2.1 | Heat recovery systems | 69 |
| 2.2.2 | Floating head pressure | 69 |
| 2.2.3 | Installing glass doors in open cases..... | 70 |
| 2.2.4 | Hot Gas Defrost..... | 70 |
| 2.3 | Results for energy consumption | 70 |
| 2.3.1 | Energy consumption in the commercial refrigeration sector | 70 |
| 2.3.1.1 | Results for grocery supermarkets..... | 70 |
| 2.3.1.2 | Results including the other small stores using refrigeration equipment..... | 72 |
| 2.3.2 | Technical options for energy savings | 72 |
| 2.3.2.1 | Technical option 1: night curtain installed on every open display case..... | 73 |
| 2.3.2.2 | Technical option 2: Open display cases closed with glass doors | 74 |
| 2.3.2.3 | Technical option 3: Cabinet lighting, anti-sweat heater and ventilation: low energy consuming technologies | 75 |
| 2.3.2.4 | Technical option 4: Floating head pressure on centralized systems..... | 76 |
| 2.3.2.5 | Technical option 5: three options combined | 77 |
| 2.3.2.6 | Summary | 78 |
| 2.4 | General approach for Life Cycle Cost Analysis..... | 80 |
| 2.4.1 | Calculation method..... | 80 |
| 2.4.1.1 | Total installed cost..... | 81 |
| 2.4.1.2 | Baseline manufacturer selling price..... | 81 |
| 2.4.1.3 | Operating cost | 82 |
| 2.4.1.4 | Pay Back Period (PBP) | 85 |
| 2.4.2 | Life cycle cost assessment (LCCA) of the technical options in an aggregated model..... | 86 |
| 2.4.2.1 | Baseline scenario | 87 |
| 2.4.2.2 | Technical options for energy savings | 87 |
| 2.4.2.3 | Total installed cost..... | 88 |
| 2.4.2.4 | Total operating cost | 89 |
| 2.4.2.5 | Centralized system energy consumption..... | 89 |
| 2.4.2.6 | Results of LCC analysis | 91 |
| 2.4.3 | LCCA of direct and indirect centralized systems | 92 |
| 2.4.3.1 | Description of technical options..... | 92 |
| 2.4.3.2 | Life cycle cost assessment (LCCA) of screened refrigeration systems | 101 |
| 2.5 | TEWI analysis of refrigeration systems | 106 |
| 2.5.1 | Assumptions for indirect emission calculations | 108 |
| 2.5.2 | TEWI calculation..... | 109 |

| | | |
|---|--|-----|
| 2.5.3 | Derivation to Californian state | 110 |
| 2.5.4 | Costs of CO ₂ savings | 111 |
| SUMMARY CONCLUSIONS AND RECOMMENDATIONS | | 113 |
| REFERENCES | | 115 |
| GLOSSARY | | 118 |
| ABBREVIATIONS AND ACRONYMS | | 121 |
| NOMENCLATURE | | 123 |
| APPENDICES | | 124 |

LIST OF FIGURES

| | |
|--|----|
| Figure 1.1 Population growth in California..... | 8 |
| Figure 1.2 GDP/inhab. growth in California..... | 8 |
| Figure 1.3 Number of supermarkets in California. Data from U.S. Bureau of Census..... | 8 |
| Figure 1.4 Average sale area/per inhabitant growth from 1950 to 2020..... | 8 |
| Figure 1.5 Supermarket total sale area in California..... | 9 |
| Figure 1.6 Average area of grocery supermarkets..... | 9 |
| Figure 1.7 Refrigerant charge ratio (kg/m ²)..... | 11 |
| Figure 1.8 Refrigerant recovery efficiency at end of life..... | 11 |
| Figure 1.9 Refrigerant market shares (new equipment and remodeling)..... | 12 |
| Figure 1.10 Total demand in centralized systems – Lower threshold..... | 14 |
| Figure 1.11 Total demand in centralized systems – Higher threshold..... | 14 |
| Figure 1.12 Refrigerant demand of condensing unit systems..... | 14 |
| Figure 1.13 Refrigerant demand of stand-alone equipment..... | 14 |
| Figure 1.14 Total demand in commercial refrigeration – Lower threshold..... | 15 |
| Figure 1.15 Refrigerant demand in commercial refrigeration – Higher threshold..... | 15 |
| Figure 1.16 Distribution by refrigeration equipment technology – Higher threshold..... | 15 |
| Figure 1.17 Refrigerant bank in centralized systems (grocery supermarkets)..... | 15 |
| Figure 1.18 Refrigerant bank in condensing unit systems..... | 15 |
| Figure 1.19 Refrigerant bank in stand-alone equipment..... | 15 |
| Figure 1.20 Refrigerant bank in commercial refrigeration..... | 16 |
| Figure 1.21 Distribution by refrigeration equipment technology..... | 16 |
| Figure 1.22 Total emissions in centralized systems – Lower threshold..... | 16 |
| Figure 1.23 Total emissions in centralized systems – Higher threshold..... | 16 |
| Figure 1.24 Refrigerant emissions in condensing unit systems..... | 16 |
| Figure 1.25 Refrigerant emissions in stand-alone equipment..... | 16 |
| Figure 1.26 Total emissions in commercial refrigeration – Lower threshold..... | 17 |
| Figure 1.27 Total emissions in commercial refrigeration – Higher threshold..... | 17 |
| Figure 1.28 Distribution of emissions by refrigeration equipment technology..... | 17 |
| Figure 1.29 CO ₂ equiv. emissions in centralized systems – Lower threshold..... | 17 |
| Figure 1.30 CO ₂ equiv. emissions in centralized systems – Higher threshold..... | 17 |
| Figure 1.31 CO ₂ emissions in condensing unit systems..... | 17 |
| Figure 1.32 CO ₂ emissions in stand-alone equipment..... | 17 |
| Figure 1.33 CO ₂ equiv. emissions in commercial refrigeration – Higher threshold..... | 18 |
| Figure 1.34 CO ₂ equiv. emissions in commercial refrigeration – Lower threshold..... | 18 |
| Figure 1.35 Distribution by refrigeration equipment technology..... | 18 |
| Figure 1.36 Scenario 1 Refrigerant bank changes in centralized systems..... | 20 |
| Figure 1.37 Scenario 2 Refrigerant bank changes in centralized systems..... | 20 |
| Figure 1.38 Scenario 3 Refrigerant bank changes in centralized systems..... | 20 |
| Figure 1.39 Scenario 1 - Refrigerant bank changes in commercial refrigeration..... | 20 |
| Figure 1.40 Scenario 2 - Refrigerant bank changes in commercial refrigeration..... | 20 |
| Figure 1.41 Scenario 3 - Refrigerant bank changes in commercial refrigeration..... | 20 |
| Figure 1.42 Scenario 1 - Refrigerant emission changes in centralized systems..... | 21 |
| Figure 1.43 Scenario 2 - Refrigerant emission changes in centralized systems..... | 21 |
| Figure 1.44 Scenario 3 - Refrigerant emission changes in centralized systems..... | 21 |
| Figure 1.45 Scenario 1 - Refrigerant emission changes in commercial refrigeration..... | 21 |
| Figure 1.46 Scenario 2 - Refrigerant emission changes in commercial refrigeration..... | 21 |
| Figure 1.47 Scenario 3 - Refrigerant emission changes in commercial refrigeration..... | 21 |
| Figure 1.48 Scenario 1 - CO ₂ emission changes in centralized systems..... | 22 |

| | |
|---|----|
| Figure 1.49 Scenario 2 - CO ₂ emission changes in centralized systems. | 22 |
| Figure 1.50 Scenario 3 - CO ₂ emission changes in centralized systems. | 22 |
| Figure 1.51 Scenario 1 - CO ₂ emission changes in commercial refrigeration. | 22 |
| Figure 1.52 Scenario 2 - CO ₂ emission changes in commercial refrigeration. | 22 |
| Figure 1.53 Scenario 3 - CO ₂ emission changes in commercial refrigeration. | 22 |
| Figure 1.54 Scenario 1 - R-22 demand and recovery. | 23 |
| Figure 1.55 Scenario 2 & 3 - R-22 demand and recovery. | 23 |
| Figure 1.56 Law of end of life equipment (cf. Annex 3). | 25 |
| Figure 1.57 Installed base of stationary air conditioners in number of units. | 26 |
| Figure 1.58 Refrigerant bank in stationary AC. | 29 |
| Figure 1.59 Refrigerant bank in chillers. | 29 |
| Figure 1.60 Refrigerant emissions from stationary AC. | 30 |
| Figure 1.61 Refrigerant emissions from chillers. | 30 |
| Figure 1.62 CO ₂ equivalent emissions from stationary AC. | 30 |
| Figure 1.63 CO ₂ equivalent emissions from chillers. | 30 |
| Figure 1.64 Refrigerant bank in stationary AC. | 32 |
| Figure 1.65 Refrigerant bank in chillers. | 32 |
| Figure 1.66 Scenario 1, emissions from stationary AC. | 33 |
| Figure 1.67 Scenario 2, emissions from stationary AC. | 33 |
| Figure 1.68 Scenario 3, emissions from stationary AC. | 33 |
| Figure 1.69 Scenario 1, emissions from chillers. | 33 |
| Figure 1.70 Scenario 2, emissions from chillers. | 33 |
| Figure 1.71 Scenario 3, emissions from chillers. | 33 |
| Figure 1.72 Scenario 1, CO ₂ equiv. emissions in stationary AC. | 34 |
| Figure 1.73 Scenario 2, CO ₂ equiv. emissions in stationary AC. | 34 |
| Figure 1.74 Scenario 3, CO ₂ equiv. emissions in stationary AC. | 34 |
| Figure 1.75 Scenario 1, CO ₂ equivalent emissions in chillers. | 34 |
| Figure 1.76 Scenario 2, CO ₂ equivalent emissions in chillers. | 34 |
| Figure 1.77 Scenario 3, CO ₂ equivalent emissions in chillers. | 34 |
| Figure 1.78 HCFC demand and recovery in business as usual scenario. | 35 |
| Figure 1.79 HCFC demand and recovery in scenario 2. | 35 |
| Figure 1.80 Calculation steps for emission forecasts in the food industry. | 36 |
| Figure 1.81 Methodology for each type of refrigerated/frozen food industry. | 38 |
| Figure 1.82 Evolution of refrigerant bank in industrial refrigeration. | 40 |
| Figure 1.83 Law of end of life of refrigeration equipment. | 41 |
| Figure 1.84 Refrigerant bank in industry. | 46 |
| Figure 1.85 Refrigerant emissions in industry. | 46 |
| Figure 1.86 CO ₂ equivalent emissions in industry. | 46 |
| Figure 1.87 California refrigerant bank per refrigerant types. | 46 |
| Figure 1.88 Structure of the refrigerant bank per sectors. | 47 |
| Figure 1.89 Refrigerant emissions per refrigerant type. | 47 |
| Figure 1.90 Refrigerant emissions per application sectors. | 48 |
| Figure 1.91 Refrigerant emissions expressed in CO ₂ equivalent. | 48 |
| Figure 1.92 Refrigerant emissions per sectors and expressed in CO ₂ equivalent. | 49 |
| Figure 1.93 Recovery per refrigerant type. | 49 |
| | |
| Figure 2.1 Lay out of the refrigerated fixtures in a supermarket [ORN04]. | 57 |
| Figure 2.2 Typical electrical energy usage in a grocery store in USA [LIT96]. | 60 |
| Figure 2.3 Energy balance of vertical (left) and horizontal (right) display cases. | 64 |
| Figure 2.4 Temperature evolution in one year – 3 weather station measurements. | 68 |
| Figure 2.5 Climatic zones and population distribution. | 69 |

| | |
|---|-----|
| Figure 2.6 Distribution of energy consumption by technology, in commercial refrigeration. | 72 |
| Figure 2.7 Energy savings / technical options applied in Californian supermarkets. | 78 |
| Figure 2.8 Energy savings / technical options applied in Californian small stores. | 79 |
| Figure 2.9 Energy savings / technical options applied in commercial sector. | 79 |
| Figure 2.10 All technical options combined: energy consumption distribution. | 80 |
| Figure 2.11 Electricity price trend out to year 2020 ([DOE07]). | 85 |
| Figure 2.12 Energy saving option contribution to equipment energy consumption. | 90 |
| Figure 2.13 Energy savings breakdown for closed display cases. | 91 |
| Figure 2.14 LCCA of a supermarket over a 10-year lifetime. | 92 |
| Figure 2.15 Roof-top air-cooled condenser. | 93 |
| Figure 2.16 Piping diagram for the Medium Temperature Multiplex Refrigeration. | 94 |
| Figure 2.17 Design of a multiplex refrigeration system using R-404A. | 95 |
| Figure 2.18 Description of the distributed refrigeration system. | 96 |
| Figure 2.19 Elements of a secondary loop refrigeration for medium-temperature racks. | 97 |
| Figure 2.20 Secondary loop refrigeration system using MPG and CO ₂ for medium and low-temperature racks respectively. | 99 |
| Figure 2.21 Secondary loop refrigeration system using CO ₂ as the only refrigerant. | 99 |
| Figure 2.22 Cascade system with CO ₂ in the low-temperature stage. | 100 |
| Figure 2.23 Comparison of liquid and suction pipes for different refrigerating fluids. | 103 |
| Figure 2.24 LCC distribution for investigated refrigerating systems. | 105 |
| Figure 2.25 TEWI analysis, lower threshold. | 110 |
| Figure 2.26 TEWI analysis, upper threshold. | 110 |
| Figure 2.27 TEWI analysis in supermarkets at California state level. | 111 |

LIST OF TABLES

| | |
|--|----|
| Table 1.1 Cooling capacity of each refrigeration system for a typical grocery supermarket. | 10 |
| Table 1.2 Ratios for refrigerant charge. | 10 |
| Table 1.3 Refrigerant charge in a grocery supermarket. | 10 |
| Table 1.4 Stores reported in the database. | 13 |
| Table 1.5 Refrigerant charges. | 13 |
| Table 1.6 Emission rates and recovery efficiency. | 14 |
| Table 1.7. Characteristics of the eight categories of air-to-air AC equipment. | 24 |
| Table 1.8 Installed base of stationary air conditioners. | 25 |
| Table 1.9 Fugitive emission rates and recovery efficiency in 2004. | 27 |
| Table 1.10 Chiller market in 2004 [BSR05]. | 27 |
| Table 1.11 U.S. installed base of chillers, from 1990 to 2004. | 27 |
| Table 1.12 Centrifugal chillers, refrigerant distribution in market of brand new equipment. | 28 |
| Table 1.13 Volumetric chillers, refrigerant distribution in market of brand new equipment. | 28 |
| Table 1.14 Charge / cooling capacity ratio for centrifugal chillers [TEA04]. | 29 |
| Table 1.15 Charge / cooling capacity ratio for volumetric chillers [TEA04]. | 29 |
| Table 1.16 Annual emission rate for centrifugal chillers. | 29 |
| Table 1.17 Recovery efficiency. | 29 |
| Table 1.18 Fugitive emission for different scenarios. | 31 |
| Table 1.19 Recovery efficiency. | 32 |
| Table 1.20 Refrigerant charge ratio. | 32 |
| Table 1.21 Ratios w and x for the different sub-domains. | 39 |
| Table 1.22 Ratio of indirect systems in new equipment in 2004. | 39 |
| Table 1.23 Refrigerant charge referred to the cooling capacity. | 40 |
| Table 1.24 Complementary data necessary to perform the RIEP calculations. | 40 |
| Table 1.25 Meat production in the U.S. and California. | 41 |
| Table 1.26 Dairy production. | 42 |
| Table 1.27 Wine production. | 42 |
| Table 1.28 Fish production. | 42 |
| Table 1.29 Warehouse capacity. | 43 |
| Table 1.30 Carbonated soft drinks production. | 43 |
| Table 1.31 Characteristics of milk tanks. | 43 |
| Table 1.32 Refrigerant distribution on the market. | 44 |
| Table 1.33 Refrigerant charge and cooling capacity for a chemical plant. | 45 |
| Table 1.34 Other characteristics of typical refrigerating systems installed in chemical plants. | 45 |
| Table 1.35 Refrigerant distribution in industrial processes. | 45 |
| | |
| Table 2.1 Store categories based on field survey. | 50 |
| Table 2.2 Baseline stand-alone equipments list. | 56 |
| Table 2.3 Baseline display cases list. | 56 |
| Table 2.4 Baseline walk-in cases list. | 56 |
| Table 2.5 Self-contained refrigerating equipments found in a grocery store. | 58 |
| Table 2.6 Display cases equipments found in a grocery store. | 58 |
| Table 2.7 Walk-in and cold rooms found in a grocery store. | 58 |
| Table 2.8 Self-contained refrigerating equipment distribution for different store categories. | 59 |
| Table 2.9 Distribution of refrigerated display cases for different store categories. | 59 |
| Table 2.10 Distribution of walk-in and cold storage rooms for different store categories. | 59 |

| | | |
|-------------|---|-----|
| Table 2.11 | Number of air exchanges [ARI05]. | 66 |
| Table 2.12 | Temperature difference in heat exchangers. | 66 |
| Table 2.13 | Cycle efficiency (COP / COPc). | 67 |
| Table 2.14 | Cooling capacity in a typical grocery supermarket. | 70 |
| Table 2.15 | Annual energy consumption for 1 grocery supermarket in LA climatic zone. | 71 |
| Table 2.16 | Annual energy consumption for grocery supermarkets in California. | 71 |
| Table 2.17 | Annual energy consumption for commercial refrigeration sector in California, small stores included. | 72 |
| Table 2.18 | Energy consumption for one grocery supermarket – Technical option 1. | 73 |
| Table 2.19 | Energy consumption for all supermarkets in California – Technical option 1. | 73 |
| Table 2.20. | Energy consumption in commercial refrigeration sector – Technical option 1. | 73 |
| Table 2.21 | Energy consumption for one grocery supermarket – Technical option 2. | 74 |
| Table 2.22 | Energy consumption for all supermarkets in California – Technical option 2. | 74 |
| Table 2.23 | Energy consumption in commercial refrigeration sector – <i>Technical option 2</i> . | 74 |
| Table 2.24 | Energy consumption for one grocery supermarket – Technical option 3. | 75 |
| Table 2.25 | Energy consumption for all supermarkets in California – Technical option 3. | 75 |
| Table 2.26 | Energy consumption in commercial refrigeration sector – Technical option 3. | 75 |
| Table 2.27 | Energy consumption for one grocery supermarket – Technical option 4. | 76 |
| Table 2.28 | Energy consumption for all supermarkets in California – Technical option 4. | 76 |
| Table 2.29 | Energy consumption in commercial refrigeration sector – Technical option 4. | 76 |
| Table 2.30 | Energy consumption for one grocery supermarket – Technical option 5. | 77 |
| Table 2.31 | Energy consumption for all supermarkets in California – Technical option 5. | 77 |
| Table 2.32 | Energy consumption in commercial refrigeration sector – Technical option 5. | 77 |
| Table 2.33 | Installation cost indices (national average value = 100). | 82 |
| Table 2.34 | Commercial electricity prices cents/kWh ([DOE07]). | 84 |
| Table 2.35 | Electricity price ratios for different businesses ([DOE07]). | 85 |
| Table 2.36 | Display cases categories and corresponding installed and operating costs [DOE07]. | 87 |
| Table 2.37 | Impact of energy saving options on total installed cost. | 88 |
| Table 2.38 | Impact of implementing higher efficiency options on operating cost. | 89 |
| Table 2.39 | Energy consumption evaluation for possible energy saving options. | 89 |
| Table 2.40 | Break down of a supermarket energy consumption due to centralized refrigeration system. | 89 |
| Table 2.41 | LCC and PBP of investigated technical options for a typical supermarket layout. | 91 |
| Table 2.42 | Multiplex refrigeration system operating conditions for two refrigerants R-22 and R-404A. | 100 |
| Table 2.43 | Secondary loop refrigeration systems operating conditions with R-404A as a refrigerant. | 100 |
| Table 2.44 | Installed cost breakdown for a typical supermarket refrigeration system. | 101 |
| Table 2.45 | Typical supermarket refrigeration system cost and energy consumption breakdown. | 102 |
| Table 2.46 | Total installed cost for the 5 refrigeration system components. | 104 |
| Table 2.47 | Component prices for the 5 refrigeration systems. | 104 |
| Table 2.48 | Component installation costs for the 5 refrigeration systems. | 105 |
| Table 2.49 | Component energy consumption for the 5 refrigeration systems. | 105 |
| Table 2.50 | Assumptions for direct emission calculations. | 107 |
| Table 2.51 | Annual energy consumption per supermarket, for different refrigeration systems. | 108 |
| Table 2.52 | Energy Power Mix in California in 2006. | 108 |
| Table 2.53 | Emission conversion factors. | 108 |
| Table 2.54 | Calculation of the energy power mix in California. | 109 |
| Table 2.55 | TEWI calculation. | 109 |

Table 2.56 TEWI analysis in supermarkets at California state level111
Table 2.57 Costs of CO₂ savings.....111
Table 2.58 Savings for technical options applied to display cases, coupled with Cascade CO₂ /
secondary loop systems.....112

ABSTRACT

This project, *Inventory of Direct and Indirect GHG Emissions from Stationary Air Conditioning and Refrigeration Sources, with Special Emphasis on Retail Food Refrigeration and Unitary Air Conditioning*, contains two parts; the first one addresses the refrigerant inventory and greenhouse gas (GHG) emissions of Californian stationary refrigeration equipment. The inventory method follows the Intergovernmental Panel on Climate Change (IPCC) guidelines 2006 and is based on activity data describing the installed base of refrigeration equipment, refrigerants in use, and emission factors depending on the activity sector. The second part addresses the energy consumption of commercial refrigeration and evaluates technical options to improve energy efficiency and their associated costs. The report evaluates the possible energy gains as well as greenhouse gas emission abatement in the commercial refrigeration sector.

EXECUTIVE SUMMARY

Background

To meet the goals of AB 32 (the Global Warming Solutions Act of 2006) the Air Resources Board (ARB) identified and approved two early action measures to reduce direct emissions of high global warming potential (GWP) refrigerant from stationary refrigeration and air conditioning equipment that contribute to climate change. To inform development of these early action measures an inventory of direct greenhouse gas (GHG) emissions from stationary air conditioning and refrigeration equipment, and indirect GHG emissions created by power consumed during the operation of refrigeration equipment, was needed. ARB contracted with ARMINES to:

- 1) Estimate the refrigerant inventory and emissions of the stationary refrigeration and air conditioning sector in California; and
- 2) Estimate indirect greenhouse gas emissions from commercial and industrial refrigeration equipment, and evaluate current energy consumption and possible energy saving strategies achieved by integrating high-efficiency technical options in the commercial refrigeration sector.

Methods

The calculation method used for refrigerant inventory follows the Tier 2a method recommended by the Intergovernmental Panel on Climate Change (IPCC) guidelines in 2006, which is a “bottom-up” method based on the description of refrigeration equipment by sector. The sectors taken into account are: commercial refrigeration, industrial refrigeration, and air conditioning (including chillers). The installed base of equipment is described for each year and throughout the lifetime of the equipment, which can vary from 10 years to more than 40 years. In addition to annual emission estimates, the installed amount of refrigerant in equipment, or “banks” have been estimated to produce reliable projections of future refrigerant emissions through 2020.

ARMINES evaluated new refrigeration architectures and technologies that could result in a lower overall carbon footprint (total warming impact) from a combination of less refrigerant required in a system and potentially less energy required to operate the system.

For energy consumption of commercial refrigeration systems installed in California, the report describes in detail the commercial outlets where refrigeration systems are in use: Thirteen different categories of stores are defined, including supermarkets, grocery stores, restaurants, hotels, and gas stations. Commercial refrigeration systems are classified in three main categories depending on the size, the technology and their energy consumption: stand-alone equipment, condensing units, and supermarket centralized systems. In order to assess the energy consumption of each type, more than 100 detailed visits to stores were conducted in order to evaluate the types of equipment used in commercial refrigeration.

The annual energy consumption of all commercial refrigeration systems have been estimated by evaluating the energy use of the 28 different types of equipment used in these systems. The calculation method developed takes into account the equipment types, their operating conditions, and the outdoor temperatures of the eight climatic zones of California.

Three main technical options have been evaluated for energy saving in supermarkets:

- 1) Installing glass doors on medium-temperature display cases;

- 2) New technologies for auxiliary components (efficient lighting, efficient fan motors, better control of defrosting devices), and
- 3) Better control of the refrigeration system condensing pressure.

Energy savings from using these technical options have been estimated for a typical supermarket and for a typical small grocery store in California.

Results

Annual GHG emissions in 2004 from stationary refrigerant sources in California were estimated at 16 million metric tons of carbon dioxide equivalents (MMT CO_2E). Air-conditioning is the dominant source of these emissions, accounting for 55 percent of the total, with the remaining from commercial refrigeration (19 percent), chillers (19 percent), and industrial refrigeration (7 percent).

An additional 185 MMT CO_2E of potential emissions exists in the installed base, or “bank” of refrigerant in equipment. The majority of the bank, 57 percent, is represented by HCFC-22, and another 40 percent is comprised of hydrofluorocarbons (HFCs). The production of HCFC-22 will be phased out beginning in 2010, and its replacement with higher-global warming HFCs could double the global warming impact from this sector if emission rates remain the same (HCFC-22 has a GWP of 1,500; and a likely replacement is R-404A, with a much higher GWP of 3,260).

Equipment changes in commercial refrigeration lead to a potential three-fold reduction in the carbon footprint of grocery stores, supermarkets, and food-related businesses by replacing current centralized systems (which tend to be very emissive) with more leak-tight indirect systems. In indirect systems, the high-GWP refrigerant is contained in a much smaller circuit in the machinery room and a heat transfer fluid with a negligible GWP provides the coldness in the display cases located in the sales area.

Annual energy consumption of commercial refrigeration systems in California is significant, accounting for up to 8 percent of all electrical usage in the state, with year 2004 consumption estimated at 20,200 GWh (giga-watt hours; or billion-watt hours) for all Californian commercial refrigeration. Grocery supermarkets used 5,300 GWh, or 25 percent of the total commercial refrigeration energy usage. Current energy consumption can be decreased 30 percent for supermarkets, and decreased 20 percent for the entire commercial sector, by using currently available best technologies for stand-alone equipment, condensing units, and supermarket centralized systems. The payback period from applying best technologies vary from three months to less than four years.

Conclusions

This study establishes that refrigerant GHG emissions from stationary refrigerant sources in California are significant, and will most likely increase through 2020 without changes made to the types of equipment technologies used. Progress has been made by some commercial chains, and refrigerant emissions have been lowered from an average of about 30% per year to about 15%, but this progress needs to be consolidated and furthered.

Indirect systems using CO_2 as heat transfer fluid is a technical option decreasing the refrigerant charge required four to eight-fold, and radically changes future refrigerant emissions with very significant GHG reductions. In parallel with possible refrigeration system evolution, several technical options are available to limit the energy consumption of commercial refrigeration systems. Significant energy gains are realized from the redesign of display cases by adding

transparent doors for all operating temperatures, the use of LED lighting, and the adoption of efficient technologies for fan motors and defrosting.

INTRODUCTION

High global warming potential (GWP) greenhouse gas (GHG) emissions are expected to grow substantially over the next several decades, primarily from the use of ozone-depleting substance (ODS) substitutes, such as hydrofluorocarbons (HFCs). The introduction of ODS substitutes to the refrigeration and air-conditioning (A/C) sectors is the major driver of this growth. Additionally, although they are being phased out, ODS (many of which have high GWPs) are currently used in older refrigeration and air-conditioning equipment

There are two significant sources of GHG emissions from the refrigeration and air-conditioning sectors, direct emissions (high GWP refrigerant emissions due to leaks, routine servicing, intentional or accidental venting, and end-of-life refrigerant reclamation and/or venting), and indirect emissions (CO₂ emissions resulting from energy generated to operate the equipment). The purpose of this study is to quantify direct GHG emissions from the refrigeration and air-conditioning sectors in California, and to quantify indirect GHG emissions from the retail food sector.

The study is based on a field survey of commercial outlets to evaluate the numbers and the types of all refrigerating equipment of the commercial sector. Refrigeration equipment can be classified in three families: stand-alone equipment, condensing units, and centralized systems. They differ in size, refrigerant charge, refrigerant type, emissions, and energy efficiency. The survey is necessary to inventory refrigerants and to assess the energy consumption.

For the refrigerant inventory, the CEP (Center for energy and Processes) has developed a long experience for the French inventories but also at the global level. RIEP database (Refrigerant inventories and emission previsions) has been developed; refrigerant banks of 62 countries and eight regions are stored and updated every 3 years. Specific studies have been carried out for the U.S. and the U.S. EPA "vintaging model" has been compared with RIEP [Pal 04]. The database is filled with data either bought from marketing studies or coming from interviews of experts from the refrigeration industry, as well as field survey and data collection from technical papers, specialized magazines, and web sites. For California, the data are either derived from U.S. numbers, California statistics or direct survey.

For energy consumption, based on the field survey a typical "averaged" supermarket is defined. Knowing the total number of supermarkets, the total energy consumption can be derived for California as well as the energy savings associated with the implementation of energy efficient technical options. Moreover, small commercial stores using refrigeration systems have also to be described because all stand-alone equipment such as vending machines, ice cube machines, soda fountains, and movable display cases constitute a large stock of equipment with low energy efficiency.

A calculation tool has to be developed in order to calculate energy consumption of all refrigeration systems based on their technical description, their operating conditions, and the outdoor temperatures of the eight climatic zones of California. The calculation will be performed on a hour-by-hour basis for all the year and for each type of system.

The report is structured in two parts: the first one addresses refrigerant banks and emissions of stationary refrigeration system including AC systems, and the second part develops the analysis of energy consumption of the commercial refrigeration sector, evaluates the energy gains

associated with several technical options, and makes the TEWI (Total Equivalent Warming Impact) comparison of direct and indirect systems in order to evaluate direct and indirect emissions of those refrigeration systems.

Part 1 - REFRIGERANT INVENTORY AND EMISSIONS FOR CALIFORNIAN STATIONARY REFRIGERATION SYSTEMS

1 Method of calculation

The calculation method is described in Annex 2.

2 Database for commercial refrigeration in California

The bank of refrigerants contained in grocery supermarkets is calculated based on the last 30 years. The bank represents the cumulated market of refrigerants filled in new refrigerating systems year after year, taking into account the average lifetime of the store (30 years for a supermarket) and the lifetime of the refrigeration system (15 years for centralized systems) before remodeling. The average lifetime of refrigeration systems is thus 15 years. However, calculations are performed taking into account an extinction curve of the equipment around this average value.

Calculations are performed from year 1990 to 2004, and forecasts are simulated until 2020. In order to initiate calculations as of 1990, the database has to include data from 1960 to 2020, assuming an average 30-year lifetime of grocery supermarkets and other small stores.

2.1 Grocery supermarkets

2.1.1 Number of stores in California

The number of grocery supermarkets in California from 1960 to 2020 must be evaluated. Statistical data issued from the U.S. Bureau of Census are used. For a given year, different numbers have been found depending on the source. The definition of supermarket store reported in the U.S. Bureau of Census is as follows:

"Supermarkets and other general-line grocery stores: establishments commonly known as supermarkets, food stores, grocery stores, and food warehouses, primarily engaged in the retail sale of a wide variety of grocery store merchandise. Customers normally make large, volume purchases from these stores."

Numbers of grocery supermarkets in the State of California are available for a few years. More data are available for USA, and can be helpful to evaluate California numbers, by means of ratio based on GDP and population. Those ratios are used to fill the database back to 1960.

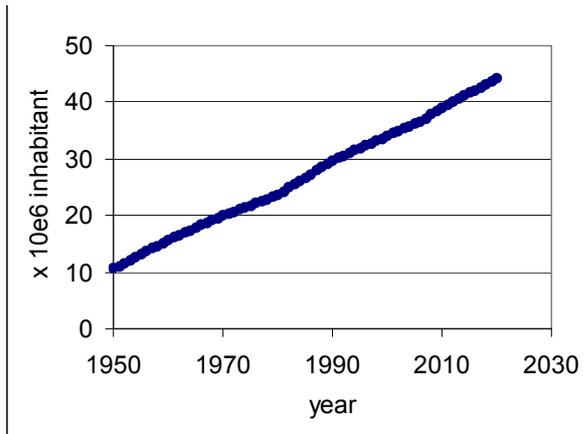


Figure 1.1 Population growth in California.

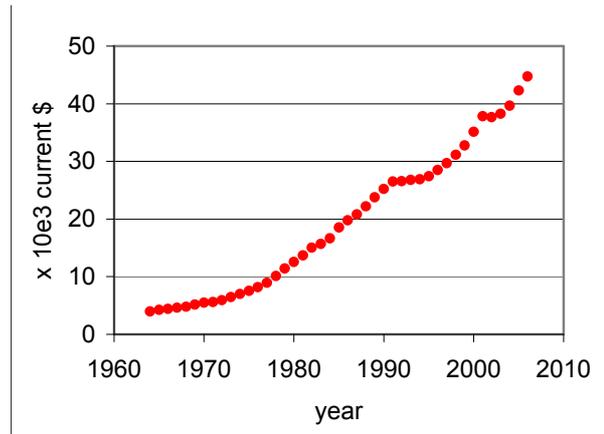


Figure 1.2 GDP/inhab. growth in California.

Figure 1.3 draws the evolution of supermarket number in California, based on U.S. Bureau of Census data for U.S. and GDP ratio (California / USA). The first supermarkets were built after the Second World War. 1950 is taken as the initial year. The average area of supermarket is known for a few years [FMI07]. A ratio of the total sales area to population was introduced and extrapolated for all years concerned by this study (see Figure 1.4).

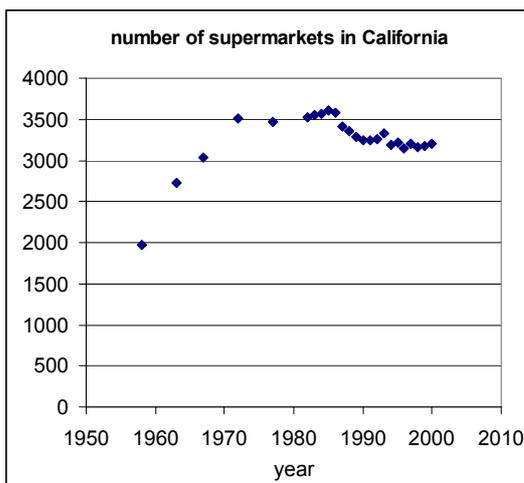


Figure 1.3 Number of supermarkets in California. Data from U.S. Bureau of Census.

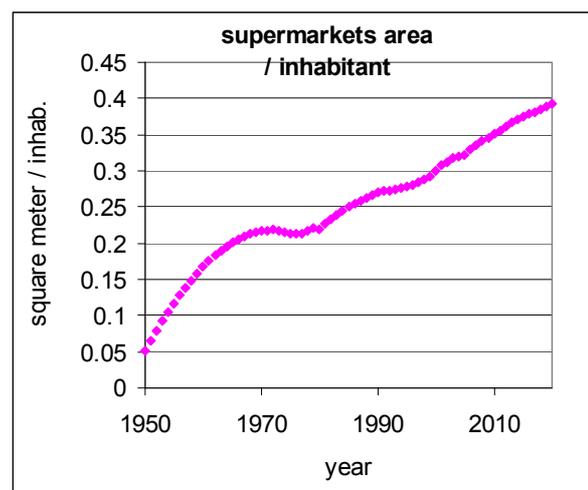


Figure 1.4 Average sale area/per inhabitant growth from 1950 to 2020.

Multiplying this ratio (sale area / inhab.) by the population, the total sales area in California is derived from 1950 to 2020 as shown in Figure 1.5.

From the evolution of the supermarket number in California, openings of new stores per year can be determined. The average lifetime of a supermarket store is generally 30 years before replacement or significant remodeling.



Figure 1.5 Supermarket total sale area in California.

2.1.2 Average area and refrigerant charge

The average area in 2004 is 4,400 m² (47,360 ft²) but this value was not constant throughout the last 50 years. Newly opened stores, including supermarkets, have a sales area larger than this average value.

Figure 1.6 depicts the evolution of the sales area of grocery supermarkets as of 1950. This value is the typical area of stores classified by vintage, meaning that the average value for all supermarkets is lower than the current vintage area.

For example it is assumed that the average sales area of supermarkets in California, whatever their date of opening, is 4400 m² in 2004. But a new supermarket opened in 2004 has an average area of 5000 m².

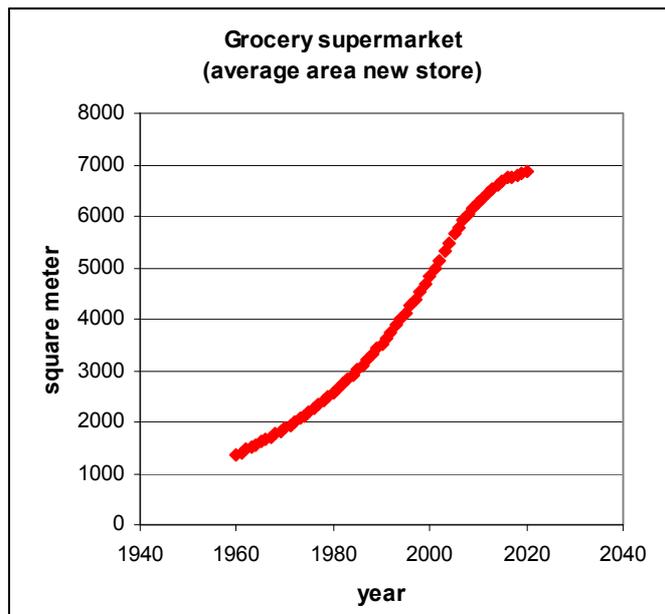


Figure 1.6 Average area of grocery supermarkets.

The refrigerant charge has been determined from the calculation of the cooling capacity of the centralized refrigeration system. The typical layout of the grocery supermarket has been established after the field survey. Each and every display case has been characterized by its cooling capacity and temperature level. Ratios of refrigerant charge per kW of cooling capacity are known for centralized systems. Table 1.1 summarizes the results of calculations used for energy consumption calculations. Table 1.2 gives the ratio of refrigerant charge / cooling capacity for the different technologies of refrigeration systems commonly found in grocery supermarkets.

Table 1.1 Cooling capacity of each refrigeration system for a typical grocery supermarket.

| Cooling Capacity | <i>Medium temperature</i> | <i>Low temperature</i> | <i>Total</i> |
|--------------------------------|---------------------------|------------------------|--------------|
| <i>Centralized System (kW)</i> | 193 | 152 | 345 |
| <i>Condensing Units (kW)</i> | 18 | 14 | 32 |
| <i>Stand-alone (kW)</i> | 13.0 | 2 | 15 |
| Total | 224 | 168 | 392 |

Table 1.2 Ratios for refrigerant charge.

| Refrigerant charge / Cooling Capacity | <i>Medium temperature</i> | <i>Low temperature</i> |
|---|---------------------------|------------------------|
| <i>Centralized System in direct expansion</i> | 2.8 kg/kW | 5.5 kg/kW |
| <i>Centralized System with secondary loop</i> | 0.8 kg/kW | 1.2 kg/kW |
| <i>Condensing Units</i> | 1.4 kg/kW | 2.4 kg/kW |

Stand-alone equipment are not included in this table because the information for the refrigerant charge is known (from the manufacturer) for each type of display case considered.

Using the cooling capacity and the refrigerant charge ratios, the total refrigerant charge for a supermarket is determined. Table 1.3 gives the results. Currently in California, it is considered that the use of secondary loop systems or CO₂ cascade is not significant enough to be considered. On the contrary, forecasts will be performed in order to evaluate the impact of a widespread use of secondary loop systems on refrigerant emissions.

Table 1.3 Refrigerant charge in a grocery supermarket.

| Refrigerant charge | <i>Medium temperature</i> | <i>Low temperature</i> | <i>Total</i> |
|---------------------------|---------------------------|------------------------|--------------|
| <i>Centralized System</i> | 540 kg | 837 kg | 1377 kg |

During the field survey, in most of supermarket stores visited, it was impossible to visit the machinery room. Nevertheless, some machinery rooms of a few supermarkets have been visited with the store manager. A first cross checking has been done with refrigerant charge indicated in one of these supermarkets. For confidentiality reasons, the brand name and the location of the reference supermarket are not mentioned. Two compressor racks for medium temperature display cases and storage room are charged with 408,15 kg of R-507A each. The compressor racks for low-temperature equipment are charged with 408,15 kg. This supermarket is representative of the typical grocery supermarkets described and the refrigerant charge is 3 x 450 kg, nearly the same (Table 1.3) as the one defined using the refrigerant ratio (Table 1.2) and the cooling capacity (Table 1.1). Those ratios have been elaborated on a number of field surveys made in the U.S. and in Europe.

For calculations in RIEP, the average refrigerant charge is related to the supermarket sale area and a coefficient of refrigerant charge per square meter is defined. This coefficient, 0.36 kg/m² for year 2004, is the expression of the share of refrigerated (and frozen) food in a grocery supermarket. The change in food consumption habits during the last 50 years had an impact on the refrigeration ratio for a given sales area.

The assumption is made that the ratio of refrigerated sales area has increased by 50% between 1960 and 1990 (see Figure 1.7).

In parallel, the average area of grocery supermarket was increasing (see Figure 1.6), meaning that the refrigerant charge in a typical supermarket was 200 kg in 1960, and is 1,600 kg today.

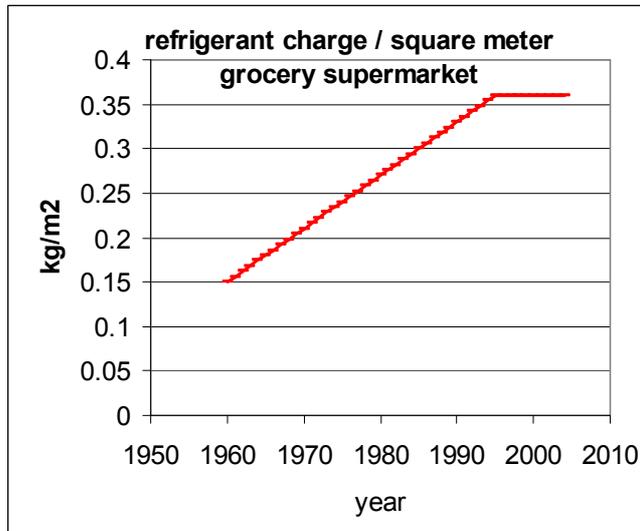


Figure 1.7 Refrigerant charge ratio (kg/m²).

2.1.3 Refrigerant emission rates

Refrigerants emissions are of two types: fugitive emissions during all the lifetime of the refrigeration equipment, including accidental emissions (rupture of pressure valve or liquid line), and end-of-life emissions when refrigerant recovery is not performed carefully (if performed).

The fugitive emission rate is an average value taking into account refrigerant losses of different types. This emission rate is established based on refrigerant annual consumption for a given store: the refrigerant quantity refilled annually in the system compensates refrigerant emissions.

In RIEP, emission rate of commercial centralized systems is usually estimated at **30% per year**, except when other emission rates are verified by the refrigerant invoices of commercial companies. This value is a conservative one, emissions could vary from 10 to 30% [GAG97], [IPC05], [TOC06]. Complementary data are needed but are not easily disclosed by commercial chains. Based on answers to a survey launched by the Center for Energy and Processes (CEP) for this study, one Californian commercial chain has explained how they have reduced their annual emission rates from more than 30% down to 18%. Those two values (18 and 30%) will be used as lower and higher thresholds for the evaluation of emissions (see Section 2.3.3) and refrigerant demand (see Section 2.3.1).

Refrigerant recovery at end of life has increased in the past 10 years due to the phase-out of CFCs. Figure 1.8 presents the refrigerant recovery efficiency evolution assumed for RIEP calculations.

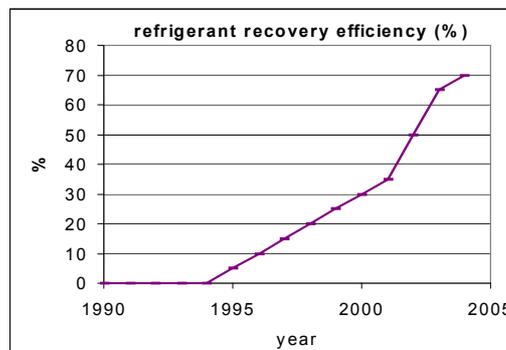


Figure 1.8 Refrigerant recovery efficiency at end of life.

2.1.4 Refrigerants in use

The refrigerant market share follows the regulations. Since 1995, CFCs are no longer used in new refrigeration systems. CFCs have been replaced first by HCFC blends for retrofitting of existing systems and in new systems. HCFCs will be banned in new refrigeration systems as of 2010. In the U.S., HFCs began to be used in centralized systems in 1999. Refrigerant shares are presented in Figure 1.9.

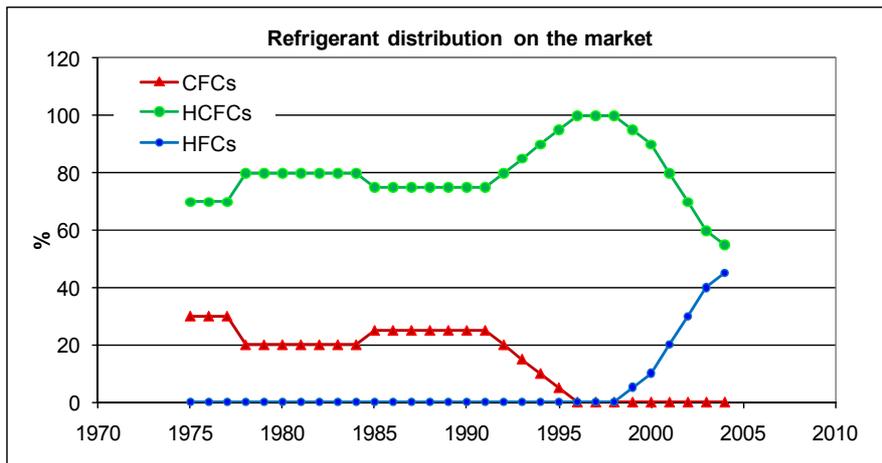


Figure 1.9 Refrigerant market shares (new equipment and remodeling).

Remodeling of the refrigeration system is supposed to be done at mid-lifetime of the store, after 15 years. After 1995, this step is typically the time to retrofit CFCs refrigerant to HCFC blends. Retrofit of CFCs was supposed to be achieved in 2004.

2.2 Small stores

2.2.1 Number of stores in California

U.S. Bureau of Census data have been mainly used to evaluate the number of the different stores in California since 1960.

The same methodology is applied to each type of store when statistical data are not available. For small stores like bakeries, butcheries, fishmongers, and convenience stores another point has been considered: these small stores were common before the growth of supermarkets. For the last 20 years, the numbers of these small stores has been decreasing. They are replaced by larger sales area stores such as mini-markets and supermarkets.

Stores, where refrigeration equipment is used, are summarized in Table 1.4. Those stores were described in Section 1.1 of "Part 2 – Energy consumption of the commercial refrigeration sector in California".

Table 1.4 Stores reported in the database.

| <i>Type of stores</i> | <i>Number of stores in 2004</i> |
|---|---------------------------------------|
| <i>Grocery stores (food dedicated)</i> | 3,370 |
| <i>Minimarkets</i> | 4,693 |
| <i>Pharmacies</i> | 4,846 |
| <i>Convenience stores</i> | 2,317 |
| <i>Liquor stores</i> | 3,466 |
| <i>Butcheries, Pork-butcheries</i> | 763 |
| <i>Fishmonger stores</i> | 184 |
| <i>Bakeries and Pastries</i> | 5,512 |
| <i>Small size Gas Stations</i> | 5,453 |
| <i>Large size Gas Stations</i> | 1,818 |
| <i>Hotels</i> | 5,458 |
| <i>Motels</i> | 5,817 |
| <i>Bars and Restaurants</i> | 66,306 |
| <i>Stand-alone equipment studied independently of their location of use</i> | <i>Number of units in use in 2004</i> |
| <i>Carbonated Soda Fountains</i> | 23,040 |
| <i>Vending machines</i> | 500,000 |

2.2.2 Refrigerant charge and type of refrigerant

The field survey has allowed identifying the typical layout of each small store using refrigerating equipment. This refrigerating equipment is not connected to a centralized system in the machinery room like in supermarkets. Stand-alone equipment, display cases, and walk-in coolers connected to one or several condensation units are the typical technologies met in those stores. Table 1.5 presents the typical refrigerant charge evaluated for each type of store, based on the field survey.

Table 1.5 Refrigerant charges.

| <i>Type</i> | <i>Refrigerant charge in stand-alone equipments (kg)</i> | <i>Refrigerant charge in condensing units (kg)</i> |
|-------------------------------|--|--|
| <i>Bakeries</i> | 2.65 | 2.4 |
| <i>Bars & restaurants</i> | 2.5 | 19.3 |
| <i>Vending machines</i> | 0.3 | - |
| <i>Butcheries</i> | 0.3 | 7.0 |
| <i>Center gas stations</i> | 3.45 | 16.7 |
| <i>Convenience stores</i> | 4.1 | 27.3 |
| <i>CSD fountains</i> | 0.3 | - |
| <i>Fishmonger stores</i> | 0.6 | 7.0 |
| <i>Grocery supermarkets</i> | 7.4 | 58.9 |
| <i>Hotels</i> | 3.4 | 19.3 |
| <i>Liquor stores</i> | 5.8 | 17.6 |
| <i>Mini-markets</i> | 9.6 | 99.2 |
| <i>Motels</i> | 1.45 | 0 |
| <i>Pharmacies</i> | 2.35 | 34.8 |
| <i>Small gas stations</i> | 0.8 | 3.2 |

Note: Grocery supermarkets are considered in the list of stores because the use of stand-alone equipment in the sales area is significant. Moreover some walk-in coolers are not connected to the centralized system, but run with independent condensing units. Stand-alone equipment and condensing units are not similar to centralized system in terms of energy efficiency, refrigerant type, and emissions. In order to be more accurate in the evaluation of refrigerant

emissions, refrigerating equipment has been sorted and calculated by technology: stand alone equipment, condensing unit, and centralized system.

2.2.3 Refrigerant emission rate

Stand-alone equipment is characterized by short refrigerant circuit, the compressor and the condenser being integrated in the cabinet. Tube and fittings are usually brazed, which helps reduce fugitive emissions. Because of a small unitary refrigerant charge (less than 2 kg in most cases), refrigerant recovery at end of life is not done on stand-alone equipment.

Condensing units are more emissive systems. The refrigerant charge can be significant, for example in mini-markets, where the number of display cases is high. Recovery at end of life should be improved.

Table 1.6 Emission rates and recovery efficiency.

| Type | Emission rate (%) | Recovery efficiency (%) |
|-----------------------|-------------------|-------------------------|
| Stand-alone equipment | 1 | 0 |
| Condensing units | 15 | 30 |

2.3 Refrigerant inventory from 1990 to 2004

2.3.1 Refrigerant demand

The activity data for the commercial sector is the number of all refrigeration systems: stand-alone equipment, condensing units, and centralized systems. The uncertainties are relatively low and can be estimated in the range of $\pm 2\%$ due to the data availability. For emission factors, uncertainties are low for stand-alone equipment and emissions are also low, but for centralized systems, uncertainties are high and emission factors are strongly dependent on the containment policies of commercial companies. The refrigerant demand, related to the refrigerant charge needed for servicing is evaluated by 2 thresholds:

- High threshold where refrigerant emissions from centralized systems is evaluated at 30%, and
- Low threshold where emissions are fixed at 18% (see Section 2.1.3).

The refrigerant demand is the addition of refrigerant needs for servicing of all refrigerating systems in use, and the refrigerant needs for first charge of new refrigerating systems. Figure 1.10 and Figure 1.11 present the lower and higher threshold for the refrigerant demand in centralized systems. Figure 1.12 and Figure 1.13 give the refrigerant demand, by type, respectively for condensing units, and stand-alone equipment.




Figure 1.10 Total demand in centralized systems – Lower threshold.




Figure 1.11 Total demand in centralized systems – Higher threshold.




Figure 1.12 Refrigerant demand of condensing unit systems.




Figure 1.13 Refrigerant demand of stand-alone equipment.

Depending on the technology (centralized, condensing unit, and stand alone) the refrigerant demand is substantially different. As indicated on Figure 1.16, centralized systems, with 1,700 tonnes per year, represent nearly 72% of the refrigerant demand in the commercial refrigeration sector.

Note: 1,7000 t/yr correspond to the lower emission threshold.

Refrigerant demand for stand-alone equipment is mainly for new equipment sold on the market, because for this technology, servicing needs are low. In terms of refrigerant distribution, HFCs are mainly dedicated to stand-alone equipment. In other technologies (centralized and condensing units) refrigerant needs are high for servicing, because of high emission rates of these systems (18 to 30% in centralized systems and 15% in condensing units).

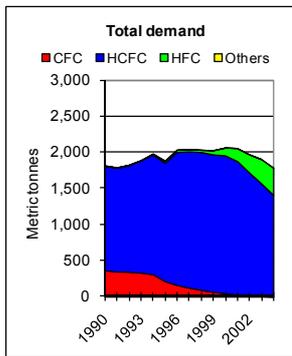


Figure 1.14 Total demand in commercial refrigeration – Lower threshold.

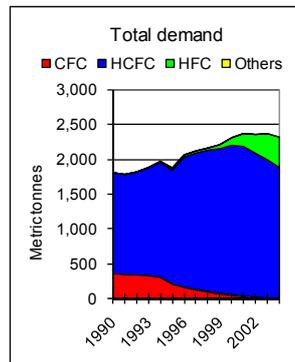


Figure 1.15 Refrigerant demand in commercial refrigeration – Higher threshold.

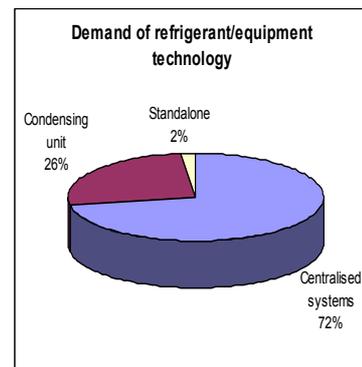


Figure 1.16 Distribution by refrigeration equipment technology – Higher threshold.

HCFC demand, mainly R-22, represents 72% of the refrigerant market. The commercial refrigeration sector demand of HCFCs in 2004 is evaluated between 1,500 and 2,000 tonnes.

2.3.2 Refrigerant bank charged in refrigeration equipment

In the commercial sector, the refrigerant bank is the total amount of refrigerant charged in all refrigeration systems in use, whatever their vintage. Figure 1.17 to Figure 1.19 present the refrigerant bank, by family, respectively in centralized systems, condensing units, and stand-alone equipment.

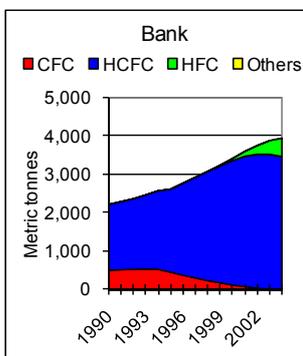


Figure 1.17 Refrigerant bank in centralized systems (grocery supermarkets).

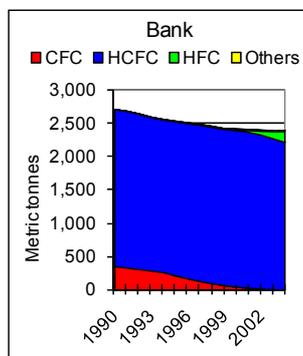


Figure 1.18 Refrigerant bank in condensing unit systems.

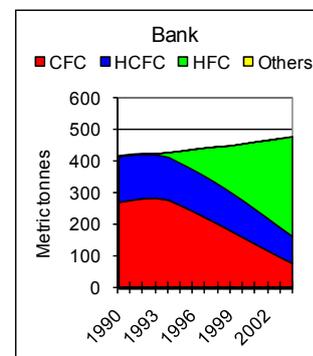


Figure 1.19 Refrigerant bank in stand-alone equipment.

In California, the bank of refrigerants in centralized systems in supermarkets is nearly 4,000 tonnes in 2004, and 90% of this bank are HCFCs. The introduction of HFC on the market, in new equipment, began in 1999. In condensing units, the bank of refrigerant is around 2,500 tonnes, but is not growing any longer.

Stand-alone equipment, working with small refrigerant unitary charges, were filled mainly with R-12 before 1992. No retrofit is performed on those systems. In 2004, the remaining bank of R-12 in stand-alone equipment is estimated at 500 tonnes. R-12 has been replaced by R-134a, which is in the main refrigerant in use, today, in stand-alone equipment.

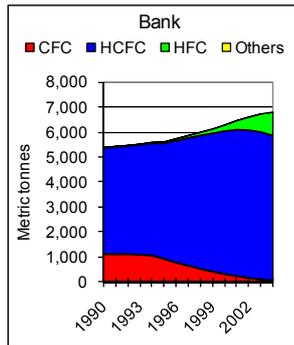


Figure 1.20 Refrigerant bank in commercial refrigeration.

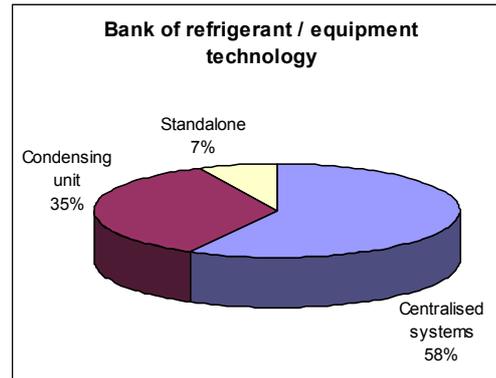


Figure 1.21 Distribution by refrigeration equipment technology.

In the commercial refrigeration sector, the total refrigerant bank is estimated around 6,800 tonnes in 2004, mainly constituted of HCFCs. 58% of the refrigerant bank is filled in centralized systems in supermarkets.

2.3.3 Refrigerant emissions

Emissions represent both fugitive losses, and end-of-life emissions. Figure 1.22 to Figure 1.25 present the refrigerant emissions, by type, respectively from centralized systems (lower and higher thresholds), condensing units, and stand-alone equipment.

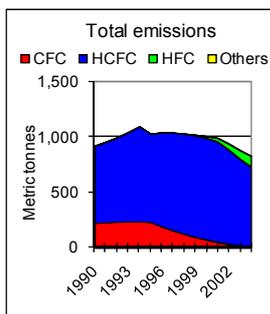


Figure 1.22 Total emissions in centralized systems – Lower threshold.

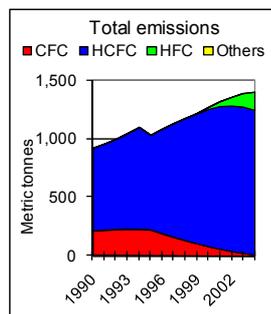


Figure 1.23 Total emissions in centralized systems – Higher threshold.

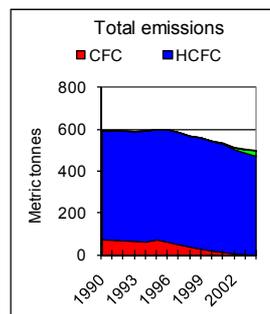


Figure 1.24 Refrigerant emissions in condensing unit systems.

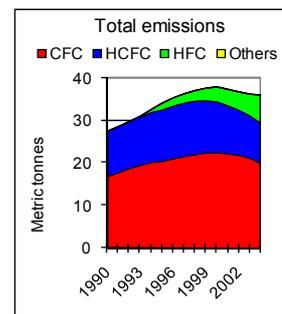


Figure 1.25 Refrigerant emissions in stand-alone equipment.

Lifetime of these refrigeration systems is estimated to be 15 years, in average. For centralized systems, the real lifetime of the system is usually longer. But from 1990 to 2020, many retrofit

operations have been and will be done, due to the phase-out of CFCs, which will be followed by the phase-out of HCFCs. When the system is renewed, most of the time, refrigerant handling leads to emissions.

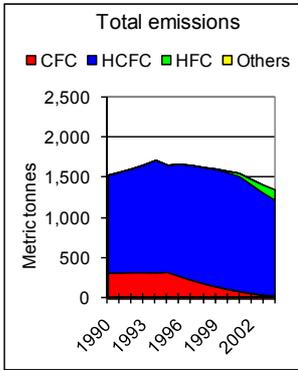


Figure 1.26 Total emissions in commercial refrigeration – Lower threshold.

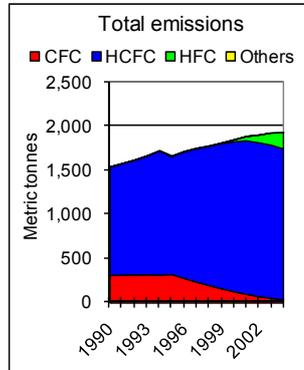


Figure 1.27 Total emissions in commercial refrigeration – Higher threshold.

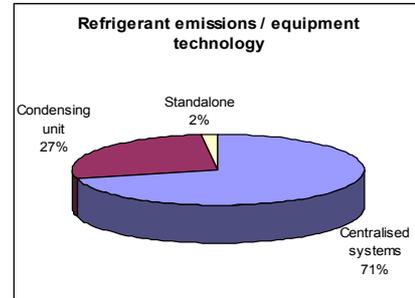


Figure 1.28 Distribution of emissions by refrigeration equipment technology.

Total emissions from the commercial refrigeration sector in California are estimated between 1,400 and 1,800 metric tonnes in 2004, more than 70% of these emissions are coming from centralized systems.

2.3.4 CO₂ equivalent emissions of refrigerants

Refrigerant emissions expressed in CO₂ equivalent are based on GWP values from the IPCC Second Assessment Report. Figure 1.29 to Figure 1.32 present the refrigerant emissions in CO₂ equivalent values, respectively from centralized systems (lower and higher thresholds), condensing units, and stand-alone equipment.

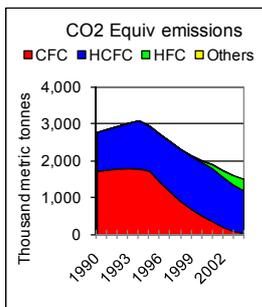


Figure 1.29 CO₂ equiv. emissions in centralized systems – Lower threshold.

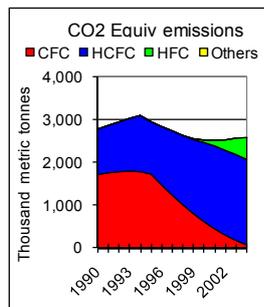


Figure 1.30 CO₂ equiv. emissions in centralized systems – Higher threshold.

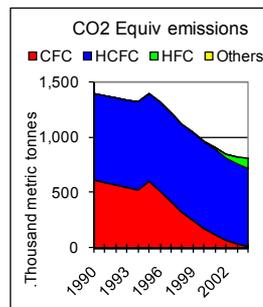


Figure 1.31 CO₂ emissions in condensing unit systems.

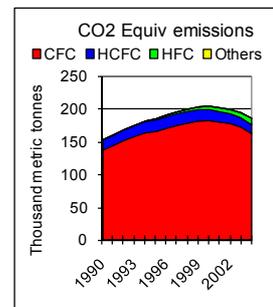


Figure 1.32 CO₂ emissions in stand-alone equipment.

From 1990 to 1995, CFC emissions represent around 20% of refrigerant emissions in centralized systems in supermarkets. Because of its high GWP (GWP R-12: 8600), emissions of this CFC represent more than 55% of CO₂ equivalent emissions.

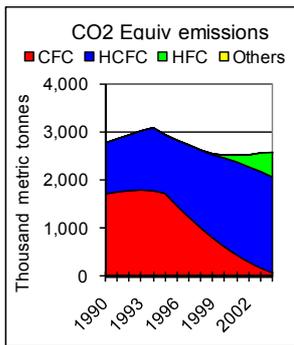


Figure 1.33 CO₂ equiv. emissions in commercial refrigeration – Higher threshold.

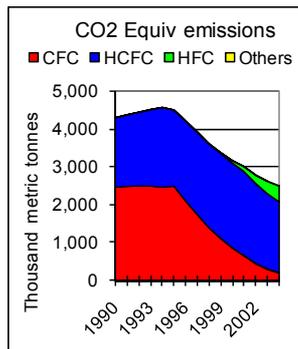


Figure 1.34 CO₂ equiv. emissions in commercial refrigeration – Lower threshold.

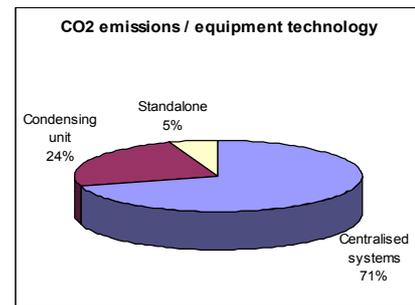


Figure 1.35 Distribution by refrigeration equipment technology.

Total CO₂ equivalent emissions have been decreasing since 1995 because of the R-12 phase-out. In 2004, CO₂ equivalent emissions in commercial refrigeration are estimated between 3.5 and 3.6 million metric tonnes of CO₂ depending on the emission factor of centralized systems.

2.4 Scenarios and projections to 2020

2.4.1 Assumptions for scenarios

Three scenarios have been simulated to evaluate the impact of technical changes and policies on refrigerants.

2.4.1.1 Scenario 1: business as usual (BAU)

No significant changes are considered. The regulation organizing the phase-out of HCFCs after 2010 is taken into account. The use of secondary loop systems is not accelerated. Emission rate and recovery efficiency are kept at the same level. There is no significant effort to retrofit R-22 systems.

2.4.1.2 Scenario 2: large introduction of secondary loop systems

Indirect refrigeration systems decrease the refrigerant charge and minimize potential refrigerant leakage. Indirect systems have many forms: complete indirect system, partial indirect system, and indirect cascade system. Water solutions have long been used as heat transfer fluid (HTF). Other very promising developments are phase-change HTF, mainly CO₂.

Starting in 2008, secondary loop systems are progressively introduced. The use of CO₂ as HTF is technically possible for both medium and low-temperature systems. For now, this technology is only used for low-temperature systems, where the pressure is limited to 1.2 MPa in operating conditions.

Assumptions made for the simulations in Scenario 2 are as follows:

- 75% of new refrigeration systems are built with a CO₂ secondary loop for low-temperature applications
- 50% of new refrigeration systems dedicated to medium-temperature are secondary loop systems with water solutions of glycols
- Secondary loop systems have an emission rate of 10%, as a result of improved refrigerant containment in the machinery room

- The refrigerant charge is reduced (see Table 7.2) with secondary loop systems, R-404A is the refrigerant used in the machinery room
- R-22 retrofit with R-422A or equivalent intermediate HFC blends starts in 2008 and is totally done in 12 years
- Recovery efficiency is progressively increased to 80%
- The emission rate on new centralized systems is progressively reduced from 30% to 20% thanks to improved leak tightness of components, improvement in the leak search and data reporting when refrigerant losses are observed.

2.4.1.3 Scenario 3: introduction of low GWP refrigerants, reduction in cooling capacity and refrigerant charge

Recent research on refrigerants has led to new molecule developments resulting in to reach very low GWP refrigerant. In 5 to 10 years, refrigerant blends with GWP lower than 500 will possibly be available for low-temperature application.

Simulations on energy consumption, when all display cases are closed, have shown significant decrease of the refrigeration needs. This scenario is evaluated in Scenario 3.

Assumptions taken for the simulations in scenario 3 are:

- Identical to scenario 2, except the choice of R-404A in secondary loop system. A new refrigerant blend, called BLD1 (blend 1) with a GWP of 500, is introduced progressively on the market, beginning in 2012. It replaces R-404A and R-507A in new refrigeration systems.
- The cooling capacity is cut by nearly 40%: all open display cases are replaced by display cases equipped with glass doors. The replacement of old display cases is done in 15 years, starting in 2008.

2.4.2 Refrigerant bank filled in refrigeration equipment

2.4.2.1 Case of centralized systems in supermarket only

Figure 1.36 to Figure 1.38 present, for each scenario, the refrigerant bank changes from 2000 to 2020 in centralized systems in supermarkets.

In Scenario 1, business as usual, the refrigerant bank continues to grow, and reaches 6,000 tonnes in 2020. In 2010, HCFC bank is still more than 50% of the total bank.

In Scenario 2, the introduction of secondary loop systems starting in 2008, allows reversing the growth of the bank. In 2020, around 2,000 tonnes of refrigerants are avoided compared to the BAU scenario.

In Scenario 3, both secondary loop systems, and reduction of the refrigeration needs in the sales area (glass doors) have permitted to divide the BAU bank of refrigerants by a factor 2, at 3,000 tonnes, in 2020.

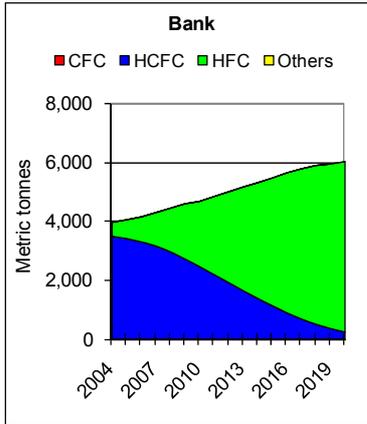


Figure 1.36 Scenario 1
Refrigerant bank changes in centralized systems.

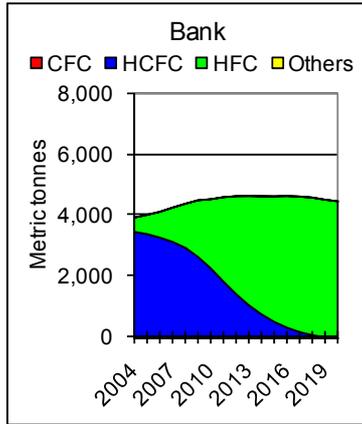


Figure 1.37 Scenario 2
Refrigerant bank changes in centralized systems.

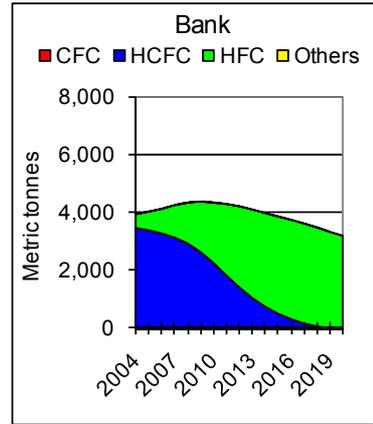


Figure 1.38 Scenario 3
Refrigerant bank changes in centralized systems.

2.4.2.2 Commercial refrigeration sector, including small stores

Figure 1.39 to Figure 1.41 present, for each scenario, the refrigerant bank changes from 2000 to 2020 in the commercial refrigeration sector.

In the business as usual scenario, the total bank of commercial refrigeration sector reaches 9,000 tonnes in 2020.

In Scenario 2, the impact of secondary loop introduction in supermarkets is less significant in relative value, because of the refrigerant bank in condensing units. Technically, the use of secondary loop systems is possible in small stores in replacement of condensing units, but the uptake of the technology is relatively slow. In the commercial refrigeration sector, including small stores, the impact of measures taken in Scenarios 2 and 3 are significant. In Scenario 3, the refrigerant bank reduction is 30% in 2020.

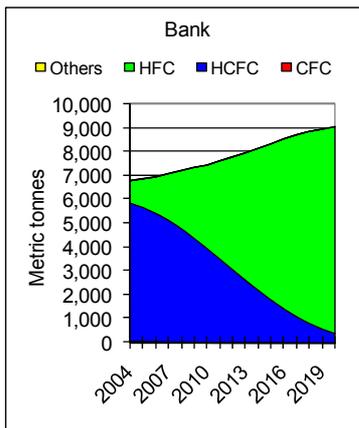


Figure 1.39 Scenario 1 -
Refrigerant bank changes in commercial refrigeration.

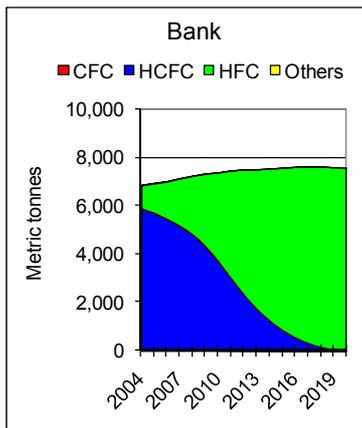


Figure 1.40 Scenario 2 -
Refrigerant bank changes in commercial refrigeration.

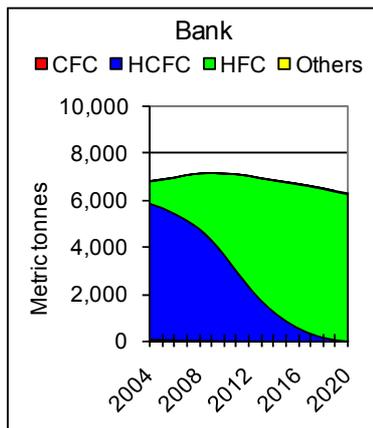


Figure 1.41 Scenario 3 -
Refrigerant bank changes in commercial refrigeration.

2.4.3 Refrigerant emissions

2.4.3.1 Centralized systems in supermarkets only

The impact of technology changes, moving to secondary loop systems, is both on the refrigerant charge and on the fugitive emission rate. As shown on Figure 1.43 (Scenario 2) and Figure 1.44 (Scenario 3), the level of HFC emissions is divided by 2 (Scenario 2) and divided by a factor 3 in Scenario 3.

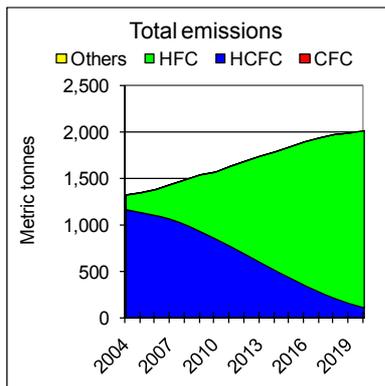


Figure 1.42 Scenario 1 - Refrigerant emission changes in centralized systems.

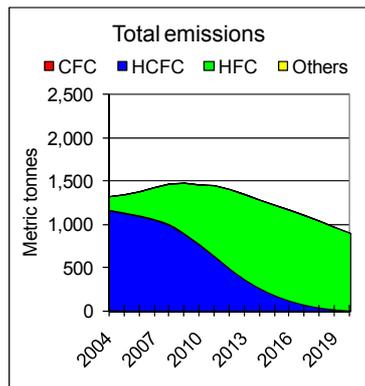


Figure 1.43 Scenario 2 - Refrigerant emission changes in centralized systems.

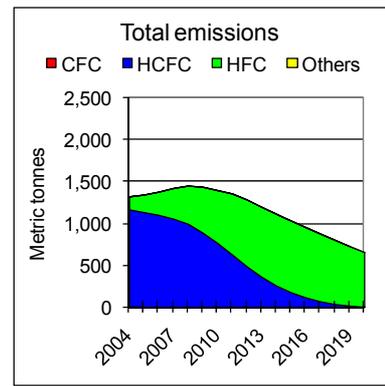


Figure 1.44 Scenario 3 - Refrigerant emission changes in centralized systems.

2.4.3.2 Commercial refrigeration sector, including small stores

In Scenarios 2 and 3, improvements of leak tightness and of recovery efficiency have also been considered for condensing units and stand-alone equipment. Figure 1.45 to Figure 1.47 present results in emission reductions for the commercial refrigeration sector, taking into account all technologies.

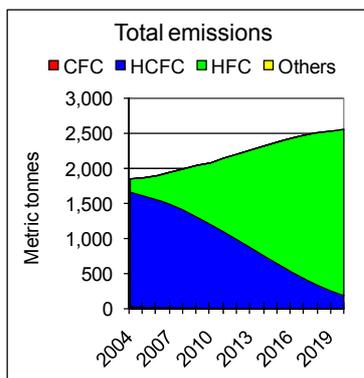


Figure 1.45 Scenario 1 - Refrigerant emission changes in commercial refrigeration.

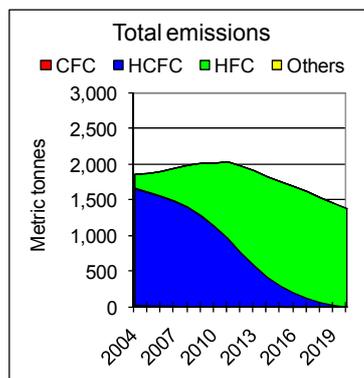


Figure 1.46 Scenario 2 - Refrigerant emission changes in commercial refrigeration.

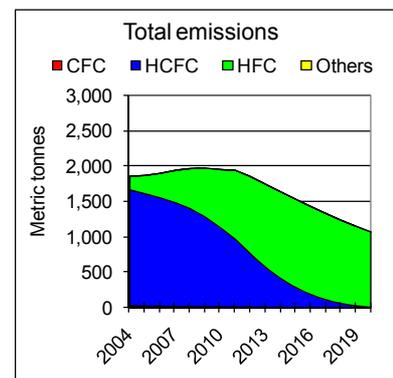


Figure 1.47 Scenario 3 - Refrigerant emission changes in commercial refrigeration.

In the business as usual scenario, the level of refrigerant emissions is above 2,500 tonnes per year in 2020. In Scenario 2, after the introduction of secondary loop systems in supermarkets, refrigerant emissions are limited to 1,400 tonnes in 2020. When the cooling capacity is decreased (Scenario 3), in addition of a secondary loop system, refrigerant emissions are lower: 1,000 tonnes in 2020.

2.4.4 Refrigerant CO₂ equivalent emissions

2.4.4.1 Centralized system in supermarkets only

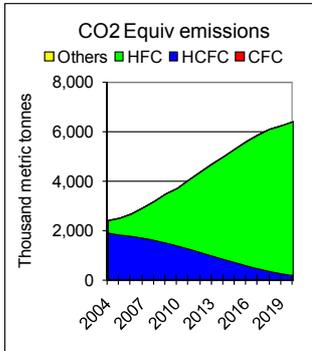


Figure 1.48 Scenario 1 - CO₂ emission changes in centralized systems.

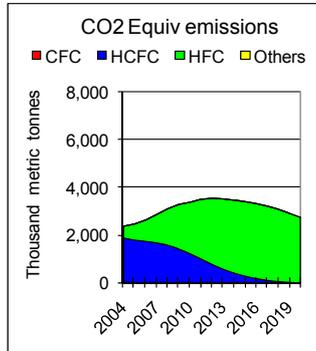


Figure 1.49 Scenario 2 - CO₂ emission changes in centralized systems.

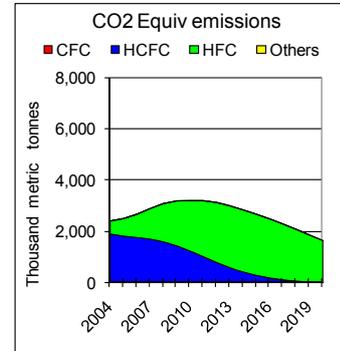


Figure 1.50 Scenario 3 - CO₂ emission changes in centralized systems.

R-507A and R-404A have the highest GWP of HFC refrigerants currently used, with GWPs of 3300, and 3260 respectively. The phase-out of HCFCs that had lower GWPs has an impact on CO₂ equivalent emissions. In scenario 1, which is the current scenario for year 2000 to 2008, a minimum of CO₂ equivalent emissions is observed in 2004. After this date, the wide use of R-404A has a negative impact on CO₂ equivalent emissions. Those emissions could reach 6.2 million tonnes in 2020, more than the values met in the period of use of CFCs (from 1990 to 1994) (see Figure 1.48).

2.4.4.2 Commercial refrigeration sector, including small stores

The commercial refrigeration sector includes all centralized systems, condensing units, and standalone equipment in supermarkets and all small stores.

Changes in refrigerants, with low-GWP blends, could take place beginning in 2012, but would most likely be used only in new refrigeration systems. The simulation of scenario 3 does not consider a retrofit of existing systems with R-404A. Nevertheless, the reduction in CO₂ equivalent emissions is significant: less than 2.5 million tonnes in 2020, instead of 8 million in scenario 1 under business as usual.

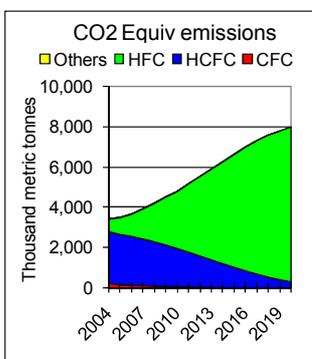


Figure 1.51 Scenario 1 - CO₂ emission changes in commercial refrigeration.

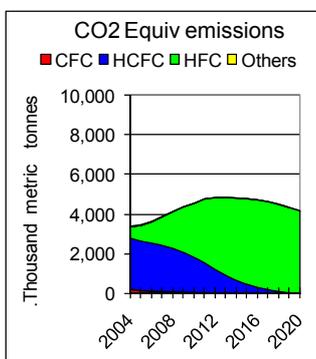


Figure 1.52 Scenario 2 - CO₂ emission changes in commercial refrigeration.

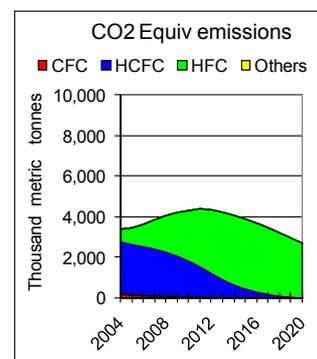


Figure 1.53 Scenario 3 - CO₂ emission changes in commercial refrigeration.

2.4.5 HCFC recovery and refrigerant demand

In 2010, the production of virgin HCFCs is banned. In developed countries, the use of HCFCs is still possible with recycled fluids, but the demand will have an impact on the refrigerant prices. Figure 1.54 and Figure 1.55 give an evaluation of HCFC demand for servicing in commercial refrigeration, and, in parallel, the total amount of HCFCs recovered after end of life or retrofit operation.

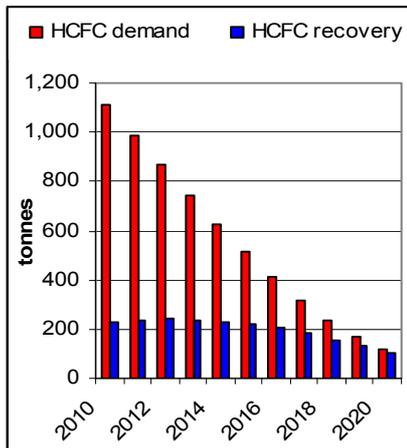


Figure 1.54 Scenario 1 - R-22 demand and recovery.

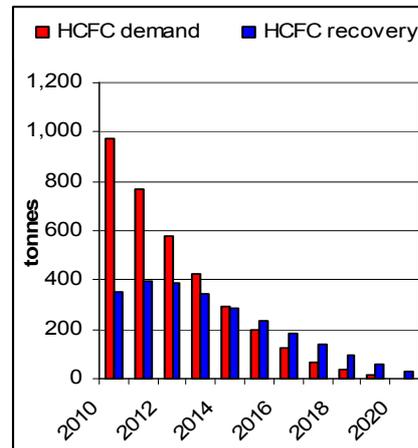


Figure 1.55 Scenario 2 & 3 - R-22 demand and recovery.

In Scenario 1, no retrofit has been considered before the end of life of systems, or before the renewing period (15 years). Figure 1.54 shows clearly the lack in refrigerant for the period from 2010 to 2020: the recovery of R-22 is nearly 200 tonnes per year, when the refrigerant needs for servicing are 1,100 tonnes in 2010 and 600 tonnes in 2015. Without any leak tightness improvement, and retrofit policy, HCFC needs will exceed available recycled refrigerants and thereby the change to intermediate blend has to be highly accelerated.

In Scenarios 2 and 3 (Figure 1.55), retrofits of HCFC installations start in 2008 and generate additional refrigerant on the market after recycling. The demand for HCFCs is covered by recovery from 2013 to 2020. Before 2013, needs of R-22 for servicing cannot be covered by refrigerant recovery from the commercial sector only.

3 Unitary Air Conditioning and chillers

This section covers two sub-domains:

- air-to-air stationary air-conditioning systems and
- chillers

Chillers are used for climate comfort and in industrial processes. Chiller manufacturers consider that about 2/3 of large chillers manufactured have been installed for climate comfort. The two equipment sub-domains and even the eight categories of air/air AC systems, and the two categories of chillers exist as specific parts in the RIEP database. These categories have been merged into one category when it comes to markets, banks, emissions, etc... in order to comply with the IPCC reporting format and limit the amount of tables and figures.

3.1 Air-to-air systems

3.1.1 Data sources and detailed calculation method

Data for sales and production of new equipment are not available for California. Therefore, a ratio (*Population of California/Population of USA*) is applied to available statistics of the USA from Building Services Research and Information Association (BSRIA) [BSR02], [BSR05].

$$\text{Market California (year } i) = \text{Market USA (year } i) * \text{Ratio (year } i) \quad (1.1)$$

$$\text{Production California (year } i) = \text{Production USA (year } i) * \text{Ratio (year } i) \quad (1.2)$$

This source includes 8 categories of air-to-air systems:

- Portable/Moveable
- Window
- Splits (Ductless < 5 kW)
- Splits (Ductless > 5 kW)
- Indoor Packaged
- Ducted Splits < 17 kW
- Ducted Splits > 17 kW
- Roof tops.

In the RIEP database, the eight different categories are calculated separately, and one global methodology is applied to all categories. Differences in refrigerant charge and choices are described the following sections.

Based on data from reference sources, the equipment production and markets are calculated, taking into proper account exports and imports of equipment. Knowing the average charge and the refrigerant type selected for each eight air-to-air AC category, the annual refrigerant quantity charged in new equipment is calculated. This also applies to the total refrigerant charge of the equipment exported.

- With data on the annual refrigerant market and the equipment lifetime, the Californian refrigerant bank can be determined.
- Using the fugitive emission rate of each category, the annual refrigerant servicing market of a country is determined.
- Refrigerant emissions (fugitive and at end of life) can be derived from the refrigerant bank while using data on the equipment lifetime.

3.1.2 Installed base of AC unitary systems

Based on data available for each category [TOC03] [TOC07] [BSR02] [BSR05], the average refrigerant charge can be established (see Table 1.7). These values correspond to average values if one uses information on the typical shares of refrigerating capacities (which is directly related to the refrigerant charge) within the different categories.

Table 1.7. Characteristics of the eight categories of air-to-air AC equipment.

| <i>Type</i> | <i>Charge (kg)</i> | <i>Life (years)</i> |
|-----------------------------------|--------------------|---------------------|
| <i>Portable/Moveable</i> | 0.5 | 10 |
| <i>Splits (Ductless <5kW)</i> | 1 | 15 |
| <i>Splits (Ductless > 5kW)</i> | 7.5 | 15 |

| | | |
|---------------------------------|-----|----|
| <i>Indoor Packaged</i> | 5.5 | 15 |
| <i>Window</i> | 0.7 | 12 |
| <i>Roof Top</i> | 5 | 20 |
| <i>Ducted Splits < 17 kW</i> | 3.5 | 15 |
| <i>Ducted Splits > 17 kW</i> | 9 | 15 |

Table 1.7 shows as well the average lifetime used to establish the law of end of life of equipments given in the following figures.

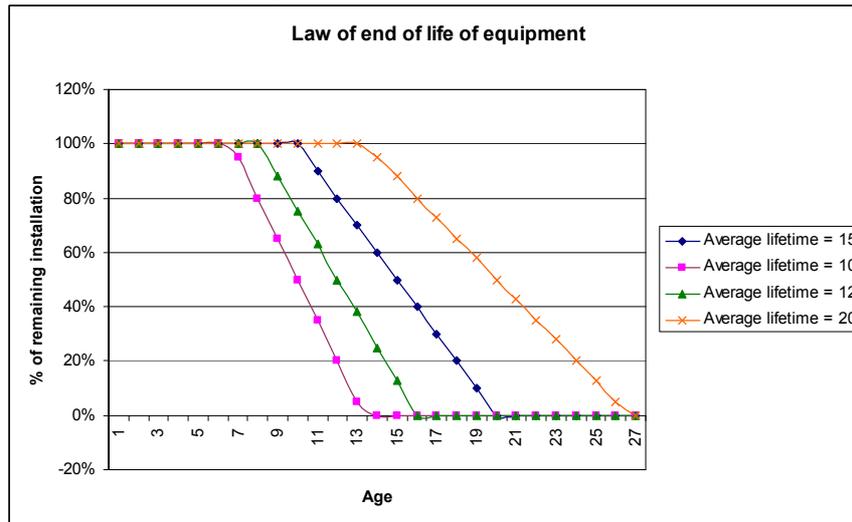


Figure 1.56 Law of end of life equipment (cf. Annex 3).

End of life curves given above are applied to the market of corresponding AC unitary system. The installed base for eight categories is given in Table 1.8.

Table 1.8 Installed base of stationary air conditioners.

| Year | Portable | Splits (Ductless <5kW) | Splits (Ductless >5kW) | Indoor Pack | Window | Roof Top | Ducted Splits <17kW | Ducted Splits >17kW |
|------|----------|------------------------|------------------------|-------------|-----------|-----------|---------------------|---------------------|
| 1990 | 11,820 | 39,290 | 18,011 | 418,596 | 3,598,786 | 785,746 | 3,288,974 | 332,330 |
| 1991 | 12,680 | 42,460 | 19,464 | 452,398 | 3,875,957 | 856,228 | 3,544,786 | 359,164 |
| 1992 | 13,580 | 45,750 | 20,972 | 487,456 | 4,160,071 | 929,383 | 3,807,006 | 386,999 |
| 1993 | 14,460 | 49,120 | 22,516 | 523,378 | 4,447,229 | 1,004,331 | 4,081,997 | 415,517 |
| 1994 | 15,420 | 52,660 | 24,136 | 561,036 | 4,748,529 | 1,082,784 | 4,366,097 | 445,414 |
| 1995 | 16,380 | 56,310 | 25,809 | 599,925 | 5,059,829 | 1,163,782 | 4,662,766 | 476,289 |
| 1996 | 17,340 | 60,020 | 27,761 | 639,127 | 5,384,157 | 1,250,271 | 5,005,851 | 508,741 |
| 1997 | 18,300 | 62,810 | 30,959 | 678,525 | 5,734,143 | 1,336,451 | 5,342,049 | 540,454 |
| 1998 | 19,260 | 65,750 | 34,311 | 718,222 | 6,097,200 | 1,422,595 | 5,667,471 | 572,244 |
| 1999 | 20,240 | 68,790 | 37,876 | 758,109 | 6,480,214 | 1,509,996 | 5,997,946 | 618,732 |
| 2000 | 21,260 | 71,930 | 41,619 | 798,209 | 6,856,471 | 1,598,626 | 6,335,109 | 665,973 |
| 2001 | 22,620 | 75,810 | 44,204 | 835,867 | 7,065,471 | 1,682,353 | 6,658,249 | 706,990 |
| 2002 | 24,340 | 81,930 | 45,617 | 870,958 | 7,525,829 | 1,760,888 | 7,026,360 | 741,621 |
| 2003 | 26,400 | 89,620 | 45,851 | 903,462 | 8,031,314 | 1,834,038 | 7,368,209 | 769,781 |
| 2004 | 28,520 | 97,950 | 46,095 | 940,395 | 8,410,257 | 1,907,035 | 7,740,046 | 800,630 |

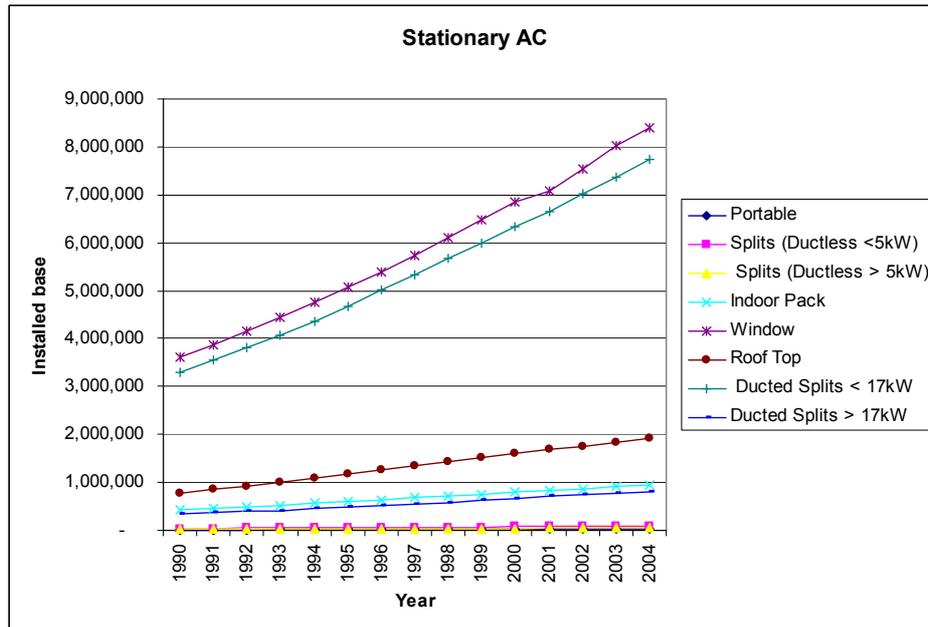


Figure 1.57 Installed base of stationary air conditioners in number of units.

3.1.3 Analysis of the uptake of R-410A

The phase-out of HCFC in brand new equipment in Europe and Japan has led to the introduction of HFC blends on the market: R-410A and R-407C.

In the U.S., the use of R-22 in new equipment is allowed until year 2010. Little interest has been shown by U.S. manufacturers to use R-407C in new equipment, because R-22 is still widely used and readily available. Nevertheless, the use of R-410A, a higher pressure refrigerant and nearly azeotrope blend, makes it possible to reduce the compressor size and increase the compactness of the AC unit.

R-410A units were introduced on the market in 1999 but were limited to small size units. R-410A compressors are specially designed for high operating pressures, up to 40 bar (580 Psi abs.). At first, the range of R-410A compressor capacity was limited to 25 kW cooling capacity. Later on in 2004, as a result of new research and development, the average cooling capacity of a roof-top unit with R-410A reached.

In the U.S. and California, the share of R-410A used in brand new equipment approached 10% in 2004. However, a rapid growth is forecasted and R-410A will be the major refrigerant used in stationary AC.

3.1.4 Fugitive emission rate and recovery efficiency

Table 1.9 summarizes the fugitive emission rate and the recovery efficiency at end of life for stationary equipment. The recovery efficiency is directly related to the refrigerant charge. Namely, the higher the refrigerant charge, the higher the recovery rate. This may sound optimistic, but corresponds to the thresholds in a number of regulations, i.e., recovery is made mandatory above a certain refrigerant charge value.

Table 1.9 Fugitive emission rates and recovery efficiency in 2004.

| | <i>Portable</i> | <i>Ductless Splits<5 kW</i> | <i>Ductless Splits>5 kW</i> | <i>Indoor Packaged</i> | <i>Window</i> | <i>Roof Top</i> | <i>Ducted Splits<17 kW</i> | <i>Ducted Splits>17kW</i> |
|-----------------------------|-----------------|--------------------------------|--------------------------------|------------------------|---------------|-----------------|-------------------------------|------------------------------|
| <i>Annual emission rate</i> | 2% | 5 % | 10% | 5% | 2% | 5% | 5% | 5% |
| <i>Recovery efficiency</i> | 0% | 0% | 30% | 50% | 0% | 70% | 50% | 70% |

3.2 Chillers

3.2.1 Data sources and calculation method

An additional parameter to take into account when dealing with chillers is the refrigerant charge ratio, which is used here in the calculation process. The refrigerant charge ratio depends on the type of chiller: volumetric (reciprocating, screw, and scroll) or centrifugal. These two categories exist as specific separate parts within the RIEP database.

Data for California are not available. Market data are derived from the BSRIA marketing study [BSR05]. A ratio (*Population of California/Population of USA*) is applied to the U.S. available statistics. The average cooling capacity of centrifugal chillers is 3 MW and the average cooling capacity of a volumetric chiller is 350 kW. Table 1.10 shows the chiller market in 2004.

Table 1.10 Chiller market in 2004 [BSR05].

| Chillers market | <i>USA</i> | <i>California</i> |
|------------------------|------------|-------------------|
| <i>Centrifugal</i> | 3402 | 418 |
| <i>Other Chillers</i> | 14980 | 1845 |

3.2.2 Installed base of chillers

The U.S. installed base of chillers is the derivation of chiller market for the last 20 years, taking into account the extinction curve of these units.

Table 1.11 U.S. installed base of chillers, from 1990 to 2004.

| Year | <i>Centrifugal chillers</i> | <i>Other chillers (volumetric)</i> |
|-------------|-----------------------------|------------------------------------|
| 1990 | 9,309 | 13,553 |
| 1991 | 9,465 | 13,942 |
| 1992 | 9,781 | 14,389 |
| 1993 | 10,430 | 14,941 |
| 1994 | 11,360 | 15,687 |
| 1995 | 12,268 | 16,310 |
| 1996 | 13,122 | 17,240 |
| 1997 | 13,571 | 18,175 |
| 1998 | 13,571 | 18,833 |
| 1999 | 13,748 | 19,247 |
| 2000 | 13,982 | 19,737 |
| 2001 | 14,145 | 20,295 |
| 2002 | 14,246 | 20,886 |
| 2003 | 14,281 | 21,500 |
| 2004 | 14,309 | 22,175 |

3.2.3 Analysis of the R-123 uptake

Refrigerants used in centrifugal chillers (CFC-11, CFC-12, HFC-134a, and HCFC-123) are significantly different from those used in volumetric chillers (HCFC-22, HFC-134a, R-410A, and R-717 (ammonia)). For these two categories, refrigerant types are analyzed below.

Table 1.12 Centrifugal chillers, refrigerant distribution in market of brand new equipment.

| Year | % of R-134a | % of R-11 | % of R-12 | % of R-123 |
|-------------|--------------------|------------------|------------------|-------------------|
| 1990 | 0 | 70 | 30 | 0 |
| 1991 | 0 | 70 | 30 | 0 |
| 1992 | 5 | 70 | 25 | 0 |
| 1993 | 10 | 50 | 20 | 20 |
| 1994 | 20 | 30 | 10 | 40 |
| 1995 | 40 | 0 | 0 | 60 |
| 1996 | 40 | 0 | 0 | 60 |
| 1997 | 40 | 0 | 0 | 60 |
| 1998 | 40 | 0 | 0 | 60 |
| 1999 | 40 | 0 | 0 | 60 |
| 2000 | 40 | 0 | 0 | 60 |
| 2001 | 40 | 0 | 0 | 60 |
| 2002 | 40 | 0 | 0 | 60 |
| 2003 | 40 | 0 | 0 | 60 |
| 2004 | 50 | 0 | 0 | 50 |

Table 1.13 Volumetric chillers, refrigerant distribution in market of brand new equipment.

| Year | % of R-134a | % of R-717 | % of R-22 | % of R-410A |
|-------------|--------------------|-------------------|------------------|--------------------|
| 1990 | 0 | 2 | 98 | 0 |
| 1991 | 0 | 2 | 98 | 0 |
| 1992 | 0 | 2 | 98 | 0 |
| 1993 | 1 | 2 | 97 | 0 |
| 1994 | 2 | 2 | 96 | 0 |
| 1995 | 3 | 2 | 95 | 0 |
| 1996 | 3 | 2 | 95 | 0 |
| 1997 | 3 | 2 | 95 | 0 |
| 1998 | 3 | 2 | 95 | 0 |
| 1999 | 3 | 2 | 95 | 0 |
| 2000 | 3 | 2 | 95 | 0 |
| 2001 | 3 | 2 | 95 | 0 |
| 2002 | 3 | 2 | 95 | 0 |
| 2003 | 3 | 2 | 95 | 0 |
| 2004 | 3 | 2 | 90 | 5 |

3.2.4 Refrigerant charge, emission factor, and recovery efficiency

The refrigerant charge corresponding to the refrigerating capacity varies significantly with the technology and the liquid density. The ratio of refrigerant charge per one kilowatt of refrigerating capacity is shown in Table 1.14 for centrifugal chillers.

Table 1.14 Charge / cooling capacity ratio for centrifugal chillers [TEA04].

| Refrigerant | CFC-11 | CFC-12 | HCFC-123 | HFC-134a |
|---------------------------------------|--------|--------|----------|----------|
| Charge/cooling capacity ratio (kg/kW) | 0.28 | 0.35 | 0.40 | 0.36 |

When considering volumetric chillers, two technical options are available for the evaporator, either dry expansion evaporator (dry Hex) or flooded evaporator used with centrifugal chillers. As shown in Table 1.15, the evaporator technology influences the refrigerant charge per kW of refrigerating capacity.

Table 1.15 Charge / cooling capacity ratio for volumetric chillers [TEA04].

| Refrigerant and chiller type | Evaporator type | kg/kW |
|---------------------------------------|-----------------|-------------|
| HCFC-22 and HFC-134a screw and scroll | Dry Hex | 0.27 |
| R-410A and R-407C scroll | Dry Hex | 0.27 |
| HCFC-22 and HFC-134a screw | Flooded | 0.35 |
| HCFC-22 reciprocating | Dry Hex | 0.26 |
| R-717 screw or reciprocating | Dry Hex | 0.04 to 0.2 |
| R-717 screw or reciprocating | Flooded | 0.2 to 0.25 |

Table 1.16 Annual emission rate for centrifugal chillers.

| Centrifugal chillers | R-134a | R-11 | R-12 | R-22 | R-123 |
|--------------------------|--------|------|------|------|-------|
| Annual emission rate (%) | 5 | 10 | 10 | 10 | 3 |

Table 1.17 Recovery efficiency.

| Chiller type | Centrifugal chillers | Volumetric chillers |
|--------------------------|----------------------|---------------------|
| Recovery Efficiency (%) | 80 | 50 |
| Annual emission rate (%) | (See Table 1.16) | 5 |

3.3 Results of calculations: refrigerant bank and emissions

3.3.1 Refrigerant bank

Figure 1.57 and Figure 1.59 present refrigerant bank evolution from 1990 to 2004 in stationary air conditioning and chillers.

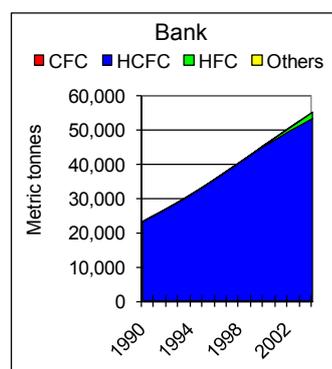


Figure 1.58 Refrigerant bank in stationary AC.

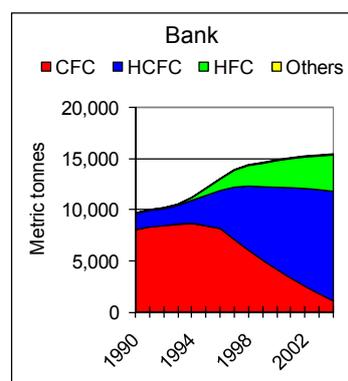


Figure 1.59 Refrigerant bank in chillers.

R-22 dominates refrigerant bank in stationary AC sector where a remarkable growth rate is observed between years 1990 and 2004. In 2004, the installed base of stationary equipment is filled with more than 53,000 tonnes of R-22. Chillers contribute to 16,000 tonnes of refrigerant bank, with HCFCs accounting for 80% of the chiller refrigerant bank in 2004. The primary HCFCs used in chillers are R-123 and R-22. CFCs are still used in some chillers, but this use will be null in a few years, as older systems are replaced or retrofitted.

3.3.2 Refrigerant emissions

Figure 1.60 and Figure 1.61 illustrate refrigerant emissions evolutions from 1990 to 2004 in stationary air conditioning and chillers.

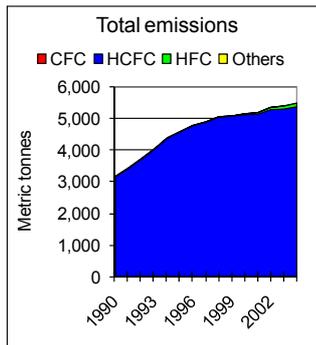


Figure 1.60 Refrigerant emissions from stationary AC.

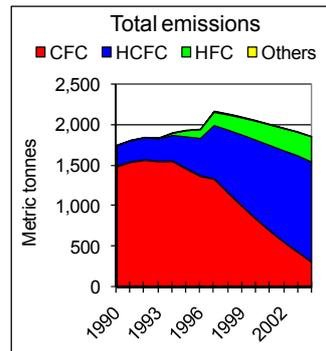


Figure 1.61 Refrigerant emissions from chillers.

Following the trend of the bank, the emissions in stationary AC sector reach 5,500 tonnes in 2004. CFC emissions from chillers are still significant, with nearly 500 tonnes in 2004.

3.3.3 Refrigerant CO₂ equivalent emissions

Figure 1.62 and Figure 1.63 present refrigerant CO₂ equivalent emissions from 1990 to 2004 in stationary air conditioning and chillers. CO₂ equivalent emissions from chillers were significant in the beginning of the 1990s due to the high GWP of R-12 and R-11 compared to R-134a and R-22. In the stationary AC sector, CO₂ equivalent emissions total 8 million of CO₂ metric tonnes.

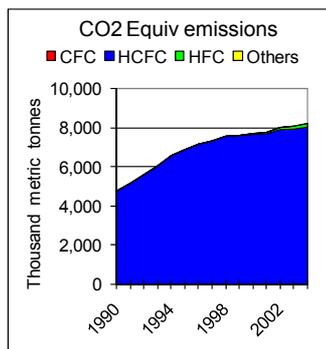


Figure 1.62 CO₂ equivalent emissions from stationary AC.

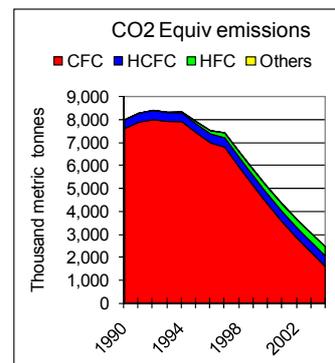


Figure 1.63 CO₂ equivalent emissions from chillers.

3.4 Scenarios to forecast refrigerant emission from unitary air conditioners and chillers

3.4.1 Scenarios assumptions

3.4.1.1 Business as usual scenario (scenario 1): Scenario 1: Business As Usual

Usual practices and emission rates are kept unchanged for the next 16 years. The recovery efficiency is not improved. Nevertheless, the regulation corresponding to the refrigerant phase-out is taken into account for refrigerant replacement. No effort is made to perform the retrofit of HCFCs during this period.

3.4.1.2 Scenario 2

Some improvements are made to reduce equivalent CO₂ emissions of refrigerants:

- The system leak tightness is improved by choosing more reliable components
- The recovery efficiency is improved at servicing and end of life. Recovery begins on low charge equipment where it was not done before
- Technologies permitting to reduce the refrigerant charge are chosen (compactness, dry heat exchanger)
- Lower GWP refrigerants are preferred when possible
- Retrofit of R-22 starts from 2012 and continues for a period of 12 years.

3.4.1.3 Scenario 3: Partial phase-out of high GWP HFCs

Efforts are made with the same improvements mentioned in the second scenario. Technological options are chosen in order to decrease refrigerant charge and GWP when possible. A new blend is introduced with a low GWP (100). In 2020, this blend will cover 50% of market of brand new equipment.

Table 1.18 Fugitive emission for different scenarios.

| Emission rate (%) | 2004 | 2020 – Scenario 1 | 2020 - Scenario 2 | 2020 - Scenario 3 |
|------------------------------------|-------------|--------------------------|--------------------------|--------------------------|
| <i>Portable</i> | 2 | 2 | 2 | 2 |
| <i>Splits (Ductless < 5 kW)</i> | 5 | 5 | 5 | 5 |
| <i>Splits (Ductless > 5 kW)</i> | 10 | 10 | 8 | 8 |
| <i>Indoor Packaged</i> | 5 | 5 | 5 | 2 |
| <i>Window</i> | 2 | 2 | 2 | 2 |
| <i>Roof Top</i> | 5 | 5 | 5 | 5 |
| <i>Ducted Splits < 17 kW</i> | 5 | 5 | 5 | 5 |
| <i>Ducted Splits > 17 kW</i> | 5 | 5 | 5 | 5 |

The level of emission rate is low in stationary AC equipment, compared to commercial and industrial refrigeration. Unitary AC systems are compact and most of components are molded. The number of fittings is limited and the sensitivity to leaks is low.

Table 1.19 Recovery efficiency.

| Recovery efficiency (%) | 2004 | 2020 – Scenario 1 | 2020 - Scenario 2 | 2020 - Scenario 3 |
|------------------------------------|-------------|--------------------------|--------------------------|--------------------------|
| <i>Portable</i> | 0 | 0 | 30 | 30 |
| <i>Splits (Ductless < 5 kW)</i> | 0 | 0 | 30 | 30 |
| <i>Splits (Ductless > 5 kW)</i> | 30 | 30 | 50 | 50 |
| <i>Indoor Packaged</i> | 50 | 70 | 70 | 80 |
| <i>Window</i> | 0 | 0 | 30 | 30 |
| <i>Roof Top</i> | 70 | 70 | 70 | 80 |
| <i>Ducted Splits < 17 kW</i> | 50 | 50 | 70 | 70 |
| <i>Ducted Splits > 17 kW</i> | 70 | 70 | 70 | 70 |

Recovery of refrigerant at the end of life is not performed on low charge equipment such as windows, portable or split systems. In scenarios 2 and 3, it is considered that refrigerant recovery starts in 2010 for these small unitary systems.

Table 1.20 Refrigerant charge ratio.

| Ratio kg/kW | 2004 | 2020 – Scenario 1 | 2020 - Scenario 2 | 2020 - Scenario 3 |
|-----------------------------|-------------|--------------------------|--------------------------|--------------------------|
| <i>Centrifugal chillers</i> | 0.3 | 0.3 | 0.25 | 0.25 |
| <i>Volumetric chillers</i> | 0.35 | 0.35 | 0.3 | 0.3 |

Flooded evaporators have a large content of refrigerant while dry expansion heat exchangers are more adapted to reduce the refrigerant charge. Moreover, air cooled condenser can be built with micro-channel flat tubes to limit the refrigerant charge.

3.4.2 Refrigerant bank

Figure 1.64 and Figure 1.65 present refrigerant bank evolution from 1990 to 2004 in stationary air conditioning and chillers. No significant change in the bank growth is observed for different scenarios. In 2010, new systems are no longer filled with HCFCs. R-22 is replaced by HFCs, especially R-410A.

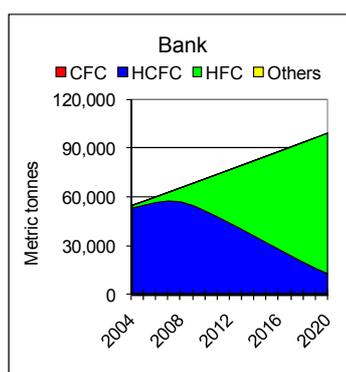


Figure 1.64 Refrigerant bank in stationary AC.

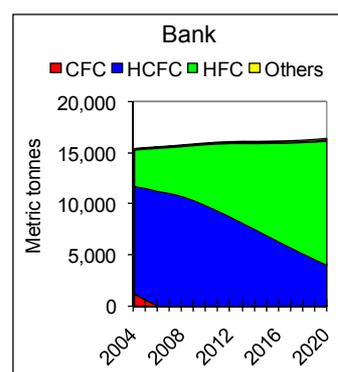


Figure 1.65 Refrigerant bank in chillers.

Figure 1.64 shows that the bank growth in 2020 in stationary AC units is still high and could reach 100,000 tonnes. In chillers the bank stabilizes at 15,000 tonnes. The market growth of chillers is absorbed by the decrease of the refrigerant charge in new chillers.

3.4.3 Refrigerant emissions

Figure 1.66 to Figure 1.68 present refrigerant emissions evolution from 2004 to 2020 in the stationary air-conditioning sector.

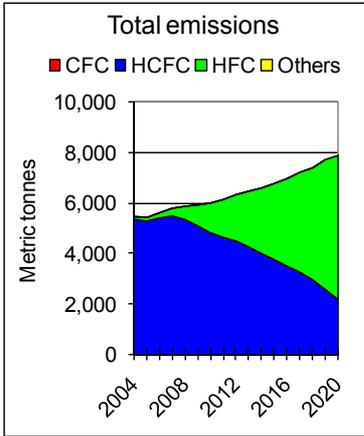


Figure 1.66 Scenario 1, emissions from stationary AC.

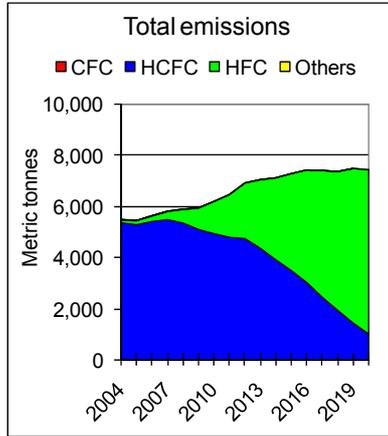


Figure 1.67 Scenario 2, emissions from stationary AC.

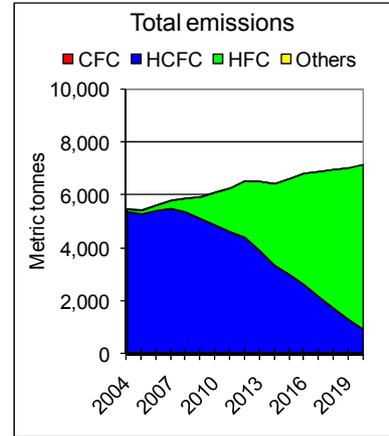


Figure 1.68 Scenario 3, emissions from stationary AC.

In 2004, the level of refrigerant emissions (fugitive and end of life) is 5,500 metric tonnes for stationary AC and consists mainly of HCFCs. In the BAU scenario, refrigerant emissions reach 8,000 in 2020 due to the bank increase.

In Scenarios 2 and 3, improved recovery of refrigerant is considered at the equipment end of life. Nevertheless, the side effect of R-22 retrofit causes a rapid increase in HCFC emissions after 2010. Retrofit of R-22 generates anticipated end of life emissions. In 2020, HCFC emissions are lower and the total amount of refrigerant release to the atmosphere is limited to 7,500 metric tonnes for scenario 2 and 7,000 for Scenario 3. Figure 1.69 to Figure 1.71 present refrigerant emissions evolution from 2004 to 2020 in chillers.

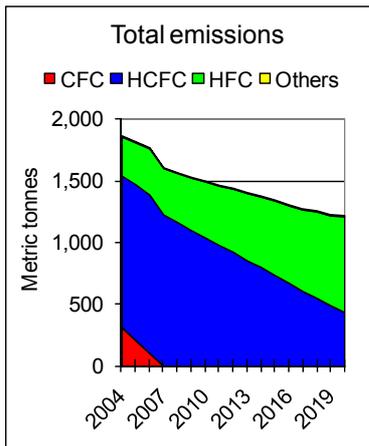


Figure 1.69 Scenario 1, emissions from chillers.

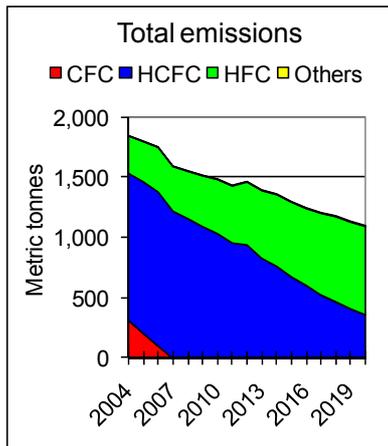


Figure 1.70 Scenario 2, emissions from chillers.

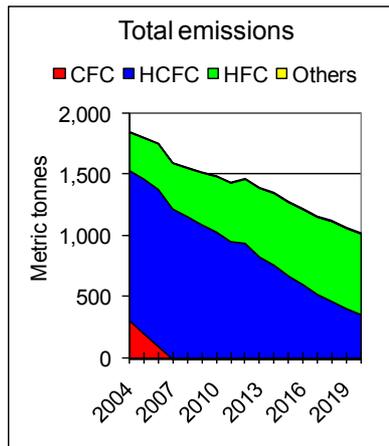


Figure 1.71 Scenario 3, emissions from chillers.

The new generation of chillers, filled with R-134a and R-123 are more leak tight than CFC chillers. These improvements, along with a better recovery efficiency at end of life, lead to a reduction in refrigerant emissions of 1,000 metric tonnes in 2020.

3.4.4 Refrigerant CO₂ equivalent emissions

Figure 1.72 to Figure 1.74 present CO₂ equivalent emissions evolution from 2004 to 2020 in the stationary air-conditioning sector.

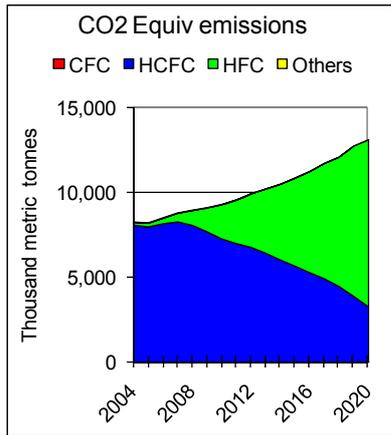


Figure 1.72 Scenario 1, CO₂ equiv. emissions in stationary AC.

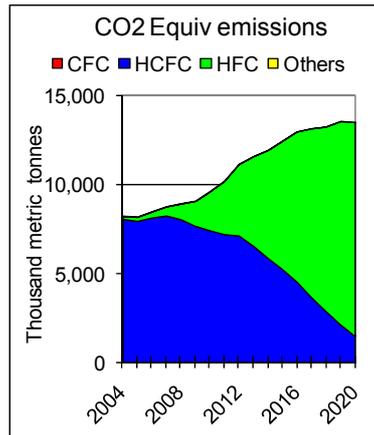


Figure 1.73 Scenario 2, CO₂ equiv. emissions in stationary AC.

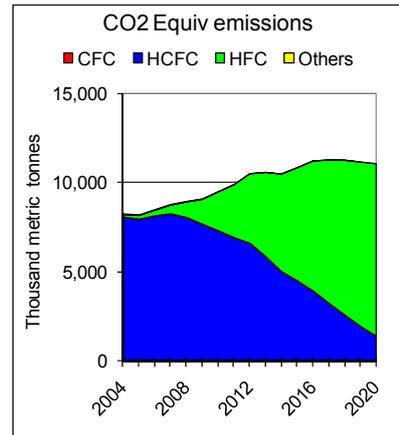


Figure 1.74 Scenario 3, CO₂ equiv. emissions in stationary AC.

R-22 GWP is 1500 and R-410A GWP is nearly 2000. The introduction of R-410A on the market has an impact on CO₂ equivalent emissions in stationary AC. As shown in scenario 2, the retrofit of R-22 increases CO₂ equivalent emissions because of higher GWP of HFCs. In 2020, the level of emission reaches 13 million metric tonnes CO₂ equivalent. In scenario 3, a new refrigerant blend with a very low GWP is assumed to be available in 2012, and filled in 50% of new equipment in 2020. Therefore, CO₂ equivalent emissions in 2020 will decrease to 11 million metric tonnes CO₂ equivalent. Figure 1.75 to Figure 1.77 present CO₂ equivalent emissions evolution from 2004 to 2020 in chillers.

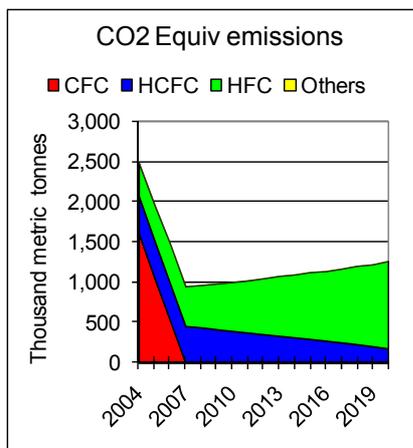


Figure 1.75 Scenario 1, CO₂ equivalent emissions in chillers.

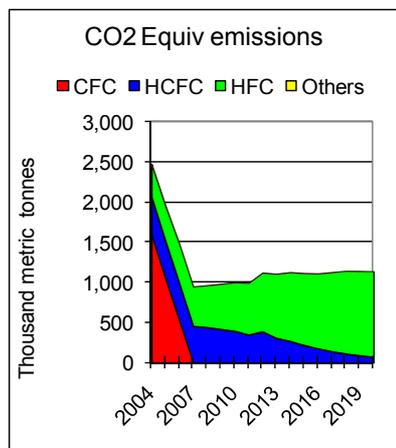


Figure 1.76 Scenario 2, CO₂ equivalent emissions in chillers.

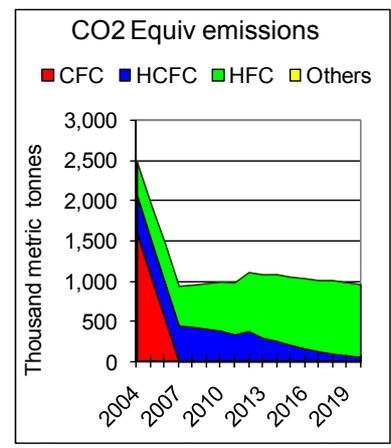


Figure 1.77 Scenario 3, CO₂ equivalent emissions in chillers.

The Scenario 3 observation concerns the continuing phase-out of CFCs used in centrifugal chillers. The phase-out will decrease CO₂ equivalent emissions. R-123 has a low GWP, and R-134a GWP is “only” 1300 (compared to R-12 (GWP 8600) and R-11 (GWP 4600)). In Scenario 3, the level of CO₂ equivalent emissions is limited to 1 million metric tonnes in 2020.

3.5 Refrigerant demand and recovery

Figure 1.78 and Figure 1.79 present the comparison of R-22 demand recovery for the period from 2010 to 2020 in both stationary AC and chillers sectors.

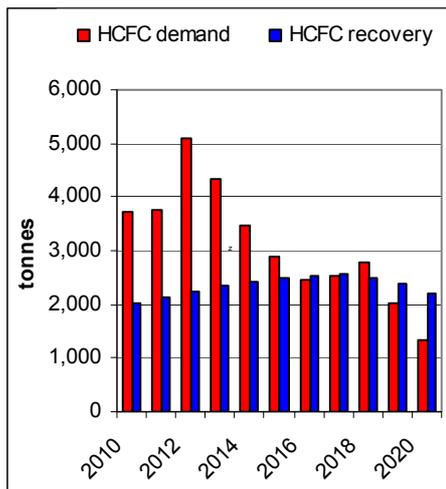


Figure 1.78 HCFC demand and recovery in business as usual scenario.

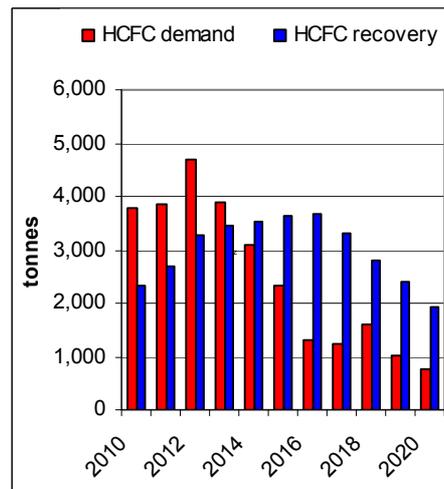


Figure 1.79 HCFC demand and recovery in scenario 2.

In the Business As Usual (BAU) scenario (see Figure 1.78), HCFC demand reaches twice the recovery of HCFCs for the year 2013. This figure shows that the recovery is not sufficient to feed the market for servicing demand.

In scenario 2 (see Figure 1.79), the retrofit of R-22 in large capacity equipment starts in 2010, for a 15-year period. Between the years 2010 and 2013, R-22 recovery covers almost 2/3 of the servicing demand, then after 2014 the recovery exceeds the demand.

Scenario 2 shows that R-22 phase-out should not be a problem in the stationary and chiller air conditioning sectors if the recovery is efficiently carried out in these sectors and the R-22 retrofit is performed.

4 Refrigerant emissions from the industrial sector

This section describes refrigerant use, banks, and emissions from the non-retail food industry, cold storage facilities, and industrial process cooling.

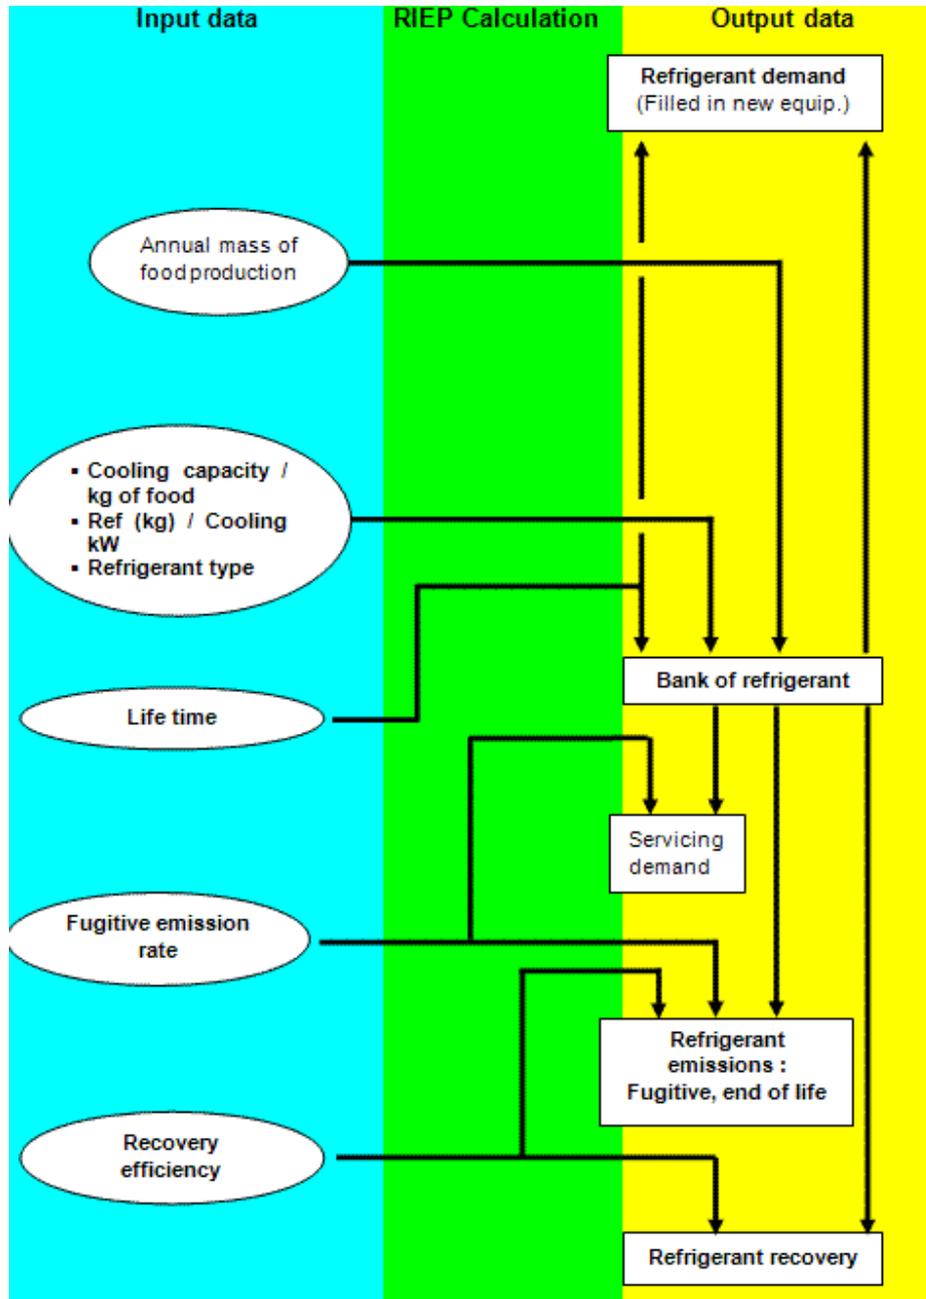


Figure 1.80 Calculation steps for emission forecasts in the food industry.

4.1 Food industry and cold storage

Cooling and freezing processes in the food industry are applied to all types of meat, to dairy products, wines, beers, soft drinks, frozen food, and chocolate. Flake ice is used for the cooling of fresh fish.

4.1.1 Calculation method - RIEP

The methodology is based on food products. This choice has been made since the "Food and Agricultural Organization (FAO) updates the database every year for food products produced and sold in each country. These data are needed for the "Inventories of the worldwide fleets of refrigerating and air-conditioning equipment in order to determine refrigerant emissions".

Vegetables and fruits are taken into account in the cold storage and warehouse calculations. This choice has been made due to the very large difference that exists between crops and refrigerated vegetables and fruits. A calculation performed for the storage volume avoids large overestimates.

Food domains taken into account are those of major importance: meat, dairy products, wines, beers, fishes, and frozen food. Cold storage is taken into account via two different routes:

- at the process facilities using a ratio between the cooling process and the properties of the product; it is therefore integrated in the cooling capacity dedicated to products,
- for general cold storage purposes, where needs are calculated separately.

For the Californian inventory, chocolate processes are not taken into account due to lack of information, but their contribution to the total bank and emissions is not significant. The only available information found for the U.S. is the following [SCN08]:

| <i>Shipments (million lbs)</i> | |
|--------------------------------|-------|
| 1994 | 2.859 |
| 1995 | 3.02 |
| 1996 | 3.1 |

The consumption ($Consumption = Shipments + Imports - Exports$) [SCN08] is also given for another three years.

The global methodology (see Figure 1.80) used to determine the refrigerant inventories and emissions is based on data available for the production of all types of refrigerated and frozen food. The different food products are cooled or frozen at production sites, transported in refrigerated transport means, and then possibly stored in general warehouses. So, the food production data is used to establish the refrigerating equipment installed in the food industries.

The calculation steps are as follows:

- Analysis of the usual process design of a slaughterhouse, dairy, brewery, etc... to determine the installed refrigerating capacity
- Definition of typical ratios of refrigerant charge referenced to the refrigerating capacity and the temperature level
- Definition of the type of refrigerants selected, which selection depends on the temperature level and on the type of country
- Calculation of the refrigerant bank

- Calculation of the refrigerant demand for new equipment (based on the equipment lifetime and the bank)
- Determination of national or regional emission factors applicable to the bank, yielding emissions.

4.1.2 Calculation of the cooling capacity and the refrigerant charge

Calculations are performed for the seven following sub-domains:

1. meat industry
2. dairy industry
3. wine and beers
4. flake ice for fresh fish
5. frozen food
6. warehouses
7. soft drinks

Annex 4 presents detailed calculations for each sub-domain where the ratio between the cooling capacity and the annual production of a given product (kW/kg) is defined. Figure 1.81 summarizes the methodology and describes the relation between the annual production of refrigerated and frozen food and the refrigerant bank for all sub-domains.

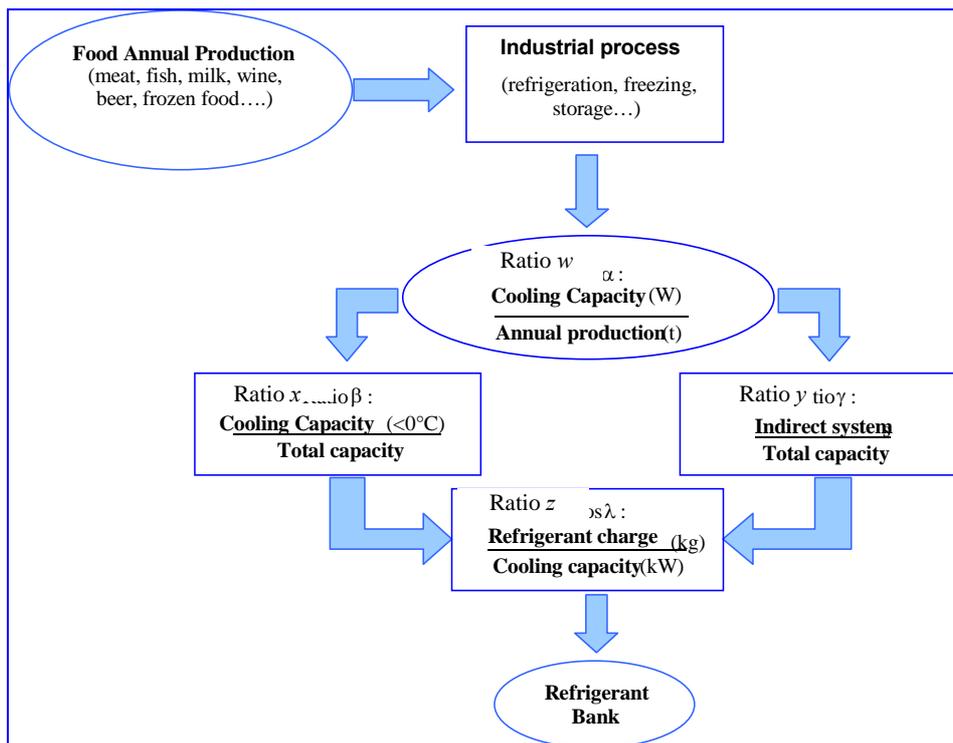


Figure 1.81 Methodology for each type of refrigerated/frozen food industry.

The detailed studies of the processes applied in each sub-domain (see Annex 4) allows determining the ratio between the total cooling capacity and the annual mass production of each sub-domain:

$$w = \text{Cooling Capacity (W)} / \text{Annual production (t)} \quad (1.3)$$

Taking into account the division the cooling capacities for low and medium temperatures, which are again dependent on the cooling process, for each sub-domain the ratio x is defined:

$$x = \text{Low Temp. Cooling Capacity } (<0^{\circ}\text{C}) / \text{Total cooling capacity} \quad (1.4)$$

Depending on the sub-domain and the technology, the indirect systems form a different part in the total. y is defined as the ratio of the cooling capacity of indirect systems and the total cooling capacity (direct + indirect):

$$y = \text{Cooling Capacity of indirect systems} / \text{Total capacity} \quad (1.5)$$

The ratio z refers the refrigerant charge to the cooling capacity while considering the temperature level, and the technology (indirect or not).

$$z = \text{Refrigerant charge (kg)} / \text{Cooling capacity (kW)} \quad (1.6)$$

4.1.2.1 The cooling capacity per mass of product and by level of temperature

Ratios defined in Equations (9.1) and (9.2) are presented in Table 1.21 (see also Annex 4 for a justification).

Table 1.21 Ratios w and x for the different sub-domains.

| | w Cooling Capacity / mass of processed product | x Low T Cooling Capacity / Total cooling capacity |
|--------------------------|--|---|
| Meat industry | 43 W/t | 0.3 |
| Dairy industry | 12.9 W/t | 0.2 |
| Wine and beers | 20.5 W/t | 0 |
| Flake ice for fresh fish | 11.9 W/t | 1 |
| Soft drinks | 4 W/t | 0 |
| Frozen food | 35.8 W/t | 1 |
| Warehouses | 33 W/m ³ | 0.7 |

The freezing capacity for meat is included in the calculations for the amount of frozen products globally. The cooling capacity in the meat industry is only defined for the production of fresh meat.

4.1.2.2 The Cooling capacity of indirect systems

Values of the y ratio as defined in Equation (1.5) are given in Table 1.22 for each sub-domain, for the year 2004. This ratio is year dependent.

Table 1.22 Ratio of indirect systems in new equipment in 2004.

| Industry | $y = \text{Cooling Capacity of indirect systems} / \text{Total capacity}$ |
|--------------------------|---|
| Meat industry | 0.15 |
| Dairy industry | 0.3 |
| Wine and beers | 0.15 |
| Flake ice for fresh fish | 0 |
| Soft drinks | 1 |
| Frozen food | 0.25 |
| Warehouses | 0.15 |

4.1.2.3 The refrigerant charge

Values of the z ratio as defined in Equation (1.6) are given in Table 1.23. This ratio is given for medium and low temperature, for both direct and indirect systems. Because of lower liquid density, these ratios have to be divided by a factor of 2 for ammonia.

Table 1.23 Refrigerant charge referred to the cooling capacity.

| System | $z = \text{Refrigerant charge (kg)} / \text{Cooling capacity (kW)}$ |
|---------------------------|---|
| Med Temp. Direct system | 5.5 |
| Low Temp. Direct system | 8.8 |
| Med Temp. Indirect system | 1 |
| Low Temp. Indirect system | 1.5 |

4.1.3 Type of refrigerants

Ammonia (R-717) is widely used in the domain of industrial refrigeration (50% to 60% in U.S.).

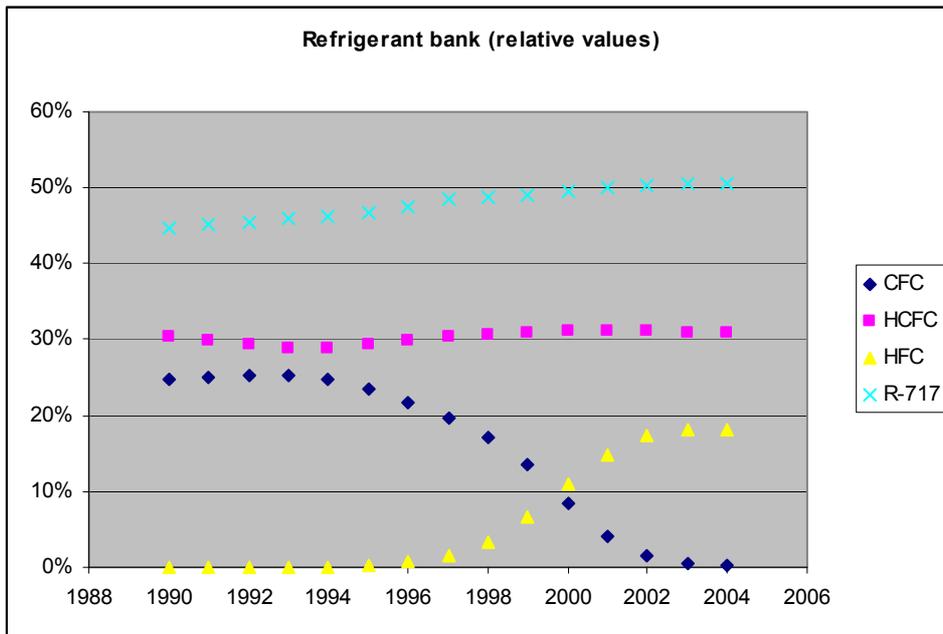


Figure 1.82 Evolution of refrigerant bank in industrial refrigeration.

4.1.4 Other characteristics

The average lifetime is used to establish the law of end-of-life of equipment.

Table 1.24 Complementary data necessary to perform the RIEP calculations.

| Year 2004 | California |
|---|-------------------|
| Average equipment lifetime | 30 years |
| Annual fugitive emission rate | 10% |
| Percentage of charge emitted before servicing | 30% |
| Recovery efficiency | 70% |

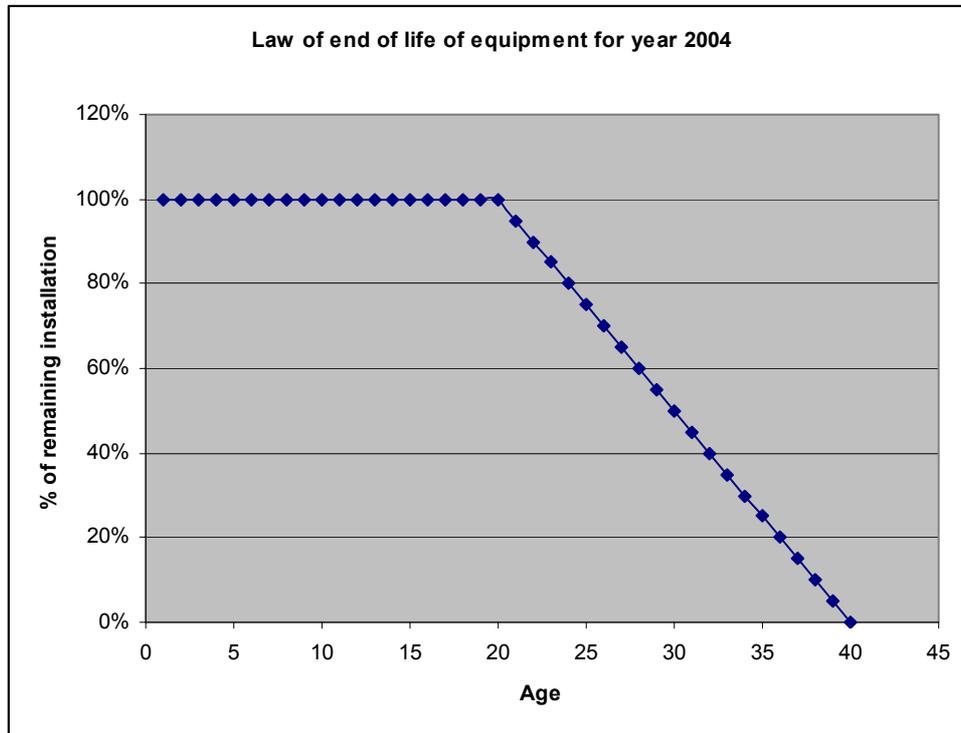


Figure 1.83 Law of end of life of refrigeration equipment.

4.1.5 Production data for food products

4.1.5.1 Production data is available for the following sub-domains.

Meat industry

Data on production of meat is available for the USA from the FAO [FAO08] and USDA [USD01]. For California, such data is available from the United States Department of Agriculture (USDA) for many years, except for chicken meat. A compilation of both sources allowed establishing the total meat production for California.

Table 1.25 Meat production in the U.S. and California.

| Meat production (t) | 1990 | 2004 |
|----------------------------|-------------|-------------|
| USA | 39,747,784 | 49,966,545 |
| California | 2,058,102 | 2,637,806 |

Dairy industry

The dairy industry covers the production of milk, butter, cheese, and cream. California is a leading state in milk production, covering approximately 20% of the total national milk production.

Both United States Department of Agriculture (USDA) [USD02] and FAO [FAO08] sources were used in order to compute the total industry dairy production.

Historical data for the U.S. are available. For those unavailable values for the state of California, ratios for cheese, butter, and cream production over the USA production were established (eg.

Cheese Production U.S. (t) /Milk Production U.S. (t)) were established, and applied to the milk production in California in order to compute the cheese and other unavailable dairy products historical statistics for California.

Table 1.26 Dairy production.

| Food Production | | 1990 | 2004 |
|------------------------------|-------------------|-------------|-------------|
| <i>Milk production (t)</i> | <i>USA</i> | 67,005,118 | 77,534,358 |
| | <i>California</i> | 9,501,399 | 16,540,246 |
| <i>Cheese production (t)</i> | <i>USA</i> | 2,748,516 | 4,024,793 |
| | <i>California</i> | 317,054 | 903,928 |

Wine and beers

California produces more than 90 percent of total U.S. wine production [WIN]. Production data is available for California from the Wine Institute [WIN] for years 1986 to 2004. The FAO provides statistics for the USA starting from the year 1961. Both sources were used to compute the historical production for California.

Table 1.27 Wine production.

| Wine production (t) | 1995 | 2004 |
|----------------------------|-------------|-------------|
| <i>USA</i> | 1,654,354 | 2,304,817 |
| <i>California</i> | 1,502,967 | 2,070,724 |

Information on the beer production is available for the USA from the FAO [FAO08] and the Beer Institute [BEI08]. The total USA production of beer is about 23 million of metric tons. The Beer Institute gives data for California for many years. In 2004, the California beer production accounts for about 11% of the global U.S. beer production. This ratio is almost constant for years 1999 to 2006, and was therefore applied to estimate historical values for California.

Flake ice for fresh fish

In the calculations, flake ice production is directly linked to the daily catch of sea and river fish. NOAA's National Marine Fisheries Service provides statistics on domestic commercial landings [NMF07] for the USA and California, and the FAO gives global production statistics.

Referring to the NOAA's data, the fish landing in California accounted for 31% of the total U.S. landings in the year 1950. In the year 2005, the share of California in the total U.S. landings decreased to reach 5%, while the state of Alaska became the most important producer with 60% of the total U.S. landings. Both sources were therefore used to calculate the production of California.

Table 1.28 Fish production.

| Fish production (t) | 1990 | 2004 |
|----------------------------|-------------|-------------|
| <i>USA</i> | 6,096,539 | 5,972,841 |
| <i>California</i> | 435,438 | 233,633 |

Frozen food

The FAO provides the quantity of frozen food produced in the USA, i.e. 13.8 million of metric tonnes for the year 1990 and 16.3 for the year 2004. Based on the U.S. Bureau Census, about 14% of the USA frozen food industries are in California. Due to lack of information regarding the quantity produced in California, this ratio was adopted.

Warehouses.

The volume of refrigerated warehouses is available from the USDA for the USA and for California for many years. Linear interpolation is done for the years that are not given by the USDA.

Table 1.29 Warehouse capacity.

| Net refrigerated warehouses capacity (m³) | 1990 | 2004 |
|---|-------------|-------------|
| USA | 55,578,891 | 73,086,802 |
| California | 6,015,404 | 9,137,563 |

Soft drinks

The U.S. Bureau Census gives the total number of establishments engaged in manufacturing soft drinks and artificially carbonated waters for the USA and for California. The ratio *Industries in California/Industries in USA* = 11% is applied to the total volume of carbonated soft drinks (CSD) manufactured by the U.S. industry, given by the Beverage Digest [BED07].

Table 1.30 Carbonated soft drinks production.

| | CSD volume (192 billion oz cases) | | CSD volume (t) | |
|------------|--|-------------|-----------------------|-------------|
| | 1990 | 2004 | 1990 | 2004 |
| USA | 6.1308 | 7.84384 | 33,371,171 | 41,619,252 |
| California | 0.674388 | 0.8628224 | 3,670,829 | 4,578,118 |

4.1.6 Milk tanks

Milk tanks are installed on farms and represent a sub-domain included in the dairy domain. The calculations are specific, based on the number of milkings, which enables to define the storage volume of the milk tank. Knowing the storage volume, it is possible to define the refrigerating capacity and the refrigerant charge; the method and additional data are presented in Annex 4.

4.1.6.1 Average refrigerant charge

The average charge of refrigerant is 2.09 kg/m³ of storage.

4.1.6.2 Characteristics

Table 1.31 Characteristics of milk tanks.

| Average Lifetime (years) | Annual Emissions (%) | Recovery Efficiency (%) | Charge Emitted before Servicing (%) |
|---------------------------------|-----------------------------|--------------------------------|--|
| 15 | 5 | 50 | 30 |

4.1.6.3 Refrigerant type

Table 1.32 Refrigerant distribution on the market.

| <i>Year</i> | <i>% of R-12 in Market</i> | <i>% of R-404A in Market</i> | <i>% of R-22 in Market</i> |
|-------------|----------------------------|------------------------------|----------------------------|
| 1990 | 20 | 0 | 80 |
| 1991 | 10 | 0 | 90 |
| 1992 | 0 | 0 | 100 |
| 1993 | 0 | 0 | 100 |
| 1994 | 0 | 0 | 100 |
| 1995 | 0 | 0 | 100 |
| 1996 | 0 | 0 | 100 |
| 1997 | 0 | 0 | 100 |
| 1998 | 0 | 0 | 100 |
| 1999 | 0 | 10 | 90 |
| 2000 | 0 | 20 | 80 |
| 2001 | 0 | 20 | 80 |
| 2002 | 0 | 20 | 80 |
| 2003 | 0 | 20 | 80 |
| 2004 | 0 | 20 | 80 |

4.2 Industrial process cooling

4.2.1 Data sources and detailed calculations

Refrigerating needs in industrial processes other than food processing are multiple. They cover a broad range of temperatures. Two types or categories of refrigerating equipment have been defined and analyzed.

Chillers operating at temperature above 0°C. A large amount of this equipment is bought “from the shelf”, and one only needs to define the capacity and the level of temperature. These chillers cover 55% of the refrigerating capacity needs.

Refrigerating systems particularly designed for low-temperature applications, where the process specifications are well taken into account.

In order to avoid double counting, chillers are not taken into account in this section because available data for the chiller production and the chiller demand normally merge all different chillers types, i.e., the ones for comfort cooling and the ones for industrial processes (see Section 3.2.1).

In this section only the low-temperature refrigerating systems installed in the chemical industry are considered for the following reasons:

- it is a more significant domain (except food) for low-temperature applications,
- the important industrial domains such as tire manufacturing, electronics, etc. use chillers only to cover their space cooling needs.

A thorough analysis of the installed base of a chemical company (under confidentiality agreement) has enabled the development of a typical scheme of an industrial production site. Based on this study, the low-temperature cooling capacity has been projected to all other

chemical manufacturers, in order to obtain a first estimate. Characteristics are presented in Table 1.33:

Table 1.33 Refrigerant charge and cooling capacity for a chemical plant.

| | <i>Medium temperature</i> | <i>Low temperature</i> |
|---------------------------|---------------------------|------------------------|
| <i>Cooling capacity</i> | 55% | 45% |
| <i>Ratio (kg/kW)</i> | 2.3 | 5.5 |
| <i>Refrigerant charge</i> | 40% | 60% |

Even if many installations may have a lifetime longer than 30 years - taking into account the big overhauls -, the lifetime of equipment is considered to be 15 years, i.e., the time before a significant maintenance takes place.

Table 1.34 Other characteristics of typical refrigerating systems installed in chemical plants.

| <i>Life (years)</i> <i>Before remodeling</i> | <i>Annual Emissions</i> <i>(%)</i> | <i>Recovery Efficiency</i> <i>(%)</i> | <i>Charge Emitted before Servicing</i> <i>(%)</i> |
|---|---------------------------------------|--|--|
| 15 | 10 | 50 | 30 |

Based on available information collected from the websites of the main chemical companies, operating globally, the French inventory for chemical industries has been developed. The Californian inventory for this sector was then derived from the French one by applying GDP ratios.

Table 1.35 describes the evolution of refrigerants in use for the new refrigerating systems installed in the chemical industry.

Table 1.35 Refrigerant distribution in industrial processes.

| <i>Year</i> | <i>% of R-404A</i> | <i>% of R-11</i> | <i>% of R-12</i> | <i>% of R-22</i> | <i>% of R-717</i> |
|-------------|--------------------|------------------|------------------|------------------|-------------------|
| 1990 | 0 | 4 | 34 | 60 | 2 |
| 1991 | 0 | 4 | 34 | 60 | 2 |
| 1992 | 0 | 4 | 34 | 60 | 2 |
| 1993 | 0 | 3 | 34 | 61 | 2 |
| 1994 | 0 | 1 | 25 | 72 | 2 |
| 1995 | 0 | 0 | 0 | 98 | 2 |
| 1996 | 0 | 0 | 0 | 98 | 2 |
| 1997 | 0 | 0 | 0 | 98 | 2 |
| 1998 | 0 | 0 | 0 | 98 | 2 |
| 1999 | 0 | 0 | 0 | 98 | 2 |
| 2000 | 0 | 0 | 0 | 95 | 5 |
| 2001 | 0 | 0 | 0 | 95 | 5 |
| 2002 | 5 | 0 | 0 | 90 | 5 |
| 2003 | 10 | 0 | 0 | 85 | 5 |
| 2004 | 10 | 0 | 0 | 85 | 5 |

4.3 Results of calculations: refrigerant banks, and emissions

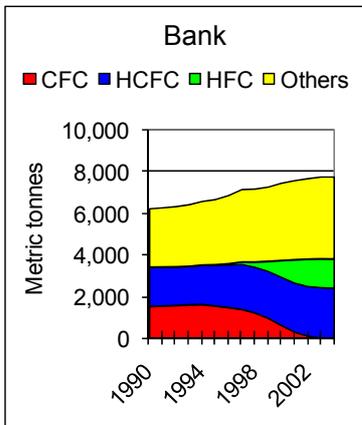


Figure 1.84 Refrigerant bank in industry.

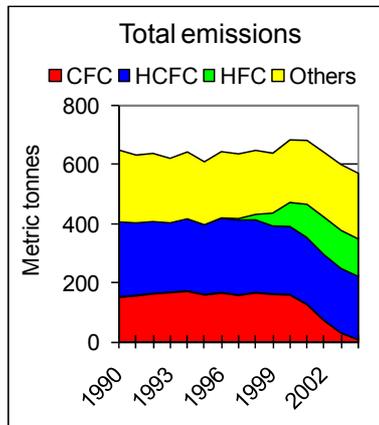


Figure 1.85 Refrigerant emissions in industry.

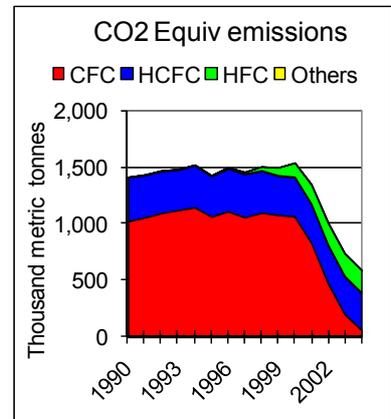


Figure 1.86 CO₂ equivalent emissions in industry.

Ammonia is widely used in industrial refrigeration. The bank of ammonia approaches 4,000 metric tonnes in 2004 (shown in Figure 1.84 as "Others"). Emissions of HCFC totals near 250 metric tonnes in 2004. The phase-out of CFCs, when started in 1996 with the retrofit of existing systems, continues to have a high impact on reducing CO₂ equivalent emissions.

5 Overall refrigerant bank and emissions

The mobile air-conditioning sector as well as the refrigerated transport sector, out of the scope of the present report, have been established nevertheless in order to have an overall picture of refrigerant inventories in California. Moreover, the inventories have also been done at the U.S. level in order to compare refrigerant demands per refrigerant as derived from this work and the refrigerant sales per refrigerant as possibly known by refrigerant manufacturers. No data have been declared so far by those manufacturers.

5.1 Refrigerant bank

The refrigerant bank is presented here by refrigerant types. The type "others" is ammonia mainly used in the food industry.

- Figure 1.87 shows the evolution of the refrigerant bank per type of refrigerants. It is clearly seen that the refrigerant bank follows the same growth as the population and GDP shown in Figure 1.1 and Figure 1.2.
- In 2004, the refrigerant bank in California is estimated at 116,000 metric tonnes and it was about 65,000 tonnes in 1990.
- CFCs are not in wide use anymore, with insignificant contribution in 2004, but R-22 and HFCs have been continuously used since 1995.
- The dominant refrigerant in the overall bank is R-22 that constitutes 57% of the bank.

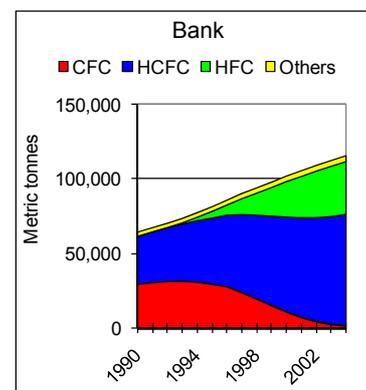


Figure 1.87 California refrigerant bank per refrigerant types

When analyzing the repartition of refrigerants in the different sectors, stationary air conditioning constitutes clearly the dominant sector with nearly 55,000 metric tonnes and so 47% of the total bank of refrigerants. Within this sector, rooftops constitute the dominant part of air-to-air systems.

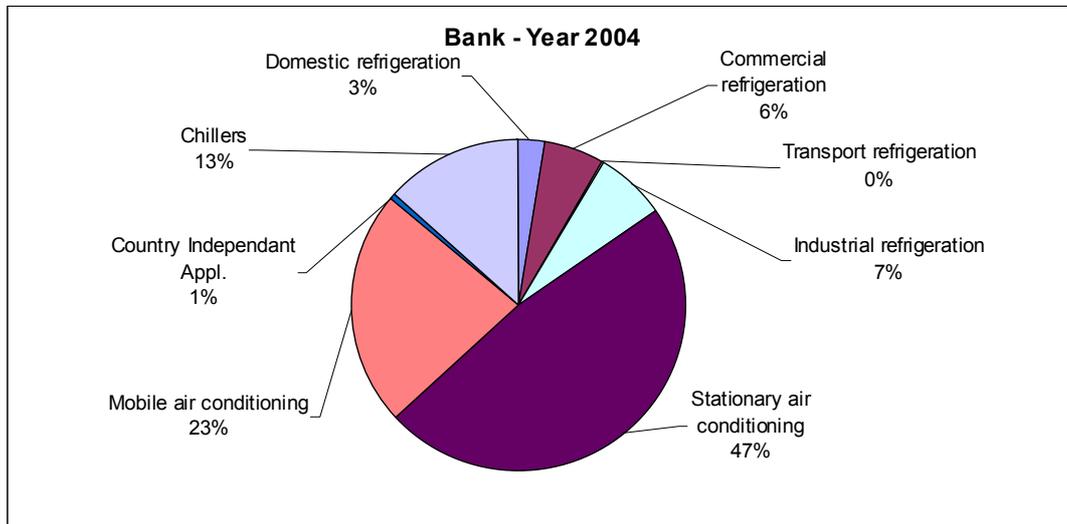


Figure 1.88 Structure of the refrigerant bank per sectors.

Note: the “country independent application” corresponds to refrigerated containers coming in California and are serviced. However, international refrigerated containers are difficult to attribute to countries.

5.2 Refrigerant emissions

Refrigerant emissions are defined for each sector and more precisely for each type of equipment as presented in Section 2 of the “Part1 - Refrigerant inventory and emissions for stationary systems” and in Annex 2.

- From 1990 to 1997 CFCs represent 50% of the emissions, and the other 50% being mainly HCFCs.
- From 2000, the emissions are decreasing based on the assumption of recovery at end of life (see section 9.3.4) and to the fact that new equipment requires less servicing during the first years of use. A mature servicing market with new refrigerant requires at least 15 years of operation.
- The replacement of CFCs and of some HCFCs by HFCs and a better initial containment explain the decreasing trend.

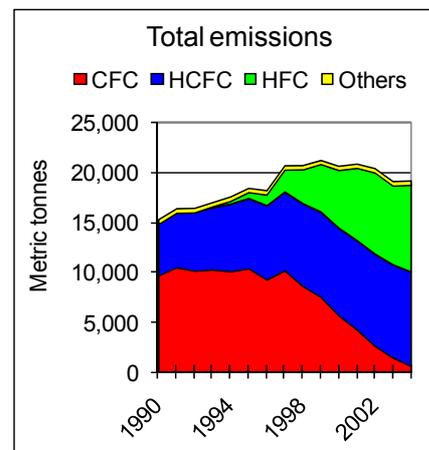


Figure 1.89 Refrigerant emissions per refrigerant type

Figure 1.90 Refrigerant emissions per application sectors shows the impact of different emission factors depending on the application sector: mobile AC that represents 23% of the bank contributes to 45% of the overall emissions. This sector has been more emissive, thanks to the use of small cans for servicing and of emissive components as the shaft seal of the open type compressor.

On the contrary Stationary AC systems whose emission factors are lower, represent 47% of the overall bank, and only 29% of the overall emissions. The main progresses have to be made for the recovery at end of life, even if lessons learnt from the field are necessary to understand what are the components to be improved in term of leak tightness.

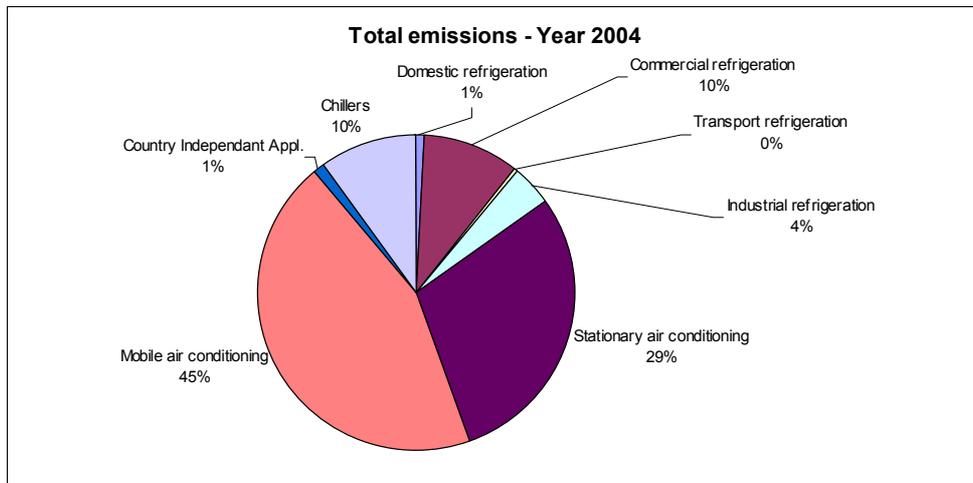


Figure 1.90 Refrigerant emissions per application sectors.

5.3 CO₂ Equivalent emissions

When looking at Figure 1.91, the paramount factor is the change from CFCs having high GWPs and specially R-12 (8,100) to HFCs mainly R-134a (1,300) resulting in a dramatic decrease of Equivalent CO₂ emissions. It is obvious that the absence of accounting of CFCs and HCFCs in the climate convention is not physically justified.

- Until 2002, the CO₂ equivalent emissions are dominated by R-12 with its high GWP and it is mainly associated with mobile air conditioning systems, domestic refrigeration and small commercial equipment.
- Note: a systematic and efficient recovery policy at end of life of equipment could have limited a very significant effect on climate change.
- In 1997, emissions reach a maximum at nearly 92 million metric tonnes CO₂ equivalent.
- In 2004, emissions drop down to 31 million metric tonnes CO₂ equivalent.

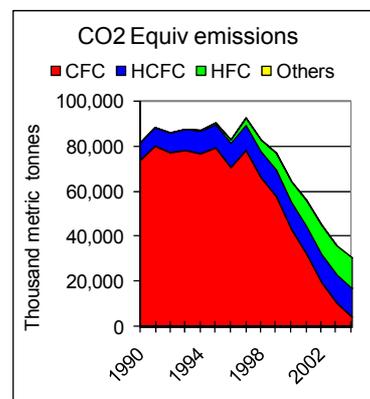


Figure 1.91 Refrigerant emissions expressed in CO₂ equivalent.

- The mobile air conditioning (MAC) sector is the first domain with 47% of CO₂ equivalent emissions in 2004, then comes stationary AC with 27% of global emissions.
- Commercial refrigeration is 6% of the refrigerant bank, but 11% of CO₂ equivalent emissions. It has to be noted that if R-404A (GWP = 3,260) is going to replace systematically R-22 (GWP = 1,500) the increase in CO₂ equivalent will be twice the one of R-22 in the next 10 years.

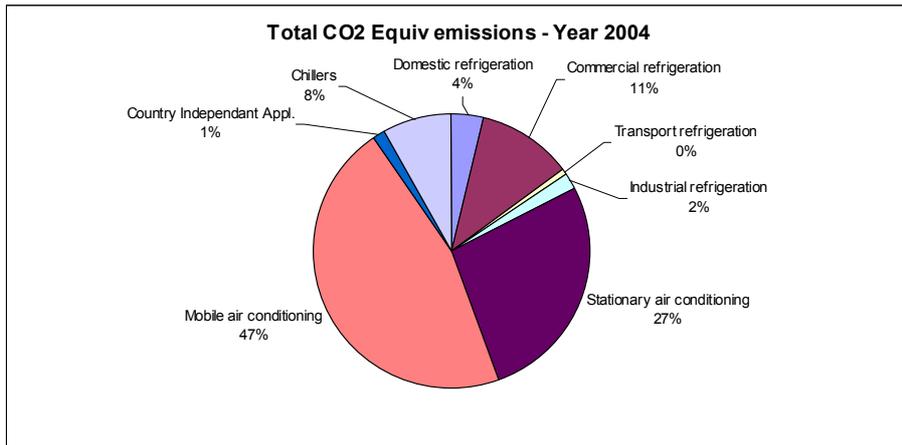


Figure 1.92 Refrigerant emissions per sectors and expressed in CO₂ equivalent.

When comparing Figure 1.90 and figure 1.92, due to the nearly nil contribution of CFCs in 2004 in the refrigerant emissions, the repartition of emissions expressed in CO₂ equivalent is not that different compared to the emissions expressed in refrigerant tonnes.

5.4 Refrigerant recovery

Figure 1.93 presents the recovered quantities from refrigeration systems at end of life, based on the assumptions taken in this report. Refrigerant distributors have provided no data.

- Refrigerant recovery is considered to be effective since 1996, with phase out of CFCs.
- Refrigerant recovery is estimated to be around 2,300 metric tonnes in California in 2004.
- These quantities include refrigerant recovered and recycled on site and refrigerant recovered and regenerated at the manufacturer plant. It is acknowledged that the need of CFCs and HCFCs have been and are motivations to recover for reuse and keep the old refrigerating systems in operation with the refrigerants no longer available on the market.

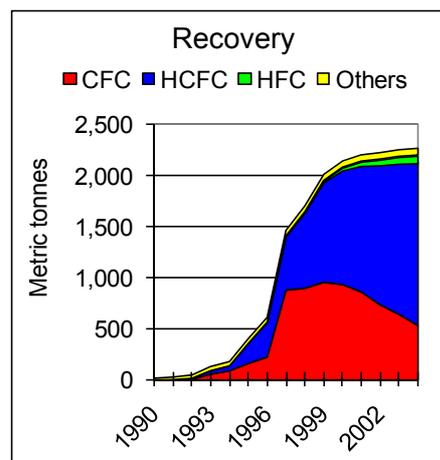


Figure 1.93 Recovery per refrigerant type.

Part 2 – ENERGY CONSUMPTION OF THE COMMERCIAL REFRIGERATION SECTOR IN CALIFORNIA

1 Description of commercial refrigeration and stores

1.1 Store categories using refrigeration equipment

Commercial refrigeration equipment is used in different types of stores, for cooled beverage delivery, and food preservation at medium or low temperature. Refrigerating equipment numbers and technologies differ significantly with store types.

Each type or category of store is characterized by a typical structure defined by the average sales surface area, the number of refrigeration equipment, and the length of refrigerated cases. Global numbers are established based on Californian statistical data or ratios taken from overall USA numbers.

In order to define a typical store layout, a field study has been carried out in the state of California over a large number of stores, brands, and sale products. Based on the field survey and technical literature analyses, sixteen categories of stores using refrigerating equipment are identified. A total number of 122 stores have been visited during the survey. Table 2.1 presents these categories as well as well the corresponding visited number. Complete list with brand name is reported in Annex 1.

Table 2.1 Store categories based on field survey

| <i>Type</i> | <i>Number of stores visited and described</i> |
|------------------------------------|---|
| <i>Grocery supermarkets</i> | 54 |
| <i>Minimarkets</i> | 3 |
| <i>Pharmacies</i> | 10 |
| <i>Convenient stores</i> | 12 |
| <i>Liquor stores</i> | 5 |
| <i>Butcheries, Pork-butcheries</i> | 4 |
| <i>Fishmonger stores</i> | 2 |
| <i>Bakeries and Pastries</i> | 1 |
| <i>Small size Gas Stations</i> | 14 |
| <i>Large size Gas Stations</i> | 4 |
| <i>Hotels</i> | 8 |
| <i>Motels</i> | 5 |
| <i>Bars and Restaurants</i> | 1 |
| <i>Carbonated Soda Fountains</i> | - |
| <i>Vending machines</i> | - |
| <i>Total</i> | 122 |

Note: Carbonated soda fountains and vending machines are refrigerating equipment studied independently. They are used in many different stores.

1.1.1 Grocery stores or grocery supermarkets

This category gathers two subcategories: grocery stores established primarily for the retailing of food, and large supermarkets that store products other than food, such as clothing or household items. However, since they present the same sales area dedicated to food retailing, these two families are merged in one category referred to as grocery supermarkets. A total number of 54 groceries have been visited. Main brands are Albertsons, Ralphs, Wholefood, Safeway, Walmart, Target, and Costco Wholesale. Those stores present an average sales area of 4,400 m².

1.1.2 Minimarkets

The mainly visited brands are Smart & Final, Foods co. The sales area varies between 300 m² and 1,000 m².

1.1.3 Convenience stores

A convenience store is a small store or shop often located along busy roads. The main visited brands are seven/eleven and AM/PM stores, as well as local stores. An average sales area of 150 m² resulted from survey data processing (visited convenience stores presented sales area varying between 100 and 300 m²).

1.1.4 Liquor stores

A liquor store is the American and Canadian name for a type of convenience stores, which specializes in the sale of alcoholic beverages in the countries where its consumption is regulated. This category presents an average sales area identical to a convenience store. However, a category is dedicated to liquor stores because survey data processing demonstrated that installed refrigeration equipment and systems differ from those found in usual convenience stores.

1.1.5 Pharmacies

The pharmacy is a retail shop where medicine and other articles are sold. The main visited brands are: Walgreens, CVS pharmacy, and Rite aid. The sales area varies from 600 m² to 1,000 m². An average sales area of 800 m² is therefore chosen for this category.

1.1.6 Gas stations

A filling station, fueling station, gas station, service station or petrol station is a facility that sells fuel and lubricants for motor vehicles. Most of the visited gas stations had convenience stores selling food and beverages of different sizes. Therefore, two categories are dedicated to gas stations according to the store size and heat load. A first category includes small gas stations, and another one includes mid-size gas stations and gas stations related to commercial centers (for example, Walmart Gas station). The principal brands present in the survey are: 76, Chevron, Mobil, Exxon, and Arco.

1.1.7 Hotels

Hotels of different sizes have been visited during the survey, starting from 1-story to 12-story hotels. The principal brands visited are Best Western, Hilton, Marriott, Crowne Plaza, and

Holiday Inn. In order to cover the wide range of hotels, a typical hotel lay-out is defined in terms of room numbers. The typical room number is estimated based on the US Census numbers for hotels and hotel rooms and is found equal to 100 rooms. For a hotel description, the kitchen description is also taken into account.

1.1.8 Motels

The data processing concerning motels is identical to that presented in the hotel section. It is not appropriate to merge these two categories mainly because of significant differences in their kitchen refrigeration features. The visited motel chains are: America's Best Value Inn, Super Motel, and Comfort Inn Sunset.

1.1.9 Bars and restaurants

Bars and restaurants have refrigerating equipment for food conservation and beverage cooling. During the survey, it was not easy to access this equipment for a technical description. The layout of the hotel, which has a restaurant and a bar, is quite similar in terms of refrigeration equipment, except for the ice dispenser at each floor.

1.1.10 Bakeries

Bakeries primarily produce bread and related products, which are then transported to numerous selling points throughout a region. They normally sell beverages and snacks. An average sales area of 125 m² is estimated based on survey data processing.

1.1.11 Butcheries

Butcheries are stores dedicated to prepare meats and other related goods for sale. Several butcheries have been visited (El Cochinito Meat Market, Economy Meat, Veronica Meat Market, Meat Market Carniceria Latina). This category presented an average area of approximately 125 m².

1.1.12 Fishmonger Stores

A fishmonger store sells fish and seafood. This category presents an average area identical to butcheries.

1.1.13 Vending machines

After the data processing, it was more appropriate to group the vending machines in one category to avoid double counting.

1.1.14 Carbonated Soda Fountains (CSD Fountains)

Data related to CSD fountains have been processed identically to vending machines data, and a category is dedicated to group them.

1.2 Identification of refrigeration systems

1.2.1 Refrigeration systems

Three main technologies of refrigeration systems are used in stores: stand-alone equipment, condensing units, and centralized systems [LIT96].

Stand-alone or plug-in equipment is a display case where the refrigeration system is integrated into the cabinet and the condenser heat is rejected to the sales area of the supermarket. The purpose of plug-in equipment is to display ice cream or cold beverages such as beer or soft drinks.

Condensing units are small-size refrigeration equipment with one or two compressors and a condenser installed on the roof or in a small machine room. Condensing units provide refrigeration to a small group of cabinets installed in convenience stores and small supermarkets.

Centralized systems consist of a central refrigeration unit located in a machine room. There are two types of centralized systems: direct and indirect systems. In a direct system (DX), racks of compressors in the machine room are connected to the evaporators in the display cases and to the condensers on the roof by long pipes. In an indirect system, the central refrigeration unit cools a heat transfer fluid (HTF) that circulates from the evaporator in the machinery room and the display cases in the sales area.

Centralized direct systems are the dominant technology in the US and globally for supermarkets.

1.2.2 Refrigerated cabinets and rooms

Refrigerating equipment is sorted under 3 cabinet technologies: stand-alone equipment or self contained system (SA), display cases (DC) and walk-in coolers (WI).

Display cases and walk-in cabinets can be connected either to centralized system or to condensing unit depending on the equipment size and on the store category, whereas stand-alone equipment are by definition self-contained refrigerating systems.

For each cabinet technology, different types or designs have been identified based on the survey feedback. Technical characteristics and thermal equations have been issued for each type.

1.3 Survey of current refrigeration cases

A survey of 115 stores has been performed from June to November 2007 in order to collect data on existing store structures and types of refrigeration systems and cabinets. The results of this survey provided an abundance of information and allowed estimates to be made of current electricity consumption for the operation of refrigeration cabinets either as direct consumption by the cabinets (lighting, fans, anti-sweat heaters, defrosting) or by refrigeration compressors and condenser fans in order to provide refrigeration to these cabinets. The survey was performed for both remotely operated cases (DC and WI) and self-contained refrigerated equipment (SA).

1.3.1 Survey contents and data collection

Display cases (DC) and stand-alone equipment (SA) include low temperature single-deck, low temperature multi-deck, low and medium temperature glass door, medium temperature single-deck, medium temperature multi-deck, service cases, and specialty cases. Specifications include the make and model, case length, blown air temperature, saturated suction temperature, and all are included in the database.

The product display has been divided into the following categories: dairy, deli, meat product, beverage, bakery, frozen food, and ice cream. In many instances, a cabinet can be used for several of these products. Where the product displayed affects the operating temperatures or heat loads, a separate entry (in the data base) for the case is provided for each product. If the specified temperatures and heat loads are identical for multiple products, the products are noted in the description.

Survey data have been collected and grouped as a function of the refrigeration cabinet type. Hence, surveys are presented separately for display cases, stand-alone equipment, walk-in and storage rooms.

During the survey, store data have been recorded and included store's brand name, location and average sales area. For the presently manufactured refrigeration equipment, the following information was also collected:

- Brand name of the equipment manufacturer
- Equipment model number: ex: for a TRUE equipment, GDM-35
- Temperature level (medium, low)
- Equipment position: horizontal, vertical, semi-vertical
- Open or closed type equipment
- For closed type, the number of doors is recorded whereas for open type, the total length of the equipment is estimated.
- Equipment capacity and dimensions: capacity in cf or liters, height, width and length.
- Refrigerant type and charge.
- Product type (dairy, deli, bakery, salads, floral, meat, drinks, ice cream...).

The purpose of remote or self-contained refrigerated display cases in a store is to provide temporary storage for perishable foods prior to sale. Most of the design characteristics and general shape and layout of display cases are based on marketing specifications and constraints. The configuration of display cases falls into essentially four different categories.

- **Tub:** The tub case is often used for the storage and display of frozen foods and meats. Tub cases operate at a very uniform temperature and require the lower refrigeration capacity per foot of any display case type. The primary disadvantage of the tub is a low product storage volume per square foot of sales area.
- **Open-front multi-deck:** This case type possesses the largest storage volume per square foot of floor area, because of the use of an upright cabinet and shelves. Refrigeration capacity required for multi-deck cases is very high, including a large latent load portion due to the entrainment of ambient air in the air curtain passing over the opening of the case.
- **Glass door reach-in:** The reach-in case has glass doors over the opening of the case; these must be opened for product removal and stock. Reach-in cases are used in supermarkets primarily for frozen foods, because of their ability to contain the cold refrigerated air, which reduces the "cold aisle" problem.

- **Single-deck or service:** Open single-deck cases are commonly used for display of fresh meat products. The service display case is a single-deck case equipped with sliding doors in the back for access by serving people and a glass front to show product to customers. Cases of this type are commonly seen in the deli and meat departments of supermarkets.

Display cases have been developed and refined for specific merchandising applications, and cases of each type listed above exist specifically for the storage and display of specific food types.

To define a refrigeration equipment baseline, survey data have been processed based on technical data of leading refrigeration cabinet manufacturers in the United States. Data processing showed capacities and dimensions found in the stores that could be different from data gathered on websites of equipment manufacturers. To take into account these differences, interpolations have been made on the refrigeration capacity as well as the input power.

When an equipment description is identical to a model listed in the Table (except for its manufacturer), input power and refrigerant data are directly applied to the studied equipment.

1.3.2 Stand-alone equipment

One objective of the survey is to define baseline stand-alone equipment models depending on description parameters stated above. Leading manufacturers of stand-alone equipments are: True Manufacturing, Beverage Air, and Hussmann Corporation. The stand-alone cases listed have been categorized into 23 models presented in Table 2.2, each model having a number starting from 1 to 23.

1.3.3 Display cases

Leading refrigeration equipment manufacturers of display cases are: Hussmann Corporation, Hill Phoenix, Tyler Refrigeration Corporation, and Kysor Warren. Fourteen baseline display cases are defined in Table 2.3, each model having a number starting from 1 to 14.

1.3.4 Walk-ins

Selections include storage walk-ins, walk-in boxes with glass doors (e.g., dairy, beverage and floral boxes), preparation areas that may be fully enclosed or have one side open to the sales area, and other perimeter zones that are air conditioned from the refrigeration system (e.g., bakery prep areas, pharmacy, etc.). Specifications include the make and model (for components in the library), size, temperature, location, reach-in doors, walk-in doors, heat load, lighting, evaporator coils, defrost type and control, fans, and internal loads. For walk-in (WI), 5 baseline categories are found and listed in Table 2.5.

Table 2.2 Baseline stand-alone equipments list.

| ID | Brand Name | Model | T° Level | Open/ Closed | Position | Number of doors | Capacity (liters) | Length (m) | Height (m) | Width (m) | Product type | Refrigerant | Refrigerant charge (g) | Cooling capacity (HP) | Product Temp (°C) | DTEvap |
|-------|------------|----------|----------|--------------|------------|-----------------|-------------------|------------|------------|-----------|-----------------------------|-------------|------------------------|-----------------------|-------------------|--------|
| SA_01 | (TRUE) | GDM-7 | Medium | closed | Vertical | 1 | 200 | 0.8 | 1 | 0.6 | drinks, salads, deli, dairy | R-134a | 300 | 0.2 | 2 | 9 |
| SA_02 | (TRUE) | GDM-10 | Medium | closed | Vertical | 1 | 300 | 0.8 | 1.4 | 0.65 | drinks, salads, deli, dairy | R-134a | 300 | 0.2 | 2 | 9 |
| SA_03 | (TRUE) | GDM-23 | Medium | closed | Vertical | 1 | 600 | 0.8 | 2 | 0.7 | drinks, salads, deli, dairy | R-134a | 300 | 0.33 | 2 | 9 |
| SA_04 | (TRUE) | GDM-35 | Medium | closed | Vertical | 2 | 1000 | 1.6 | 2 | 1 | drinks, salads, deli, dairy | R-134a | 300 | 0.5 | 2 | 9 |
| SA_05 | (TRUE) | GDM-72 | Medium | closed | Vertical | 3 | 2000 | 2.4 | 2 | 2 | drinks, salads, deli, dairy | R-134a | 550 | 0.5 | 2 | 9 |
| SA_06 | (TRUE) | TCGR-50 | Medium | closed | S-Vertical | 2 | 800 | 1.6 | 1.2 | 1.3 | salads, deli, bakery | R-134a | 300 | 0.5 | 2 | 9 |
| SA_07 | Hussman | SHM | Medium | open | S-Vertical | 0 | | 1.8 | 1.3 | 0.9 | drinks, salads, deli, dairy | R-134a | 800 | 0.5 | 2 | 9 |
| SA_08 | (TRUE) | TAC-48 | Medium | open | Vertical | 0 | 1000 | 1.22 | 2 | 1.2 | drinks, salads, deli, dairy | R-404A | 1000 | 1 | 2 | 9 |
| SA_09 | Hussman | DDS8 | Medium | open | Vertical | 0 | | 2.4 | 2.5 | 2.1 | drinks, salads, deli, dairy | R-22 | 1400 | | 2 | 9 |
| SA_10 | (TRUE) | THF-41FL | Low | closed | Horizontal | 2 | 300 | 1.6 | 1 | 0.8 | frozen | R-134a | 1200 | 0.75 | -18 | 11 |
| SA_11 | (TRUE) | GDM-23F | Low | closed | Vertical | 1 | 600 | 0.8 | 2 | 0.7 | frozen | R-404A | 600 | 0.75 | -18 | 11 |
| SA_12 | (TRUE) | GDM-35F | Low | closed | Vertical | 2 | 1000 | 1.6 | 2 | 1 | frozen | R-404A | 1000 | 1 | -18 | 11 |
| SA_13 | (TRUE) | GDM-72F | Low | closed | Vertical | 3 | 2000 | 2.4 | 2 | 2 | frozen | R-404A | 2500 | 1.5 | -18 | 11 |
| SA_14 | Bev_Air | FC-45 | Medium | closed | Vertical | 2 | 1200 | 1.6 | 2 | 0.7 | Floral | R-134a | 600 | 0.33 | 2 | 9 |
| SA_15 | Hussman | ISMG | Medium | open | Horizontal | 0 | | 1.7 | 1 | 1 | deli, dairy | R-22 | 2300 | | 2 | 9 |
| SA_16 | Hussman | ISFGG | Low | open | Horizontal | 0 | | 1.7 | 1 | 1 | frozen | R-22 | 2300 | | -18 | 11 |
| SA_17 | (TRUE) | GDM41/45 | Medium | closed | Vertical | 2 | 1200 | 1.6 | 2 | 0.75 | drinks, salads, deli, dairy | R-134a | 500 | 0.5 | 2 | 9 |
| SA_18 | (TRUE) | GDM 12 | Medium | closed | Vertical | 1 | 340 | 0.8 | 1.6 | 0.7 | drinks, salads, deli, dairy | R-134a | 250 | 0.2 | 2 | 9 |
| SA_19 | Bev_Air | MT12 | Medium | closed | Vertical | 1 | 400 | 0.8 | 1.6 | 0.61 | boissons | R-134a | 300 | 0.2 | 2 | 9 |
| SA_20 | Bev_Air | UR30 | Medium | closed | Vertical | 1 | 700 | 0.8 | 0.9 | 0.7 | boissons | R-134a | 200 | 0.2 | 2 | 9 |
| SA_21 | LEER | Model 45 | Low | closed | Vertical | 2 | 1200 | 1.6 | 2 | 1.2 | Ice maker | R-134a | 300 | 0.33 | -25 | 9 |
| SA_22 | Bev_Air | DD68 | Medium | closed | Horizontal | 2 | 800 | 1.6 | 1 | 0.7 | Beer | R-134a | 300 | 0.33 | 2 | 9 |
| SA_23 | (TRUE) | GSM | Medium | closed | Vertical | 1 | 700 | 0.8 | 2 | 0.8 | Tour Patisier | R-134a | 300 | 0.5 | 2 | 9 |

Table 2.3 Baseline display cases list.

| ID | Brand Name | Model | T° Level | Open/ Closed | Position | Number of doors | Length (m) | Height (m) | Width (m) | Cooling Capacity (W/m) | Refrigerant charge (kg/m) | Product type | Product Temp (°C) | DTEvap |
|-------|------------|----------|----------|--------------|------------|-----------------|-----------------|------------|-----------|------------------------|---------------------------|-----------------------------|-------------------|--------|
| DC-01 | TYLER | N6D | Medium | open | Vertical | | 1.2;1.8;2.4;3.6 | | 2 | 1 | 1222 | Dairy, deli, produce, juice | 4 | 13 |
| DC-02 | HUSSMAN | RM | Medium | closed | Vertical | 1;2;3 | 0.8 | | 2.12 | 1.11 | 312 | Dairy, deli, beverages | 2 | 11 |
| DC-03 | HUSSMAN | E2 | Medium | open | S-Vertical | | 1.2;1.8;2.4;3.6 | | 1.24 | 1.2 | 909 | Deli, pizza, floral, juice | 4 | 13 |
| DC-04 | HUSSMAN | SMGV | Medium | closed | S-Vertical | | 1.2;1.8;2.4;3.6 | | 1.32 | 1.1 | 202 | Meat, delicatessen | 2 | 11 |
| DC-05 | TYLER | NM/NMG | Medium | open | Horizontal | | 1.8;2.4;3.6 | 0.96 | | 1 | 416 | Meat, deli, Produce | 2 | 11 |
| DC-06 | HUSSMAN | F6L | Low | open | Vertical | | 1.2;1.8;2.4;3.6 | 2 | | 1.2 | 1688 | | -18 | 13 |
| DC-07 | HUSSMAN | RLN | Low | closed | Vertical | 2;3;4;5 | 0.8 | | 2.12 | 2 | 484 | Frozen | -18 | 13 |
| DC-08 | TYLER | NFNG | Low | closed | Horizontal | | 2.4;3.6 | 0.9 | | 1 | 352 | Frozen | -18 | 13 |
| DC-09 | TYLER | NPW | Medium | open | Horizontal | | 2.4;3.6 | 0.8 | | 1.8 | 747 | Produce | 5 | 14 |
| DC-10 | HUSSMAN | P2X | Medium | open | Vertical | | 1.2;1.8;2.4;3.6 | | 1.9 | 1 | 875 | Fruits, produce | 5 | 14 |
| DC-11 | HUSSMAN | F2XLG | Low | open | S-Vertical | | 1.2;1.8;2.4;3.6 | 1.4 | | 1.2 | 1972 | Frozen meat, seafood | -18 | 13 |
| DC-12 | HUSSMAN | DSFM | Medium | closed | S-Vertical | | 1.2;3.4; | 1.2 | | 1.06 | 481 | Seafood | 2 | 11 |
| DC-13 | Hussman | FI | Low | open | Horizontal | | 2.4;3.6 | 0.91 | | 1.471 | 462 | Frozen | -18 | 16 |
| DC-14 | ZeroZone | RMCP30FL | Medium | closed | Vertical | 2;3;4;5 | 0.8 | | 2.1 | 0.9 | 1174 | FLORAL | 5 | 14 |

Table 2.4 Baseline walk-in cases list.

| ID | T° level | Open/ Closed | ReachIn (0)/ ColdStorage (1) | Number of doors | Length (m) | Height (m) | Width (m) | ProductDH (kJ/kg) | Product mass flow (kg/m3 24h) | Product Temp (°C) |
|-------|----------|--------------|------------------------------|-----------------|------------|------------|-----------|-------------------|-------------------------------|-------------------|
| WI-01 | Medium | Open | 0 | | 1 | 2.5 | 3 | 45 | 20 | 2 |
| WI-02 | Medium | Closed | 0 | 12 | 1 | 2.5 | 3 | 45 | 20 | 2 |
| WI-03 | Low | Closed | 0 | 12 | 1 | 2.5 | 3 | 55 | 15 | -20 |
| CR-01 | Medium | Closed | 1 | | 1 | 3.5 | 6 | 45 | 20 | 2 |
| CR-02 | Low | Closed | 1 | | 1 | 3.5 | 6 | 55 | 15 | -20 |

Once the baseline refrigeration equipment, self-contained or remote refrigerated equipment are described, it is possible to draw typical layouts for the 16 store categories defined in Section 1.1. The next section presents the grocery supermarket layout based on equipment listed in Table 2.2 to Table 2.5.

1.4 Typical grocery store lay-out

A representative grocery supermarket layout is shown in Figure 2.1. Refrigerated fixtures are located throughout the store, because of the large amount of perishable food products that are sold. These fixtures fall into 3 categories, stand-alone equipment, display cases, and walk-in storage coolers. Stand-alone equipment and display cases are located on the sales floor and are designed to refrigerate food products while providing a place to merchandise them. Walk-in coolers are used to store food products during the time period between receiving the product and placing the product out for sale.

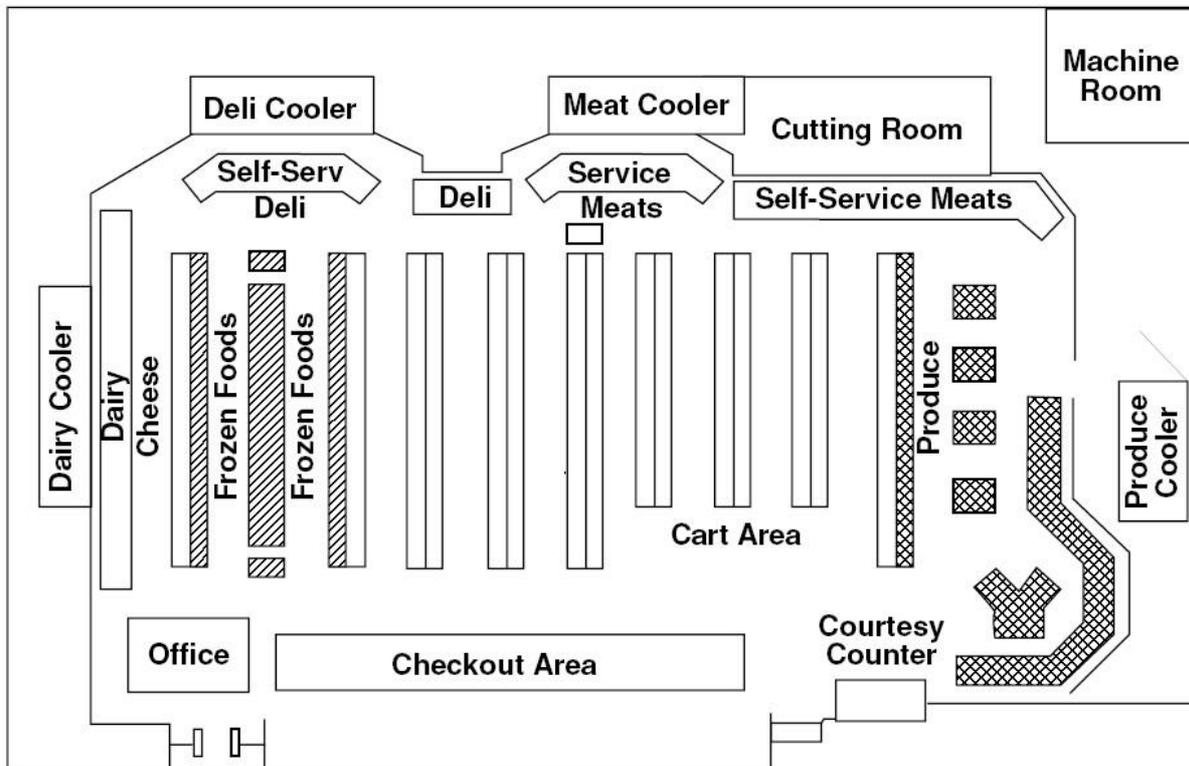


Figure 2.1 Lay out of the refrigerated fixtures in a supermarket [ORN04].

A typical arrangement of refrigerating equipment in a grocery is shown in Figure 2.1. Display cases, of a variety of configurations and products, are generally used in the sales area and are located at the periphery of the store near their associated walk-ins. The survey data processing enabled the definition of a typical grocery refrigeration configuration presented in Table 2.6, Table 2.7, and Table 2.8.

Table 2.5 Self-contained refrigerating equipments found in a grocery store.

| Stand Alone equipments | | |
|---|--------------|----------------------------|
| Description | Model | Number of equipment |
| Medium temperature self contained closed vertical case for drinks salads, deli and dairy with a capacity of 200 liters | SA-1 | 3 |
| Medium temperature self contained closed vertical case for drinks salads, deli and dairy with a capacity of 300 liters | SA-2 | 2 |
| Medium temperature self contained closed vertical case for drinks salads, deli and dairy with a capacity of 600 liters | SA-3 | 1 |
| Medium temperature self contained open vertical case for drinks salads, deli and dairy with a capacity of 1000 liters | SA-8 | 1 |
| Medium temperature self contained open vertical case for drinks salads, deli and dairy with a capacity of 2000 liters | SA-9 | 1 |
| Medium temperature self contained open horizontal case for deli and dairy with a capacity of 1500 liters | SA-15 | 1 |
| Medium temperature self contained closed vertical case for drinks salads, deli and dairy with a capacity of 1200 liters | SA-17 | 1 |
| Medium temperature self contained closed vertical case for drinks salads, deli and dairy with a capacity of 340 liters | SA-18 | 1 |
| Self contained Ice maker with a capacity of 1200 liters | SA-21 | 1 |

Table 2.6 Display cases equipments found in a grocery store.

| Display cases equipments | | |
|---|--------------|-------------------|
| Description | Model | Length (m) |
| Medium temperature Open-front multi-deck vertical display case for dairy, deli, juice and drinks | DC-1 | 75 |
| Medium temperature Glass door reach-in multi-deck vertical display case for dairy, deli, juice and drinks | DC-2 | 7 |
| Medium temperature Open-front single-deck semi-vertical display case for deli, pizza floral and juices | DC-3 | 15 |
| Medium temperature Glass door reach-in single-deck semi-vertical display case for meat and delicatessen | DC-4 | 20 |
| Medium temperature Open Tub case for meat and delicatessen | DC-5 | 10 |
| Low temperature Open-front multi-deck vertical display case for frozen products | DC-6 | 4 |
| Low temperature Glass door reach-in multi-deck vertical display case for frozen products | DC-7 | 86 |
| Medium temperature Open Tub case for produce | DC-9 | 17 |
| Medium temperature Open-front multi-deck vertical display case for produce | DC-10 | 27 |
| Medium temperature Open-front single-deck semi-vertical display case for seafood | DC-12 | 5 |
| Low temperature Open Tub case for frozen products | DC-13 | 17 |
| Medium temperature Glass door reach-in multi-deck vertical display case for floral | DC-14 | 3 |

Table 2.7 Walk-in and cold rooms found in a grocery store.

| Walk In and Storage Rooms | | |
|---|--------------|-------------------|
| Description | Model | Length (m) |
| Medium temperature Open-front multi-deck walk in for dairy, deli, juice and drinks | WI-1 | 4 |
| Medium temperature Glass door reach-in multi-deck walk in for dairy, deli, juice and drinks | WI-2 | 12 |
| Low temperature Glass door reach-in multi-deck walk in for dairy, deli, juice and drinks | WI-3 | 12 |
| Medium temperature Cold Storage room | CR-1 | 60 |
| Low temperature Cold Storage room | CR-2 | 18.5 |

1.5 Typical layout of small stores

Similarly to grocery stores, the survey data processing enabled the definition of a typical refrigeration layout for each of the 15 categories defined previously. These layouts are described in Table 2.8, Table 2.9, and Table 2.10.

Table 2.8 Self-contained refrigerating equipment distribution for different store categories.

| Stand Alone | SA-1 | SA-2 | SA-3 | SA-4 | SA-5 | SA-6 | SA-7 | SA-8 | SA-9 | SA-10 | SA-11 | SA-12 | SA-13 | SA-14 | SA-15 | SA-16 | SA-17 | SA-18 | SA-19 | SA-20 | SA-21 | SA-22 | SA-23 |
|-------------------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Grocery | 3 | 2 | 1 | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 1 | 0 | 0 | 1 | 0 | 0 |
| Large Supermarket | 2 | 2 | 0 | 3 | 0 | 0 | 0 | 0 | 0 | 2 | 1 | 0 | 0 | 2 | 0 | 1 | 1 | 0 | 0 | 0 | 2 | 0 | 0 |
| Pharmacy | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 0 | 0 |
| Convenience | 0 | 0 | 0 | 2 | 0 | 0 | 0 | 0 | 1 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 0 | 0 |
| Liquor Store | 0 | 1 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 3 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 0 | 1 | 0 | 0 |
| Minimarket | 1 | 2 | 1 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 1 | 0 | 1 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 2 | 0 |
| Small Gas Stat | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 |
| Center Gas Stat | 1 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 1 | 0 | 1 | 0 | 0 |
| Hotel | 2 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 4 | 1 |
| Motel | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 3 | 0 |
| Butchery | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fishmonger Store | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 |
| Bakery | 0 | 0 | 0 | 2 | 1 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 |
| Restaurants Bar | 2 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 |
| Vending Machine | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Soda Fountain | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 |

Table 2.9 Distribution of refrigerated display cases for different store categories.

| Display Case | DC-1 | DC-2 | DC-3 | DC-4 | DC-5 | DC-6 | DC-7 | DC-8 | DC-9 | DC-10 | DC-11 | DC-12 | DC-13 | DC-14 |
|-------------------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|
| Grocery | 75 | 7 | 15 | 20 | 10 | 4 | 86 | 0 | 17 | 27 | 0 | 5 | 17 | 3 |
| Large Supermarket | 0 | 10 | 8 | 0 | 6 | 0 | 11 | 0 | 0 | 1 | 0 | 0 | 1 | 0 |
| Pharmacy | 0 | 1 | 0 | 0 | 0 | 0 | 3 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Convenience | 1 | 0 | 0 | 2 | 0 | 0 | 1 | 0 | 0 | 3 | 0 | 0 | 0 | 0 |
| Liquor Store | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Minimarket | 4 | 0 | 0 | 0 | 0 | 0 | 3 | 0 | 0 | 2 | 0 | 0 | 2 | 0 |
| Small Gas Stat | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Center Gas Stat | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Hotel | 0 | 0 | 0 | 3 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Motel | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Butchery | 0 | 0 | 2.5 | 2.5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fishmonger Store | 0 | 0 | 5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Bakery | 0 | 0 | 0 | 5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Restaurants Bar | 0 | 0 | 0 | 3 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Vending Machine | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Soda Fountain | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Table 2.10 Distribution of walk-in and cold storage rooms for different store categories.

| Walk IN | WI-1 | WI-2 | WI-3 | CR1 | CR2 | Sales Area (m ²) |
|-------------------|------|------|------|------|-----|------------------------------|
| Grocery | 4 | 12 | 12 | 60 | 19 | 2500 |
| Large Supermarket | 0 | 6 | 9 | 27.5 | 9 | 8500 |
| Pharmacy | 3 | 8 | 4 | 0 | 0 | 800 |
| Convenience | 0 | 9 | 2 | 0 | 0 | 150 |
| Liquor Store | 0 | 14 | 0 | 0 | 0 | 153 |
| Minimarket | 0 | 14 | 21 | 27.5 | 9 | 1145 |
| Small Gas Stat | 0 | 2 | 0 | 0 | 0 | 25 |
| Center Gas Stat | 0 | 7 | 2 | 0 | 0 | 100 |
| Hotel | 0 | 0 | 0 | 6 | 3 | |
| Motel | 0 | 0 | 0 | 0 | 0 | |
| Butchery | 0 | 0 | 0 | 3 | 0 | 125 |
| Fishmonger Store | 0 | 0 | 0 | 3 | 0 | 125 |
| Bakery | 0 | 0 | 0 | 0 | 0 | 125 |
| Restaurants Bar | 0 | 0 | 0 | 6 | 3 | |
| Vending Machine | 0 | 0 | 0 | 0 | 0 | |
| Soda Fountain | 0 | 0 | 0 | 0 | 0 | |

2 Energy consumption of refrigerating systems in California

2.1 Method for energy consumption calculation

Supermarkets represent one of the largest energy-intensive building groups in the commercial sector, consuming 2 to 3 million kWh annually per store [BAX03a]. Several studies have shown that annual electricity consumption ranges from 1 to 1.5 million kWh per store for refrigeration [LIT96]. A typical electricity usage of a grocery in the U.S. shows that 39% is used for refrigeration, 23% for lighting, 11% for cooling, 4% for ventilation, 13% for heating, and 10% for miscellaneous applications (cooking, water heating, ...) as shown in Figure 2.2.

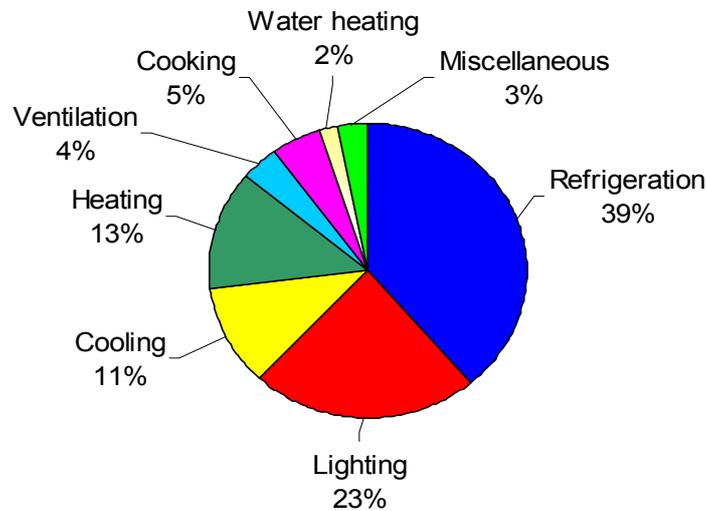


Figure 2.2 Typical electrical energy usage in a grocery store in USA [LIT96].

Recent field tests tend to confirm that this figure is still a good estimate. Data from a field test in a 50,000 ft²-store in Southern California indicate annual usage of about 1,500,000 kWh for all refrigeration including case lights, fans, heaters, etc [ORL04].


The approach for energy consumption calculation in commercial refrigeration, detailed in this report, is qualified as “bottom – up approach”. In order to simulate energy efficiency improvement of refrigeration equipment, each element in the energy consumption chain has to be considered and described in detail.

The energy consumption calculation is based on the evaluation of heat loads, hour by hour, on a given year, taking into account weather conditions (temperature and humidity) of the 8 California climatic zones.

Each type of store (16 families) has been calculated independently, when the layout of refrigeration equipment in each store has been issued.

2.1.1 Energy consumption calculation

The algorithm here below presents the method for energy consumption calculation, which is applied to each type of store.

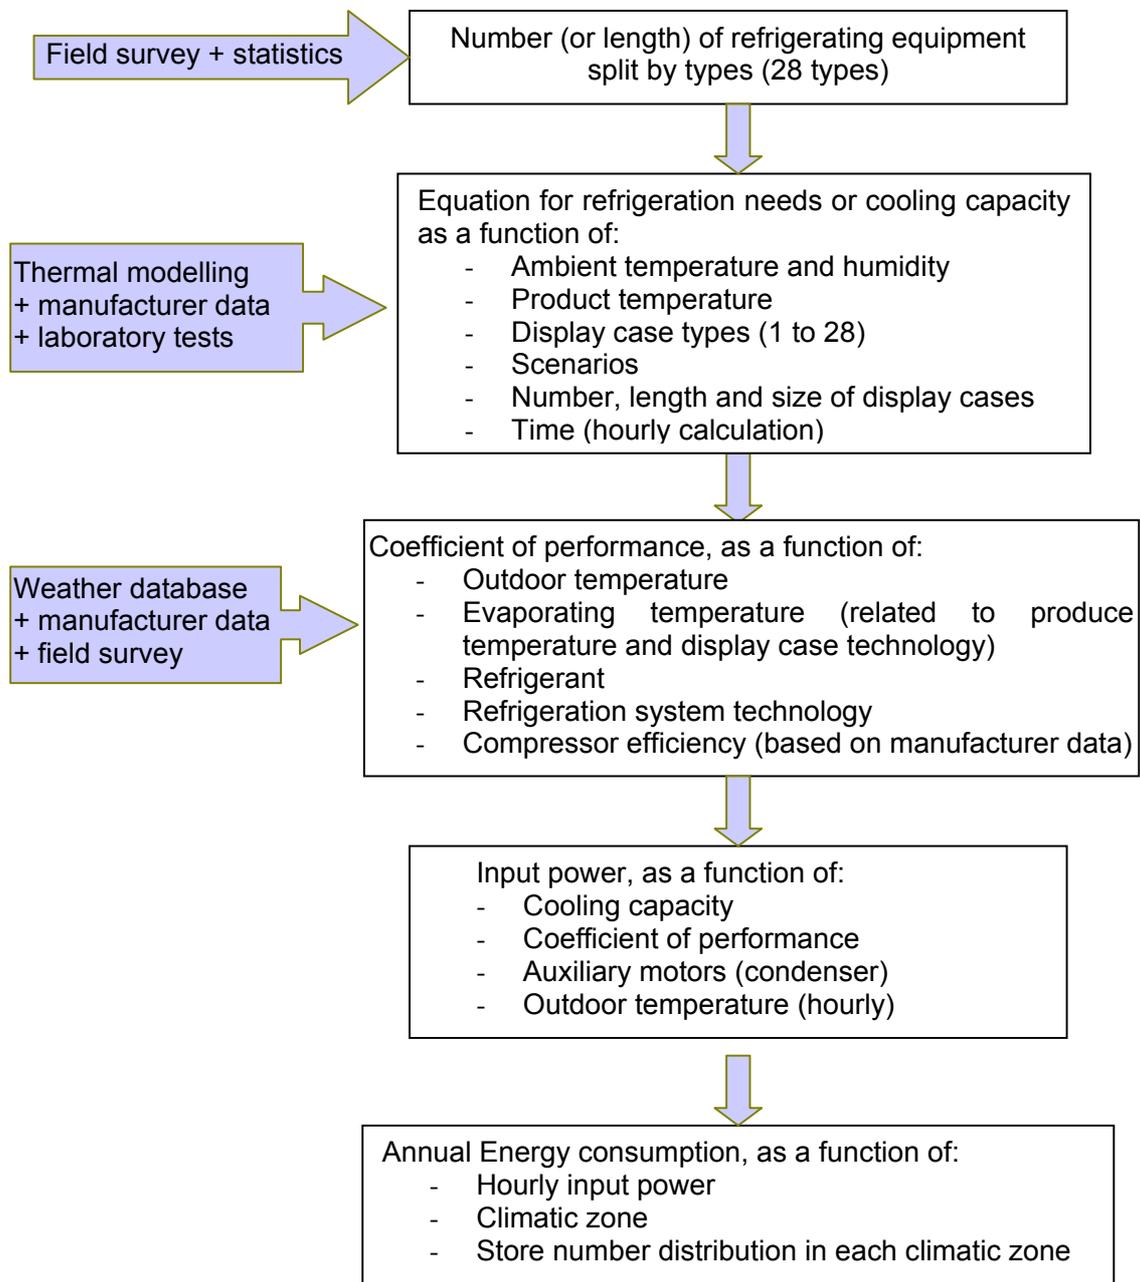

The cooling capacity of display cases is provided by a large vapor compression refrigeration system. The operating characteristics and energy requirements of the refrigeration system are directly related to the refrigeration capacity necessary to maintain the display case temperature.

There are two main temperature levels in supermarkets: medium temperature for preservation of chilled food and low temperature for frozen products. Chilled food is maintained between 1°C and 14°C, while frozen food is kept between -12°C to -18°C. The evaporation temperature, for a medium-temperature system, varies between -15°C and -5°C, and for a low-temperature system, the evaporation temperatures are in the range of -30°C to -40°C. Variations in temperature are dependent upon products, display cases and the chosen refrigeration system [LIT96].

2.1.2 Heat load, refrigeration capacity

The heat load gained by the case is the amount of heat that must be removed from the display case in order to maintain the product in the case at the desired storage temperature. The refrigeration capacity is equal or superior to the heat loads to maintain the product temperature. The refrigeration capacity of a display case is most often given at a specific blown air temperature at the outlet of the evaporator, since this value is easier to measure (and control) than the temperature of the stored product. The standard rating condition to specify the refrigeration capacity of a display case is for operation in an indoor environment with a 75°F dry-bulb temperature and a relative humidity of 55 percent. The heat loads of a refrigerated cabinet are coming from convection, conduction, radiation, and advection.

2.1.2.1 Conduction

Ambient heat that passes through the walls of the display case is intercepted by the air flowing around the perimeter of the display case.

2.1.2.2 Radiation

Thermal radiation heat transfer occurs between the interior of the display case and the surrounding ambient environment.

2.1.2.3 Convection (air entrainment)

The air curtain passing across the opening of the display case mix with and entrain part of the surrounding ambient air, which is then returned to the case evaporator. The heat load due to the entrained air consists of both sensible and latent heats. Ambient air entrainment occurs in all display case types, but represents the largest portion of the heat load for open, multi-deck cases.

2.1.2.4 Internal loads

Heat is generated by the use of electric energy in the display case for the following auxiliaries:

- Lights: fluorescent light fixtures are installed in the display cases for illumination of the product. Heat from the ballasts may also enter the case if the ballast is installed in the refrigerated portion of the case.
- Fan motors: the electric energy associated with the fans used to circulate air around the display case.
- Anti-sweat heaters: are installed in glass doors and on other surfaces that operate at a temperature below the ambient dew-point temperature. If heaters are not installed, condensation and possibly frost will form on these surfaces.

The contribution of each load source will vary according to display case type. The heat load of open multi-deck display cases is dominated by air entrainment. Internal electric loads represent a significant portion of the heat load of reach-in frozen food cases. For

single-deck and tub cases, radiation heat transfer accounts for a large fraction of the heat loads.

The impact of each of these thermal loads on the refrigeration capacity depends on the case type. For example, air infiltration is the most significant portion of heat loads for open, multi-deck cases, while radiation is the largest part of the heat load for tub-type cases. The door anti-sweat heaters represent a major share of the heat load for frozen food door reach-in cases.

- Defrosting: the conditions of air in cold storage rooms or in display cases affect the refrigerating capacity of the evaporator. At surface temperature lower than the dew point temperature of air, the water vapor contained in the humid air will condense on surfaces, and at surface temperature lower than 0°C frost will deposit on the surfaces. The frost formation that is seen on evaporator surfaces is an important factor in the operation of refrigeration systems. Without periodic removal, the frost will accumulate and eventually block the airflow passages of the evaporator, resulting in loss of cooling capacity. The usual operation for supermarket refrigeration systems is to defrost the display cases on a scheduled basis. Several different methods are employed for defrosting: off-cycle defrosting, electric defrosting.

2.1.2.5 Off-Cycle defrosting

Refrigeration to the case is shut off and the evaporator warms above the melting temperature of the frost. This method is commonly used for display cases operating at the highest blown air temperatures (34 to 37°F), because frost loading is relatively small. Off-cycle defrosting is also used where the product is not sensitive to air temperature change, such as milk and other dairy products. For frozen food or meat, off-cycle defrosting is not appropriate.

2.1.2.6 Electric defrosting

Electric heaters are installed at the inlet of the evaporator so that the circulated air can be heated. The warm air passes through the evaporator where it provides the heat needed to melt the frost. Although it is the most energy consuming application, electric defrosting remains used in all refrigeration systems and is considered the most reliable defrosting method.

Defrosting has a significant impact both for energy consumption and product temperatures because of the air and product temperature rises during defrosting and has to be lowered quickly after defrosting leading to a significant overcapacity for rapid “pull down” of temperatures. If not performed correctly, the product can be damaged. The number of defrosting cycles required for a refrigeration case depends on its type. Open, multi-deck display cases will require several (3 to 6), while tub and reach-in cases normally have only one defrosting per day. Defrosting schedule is normally controlled by a time clock that initiates defrosting for each case at specific times each day.

2.1.3 Thermal modeling of display cases

The average air temperature, inlet and return air temperatures, evaporating temperature, electrical data for fans, heating wires, defrosting heaters and light, coil volume, diameter of tubs and heat loads at 22°C – 65% RH and at 25°C – 60% RH for each cabinet have been put into a database. The heat loads in display cases are dependent on indoor conditions in the supermarket; a higher indoor temperature and relative humidity increase the cooling demand and the energy requirement. An energy balance of an open vertical cabinet is shown in Figure

2.3 where heat losses from infiltration, radiation, conduction, lighting, the fan, heating wires, and defrosting are presented.

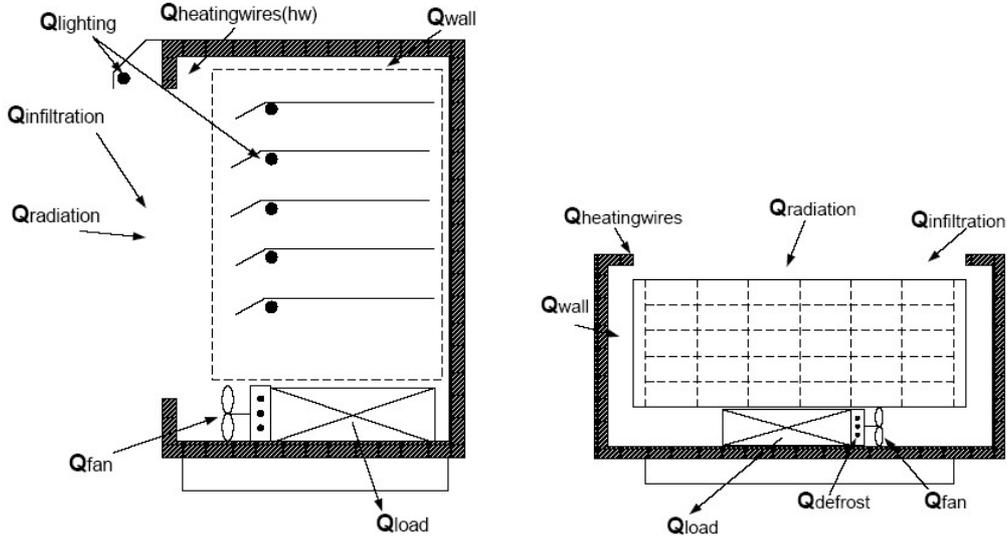


Figure 2.3 Energy balance of vertical (left) and horizontal (right) display cases.

The following Equations state the expressions of different loads accounted for in the cooling load calculations as a function of the display case and the store temperature.

Starting with the conduction load expressed in Equation (2.1):

$$\dot{Q}_w = U_{case} A_{case} (T_{store} - T_{case}) \quad (2.1)$$

Where $U_{case} = \frac{1}{\frac{1}{h_i} + \frac{t}{k} + \frac{1}{h_o}}$ and A_{case} corresponds to the total surface of the cabinet exchanging

by conduction with the surrounding store ambience. h_i and h_o represent the inner and outer convective heat exchange coefficients respectively, t and k the insulation thickness and thermal conductivity respectively.

The radiation load is also considered and can be evaluated applying Equation (2.2):

$$\dot{Q}_{radiation} = \frac{\sigma (T_w^4 - T_{case}^4)}{\left[\left(\frac{1 - \epsilon_w}{\epsilon_w A_w} \right) + \left(\frac{1}{A_w F_{case,w}} \right) + \left(\frac{1 - \epsilon_{case}}{\epsilon_{case} A_{case}} \right) \right]} \quad (2.2)$$

Where the subscript w refers to the store wall, σ Stefan Boltzmann's constant and ϵ the surface emissivity.

The infiltration load depends on the amount of store air entrained in through frozen-food cabinets. This amount is usually expressed as a ratio of the cabinet blown airflow rate. The percentages of the store air entrapment into the cabinets and freezer rooms are found in literature or evaluated through extensive measurements and parametric analyses for specific blown air velocities. For instance, for an open cabinet, air entrapment is taken equal to 7 or 8% of the blown airflow rate, while it is approximately equal to 1% for closed cabinets. Equation (2.3) states the infiltration load expression:

$$\dot{Q}_{infiltration} = \rho_{air} V_{air,ent} (h_{store} - h_{case}) \quad (2.3)$$

Where the subscript *air,ent* refers to entrapped air, V the volumetric air flow rate and h air enthalpy at store or case temperature.

Dissipations of heat from installed equipment should also be taken into account such as lamps and ballasts ($\dot{Q}_{lighting}$), fan motors (\dot{Q}_{fan}), anti-sweat heaters ($\dot{Q}_{heating-wires}$) and extra heat from defrost ($\dot{Q}_{Defrost}$). The total load is obtained by summing all of the above evaluated quantities as expressed in Equation (2.4):

$$\dot{Q}_{load} = \dot{Q}_{wall} + \dot{Q}_{infiltration} + \dot{Q}_{radiation} + \dot{Q}_{lighting} + \dot{Q}_{fan} + \dot{Q}_{heating-wires} + \dot{Q}_{Defrost} \quad (2.4)$$

The load calculation of a stand-alone equipment is identical to a closed cabinet display load calculation.

2.1.4 Thermal modeling of cold storage room

The dimensioning of refrigeration capacity for cold storage is defined by four factors: heat transmission, exchange of air, cooling or freezing of products and internal heat generation [GRA03]. Heat transmission through walls, floor, and ceiling is dependent on the overall heat transfer coefficient and the temperature difference between the room and the surroundings. The heat transmission has been defined as shown in Equation (2.5):

$$\dot{Q}_{cond} = \Sigma (U_{CR} A_{CR} (T_{store} - T_{CR})) \quad (2.5)$$

The exchange of air in cold rooms depends on the frequency of door openings and the size of the room. The exchange of air increases the heat load of the room. The influence of incoming air in the room can be calculated from Equation (2.6):

$$\dot{Q}_{airex} = \rho_{air} \dot{V}_{airex} (h_{store} - h_{CR}) \quad (2.6)$$

Where \dot{V}_{airex} is an average volume flow of incoming air that is defined in (Granryd 2003) as presented in Equation (2.7):

$$\dot{V}_{airex} = V_{CR} \frac{nd}{24.3600} \quad (2.7)$$

nd is the number of air exchanges in the room per 24 hours. Temperatures and the frequency of door openings influence the number of air exchanges. Results from experiments are presented in Table 2.11 [GRA03].

Table 2.11 Number of air exchanges [ARI05].

| Room Volume (m³) | Air exchanges - Medium temp. room (°C) | Air exchanges – Low temp. room (°C) |
|------------------------------------|---|--|
| 7 | 38 | 30 |
| 10 | 31.5 | 24.5 |
| 20 | 21.5 | 17 |
| 40 | 14.5 | 11.5 |
| 100 | 9 | 7 |
| 500 | 3.5 | 2.7 |
| 1000 | 2.5 | 2.7 |
| 3000 | 1.35 | 1.05 |

The enthalpy difference for freezer rooms has been assumed to be 45 [kJ/kg], which is the average between the enthalpies of different products at temperatures -15°C and -18°C. Similarly, the enthalpy difference for the cold room has been assumed to be 55 [kJ/kg], which is the average between the enthalpies of different products at temperatures 17°C and 1°C. The mass flow has been assumed to be 20 kg/m³ per 24 hours [ARI05] for cold rooms and 15 kg/m³ per 24 hours for freezer rooms. Internal heat generation from lighting and people also affects the heat load of the cold room. The heat generated by lighting has been assumed to be 15 W/m² and the heat from people to be 200 W.

2.1.5 Coefficient of performance

Many factors have an impact on the coefficient of performance (COP):

- Level of temperature for product or beverage conservation
- Temperature differences at the condenser and evaporator coils
- Compressor efficiency
- Type of refrigerant
- Configuration of the refrigeration system (one or two compression stage, sub-cooling or not).

For energy calculation along the year, the coefficient of performance has been considered as a function of these variable values. The expression of the COP for the theoretical cycle of Carnot is:

$$COP_c = \frac{T_e}{T_c - T_e} \quad (2.8)$$

Where T_e and T_c are respectively evaporating temperature and condensing temperature expressed in Kelvin. These temperatures are linked to product temperature and ambient temperature. Product conservation temperature is supposed to be fixed along the year. Typical temperature difference at the evaporator and the condenser are presented in Table 2.12.

Table 2.12 Temperature difference in heat exchangers.

| Difference of temperature in heat exchangers | DTev evaporator | DTcd condenser |
|---|------------------------|-----------------------|
| Centralized System / medium temperature | 15 K | 12 K |
| Centralized System / low temperature | 17 K | 10 K |
| Condensing Units / medium temperature | 15 K | 12 K |
| Condensing Units / low temperature | 17 K | 12 K |
| Stand-alone equipment / medium temperature | 15 K | 15 K |
| Stand-alone equipment / low temperature | 15 K | 15 K |

In centralized systems, the evaporating temperature is the same for all display case connected to the same compressor rack. The evaporating temperature varies usually between -10°C and -12°C for medium temperature display cases. Product temperature conservation ranges from 0°C to $+10^{\circ}\text{C}$. A thermostatic expansion valve (TxV) controls usually the refrigerant feeding of the evaporator. The superheat control is not optimized and leads to poor efficiency of the evaporator coil. In consequence, temperature difference between air and refrigerant is high.

Because of pressure drops in the compressor rack suction lines, the pressure at the suction port is lower, and the equivalent saturating temperature is between -12°C and -15°C . The airflow rate on the display-case evaporator is low, for noise reduction.

For calculations, the evaporating temperature is fixed at -13°C for medium-temperature compressor rack, and -35°C for low-temperature compressor rack.

The coefficient of performance can be expressed with the theoretical Carnot COP and the cycle efficiency. The cycle efficiency depends mainly on the compressor efficiency, the system design, and the refrigerant properties. For each type of refrigeration system (centralized, condensing units, stand alone), cycle efficiencies have been calculated for the refrigerant in use. Compressor efficiencies have been taken from manufacturer data (Copeland, Carlyle)

Table 2.13 Cycle efficiency (COP / COPc).

| Refrigeration system | Cycle efficiency |
|--|-------------------------|
| <i>Centralized System / medium temperature</i> | 45 % |
| <i>Centralized System / low temperature</i> | 42 % |
| <i>Condensing Units</i> | 40 % |
| <i>Stand-alone equipment</i> | 25 % |

The additional power consumption of the condenser fan is integrated in the cycle efficiency. In centralized systems, the input power for condenser ventilation is 7% of compressor rack input power for medium-temperature system, and 8% of compressor rack input power for low-temperature system [BIG02, FAY00].

In supermarkets, the condensation pressure is controlled to a minimum level to keep the pressure sufficiently high so that the thermo expansion valves (TxV) correctly feed the evaporators. In wintertime, with low outdoor temperature, it is possible to reduce the condensing pressure, taking advantage of a lower pressure ratio for compressors. This is possible when expansion valves are designed for a wider range of pressure differences. The impact on the cycle efficiency, when the head pressure control is activated, has been taken into account for the different scenarios of energy consumption.

Finally the equation of the coefficient of performance is a function of the outdoor temperature:

$$COP = \frac{T_{ev}}{(T_{ext} + DT_{cd}) - T_{ev}} \eta_c \quad (2.9)$$

with DT_{cd} (temperature difference at the condenser) as functions of the out door temperature (T_{ext}), the floating head pressure control (FHPC), the technology of the refrigerating system ($Tech$), and the level of the evaporating temperature (T_{ev}).

$$DT_{cd} = f(T_{ext}; FHPC; Tech; T_{ev}) \quad (2.10)$$

The cycle efficiency (η_c) is a function of the technology ($Tech$) and the level of temperature for centralized systems (T_{ev}) (see Table 2.13). Two other variables are considered for the cycle efficiency: the floating head pressure control ($FHPC$) and the outdoor temperature ($Text$).

Because ventilation is reduced when outdoor temperature is low, in wintertime for example, the additional input power of the condenser fan decreases. The cycle efficiency includes the additional power input of the condenser fans, which varies according to the outdoor temperature. In consequence, the cycle efficiency must be correlated to the outdoor temperature and the head pressure control.

$$\eta_c = f(Text; FHPC; Tech; T_{ev}) \quad (2.11)$$

2.1.6 Store distribution in climatic zones

Calculations for energy consumption are done for different climatic conditions. The outdoor temperature has an impact on the coefficient of performance of the refrigerating system. Depending on the climatic zone of the supermarket and the other stores, the hourly variation of temperature will have an impact on the energy consumption.

Eight climatic zones have been defined in California. Temperature variations during one typical year are known and registered hour by hour in weather stations. The distribution of stores and supermarkets in the different climatic zones has been done proportionally to the population living in each zone.

Figure 2.4 presents the average temperature (24 hours averaged) for three weather stations in California.

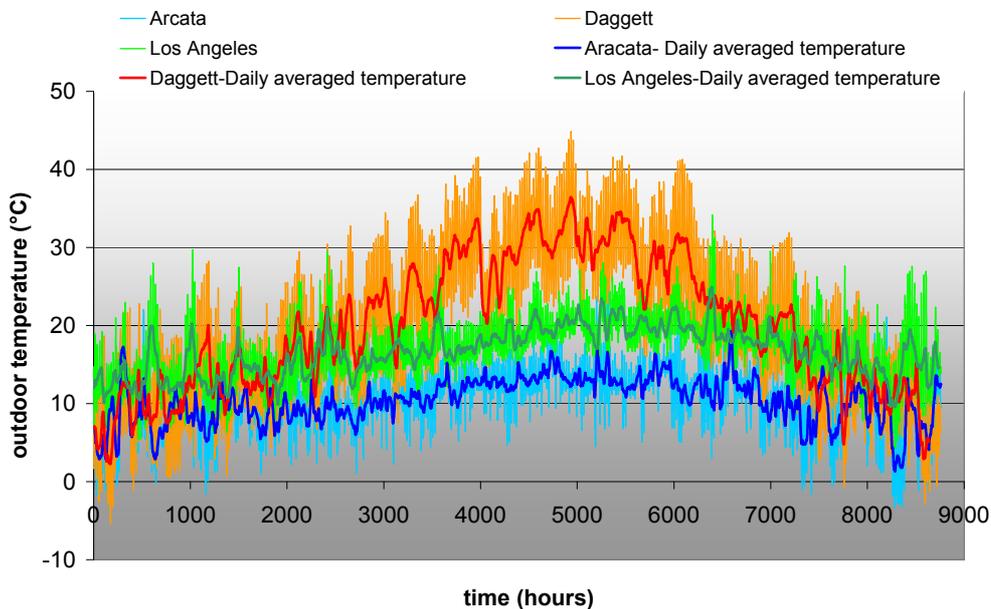


Figure 2.4 Temperature evolution in one year – 3 weather station measurements.

Figure 2.5 presents the 8 climatic zones, and the population distribution in these zones. Los Angeles, with 36% of the population, has the greatest number of inhabitants. The distribution of the different stores studied in the commercial refrigeration sector is approximately the same as the population distribution among climatic zones shown.

The population distribution is computed based on population estimates given per air basin and counties by the U.S Census Bureau. The temperature curves are obtained from the thermal engineering software TRNSYS (The Transient Energy System Simulation Tool) for all the climatic zones defined in Figure 2.5.

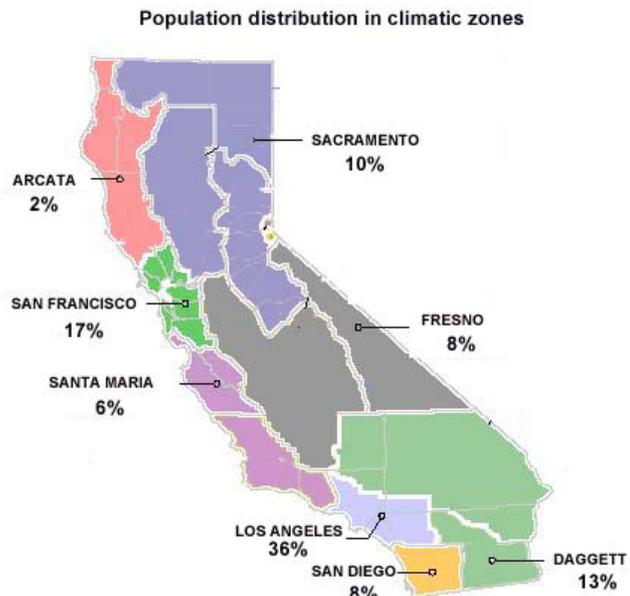


Figure 2.5 Climatic zones and population distribution.

2.2 Energy Savings

The quest for increased energy efficiency and the phase-out of ozone depleting substances (ODS) have changed the refrigeration system design for some new supermarkets. Many research laboratories as well as commercial chains or equipment manufacturers have assessed a great potential for energy efficiency improvement as well as limitation of greenhouse gas emissions. Energy saving technologies such as heat recovery, floating head pressure, defrosting control, energy efficient lighting, high efficiency motors, and efficient control have been implemented in many supermarkets to reduce energy consumption. The objective of these technical options is to develop energy-efficiency solutions in refrigerated cases, while enhancing food safety without hampering merchandizing facets.

2.2.1 Heat recovery systems

The refrigeration system in a supermarket always rejects heat to the environment through the condensers. It is possible to use the rejected heat for heating the store in the winter season. Heat rejected from condensers can also be used to heat service water and premises in cold climates, which is a good measure to improve energy usage in new efficient refrigeration cycle design. Heat recovery leads to a reduction in costs and in the usage of fossil fuels for heating.

2.2.2 Floating head pressure

A drawback of the heat recovery system is the high condensing temperatures that increase the energy consumption of the refrigeration system. In the so-called floating head pressure condensing systems, the condensing temperature follows the outdoor temperature. The system is implemented with electronic expansion valve (or multiple-orifice expansion valve) operating over a wide range of pressure differences and allowing for low condensing temperature at low ambient temperatures. A reduction of condensing temperatures increases the coefficient of performance of refrigeration systems.

2.2.3 Installing glass doors in open cases

Display cases commonly carry large heat loads, especially vertical open display cabinets. The reason is that this kind of cabinet displays a large amount of food on a small surface in the store with a large open front area. The heat and moisture exchanged between the products in the cabinet and the store environment affect the heat load, defrost and condensation, on walls and products. Infiltration causes about 60 to 70% of the cooling load for a typical open vertical display cabinet [ARI05].

The heat loads associated with the glass door reach-in case are normally less than those of the multi-deck, but greater than for the tub case. Glass door cases are, however, equipped with anti-sweat electric heaters in the doors to prevent fogging.

Installing glass doors in display cases reduces the infiltration and energy consumption of the cabinets. The reason for the absence of the doors in a display case is to avoid placing an obstacle between the customer and the product, which may hinder the customer impulse to purchase a new product. Results from a laboratory test that evaluated glass doors on a open five-deck display case show a reduction of the total cooling load of the case by 68% [FAR02].

2.2.4 Hot Gas Defrost

Discharge refrigerant gas is piped from the compressor rack to the display case where the refrigerant is condensed by melting the frost. The piping is arranged so that the liquid refrigerant is returned to the compressor rack for distribution to other display cases in the system. Hot gas defrosting is the fastest method to remove frost and tends to have the least impact on case air and product temperatures. Hot gas is the most costly defrosting method to implement because of the extensive piping and controls needed.

2.3 Results for energy consumption

2.3.1 Energy consumption in the commercial refrigeration sector

Results for energy consumption are presented first for supermarkets only, and second for all the commercial refrigeration sector, including small stores and vending machines.

2.3.1.1 Results for grocery supermarkets

One typical grocery supermarket

Before deriving the calculation for California State, one typical supermarket located in the Los Angeles (LA) climatic zone is presented. Table 2.14 gives the cooling capacity distribution, for medium and low temperature systems, and for each technology of display cases and walk-in coolers.

Table 2.14 Cooling capacity in a typical grocery supermarket.

| Cooling Capacity | Medium temperature | Low temperature | Total |
|--------------------------------|---------------------------|------------------------|--------------|
| <i>Centralized System (kW)</i> | 193 | 152 | 345 |
| <i>Condensing Units (kW)</i> | 18 | 14 | 32 |
| <i>Stand-alone (kW)</i> | 13 | 2 | 15 |
| Total (kW) | 224 | 168 | 392 |

90% of the total cooling capacity of refrigeration equipment is the centralized system. Stand-alone display cases represent a total of 12 kW of cooling capacity, which is 3 % of the refrigeration capacity in the grocery supermarket.

Refrigerant charge is around 1300 kg including stand-alone equipment and condensing units. Centralized system represents 90% of the total amount. The evaluation of the refrigerant charge is presented in detail in Section 2.2.2 of the “Part 1 - Refrigerant inventory and emissions for stationary systems”.

Energy consumption for one supermarket in LA climatic zone

Energy consumption is calculated hour by hour, for each climatic zone. Results for one supermarket in LA climatic zone are presented in Table 2.15.

Table 2.15 Annual energy consumption for 1 grocery supermarket in LA climatic zone.

| Grocery supermarket (GWh/year) | Centralized System | Condensing Units | Stand-alone |
|---|---------------------------|-------------------------|--------------------|
| <i>Compressor for refrigeration</i> | 0.827 | 0.098 | 0.041 |
| <i>Auxiliary components</i> | 0.504 | 0.071 | 0.027 |
| <i>AC additional energy consumption</i> | 0 | 0 | 0.013 |
| <i>Total (GWh)</i> | 1.331 | 0.169 | 0.081 |
| 1.581 GWh | | | |

The energy consumption of refrigeration compressors is 0.827 GWh/year. Auxiliary components (fans, lighting, anti-sweat heaters, and defrosting heaters) totalize 0.504 GWh. As mentioned by different studies, (Wal03, Bax03, ORL04, Lit96) field tests on energy consumption measurement in a supermarket are in general agreement, with consumption numbers in the same order of magnitude.

Derivation to California State

Taking into account the different climatic zones, and the distribution of the stores in these zones, the energy consumption is derived to California (Table 2.16).

Table 2.16 Annual energy consumption for grocery supermarkets in California.

| Grocery supermarkets in CA (GWh/year) | Centralized System | Condensing Units | Stand-alone |
|--|---------------------------|-------------------------|--------------------|
| <i>Compressor for refrigeration</i> | 2,810 | 334 | 137 |
| <i>Auxiliary components</i> | 1,692 | 237 | 92 |
| <i>AC additional energy consumption</i> | 0 | 0 | 39 |
| <i>Total (GWh)</i> | 4,502 | 571 | 268 |
| 5,341 GWh | | | |

Annual energy consumption evaluation of commercial refrigeration equipment in grocery supermarkets, including auxiliary electric loads, is 5,341 GWh in California. 84% is due to centralized systems, and 5% of the total energy consumption is due to stand-alone display cases.

2.3.1.2 Results including the other small stores using refrigeration equipment

Table 2.17 Annual energy consumption for commercial refrigeration sector in California, small stores included.

| Total commercial ref. (GWh/year) | Centralized System | Condensing Units | Stand-alone |
|---|---------------------------|-------------------------|--------------------|
| Compressor for refrigeration | 2,810 | 3,831 | 4,548 |
| Auxiliary components | 1,692 | 2,364 | 3,802 |
| AC additional energy consumption | 0 | 0 | 1,181 |
| Total (GWh) | 4,502 | 6,196 | 9,531 |
| 20,228 GWh | | | |

When all types of stores are added to grocery supermarkets, the annual energy consumption grows to 20,228 GWh. The share by technology of refrigeration equipment is presented on Figure 2.6.

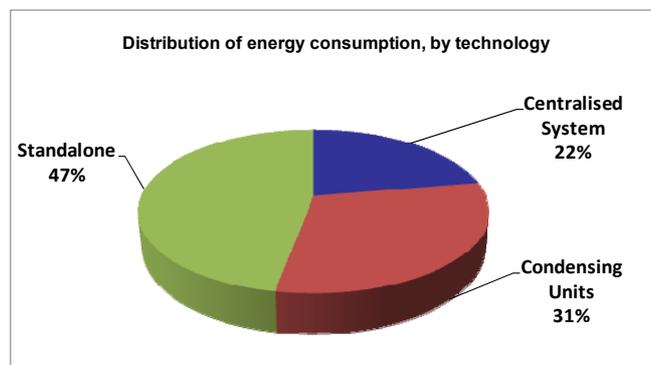


Figure 2.6 Distribution of energy consumption by technology, in commercial refrigeration.

Because of the high number of stand-alone equipment in small stores, including vending machines, and the poor efficiency of their refrigerating systems, this technology represents the largest share of energy consumption in the commercial refrigeration sector. It uses approximately 10 TWh per year in California. Centralized systems, only used in supermarkets, are more energy efficient and represent 22% of the global energy consumption.

2.3.2 Technical options for energy savings

Five technical options for energy savings have been evaluated.

- **Technical option 1:** night curtains are installed on each open display case. The ambient air induction is reduced, and the thermal load on the refrigeration system decreases. Night hours have been considered from 10 pm to 4 am. Moreover, during night hours, lighting is off in all display cases.
- **Technical option 2:** all medium-temperature open display cases (except for vegetables and flowers) are replaced by glass door display cases. Ambient air induction is significantly reduced (by factor 7), decreasing the thermal load of the display case and the energy consumption of the refrigeration system.
- **Technical option 3:** auxiliary components are replaced by new technologies, with improved energy efficiency (LED lighting, DC current fan, high efficiency heater...)
- **Technical option 4:** the floating head pressure control is done on every centralized system in supermarkets. Depending on the climatic zone, the impact is more or less significant on the annual energy consumption.

- **Technical option 5:** three options are combined: 100% glass door + high efficiency electrical components + floating head pressure control.

2.3.2.1 Technical option 1: night curtain installed on every open display case

Grocery supermarkets

Table 2.18 presents the results for one typical supermarket in LA climatic zone. Energy savings, thanks to night curtains installed on every open display case in a supermarket is 92 MWh/year, 5.82% of the energy consumption without night curtain.

Table 2.18 Energy consumption for one grocery supermarket – Technical option 1.

| Operating Mode | Night curtains | | |
|---|---------------------------|-------------------------|--------------------|
| Grocery supermarket (GWh/year) | Centralized System | Condensing Units | Stand-alone |
| <i>Compressor for refrigeration</i> | 0.745 | 0.096 | 0.038 |
| <i>Auxiliary components</i> | 0.497 | 0.072 | 0.028 |
| <i>AC additional energy consumption</i> | 0 | 0 | 0.013 |
| <i>Total</i> | 1.242 | 0.168 | 0.079 |
| | | 1.489 | |
| | Energy Savings (GWh ; %) | 0.092 | 5.82% |

Table 2.19 Energy consumption for all supermarkets in California – Technical option 1.

| Operating Mode | Night curtains | | |
|--|---------------------------|-------------------------|--------------------|
| Grocery supermarkets in CA (GWh/year) | Centralized System | Condensing Units | Stand-alone |
| <i>Compressor for refrigeration</i> | 2,533 | 327 | 128 |
| <i>Auxiliary components</i> | 1,666 | 240 | 94 |
| <i>AC additional energy consumption</i> | 0 | 0 | 37 |
| <i>Total</i> | 4,200 | 567 | 259 |
| | | 5,027 | |
| | Energy Savings (GWh ; %) | 313 | 6% |

Deriving the calculation for all supermarkets in California, the energy saving associated to the installation of night curtain is 313 GWh/year.

All commercial refrigeration equipment (small stores and supermarkets) in California

Considering now all refrigeration equipment, the additional savings is limited and evaluated between 313 and 351 GWh, because most of stand-alone equipment is already closed with glass doors and the night curtain technical option has no effect on this equipment.

Table 2.20. Energy consumption in commercial refrigeration sector – Technical option 1.

| Operating Mode | Night curtains | | |
|---|---------------------------|-------------------------|--------------------|
| Total commercial ref. (GWh/year) | Centralized System | Condensing Units | Stand-alone |
| <i>Compressor for refrigeration</i> | 2,534 | 3,797 | 4,532 |
| <i>Auxiliary components</i> | 1,666 | 2,365 | 3,805 |
| <i>AC additional energy consumption</i> | 0 | 0 | 1,178 |
| <i>Total</i> | 4,200 | 6,162 | 9,515 |
| | | 19,877 | |
| | Energy Savings (GWh ; %) | 351 | 2% |

2.3.2.2 Technical option 2: Open display cases closed with glass doors

The impact of night curtain is limited to 6 hours in the night when the coefficient of performance increases due to reduced outdoor temperatures. Closing all open display cases with doors represents a more radical change in display case technology to reduce energy consumption.

Grocery supermarkets

Table 2.21 Energy consumption for one grocery supermarket – Technical option 2.

| Operating Mode | Add doors | | |
|---|---------------------------|-------------------------|--------------------|
| Grocery supermarket (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 0.539 | 0.084 | 0.034 |
| <i>Auxiliary components</i> | 0.611 | 0.074 | 0.031 |
| <i>AC additional energy consumption</i> | 0 | 0 | 0.011 |
| <i>Total</i> | 1.15 | 0.158 | 0.076 |
| | | 1.384 | |
| <i>Energy Savings (GWh ; %)</i> | | 0.197 | 12.46% |

Closing all the display cases, the energy savings for one year is 12.5%: 200 MWh per supermarket.

Table 2.22 Energy consumption for all supermarkets in California – Technical option 2.

| Operating Mode | Add doors | | |
|--|---------------------------|-------------------------|--------------------|
| Grocery supermarkets in CA (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 1,812 | 281 | 114 |
| <i>Auxiliary components</i> | 2,050 | 250 | 105 |
| <i>AC additional energy consumption</i> | 0 | 0 | 32 |
| <i>Total</i> | 3,862 | 531 | 251 |
| | | 4,644 | |
| <i>Energy Savings (GWh ; %)</i> | | 697 | 13.05% |

Deriving the scenario to California, the energy saving is nearly 0.7 TWh per year.

All commercial refrigeration equipment (small stores and supermarkets) in California

Table 2.23 Energy consumption in commercial refrigeration sector – Technical option 2.

| Operating Mode | Add doors | | |
|---|---------------------------|-------------------------|--------------------|
| Total commercial ref. (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 1,812 | 3,412 | 4,518 |
| <i>Auxiliary components</i> | 2,050 | 2,374 | 3,816 |
| <i>AC additional energy consumption</i> | 0 | 0 | 1,173 |
| <i>Total</i> | 3,862 | 5,786 | 9,507 |
| | | 19,155 | |
| <i>Energy Savings (GWh ; %)</i> | | 1,073 | 5.305% |

Most of stand-alone equipment is already equipped with glass doors. The impact on energy savings is significant mainly in supermarkets. Nevertheless, for the complete commercial refrigeration sector, the energy savings are 5.3 % compared to the baseline.

2.3.2.3 Technical option 3: Cabinet lighting, anti-sweat heater and ventilation: low energy consuming technologies

Grocery supermarkets

Table 2.24 Energy consumption for one grocery supermarket – Technical option 3

| Operating Mode | Eco for auxiliary components | | |
|---|------------------------------|-------------------------|--------------------|
| Grocery supermarket (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 0.698 | 0.078 | 0.038 |
| <i>Auxiliary components</i> | 0.358 | 0.047 | 0.023 |
| <i>AC additional energy consumption</i> | 0 | 0 | 0.013 |
| <i>Total</i> | 1.056 | 0.125 | 0.074 |
| | | 1.255 | |
| <i>Energy Savings (GWh ; %)</i> | | 0.326 | 20.62% |

Auxiliary components are energy consumers, first by their own electrical load, and second by the additional heat load to the display case. This additional heat load increases the cooling capacity of the refrigeration system, and its energy consumption.

Improved technologies are available to retrofit lighting, ventilation, and anti-sweat heaters. Technical option 3 gives the range of energy savings if all auxiliary components were replaced.

Table 2.25 Energy consumption for all supermarkets in California – Technical option 3.

| Operating Mode | Eco for auxiliary components | | |
|---|------------------------------|-------------------------|--------------------|
| Grocery supermarkets CA (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 2,345 | 261 | 128 |
| <i>Auxiliary components</i> | 1,200 | 159 | 77 |
| <i>AC additional energy consumption</i> | 0 | 0 | 37 |
| <i>Total</i> | 3,545 | 420 | 241 |
| | | 4,206 | |
| <i>Energy Savings (GWh ; %)</i> | | 1,134 | 21.24% |

Energy savings, thanks to high-efficiency auxiliary components, is around 21% compared to the baseline. In California, the annual savings are 1.2 TWh for this technical option.

All commercial refrigeration equipment (small stores and supermarkets) in California

Table 2.26 Energy consumption in commercial refrigeration sector – Technical option 3.

| Operating Mode | Eco for auxiliary components | | |
|---|------------------------------|-------------------------|--------------------|
| Total commercial ref. (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| <i>Compressor for refrigeration</i> | 2,345 | 3,058 | 4,112 |
| <i>Auxiliary components</i> | 1,200 | 1,488 | 3,125 |
| <i>AC additional energy consumption</i> | 0 | 0 | 1,062 |
| <i>Total</i> | 3,545 | 4,546 | 8,298 |
| | | 16389 | |
| <i>Energy Savings (GWh ; %)</i> | | 3,840 | 19.0% |

Technical option 3 is applied to each type of display cases. Stand-alone equipment can benefit of the technical changes. Deriving the scenario to California, for commercial refrigeration sector, energy savings for one year are 3.84 TWh, nearly 19% of the baseline consumption.

2.3.2.4 Technical option 4: Floating head pressure on centralized systems

Grocery supermarkets

Table 2.27 Energy consumption for one grocery supermarket – Technical option 4.

| Operating Mode | Floating head pressure (Eco) | | |
|---------------------------------------|------------------------------|-------------------------|--------------------|
| | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Grocery supermarket (GWh/year) | | | |
| Compressor for refrigeration | 0.778 | 0.089 | 0.041 |
| Auxiliary components | 0.504 | 0.071 | 0.027 |
| AC additional energy consumption | 0 | 0 | 0.013 |
| Total | 1.282 | 0.16 | 0.081 |
| | | 1.523 | |
| Energy Savings (GWh ; %) | | 0.058 | 3.67% |

Table 2.27 presents the energy consumption for one supermarket in LA climatic zone, when floating head pressure control is activated. The interest of this control, and the energy savings associated are strongly dependent on the temperature changes during the year. In a climatic zone where maximum and minimum temperatures are not far from each other, the interest of a floating head pressure is limited. In LA climatic zone, the energy saving is 3.7%. The derivation of energy consumption in California, taking into account 8 climatic zones, give a better result with 5% of energy savings thanks to the floating head pressure control.

Table 2.28 Energy consumption for all supermarkets in California – Technical option 4.

| Operating Mode | Floating head pressure (Eco) | | |
|--|------------------------------|-------------------------|--------------------|
| | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Grocery supermarkets in CA (GWh/year) | | | |
| Compressor for refrigeration | 2,583 | 296 | 137 |
| Auxiliary components | 1,692 | 237 | 92 |
| AC additional energy consumption | 0 | 0 | 39 |
| Total | 4,275 | 534 | 268 |
| | | 5,077 | |
| Energy Savings (GWh ; %) | | 264 | 5% |

All commercial refrigeration equipment (small stores and supermarkets) in California

Table 2.29 Energy consumption in commercial refrigeration sector – Technical option 4.

| Operating Mode | Floating head pressure (Eco) | | |
|---|------------------------------|-------------------------|--------------------|
| | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Total commercial ref. (GWh/year) | | | |
| Compressor for refrigeration | 2,583 | 3,400 | 4,548 |
| Auxiliary components | 1,692 | 2,364 | 3,802 |
| AC additional energy consumption | 0 | 0 | 1,181 |
| Total | 4,275 | 5,764 | 9,531 |
| | | 1,9570 | |
| Energy Savings (GWh ; %) | | 658 | 3.251% |

Floating head pressure cannot be applied to stand-alone equipment, which are located in an air-conditioned area. The overall impact of this technical option, on complete commercial refrigeration sector is lowered to 3.3%, representing 0.66 TWh per year.

2.3.2.5 Technical option 5: three options combined

The last scenario is the combination of three technical options: closing all open display cases, low energy consuming components, and floating head pressure.

Grocery supermarkets

In a typical supermarket, located in LA climatic zone, the annual energy savings is 37%, meaning 811 MWh saved (see Table 4.17).

Table 2.30 Energy consumption for one grocery supermarket – Technical option 5.

| Operating Mode | Add doors + eco Aux + FHP | | |
|---------------------------------------|---------------------------|-------------------------|--------------------|
| Grocery supermarket (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Compressor for refrigeration | 0.489 | 0.071 | 0.031 |
| Auxiliary components | 0.442 | 0.05 | 0.026 |
| AC additional energy consumption | 0 | 0 | 0.01 |
| <i>Total</i> | 0.931 | 0.121 | 0.067 |
| | | 1.119 | |
| <i>Energy Savings (GWh ; %)</i> | | 0.462 | 29.22% |

Table 2.31 Energy consumption for all supermarkets in California – Technical option 5.

| Operating Mode | Add doors + eco Aux+Eco FHP | | |
|--|-----------------------------|-------------------------|--------------------|
| Grocery supermarkets in CA (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Compressor for refrigeration | 1,621 | 235 | 103 |
| Auxiliary components | 1,482 | 168 | 86 |
| AC additional energy consumption | 0 | 0 | 29 |
| <i>Total</i> | 3,103 | 403 | 218 |
| | | 3,724 | |
| <i>Energy Savings (GWh ; %)</i> | | 1,617 | 30.273% |

For all supermarkets in California, the maximum energy savings are 1.62 TWh per year when all technical options are applied.

All commercial refrigeration equipment (small stores and supermarkets) in California

Table 2.32 Energy consumption in commercial refrigeration sector – Technical option 5.

| Operating Mode | Add doors + eco Aux+Eco FHP | | |
|---|-----------------------------|-------------------------|--------------------|
| Total commercial ref. (GWh/year) | <i>Centralized System</i> | <i>Condensing Units</i> | <i>Stand-alone</i> |
| Compressor for refrigeration | 1,621 | 2,955 | 4,080 |
| Auxiliary components | 1,482 | 1,495 | 3,135 |
| AC additional energy consumption | 0 | 0 | 1,052 |
| <i>Total</i> | 3,103 | 4,450 | 8,267 |
| | | 15,820 | |
| <i>Energy Savings (GWh ; %)</i> | | 4,409 | 21.8% |

For the complete commercial refrigeration sector, the maximum energy savings is 4.41 TWh per year, totalizing 22% of the baseline consumption. Overall annual energy consumption is evaluated at 15.8 TWh, and stand-alone equipment consumes more than half of this value.

2.3.2.6 Summary

Energy savings in supermarkets

Figure 2.7 presents the comparison of the energy savings, related to the baseline, for different technical options applied to grocery supermarkets in California.

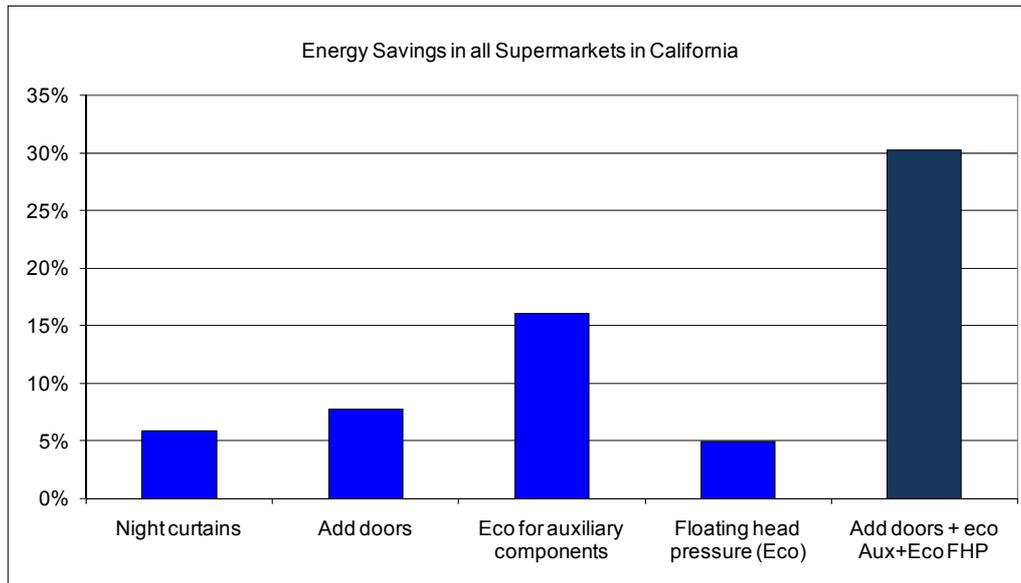


Figure 2.7 Energy savings / technical options applied in Californian supermarkets.

- Night curtains installed on open display cases have a limited impact on the energy consumption. Night period is short in time in supermarkets (6 hours only) and during this period, the coefficient of performance of the refrigerating system is improved thanks to quite low outdoor temperature, lowering the condensation temperature.
- Floating head pressure control is interesting in climatic zones with wide temperature differences between day and night. Near the coast, where the temperature is more stable, the interest of this system is limited.
- In supermarkets, most of display cases are open, and heat loads due to air induction is around 70% of the total load. Closing the display cases decreases the cooling capacity and the energy consumption of the compressor racks. 8 % of energy saving are possible with this change in technology.
- The other elements for energy consumption are the auxiliary components. High energy efficiency technologies exist and could reduce by 16% the energy consumption.
- All options applied together lead to 30% of energy savings in supermarkets

Energy savings in small stores (condensing units and standalone equipment)

Figure 2.8 presents the comparison of the energy savings, related to the baseline, for different technical options applied to small stores in California. Stand-alone equipment and condensing units are the two refrigeration technologies used in small stores.

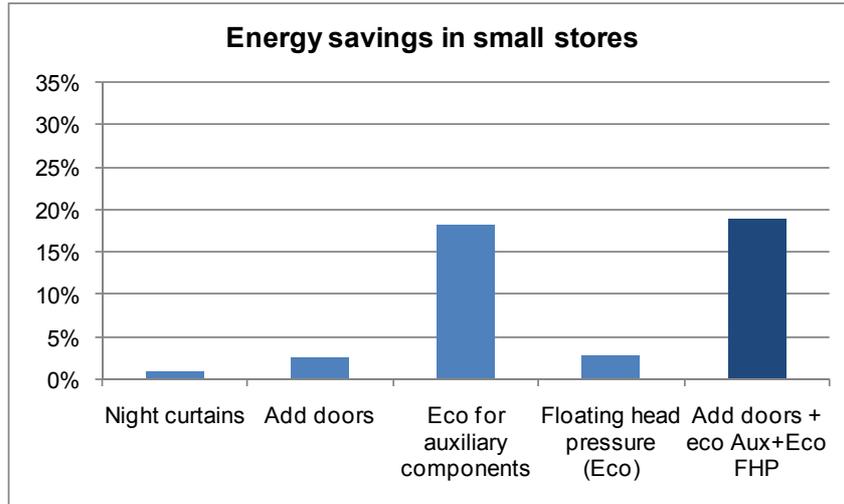


Figure 2.8 Energy savings / technical options applied in Californian small stores.

Most of stand-alone equipment is closed with glass doors (vending machines for example). Options of night curtains and closing the display cases are not applied on this stand-alone equipment. The impact on energy consumption is low.

Progresses to save energy on stand-alone equipment must be focused on auxiliary components and compressor efficiency, which is very poor today.

Energy savings in commercial refrigeration sector, all types of stores

Figure 2.9 presents the comparison of the energy savings, related to the baseline, for different technical options applied to all types of stores using refrigeration equipment in California, whatever the technology.

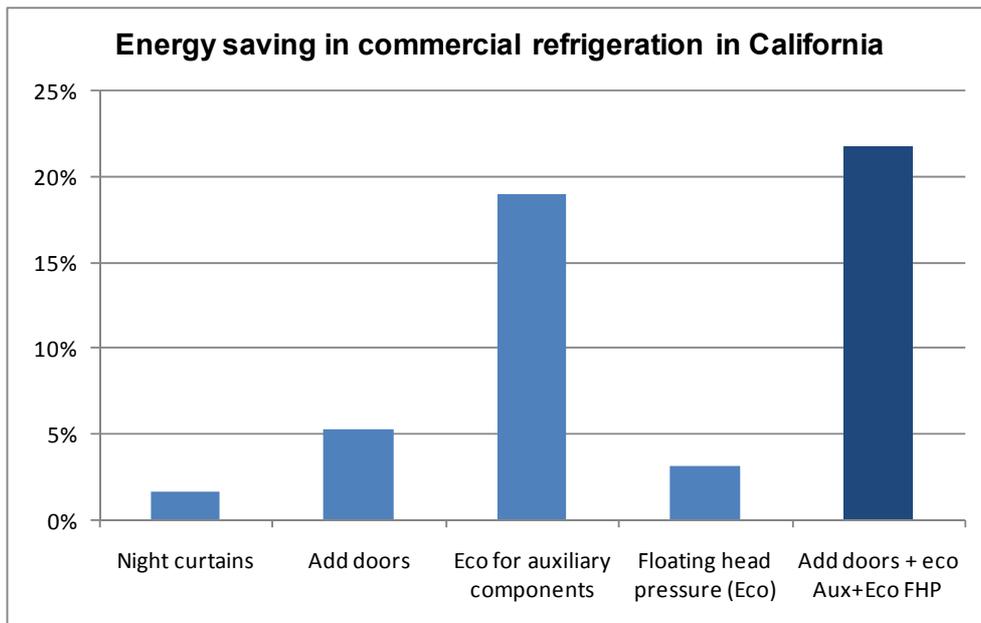


Figure 2.9 Energy savings / technical options applied in commercial sector.

Figure 2.10 presents for technical option 5, where all technical options are applied, the distribution in energy consumption by technology of refrigerating system.

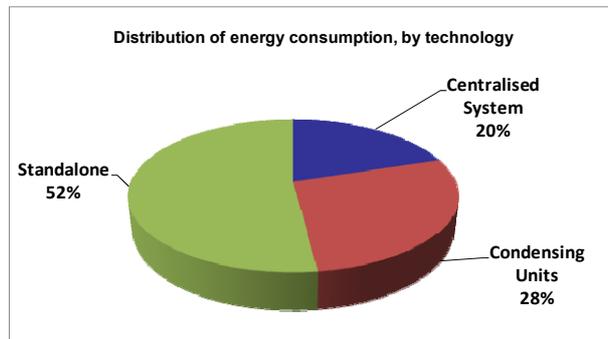


Figure 2.10 All technical options combined: energy consumption distribution.

It appears clearly that stand-alone equipment, by their high numbers in every type of stores, consumes more than 50% of the total energy consumption in commercial refrigeration sector. The poor efficiency of small hermetic compressor, and sometime heat exchanger designs not adapted, lead to a poor cycle efficiency (25%). Technical options to reduce energy consumption are more effective for centralized system. In technical option 5, the energy consumption of centralized systems is cut by nearly 40% compared to the baseline.

2.4 General approach for Life Cycle Cost Analysis

2.4.1 Calculation method

The Life Cycle Cost (LCC) is the total customer cost over the lifetime of the equipment, including purchase cost and operating cost (including energy cost). Future operating costs are discounted to the time of purchase and summed over the lifetime of the equipment. Inputs to the LCC analysis are categorized as follows:

- inputs for establishing the purchase cost, otherwise known as the total installed cost, and
- inputs for calculating the operating cost (i.e., energy, maintenance, and repair costs).

Life-cycle cost is defined by Equation (2.12):

$$LCC = IC + \sum_{t=1}^N \frac{OC_t}{(1+r)^t} \quad (2.12)$$

Where

- LCC life-cycle cost (\$),
- IC total installed cost (\$),
- N lifetime of equipment expressed in years,
- Σ sum over the lifetime, from year 1 to year N ,
- OC operating cost (\$),
- r discount rate (4.76% [DOE07]),
- t year for which operating cost is being determined.

Because most of data used to conduct the LCC analysis are collected in 2008, all costs are expressed in US \$ (2008).

The LCC analysis is performed for different efficiency levels and LCC difference between the baseline equipment and equipment with higher efficiency level is evaluated. A distribution of LCC differences is then generated to determine the mean LCC difference.

2.4.1.1 Total installed cost

The primary inputs for establishing the total installed cost are: the baseline manufacturer selling price, mark-ups and sales tax, and the installation price.

2.4.1.2 Baseline manufacturer selling price

Baseline manufacturer selling price is the price charged by the manufacturer to either a wholesaler or customer for equipment meeting existing minimum efficiency (or baseline) standards. The manufacturer selling price includes a markup that converts the cost (i.e., the manufacturer cost) to a manufacturer selling price. Standard-level manufacturer selling price increase: standard-level manufacturer selling price increase is the incremental change in manufacturer selling price associated with producing equipment at each of the higher standard levels.

Markups and sales tax

Markups and sales tax convert the manufacturer selling price into a customer price.

Installation price

The installation price is the cost to the customer of installing the equipment. The installation price represents all costs required to install equipment but does not include the marked-up customer equipment price. The installation price includes labor, overheads, and any miscellaneous materials and parts. Thus, the total installed cost equals the customer equipment price plus the installation price and is defined by Equation (2.13):

$$IC = EP + InstC \quad (2.13)$$

where

EP equipment price (i.e., customer price for the equipment only), expressed in \$,
InstC the installation cost or the customer price to install equipment (i.e., the cost for labor and materials), also expressed in \$.

The equipment price includes the manufacturing cost of equipment multiplied by different markups. A first markup, “the baseline manufacturer markup”, converts the manufacturing cost to a manufacturer selling price, which is the price charged by manufacturers to either a wholesaler/distributor or a very large customer for existing equipment. All associated retail markups and applicable sales tax markup together are then multiplied and expressed as the “overall markup”. The overall markup in turn is multiplied by a “baseline manufacturer selling price” to attain the price paid by the customer as stated in Equation (2.14):

$$EP = OMU \times BMU \times MFC \quad (2.14)$$

Where

OMU Overall markup.
BMU Baseline manufacturer markup
MFC Manufacturing cost

The installation cost is the price to the customer of labor and materials (other than the actual equipment) needed to install the refrigeration equipment. Installation costs were derived for commercial refrigeration equipment from data provided by the DOE based on RS Means Mechanical Cost Data.3. RS Means provides estimates on person-hours required to install

commercial refrigeration equipment and labor rates associated with the type of crew required to install the equipment [DOE07].

The installation cost is then calculated by multiplying the number of person-hours by the corresponding labor rate. Since labor rates vary significantly from one region to another, the regional variability is taken into account and is expressed in terms of cost indices for 50 states as shown in Table 2.33.

The total installed cost is therefore expressed as shown in Equation (2.15):

$$IC_{CA} = OMU \times BMU \times MFC + InstC_{USA} \times \frac{II_{CA}}{II_{USA}} \quad (2.15)$$

where *II* represents the cost installation index and CA refers to California. This method is applied to display cases and self contained categories defined in section 1.4.

Table 2.33 Installation cost indices (national average value = 100).

| State | Index | State | Index | State | Index |
|-------------------|-------|----------------|-------|----------------|-------|
| Alabama | 65.4 | Kentucky | 73.2 | North Dakota | 67.0 |
| Alaska | 117.1 | Louisiana | 60.9 | Ohio | 103.0 |
| Arizona | 79.1 | Maine | 76.9 | Oklahoma | 67.3 |
| Arkansas | 53.7 | Maryland | 92.1 | Oregon | 115.3 |
| California | 123.8 | Massachusetts | 123.1 | Pennsylvania | 128.5 |
| Colorado | 88.3 | Michigan | 112.3 | Rhode Island | 120.9 |
| Connecticut | 111.7 | Minnesota | 122.8 | South Carolina | 42.6 |
| Delaware | 125.1 | Mississippi | 41.6 | South Dakota | 40.1 |
| Dist. of Columbia | 97.7 | Missouri | 104.0 | Tennessee | 75.2 |
| Florida | 64.8 | Montana | 80.9 | Texas | 66.7 |
| Georgia | 67.3 | Nebraska | 83.7 | Utah | 76.6 |
| Hawaii | 126.6 | Nevada | 113.1 | Vermont | 73.6 |
| Idaho | 78.5 | New Hampshire | 91.9 | Virginia | 70.8 |
| Illinois | 129.1 | New Jersey | 132.3 | Washington | 109.8 |
| Indiana | 91.7 | New Mexico | 78.3 | West Virginia | 93.5 |
| Iowa | 85.6 | New York | 166.3 | Wisconsin | 99.3 |
| Kansas | 75.0 | North Carolina | 46.4 | Wyoming | 56.4 |

2.4.1.3 Operating cost

The operating cost includes the equipment energy consumption, repair cost associated with component failure, and maintenance cost for equipment operation as expressed in Equation (2.16) :

$$OC = EC + RC + MC \quad (2.16)$$

- OC Operating cost, expressed in \$,
- EC Energy cost associated with operating the equipment, in \$,
- RC Repair cost associated with component failure, in \$,
- MC Service cost for maintaining equipment operation, in \$,

Several primary inputs are needed to evaluate the operating cost such as: the lifetime, discount rate, electricity prices, and electricity price trends.

Equipment energy consumption

The equipment energy consumption is the site energy use associated with the use of commercial refrigeration equipment. Although there are potentially some minor interactive effects on the overall heating and cooling of the building, for purposes of the ANOPR (Advanced

Notice for Proposed Rulemaking), the LCC analysis includes only the use of electricity by the equipment itself. This approach is consistent with most other DOE equipment efficiency rulemakings.

Maintenance costs

The maintenance cost is the cost to the consumer associated with general maintenance, such as checking and maintaining refrigerant charge levels, cleaning heat exchanger coils,... Annualized maintenance costs for commercial refrigeration equipment were taken from DOE reports based on RS Means Facilities Maintenance & Repair Cost Data [DOE07]. RS Means provides estimates on the person-hours, labor rates, and materials required to maintain commercial refrigeration equipment.

Maintenance costs include both preventive activities and lighting maintenance. For commercial display cases, preventive maintenance activities expected to occur on a semi-annual basis include the following actions: cleaning evaporator coils, drain pans, fans and intake screens; lubricating motors; inspecting door gaskets and seals, and lubricating hinges; cleaning condenser coils; checking refrigerant pressures and compressor oil as necessary; checking starter panels and controls; and checking defrost system operation. However, these activities were not broken into separate line-item maintenance activities since no detailed data were available.

A single figure of \$156/yr (in 2008 \$) for preventive maintenance activities is applied for all commercial refrigeration (DOE value). Moreover, preventive maintenance costs remain constant as equipment efficiency increases since no data were available to indicate how maintenance costs vary with equipment efficiency level.

Lamp replacements and other lighting maintenance activities are considered apart from preventive maintenance and are required for commercial refrigeration equipment. Because the lighting configurations can vary by equipment class and efficiency level, the relative maintenance cost are estimated for each case type and lighting technology. The frequency of failure and replacement of individual lighting components are estimated based on DOE report [DOE07], then an annualized maintenance cost is defined as the sum of the total lighting maintenance costs (in 2008 \$) over the estimated equipment lifetime divided by the estimated equipment lifetime.

Lifetime estimates for particular components were as follows:

- Fluorescent lamps would be replaced every 24 months in a preventive mode
- Fluorescent lamp ballasts would be replaced once over the estimated 10-year life of the equipment based on a typical ballast life of 80,000 hours
- LED lamps would be replaced once over the estimated 10-year life of the equipment based on a typical fixture life of 50,000 hours.

Repair costs

Those costs cover the labor and materials costs associated with repairing or replacing components that have failed. The repair cost is the cost to the consumer for replacing or repairing components in the commercial refrigeration equipment that have failed. The annualized repair cost for baseline energy consumption commercial refrigeration equipment (i.e., the cost the customer pays annually for repairing the equipment) is based on Equation (2.17) developed by the DOE:

$$RC = k \frac{EP}{N} \quad (2.17)$$

Where

- k Fraction of the equipment price (a value of 0.5 was assumed)
- EP Equipment price expressed in \$
- N Average lifetime of the equipment in years (a value of 10.0 years was assumed).

Since no data were available to indicate how repair costs vary with equipment efficiency level, they were taken constant.

Lifetime

Lifetime t expresses the age at which the commercial refrigeration equipment is retired from service. A typical lifetime of 10 years is appropriate for commercial refrigeration equipment based on [DOE07] and discussion with experts.

Discount rate

The discount rate “ r ” expresses the rate at which future costs are discounted to establish their present value. The discount rate varies accordingly with economic sectors and store categories. Based on [DOE07], a discount rate of 4.76% is considered after deducting expected inflation from the cost of capital.

Electricity prices

Electricity prices used in the analysis are the price per kilowatt-hour in cents or dollars (e.g., cents/kWh) paid by each customer for electricity. Because of the wide variation in electricity consumption patterns, wholesale costs, and retail rates across the US, regional differences in electricity prices were considered. Electricity prices are determined using average commercial electricity prices in each state, as determined from Energy Information and used by the Department of Energy of the US government. Table 2.34 provides data on the adjusted electricity prices for different states.

Table 2.34 Commercial electricity prices cents/kWh ([DOE07]).

| State | Commercial Electricity Price | State | Commercial Electricity Price | State | Commercial Electricity Price |
|---------------|------------------------------|----------------|------------------------------|----------------|------------------------------|
| Alabama | 7.32 | Kentucky | 5.73 | North Dakota | 6.02 |
| Alaska | 11.20 | Louisiana | 7.92 | Ohio | 8.06 |
| Arizona | 7.57 | Maine | 11.04 | Oklahoma | 6.82 |
| Arkansas | 5.91 | Maryland | 7.42 | Oregon | 6.81 |
| California | 13.01 | Massachusetts | 11.18 | Pennsylvania | 9.20 |
| Colorado | 7.05 | Michigan | 8.06 | Rhode Island | 10.77 |
| Connecticut | 10.60 | Minnesota | 6.54 | South Carolina | 7.27 |
| Delaware | 7.81 | Mississippi | 7.74 | South Dakota | 6.44 |
| Dist. of Col. | 7.85 | Missouri | 6.17 | Tennessee | 7.13 |
| Florida | 7.62 | Montana | 7.31 | Texas | 8.37 |
| Georgia | 7.11 | Nebraska | 6.20 | Utah | 5.96 |
| Hawaii | 16.04 | Nevada | 9.38 | Vermont | 12.05 |
| Idaho | 5.94 | New Hampshire | 10.99 | Virginia | 6.13 |
| Illinois | 7.79 | New Jersey | 9.72 | Washington | 6.48 |
| Indiana | 6.54 | New Mexico | 7.85 | West Virginia | 5.82 |
| Iowa | 6.67 | New York | 13.80 | Wisconsin | 7.44 |
| Kansas | 6.85 | North Carolina | 7.10 | Wyoming | 6.13 |

Furthermore, DOE recognized that different kinds of businesses typically use electricity in different amounts at different times of the day, week, and year, and therefore face different effective prices. To make this adjustment, average prices paid by the four kinds of businesses were identified and considered in this analysis compared with the average prices paid by all commercial customers.

$$Eprice_{Bld,CA} = Eprice_{CA} \times \frac{Eprice_{Bld,USA}}{Eprice_{USA}} \quad (2.18)$$

Where

- $Eprice_{Bld,CA}$ average commercial sector electricity price in a specific building in California in year 2008
- $Eprice_{CA}$ average commercial sector electricity price in California in year 2008
- $Eprice_{Bld,USA}$ national average commercial sector electricity price in the considered building
- $Eprice_{USA}$ national average commercial sector electricity price.

Table 2.35 shows the derivation of electricity price ratios for different businesses/building types.

Table 2.35 Electricity price ratios for different businesses ([DOE07]).

| Business type | Grocery/ Store food | Convenience store | Convenience store with gas station | Other | All food sales | All Commercial buildings |
|--|------------------------|----------------------|---------------------------------------|-------|-------------------|-----------------------------|
| Electricity Price (cents/kWh) | 7.2 | 8.6 | 7.7 | 8.2 | 7.6 | 7.8 |
| Ratio of electricity price to average price for commercial buildings | 0.92 | 1.10 | 0.99 | 1.05 | 0.97 | 1.00 |

Electricity price trends

The electricity price trend provides the relative change in electricity prices for future years out to year 2017 corresponding to a lifetime of 10 years considered for this study. The EIA's Annual Energy Outlook AEO 2006 reference case is applied to forecast future electricity prices for the LCC analysis presented in this work. Figure 2.11 illustrates the electricity price trend.

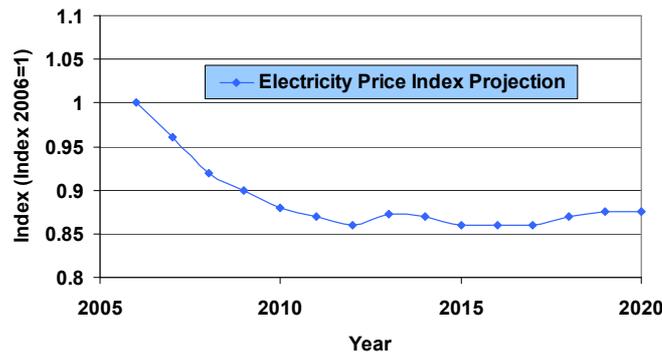


Figure 2.11 Electricity price trend out to year 2020 ([DOE07]).

2.4.1.4 Pay Back Period (PBP)

The PBP (Pay Back Period) is the change in purchase cost due to an increased efficiency standard divided by the change in annual operating cost that results from the standard. It represents the number of years it will take the customer to recover the increased purchase cost through decreased operating costs. In the calculation of PBP, future costs are not discounted.

Inputs to PBP analysis are categorized as presented for the LCC analysis, i.e. inputs for establishing the total installed cost and inputs for calculating the operating cost.

Numerically, the PBP is the ratio of the increase in purchase cost (i.e., from a less efficient design to a more efficient design) to the decrease in annual operating expenditures. The Equation (2.19) shows PBP expression:

$$PBP = \frac{\ln\left(\frac{\Delta OC}{\Delta IC}\right) - \ln\left(\frac{\Delta OC}{\Delta IC} - \frac{r - apel}{1 + apel}\right)}{\ln\left(\frac{1+r}{1+apel}\right)} \quad (2.19)$$

where

PBP Payback period in years,

ΔIC Difference in the total installed cost between a more efficient equipment and baseline equipment,

ΔOC Difference in annual operating costs,

r discount rate,

apel Actualization rate of the electricity price.

Payback periods are expressed in years. Payback periods greater than the life of the product mean that the increased total installed cost of the more efficient equipment is not recovered in reduced operating costs over the life of the equipment. Hence, The PBP can be computed only when the following condition is fulfilled (Equation (2.20)):

$$\frac{\Delta OC}{\Delta IC} = \frac{OC_{Base} - OC_{Efficient}}{IC_{Efficient} - IC_{Base}} > \frac{r - apel}{1 + apel} \quad (2.20)$$

In the present work, two LCC analyses are conducted. The first one aims at defining the optimal aggregation of technical options for energy savings in a supermarket. The second analysis establishes the distribution of LCC differences between the baseline refrigerating system (direct expansion) and other systems (distributed and secondary loop systems).

2.4.2 Life cycle cost assessment (LCCA) of the technical options in an aggregated model

This section presents LCC results for higher efficiency and energy saving options specified in the previous intermediate report. A screening analysis was conducted in order to choose the technologies to be evaluated, and implemented as design options in the energy consumption model. The investigated design options are:

- Higher efficiency lighting and ballasts for equipment families (LED lighting),
- Closing open display cases with glass doors,
- Higher efficiency evaporator fan motors (ECM motors),
- Defrost cycle control,
- Anti-sweat heater control,
- Installing night shields for open display cases.

First, baseline case LCC and each technical option LCC are calculated separately, and then aggregated models of technical options are studied. For a given option, LCC is calculated according to the methodology presented in section 2.4.1. Hence, the impact of applying a technical option to baseline equipment is evaluated in terms of total installed cost and operating cost.

2.4.2.1 Baseline scenario

Before evaluating incremental cost induced by applying energy saving options, the baseline supermarket LCC must be evaluated. The DOE provided in its Technical Support Document for commercial refrigeration the baseline equipment price, maintenance, repair, and installation costs [DOE07]. Therefore, the Commercial Refrigeration Equipment Families defined in the intermediate report were compared to the families defined in the DOE document in order to define corresponding cost and prices.

illustrates commercial refrigeration display case families and detailed costs used to establish the LCC analysis.

Table 2.36 Display cases categories and corresponding installed and operating costs [DOE07].

| DESCRIPTION | | | INSTALLED COST | | | | OPERATING COST | | | | | | | Symbol |
|----------------------|--------|----------|----------------|---------|------------|---------|----------------|---------|---------|---------|--------------|---------|--------------|--------|
| Position | Family | T° level | MSP (\$) | EP (\$) | InstC (\$) | IC (\$) | RC (\$) | PM (\$) | LM (\$) | MC (\$) | EC (\$/2008) | OC (\$) | | |
| Vertical | Open | Medium | 3944 | 5478 | 365 | 6118 | 274 | 156 | 132 | 288 | 1807 | 2369 | DC-1/ DC-10 | |
| Vertical | Open | Low | 6636 | 9217 | 365 | 9857 | 461 | 156 | 43 | 199 | 4671 | 5331 | DC-6 | |
| Vertical | Closed | Medium | 6546 | 9092 | 365 | 9742 | 455 | 156 | 70 | 226 | 893 | 1574 | DC-2 / DC-14 | |
| Vertical | Closed | Low | 6664 | 9256 | 365 | 9906 | 463 | 156 | 96 | 252 | 1964 | 2679 | DC-7 | |
| Semi-Vertical | Open | Medium | 3890 | 5403 | 365 | 6043 | 270 | 156 | 88 | 244 | 1307 | 1821 | DC-3 | |
| Service Over Counter | Closed | Medium | 7960 | 11056 | 365 | 11696 | 553 | 156 | 73 | 229 | 1240 | 2022 | DC-12 | |
| Horizontal | Open | Medium | 3922 | 5448 | 365 | 6087 | 272 | 156 | 0 | 156 | 254 | 683 | DC-5 / DC-9 | |
| Horizontal | Open | Low | 4134 | 5742 | 365 | 6382 | 287 | 156 | 0 | 156 | 1375 | 1818 | DC-13 | |

| | |
|---|--|
| EC: energy cost associated with equipment operation | EP: equipment price |
| IC: total installed cost | InstC: installation cost |
| LM: lighting maintenance. | MC: service cost for maintaining equipment operation |
| MSP: manufacturer selling price | OC: operating cost |
| PM: preventative maintenance costs | RC : repair cost associated with component failure |

2.4.2.2 Technical options for energy savings

A number of technologies that could potentially be used to improve the efficiency of commercial refrigeration equipment was considered to evaluate energy savings in commercial refrigeration. These include higher efficiency lighting, higher efficiency fan motors, defrost cycle control, anti sweat heater control, and door installation for open display cases (except for display cases dedicated for vegetables and fruits).

Higher efficiency lighting (LED)

Higher efficiency lighting leads to energy savings in two ways: less energy is used directly for lighting, and less heat energy is dissipated into the refrigerated case by lamps. The most recent trend in case lighting is the use of light emitting diode (LED) technology that allows comparable product illumination with less total wattage. Therefore, LED technology will be considered to evaluate energy savings from lighting.

Higher efficiency evaporator fan motors (ECM)

The electronically commutated permanent magnet motor (ECM), a three-phase electric motor, is more energy efficient than either shaded pole or PSC motors but ECM motors are more

expensive than equivalent PSC motors. ECM motors are regarded in this report as an energy saving technical option, and energy savings induced are evaluated.

Anti-sweat heaters controllers (ASH)

Anti-sweat heating is necessary to prevent moisture condensation on surfaces of display cases, whose temperature can drop below ambient dew point. Anti-sweat heating controllers match the on-time of the anti-sweat heaters to the anti-sweat heating requirements imposed by the ambient humidity, reducing energy consumption when the ambient humidity is low.

Defrost Cycle Control

As the air in the refrigerated space is cooled, water vapor condenses on the evaporator coil surface. In refrigerators and freezers, where evaporator coil is below 32°F, this water freezes, forming a growing frost layer, increasing the thermal resistance to heat transfer from the coil to the air, reducing thus the cooling performance. Among available defrosting mechanisms, electric defrost is investigated in this study. It involves melting frost by briefly turning on an electric resistance heater, near or in contact with the evaporator coil. However, for energy saving purposes, defrost cycle control is needed to minimize energy required for defrosting. Defrost cycle control considered in this report involves management of the initiation and termination of defrost cycles, and thereby the frequency and duration of defrosting cycles according to frost conditions determined by temperature sensors.

Door installation for open display cases

Refrigerated display cases without doors allow consumers easy access to products while maintaining temperatures that ensure food safety. The heat load of such cases is dominated by entrainment of warm and moist air into the case (called infiltration). Reduction in total case energy consumption can be achieved by installing doors for open display cases whenever possible, in order to reduce the infiltration load as well as the induced frost formation on the evaporator coil.

2.4.2.3 Total installed cost

The total installed cost equals the customer equipment price plus the installation price. Therefore, implementing a new option may incur incremental costs on either equipment price, installation cost or on both. These cost increases are based on data taken from technical literature. Table 5.4 illustrates, for each energy saving option, the corresponding incremental cost to be added to equipment price and installation cost as well as the reference where these values are taken from. Blank cells in Table 2.37 mean no incremental cost is incurred.

It should be noted that installation cost does not taken into account the cost of replacing baseline options by energy saving ones.

Table 2.37 Impact of energy saving options on total installed cost.

| Technical Options | Equipment price | Installation cost | Reference |
|---------------------------|--|--------------------------|------------------------|
| <i>LED Lighting</i> | Increase of 53\$ | | [CCR08], [SMA08] |
| <i>ECM motors</i> | Increase of 50\$ | | [ACE04] |
| <i>ASH control</i> | Increase of 14 \$/ft of cabinet length | | [PGE07] |
| <i>Doors Installation</i> | Replace by equivalent equipment with doors | | Results of Simulations |
| <i>Night Shield</i> | Increase of 204 \$/m of cabinet length | | [PGE07] |
| <i>Defrost Control</i> | Increase of 14 \$/ft of cabinet length | | [CCR08] |

2.4.2.4 Total operating cost

The operating expenses include repair and maintenance costs as well as energy consumption cost. The energy consumption of commercial refrigerating equipment is based on the model developed and presented in Section 0. Table 2.38 shows the impact of applying energy saving options on maintenance, repair, and energy costs as well as references where these values are taken from.

Table 2.38 Impact of implementing higher efficiency options on operating cost.

| Technical option | Baseline case | Repair Cost | Preventive Maintenance Cost | Lighting maintenance | Energy Cost |
|---------------------------|--------------------------------|------------------------|------------------------------------|-----------------------------|---------------------------|
| <i>LED Lighting</i> | T8 linear fluorescent lighting | Lower repair frequency | | Lower maintenance frequency | Lower lighting power |
| <i>ECM motors</i> | Brushless DC motors | | | | Lower fan consumption |
| <i>ASH control</i> | No ASH control | | | | Lower energy consumption |
| <i>Doors Installation</i> | Left open cases | | | | Modify supermarket layout |
| <i>Night Shield</i> | NO night shield | | | | Lower energy consumption |
| <i>Defrost Control</i> | NO defrost control | | | | Lower energy consumption |

2.4.2.5 Centralized system energy consumption

Table 2.39 Energy consumption evaluation for possible energy saving options.

| DC description | Baseline W/mL | Baseline W/m³ | LED | ECM | ASH Control | Defrost Control | Doors Installation | Combined Options |
|-----------------------|----------------------|---------------------------------|------------|------------|--------------------|------------------------|---------------------------|-------------------------|
| <i>VOPMT</i> | 905 | 464 | 7% | 3% | 0% | 1% | 44% | 57% |
| <i>SVOPMT</i> | 662 | 445 | 9% | 5% | 0% | 1% | 47% | 65% |
| <i>HOPMT</i> | 410 | 653 | 14% | 7% | 0% | 2% | 10% | 34% |
| <i>VOPLT</i> | 2435 | 1015 | 2% | 1% | 3% | 0% | 75% | 80% |
| <i>SVOPLT</i> | 1800 | 1071 | 3% | 2% | 4% | 0% | 73% | 80% |
| <i>HOPLT</i> | 801 | 598 | 7% | 4% | 1% | 1% | 56% | 68% |
| <i>VGDMT</i> | 411 | 194 | 14% | 7% | 9% | 0% | 0% | 30% |
| <i>SVGDMT</i> | 385 | 283 | 15% | 8% | 9% | 0% | 0% | 29% |
| <i>VGDLT</i> | 603 | 142 | 10% | 5% | 6% | 0% | 0% | 18% |
| <i>HGDLT</i> | 342 | 380 | 17% | 9% | 3% | 0% | 0% | 26% |

Table 2.40 Break down of a supermarket energy consumption due to centralized refrigeration system.

| SUPERMARKET | Centralized System Energy Consumption | | | | | | |
|--|--|------------|------------|------------|------------|--------------|-----------------|
| DC description | Baseline | LED | ECM | ASH | DEF | Doors | Combined |
| <i>DC Supermarket Consumption (kWh)</i> | 166 | 140 | 153 | 158 | 164 | 143 | 92 |
| <i>DC Energy Consumption reduction (%)</i> | 0% | 15% | 8% | 5% | 1% | 14% | 44% |

Where

ASH: anti-sweat heat controller

DEF: defrost cycle control

Doors: add doors to open cases

ECM: higher efficiency evaporator fan motor
 GD: glass door
 H: horizontal
 LED: higher efficiency lighting from light-emitting diodes
 LT: low temperature
 MT: medium temperature
 V: vertical
 OP: open
 SV: semi-vertical

The thermal load of display cases found in a typical supermarket is calculated using the analytical model presented in Section 0. Results for the baseline are summarized in Table 2.40 in terms of heat load per meter of display case (second column), then per m³ of refrigerated volume (third column). Table 2.40 summarizes the relative energy gains for each type of refrigerated display case, taking into account the improvement of each technical option, and then combining the options where it can be seen that the integration of all options is different of the sum of each. For example, an energy consumption reduction of 57% can be achieved for vertical open medium temperature case (VOPMT) when combining all options (Table 2.40).

For a baseline scenario, an hourly energy consumption of 166 kWh is calculated. Combining all of the presented options and taking into account the type of display cases defined for a typical Californian supermarket, can reduce the energy consumption of display cases by 44% (Table 2.40).

The effect of door installation is highlighted in Figure 2.12 where the contribution of energy saving option is plotted, for both vertical and horizontal open display cases, medium and low temperature equipment.

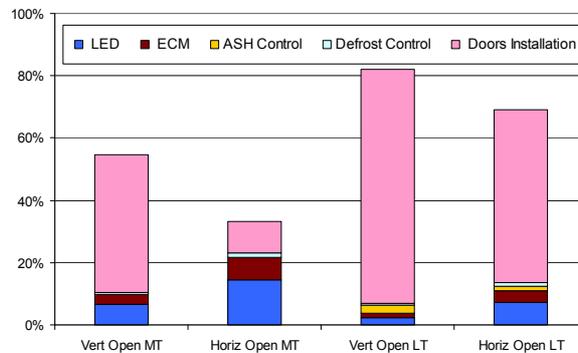


Figure 2.12 Energy saving option contribution to equipment energy consumption.

Figure 2.13 shows the energy saving breakdown for closed display cases. It appears that the heat load can be reduced by approximately 30% for these display cases. Most of this energy saving is due to LED lighting systems as one can see on Figure 2.13.

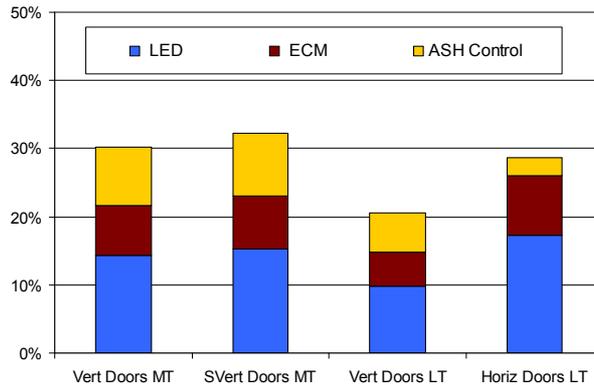


Figure 2.13 Energy savings breakdown for closed display cases.

2.4.2.6 Results of LCC analysis

The LCC analysis is conducted for a typical supermarket with a layout presented in Section 1.5. Assuming 10-year lifetime for all commercial refrigerating equipment of this layout, the LCC of a supermarket is obtained by summing the LCC of each refrigerating equipment.

After defining initial prices, costs, and possible energy savings for each commercial refrigerating equipment found in the layout, the equipment LCC and corresponding PBP are evaluated according to the LCC and PBP equations previously described in this section, and presented in Table 2.41.

Table 2.41 LCC and PBP of investigated technical options for a typical supermarket layout.

| Commercial Refrigeration Equipment Options | PBP (years) | LCC (\$) |
|---|--------------------|-----------------|
| <i>Baseline</i> | 0 | 3,130,402 |
| <i>LED Lighting</i> | 0.3 | 2,923,013 |
| <i>ECM Fan Motors</i> | 0.5 | 3,039,767 |
| <i>ASH control</i> | 1.8 | 3,081,110 |
| <i>Installing Doors</i> | 3.2 | 3,010,195 |
| <i>Defrost Control</i> | 3.7 | 3,117,375 |

Once the options are evaluated separately, the LCC of aggregated options are estimated. For the aggregated models, technical options are successively implemented according to an increasing PBP. Figure 2.14 shows the LCC distribution for different tested aggregated models. It appears that applying LED lighting, ECM fan motors, and installing doors, controlling anti-sweat heater and defrost mechanisms are profitable since a decreasing tendency is observed and the lowest LCC is calculated.

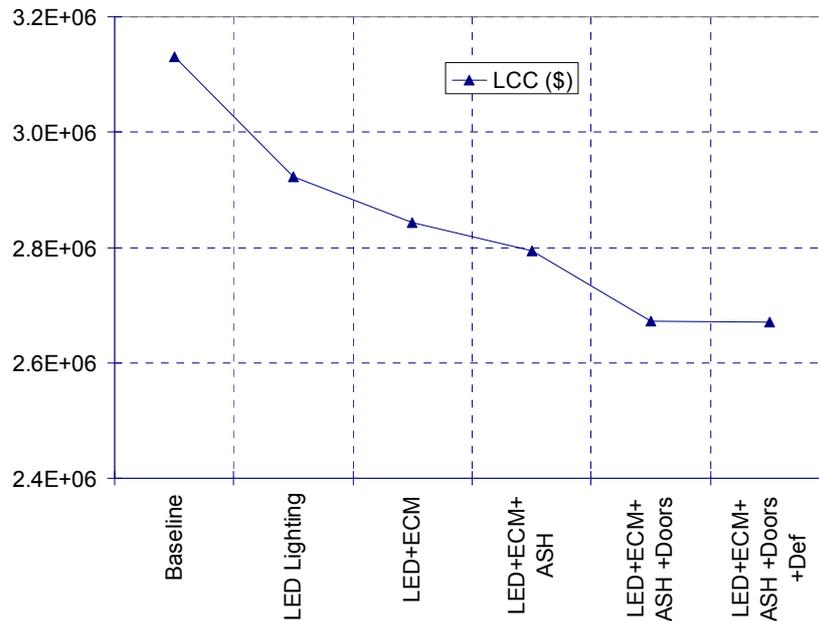


Figure 2.14 LCCA of a supermarket over a 10-year lifetime.

Applying all of the investigated energy saving options, the complete aggregated model allowed 17% savings on the LCC when compared to the baseline scenario.

2.4.3 LCCA of direct and indirect centralized systems

2.4.3.1 Description of technical options

A second LCC analysis is performed to define the most appropriate refrigerating system in terms of energy efficiency and costs. To begin with, a state of the art review is conducted in order to screen existing refrigeration systems and choose systems to be investigated in the LCCA.

Typical supermarket refrigeration systems consist of direct expansion air/refrigerant coils located in display cases and walk-in coolers. Compressors are located in a machine room, in a remote part of the refrigerated store, either in the back area or on the roof. Condensers are located either in the machinery room, or more likely, on the roof above the machinery room. Piping is connecting back and forth between the machinery room and the refrigerating equipment for refrigerant circulation either in liquid phase or in vapor phase (see Figure 2.16).

The difference between a secondary loop and a direct expansion refrigeration system is that the refrigeration of display cases and walk-in coolers is provided by a chilled secondary fluid called heat transfer fluid (HTF), pumped from a primary heat exchanger in the machinery room where the refrigerant evaporates and cools the HTF to the display cases (see Figure 2.19).

The most commonly used secondary fluid in both commercial and industrial applications is mono-propylene glycol (MPG) for medium temperature racks, but in the last 10 years a number of other products have been proposed based for example on acetate formiate. CO₂ is a promising heat transfer fluid for low temperature units. These two HTFs will be used thereafter to evaluate secondary loop performances and to carry out an LCC analysis.

Five refrigeration systems are investigated in the second LCC analysis. In addition to the multiplex direct expansion system and the distributed expansion system, three secondary loop refrigeration systems are described. The comparative study is conducted for a typical supermarket of 4,400 m² (47,360 ft²).

The first step of the analysis consists of evaluating the heat load of a supermarket. The input power required by compressors for those load conditions is then calculated for each temperature bin (low and medium-temperature racks) and the number of operating compressors is inferred.

The typical Californian supermarket includes two low-temperature racks and two medium-temperature racks. Display cases and coolers are grouped and connected to compressors racks according to the required saturated suction temperature (SST) to maintain the desired case temperature. In the following analysis, low-temperature racks will operate at -32°C (-25°F) SST whereas medium-temperature racks will operate at -10°C (+14°F) SST. Each compressor rack consists of three or four compressors sized to allow compressors, operating simultaneously, providing the cooling capacity that meets the design heat load.

For the 47,360 ft² supermarket, the refrigeration capacity is 190 kW at the medium-temperature level and about 150 kW at the low-temperature level. Assuming four compressors in each rack, the refrigerating capacity of a compressor operating at the medium-temperature level is 32 kW whereas 19-kW cooling capacity corresponds to compressors mounted on low-temperature racks.

The most common type of condensers used in supermarket refrigeration is air-cooled condensers. These condensers usually employ finned-coil construction with 8-10 fins/inch (300-400 fins/m) and multiple fans (Figure 2.15). Air-cooled condensers are known to operate reliably and require the least maintenance.



Figure 2.15 Roof-top air-cooled condenser.

Multiplex direct expansion refrigeration system

System description

The most common new direct system in supermarkets is the multiplex refrigeration system using R-404A as a working fluid. R-404A is a blend of hydrofluorocarbons that are non-ODS, but has a high-global warming potential of 3900 [IPC06]. It consists of multiple racks of compressors operating at the same saturated suction temperature with common suction and discharge refrigeration lines (one for medium temperature and another one for low-temperature racks) [BAX03a]. The term multiplex refers to the use of multiple compressors piped to a common suction and discharge manifolds, all installed on a skid containing all the necessary piping, control valves, and electrical wiring to control the compressors and the refrigeration provided to the display cases.

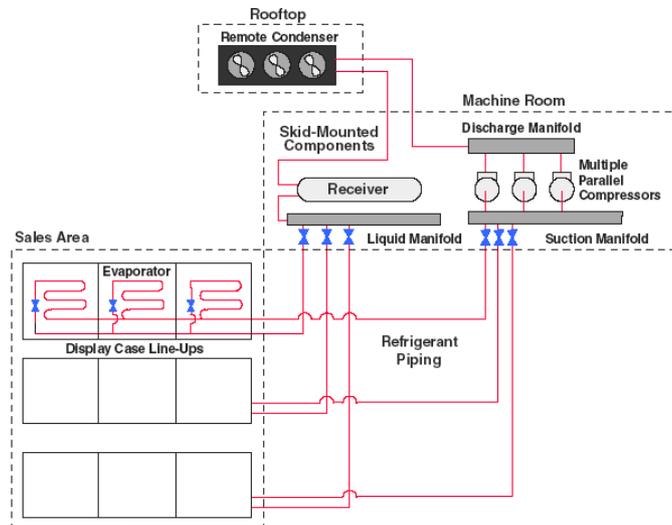


Figure 2.16 Piping diagram for the Medium Temperature Multiplex Refrigeration.

Figure 2.16 shows elements of a medium-temperature unit of a secondary loop refrigeration system. Compressor racks are installed in a machinery room with long refrigerant pipes connecting them to display cases in the sales area. The piping length can reach several hundred meters for large supermarkets, implying possible failures, fugitive emissions at joints, and pressure losses especially on the suction line. The hot gas discharge from the compressor is piped back to the remotely located condenser, which condenses gas to liquid. Liquid refrigerant is piped back to the compressor rack, where a receiver, liquid manifold, and associated control valves distribute liquid to the cases and walk-ins.

Multiplex refrigeration model

Figure 2.17 shows the diagram of the most commonly used compressor arrangement in a multiplex refrigeration system found in supermarkets. The refrigeration system configuration is described in order to evaluate its performances. Several parameters should be known beforehand such as display case evaporator temperature, minimum condenser temperature, condenser type as well as the refrigerant in use.

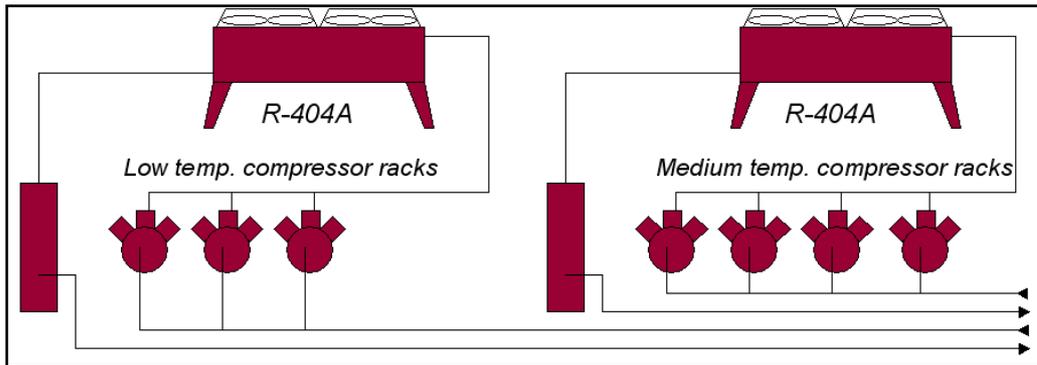


Figure 2.17 Design of a multiplex refrigeration system using R-404A.

Multiplex refrigeration state points

The refrigerant in both temperature units is R-404A. Several operating set points must be monitored for each multiplex compressor rack and for each compressor suction group.

- Saturated Suction Temperature (SST) - the saturation temperature corresponding to the refrigerant pressure measured at the compressor suction port.
- Saturated Discharge Temperature (SDT) - the saturation temperature of the refrigerant based upon the pressure measured at the compressor discharge.
- Return Gas Temperature - the refrigerant gas temperature measured at the compressor suction port.
- Refrigerant liquid temperature - the liquid temperature measured at the receiver outlet, and before and after sub-cooling heat exchangers, if installed.

Once the thermodynamic cycle points are defined, the cooling capacity and the compressor input power can be calculated based on compressor technical data supplied by manufacturers (Copeland, Carlyle, Danfoss, Bitzer...).

Operating conditions

The most significant parameter in determining condensing temperature is the temperature difference with the outdoor temperature, ΔT , since heat is rejected to the ambience. The condenser ΔT is dependent on the condenser type: for air-cooled condensers considered in this study, 8 K and 10 K are standard values of ΔT for low and medium temperatures respectively.

The fan power for remote condensers depends on the condenser type. Air-cooled condensers for low-temperature refrigeration are normally sized for a smaller temperature difference ΔT and require more fan power than condensers used with medium-temperature refrigeration [FOS04] [ORL01].

Pressure drop will occur in the suction lines (between the display-case evaporator and the compressor suction point). This pressure drop is taken into account by a lower saturated temperature value at the compressor suction port. Heat gain to the return gas will also take place and affect the refrigerant mass flow rate transferred by the compressors. Pressure drops and superheat vary depending on the distance between the display cases and the compressor racks. These factors tend to decrease the capacity of the compressor and increase the run time needed to meet the heat load. In this study, 10 K (18°F) superheat and 0.3 bar (4 psi abs) pressure drop are assumed at the compressor suction ports.

The temperature of the refrigerant in liquid phase is an important operating state point. This temperature is usually lower than the condensing temperature because the store is air-conditioned and so there is a “free” cooling of the refrigerant in the liquid lines. This “free” sub-cooling varies between 10 and 15 K. For instance, a refrigerant liquid temperature of 30°C corresponds to a condensing temperature of 45°C.

When complementary sub-cooling is realized due to refrigeration processes whose only purpose is to cool the refrigerant in its liquid phase, the liquid refrigerant leaving the sub-cooler is typically 5°C (41°F). This mechanical sub-cooling is not free and its energy consumption is taken into account in the energy consumption calculation. Nevertheless in the present analysis, no mechanical sub-cooling is taken into account. Consequently, the liquid refrigerant temperature varies from 20 to 30°C according to condensing temperature related to climatic conditions.

Distributed system with separate roof condenser

Another option for direct expansion systems is the distributed system with a separate rooftop condenser. Distributed systems may have different designs but the main concept is to install compressors in sound-proof boxes near the display cases, the condensing heat being released on a water circuit connected to dry-air coolers (as shown on Figure 2.18).

The sound-proof boxes are located within the store to provide refrigeration to a particular series of display cases, such as meat, dairy, frozen food, etc. With this arrangement, the pressure losses as well as superheat are reduced. The refrigerant suction and liquid lines are shortened in a distributed system and refrigerant charge requirement for the distributed system is reduced compared to a multiplex refrigeration system. The total refrigerant charge will be about 75% of a direct expansion multiplex system [CAG04].

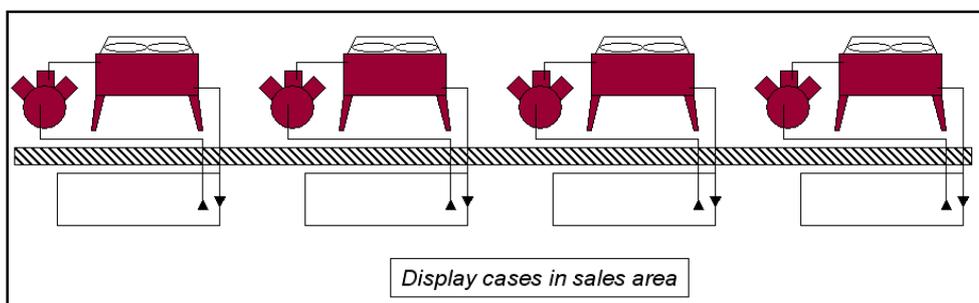


Figure 2.18 Description of the distributed refrigeration system.

Secondary Loop Refrigeration

The secondary loop consists of a HTF pumped between a central chiller and display cases. At least two fluid loops are installed in a supermarket depending on the heat load composition and temperature levels. Refrigeration with secondary loop systems has been introduced in supermarkets to decrease the refrigerant charge and to minimize potential refrigerant leakage. Secondary loop systems may have various designs with different energy efficiencies.

In the U.S., the most commonly used HTF is still MPG in both commercial and industrial refrigeration. MPG is preferred because it is inert to common piping materials and most non-metallic gaskets and seals. Nevertheless, MPG is used only for medium-temperature units: at concentrations needed for low-temperature refrigeration, its very high viscosity induces high pumping power. Consequently, other fluids, such as CO₂ are used for low-temperature units.

Secondary loop system description

Flow rates of single-phase HTF are defined by the HTF temperature change in the whole cooling circuit, typically of 4 or 5 K. Because of the high viscosity and the necessary HTF mass flow rate to provide cooling, the energy associated with pumping is substantial. But the picture is significantly different with CO₂, which is now used as a phase-change HTF: CO₂ evaporates partially in the display-case heat exchangers (typically 20% of it), so CO₂ returns at the primary evaporator where the 20% is condensed.

In a secondary loop refrigeration system, the refrigerant charge is approximately 50% lower than that of a direct expansion and consequently minimizes the pressure drop as well as the superheat on the refrigerant side. Those factors allow reducing the compressor energy consumption, but increase the HTF pumping power. Figure 2.19 illustrates the piping diagram of medium-temperature unit of a secondary loop refrigeration system.

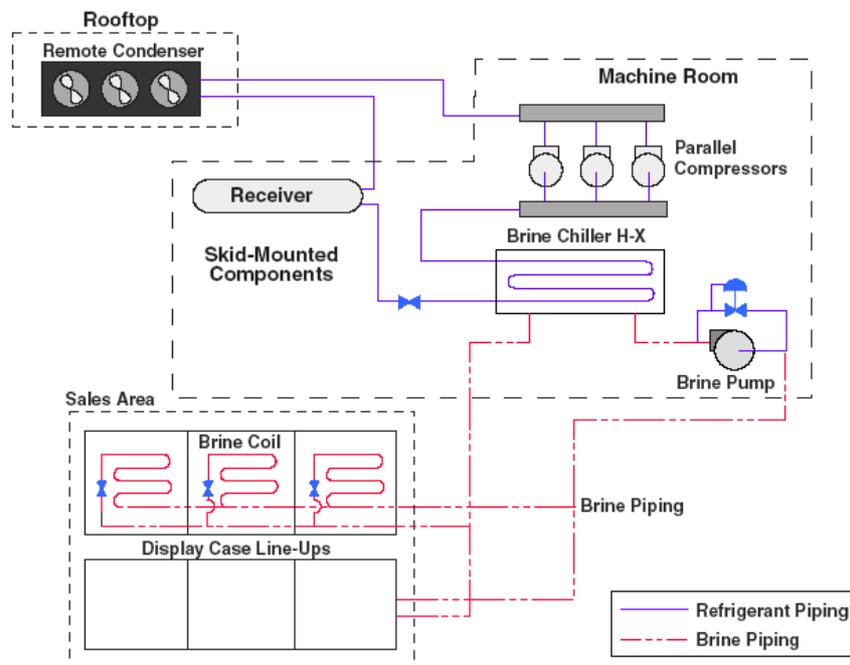


Figure 2.19 Elements of a secondary loop refrigeration for medium-temperature racks.

Note: on Figure 2.19 brine has to be understood as HTF.

Modeling of the Secondary Loop Refrigeration

The major difference in the analysis of a secondary loop refrigeration system is the operation of the secondary loop. The HTF mass flow rate (MFR) is calculated by applying Equation (2.21) when MPG is used, whereas Equation (2.22) is applied for secondary loops using vapor-liquid CO₂.

$$\dot{M}_{SF} = \frac{Q_0}{C_{SF} \Delta T_{SF}} \quad (2.21)$$

$$\dot{M}_{SF} = \frac{Q_0}{\Delta h_{SF}} \quad (2.22)$$

Where

Q_0 Heat load delivered by the secondary fluid loop (kW)

\dot{M}_{SF} HTF mass flow rate (kg/s)

ΔT_{SF} HTF temperature change in the display cases circuit

Δh_{SF} HTF Enthalpy change in the display case circuit (kJ/kg).

In the secondary loop, HTF recovers heat not only from the display cases but also along the piping due to thermal losses. A complementary heat gain is due to the operation of the secondary fluid loop pump. The power required by the pump is calculated based on HTF thermo-physical properties at the temperature level, piping length and diameter, pressure drops on all the circuit, and refrigerating capacity.

The pump input power is calculated by Equation (2.23) assuming its overall efficiency η_p is 55%.

$$W_p = \frac{\dot{M}_{SF} H_m}{\rho_{SF}} \frac{g}{\eta_p} \quad (2.23)$$

where H_m refers to required pump head expressed in Water Column (WC). The subscript p stands for pump.

Thermodynamic cycle points of the refrigerating system are determined. The evaporating temperature at the primary evaporator is set at 5 K below the HTF exit temperature. The refrigerant superheat is set at 10 K.

For air-cooled condensers considered in this study, the temperature difference between the condensing temperature and the outdoor temperature, ΔT , is 8 K and 10 K for low and medium-temperatures respectively.

Pressure drop of the refrigerant vapor to the compressor suction is lower than pressure drop in multiplex refrigeration system due to the close coupling of the compressors and heat exchangers. This pressure drop is set at 0.2 bar (2.9 psi abs.).

Investigated secondary loop refrigeration systems

Secondary loop design with completely indirect refrigeration system

CO₂ is used as a HTF in the low-temperature system whereas MPG is used for medium-temperature system. The MPG temperature at the exit of the primary evaporator is -8°C and the return temperature -5°C.

For the MPG loop, the required pump head is set at 23 m WC (Water Column). For CO₂, the required pump head is set at 15 m WC [FOS04] [ORN01].

Figure 2.20 shows a diagram of the 2 secondary loops and the associated refrigeration systems for medium and low-temperatures.

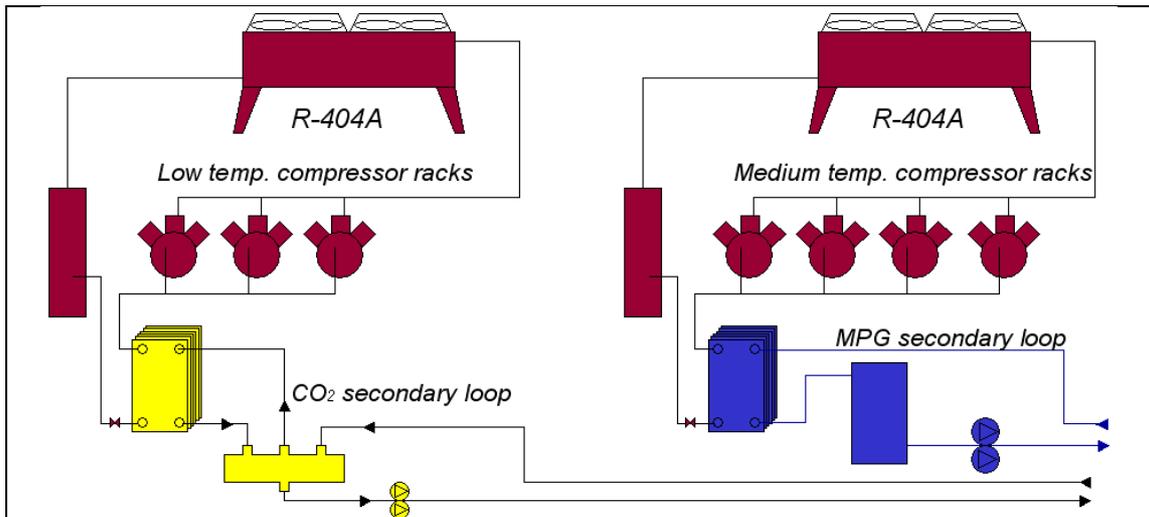


Figure 2.20 Secondary loop refrigeration system using MPG and CO₂ for medium and low-temperature racks respectively.

Indirect system with CO₂ as the only refrigerant

Another secondary loop system configuration is studied with CO₂ as the only HTF for both low and medium-temperature levels (Figure 2.21). CO₂ as a two-phase HTF is not currently used for medium-temperature systems. However, some early prototypes exist and such a solution might be developed in the near future.

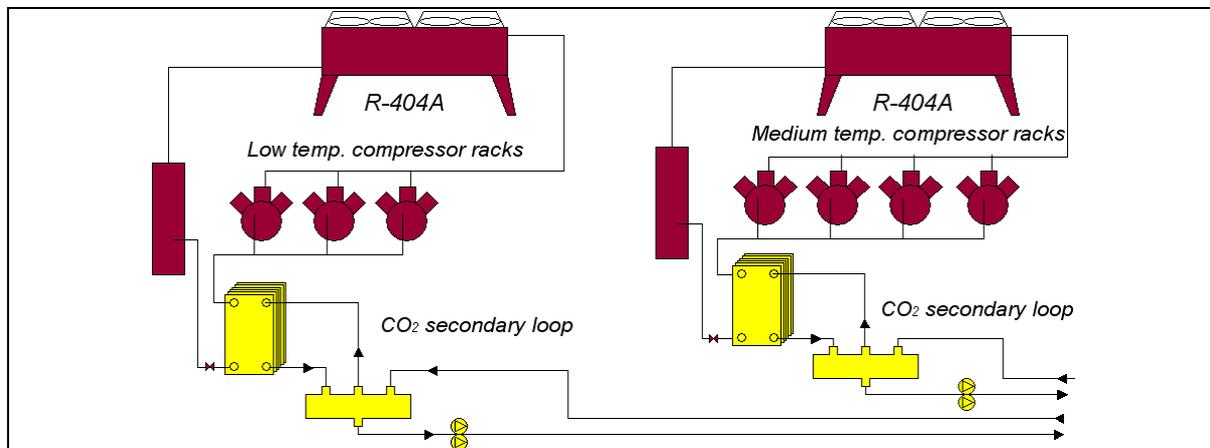


Figure 2.21 Secondary loop refrigeration system using CO₂ as the only refrigerant.

Cascade system with CO₂

The cascade system with CO₂ in the low-temperature system and a secondary loop using MPG for the medium-temperature system is an interesting solution that has been tested in several supermarkets and showed promising results [CHR99]. The HTF at the medium temperature level has a delivery temperature of about -8°C and a return temperature of -5°C.

The delivery temperature of the CO₂ in the low-temperature unit is about -32°C. Figure 2.22 illustrates the outline of a cascade system with CO₂ as secondary fluid for low-temperature unit.

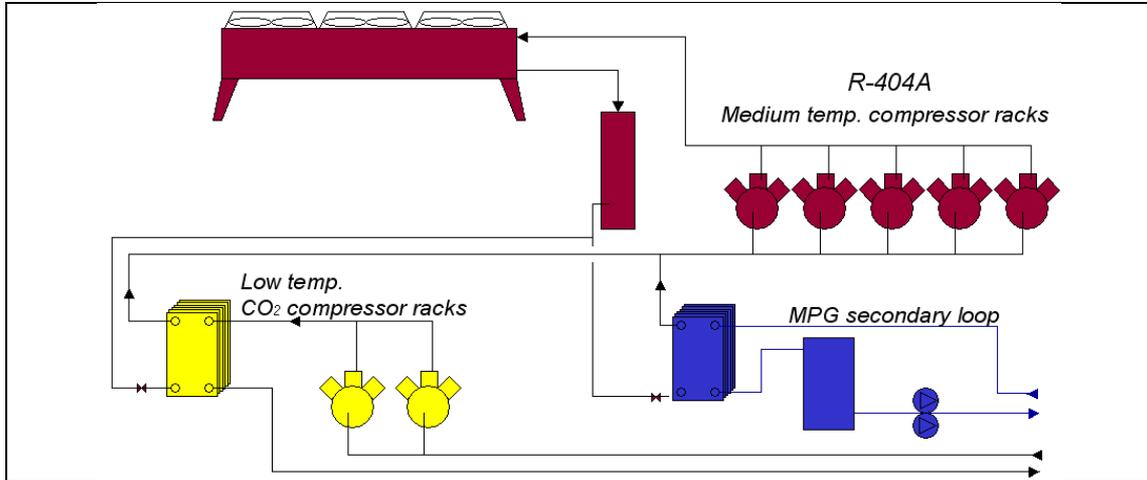


Figure 2.22 Cascade system with CO₂ in the low-temperature stage.

Table 2.42 summarizes for multiplex refrigeration, refrigerant thermodynamic cycle points, operating conditions, chosen compressors, cooling capacity, and energy consumption according to the temperature level and the refrigerant. Table 2.43 collects identical information for secondary loop systems investigated in this study, as well as the secondary fluid outgoing and return conditions at the primary heat exchanger.

Knowing operating state points and the required compressor input power, compressors for low and medium-temperature racks are chosen from manufacturers catalogs. All compressor models found in Table 2.42 and Table 2.43 are Copeland technologies except for the CO₂ cascade system compressor, which is a Bitzer technology.

Table 2.42 Multiplex refrigeration system operating conditions for two refrigerants R-22 and R-404A.

| | Refrig. | T level | SST (°C) | ΔT ₀ (K) | SDT (°C) | ΔT _k (K) | SH (K) | ΔP Suction line (K) | T Return Gas (°C) | T Liquid (°C) | ΔP Discharge line (K) | T Suction Comp (°C) | Comp. Model | Cooling Capacity (kW) | Comp. Power input (kW) | COP | Fan Power (kW) | COP _{system} |
|-----------|---------|---------|----------|---------------------|----------|---------------------|--------|---------------------|-------------------|---------------|-----------------------|---------------------|--------------------------|-----------------------|------------------------|------|----------------|-----------------------|
| Multiplex | R22 | Med | -10 | 15 | 30-45 | 10 | 10 | 3 | 7 | 20-30 | 0.5 | -13 | D4DA-200X | 32.7 | 12.7 | 2.57 | 0.635 | 2.45 |
| | | Low | -32 | 15 | 30-45 | 8 | 10 | 5 | -17 | 20-30 | 0.5 | -37 | D6TH-2000 _{SUB} | 19.25 | 15.5 | 1.24 | 0.775 | 1.18 |
| | R404A | Med | -10 | 15 | 30-45 | 10 | 10 | 2 | 8 | 20-30 | 0.5 | -12 | D3DS-100X | 32.5 | 13.7 | 2.37 | 0.685 | 2.26 |
| | | Low | -32 | 15 | 30-45 | 8 | 10 | 4 | -16 | 20-30 | 0.5 | -36 | D6TH-270X | 19.3 | 15.9 | 1.21 | 0.795 | 1.16 |

Table 2.43 Secondary loop refrigeration systems operating conditions with R-404A as a refrigerant.

| System Description | Refrig. | Sec. fluid | T level | SST (°C) | ΔT ₀ (K) | SDT (°C) | ΔT _k (K) | SH (K) | ΔP Suction line (K) | T Return Gas (°C) | T Liquid (°C) | ΔP Discharge line (K) | T suction Comp (°C) | T sec fluid (°C) | Comp. Type | Cooling Capacity (kW) | COP | Power Input (kW) | | | COP _{system} |
|---------------------|---------|------------|---------|----------|---------------------|----------|---------------------|--------|---------------------|-------------------|---------------|-----------------------|---------------------|------------------|------------|-----------------------|------|------------------|------|-------|-----------------------|
| | | | | | | | | | | | | | | | | | | Comp. | Pump | Fan | |
| SL indirect MPG-CO2 | R404A | MPG | Med | -13 | 15 | 30-45 | 10 | 10 | 3 | 4 | 20-30 | 0.5 | -16 | (-5-8) | D3DS-150X | 30.3 | 2.28 | 13.3 | 1.09 | 0.665 | 2.01 |
| | R404A | CO2 | Low | -33 | 15 | 30-45 | 8 | 10 | 3 | -16 | 20-30 | 0.5 | -36 | -28 | D6DH-350X | 20.7 | 1.28 | 16.1 | 0.09 | 0.805 | 1.22 |
| SL indirect CO2-CO2 | R404A | CO2 | Med | -13 | 15 | 30-45 | 10 | 10 | 3 | 4 | 20-30 | 0.5 | -16 | -7 | D3DS-150X | 30.3 | 2.28 | 13.3 | 0.12 | 0.665 | 2.15 |
| | R404A | CO2 | Low | -33 | 15 | 30-45 | 8 | 10 | 3 | -16 | 20-30 | 0.5 | -36 | -28 | D6DH-350X | 20.7 | 1.28 | 16.1 | 0.09 | 0.805 | 1.22 |
| Cascade CO2 | R404A | MPG | Med | -13 | 15 | 30-45 | 10 | 10 | 2 | 5 | 20-30 | 0 | -15 | (-5-8) | D6DL270 | 55.1 | 2.04 | 27 | 1.09 | 1.35 | 1.66 |
| | CO2 | - | Low | -32 | 15 | -13 | 8 | 10 | 3 | -15 | 20-30 | 0.5 | -35 | - | KP-120-2 | 19 | 5 | 3.8 | | | |

2.4.3.2 Life cycle cost assessment (LCCA) of screened refrigeration systems

The LCC of the five refrigerating systems described in previous sections are evaluated based on available data in the literature and lessons learned from the field. The methodology used is the same applied previously to define the optimal aggregated technical options, where the total installed cost and operating cost are calculated for the typical Californian supermarket.

Refrigerating system components

Major components of a refrigeration system are: compressors, condensers, evaporators, piping, display cases, and miscellaneous electronics including frequency converter, special fault interruption (FI) relay AC/DC, construction of safety circuit, compressor control, and oil control with program logic circuit (PLC).

Therefore, the total installed cost and the operating costs of each of these components will be investigated separately, and then summed together to obtain the refrigerating system installed cost and operating cost.

Lifetime and reliability

According to A.D.Little [LIT06], system compressors of supermarkets have a 10-year expected lifetime. Moreover, the typical lifetime of an air-cooled condenser is at most 10 years. Refrigerated display cases are usually replaced for merchandizing reasons prior to the end of their life and replacement occurs between 5 and 15 years, depending on the store policy. Therefore, the systems are expected to operate reliably for 10 years if properly installed and maintained [LIT96]. For the LCC estimation, the lifetime of 10 years is assumed for different refrigeration system components.

Conventional direct expansion refrigeration system

The multiplex system with air-cooled condensing is considered the baseline, since it is the most commonly installed configuration now used in supermarkets.

Total installed Cost

The total installed cost of a refrigeration system for a typical supermarket varies between 1 million and 1.1 million dollars [LIT96]. Table 2.44 shows the installed cost breakdown based on personal communication with supermarket industry representatives held by A.D.Little.

Table 2.44 Installed cost breakdown for a typical supermarket refrigeration system.

| REFRIGERATION SYSTEM COMPONENTS | INSTALLED COST SHARE |
|--|-----------------------------|
| <i>Compressors</i> | 18.0% |
| <i>Walk-in evaporators</i> | 3.0% |
| <i>Condensers</i> | 5.0% |
| <i>Miscellaneous electronics</i> | 6.0% |
| <i>Piping</i> | 2.5% |
| <i>Display cases</i> | 56.5% |
| <i>Walk- in</i> | 9.0% |

Based on the A.D. Little report on commercial refrigeration systems, the installed cost of system components are evaluated based on the breakdown of installed cost presented in Table 2.44.

Moreover, in the final report of IEA Annex 26, UK provided the cost of pipe work including installation and insulation costs: \$50,000 for direct and \$80,000 for secondary loop systems [UK03].

Table 2.45 Typical supermarket refrigeration system cost and energy consumption breakdown.

| <i>DX Components</i> | <i>Component Installed Cost (\$)</i> | <i>Component price (\$)</i> | <i>Component Installation cost (\$)</i> | <i>Energy consumption (kWh/year) -</i> |
|----------------------------------|--|---------------------------------|---|--|
| <i>Compressors</i> | 195,510 | 147,000 | 48,510 | 860,000 |
| <i>Evaporators</i> | 47,460 | 21,000 | 26,460 | 0 |
| <i>Condensers</i> | 64,050 | 42,000 | 22,050 | 99,300 |
| <i>Miscellaneous electronics</i> | 92,190 | 52,500 | 39,690 | 0 |
| <i>Piping</i> | 67,305 | 21,000 | 46,305 | 0 |
| <i>Display Cases</i> | 505,575 | 472,500 | 33,075 | 477,800 |
| <i>Walk-in</i> | 77,910 | 73,500 | 4,410 | 133,800 |
| <i>Total</i> | 1,050,000 | 829,500 | 220,500 | 1,570,900 |

Maintenance Cost

Costs for refrigeration system maintenance are roughly 0.25% of supermarket revenues. The maintenance cost for a multiplex refrigeration system is about \$75 per 100 sq.ft. of store sales area, which gives a maintenance cost of approximately \$20,000 for a typical supermarket of 27,000 sq ft [LIT96].

Investigated refrigeration systems

Investigations are based on literature reviews, expert opinions, and personal communication with supermarket industry representatives. These investigations considered the total cost of the system including cases, piping, refrigerant, brine, and labor in addition to the compressor rack or primary chiller with the exception of the condenser sub-system. It was considered identical for all of the refrigeration systems, hence no cost premium is incurred when comparing to the baseline refrigeration system.

Distributed systems

Predicted energy consumption savings for a distributed system compared to a conventional multiplex refrigeration system is 12% [BAX03a]. The estimated installed cost premiums for distributed are presented in [ORL01]. Estimates are based on actual construction budgets supplied by engineering departments of visited supermarket chains. The distributed system shows higher equipment cost when compared to conventional direct expansion system with an incremental equipment price of \$53,000. However, only a small increase in installation cost is observed and an incremental cost of \$7,000 is estimated. This can be attributed to reduced refrigeration piping cost, but also increased electrical and fluid loop costs.

Secondary loop systems

In secondary loop systems, incrementally higher costs would be incurred in several areas: additional hardware costs of the secondary loop fluid circulation pumps, fluids reservoirs, the secondary fluid itself, and the refrigerant evaporator to chill the secondary fluid. The incremental cost is estimated to \$50,000 for a typical supermarket. Different areas primarily influence the total additional charge [CHR99]:

1. The electrical board, especially influenced by the frequency converter and compressor control, and the safety circuit construction due to flammability. A.D. Little estimated an

additional cost of \$10,000 to account for alarms and emergency ventilation of the mechanical equipment room [LIT02].

2. The assembly and the construction of the refrigeration system.

In the J. Arias thesis, the investment cost of the direct system is assumed to be 10% cheaper than that of an indirect system according to Bjerkhög, who is responsible for the implementation of a new refrigeration system in the supermarket chain COOP Sweden [ARI05]. On the other hand, based on interviews with supermarket industry professionals, D.H. Walker [ORL01] estimated a cost premium associated with using a secondary loop system, because of higher equipment and installation costs. The incremental refrigeration equipment system price is approximately \$70,000; and the incremental installation cost is an additional \$77,000. Hence a total cost premium of \$147,000 is estimated.

As reported in discussions at the Annex 26 workshop [BAX03b], installation cost premiums for secondary loop approaches (using R-404A or R-507A as primary refrigerant and propylene glycol or potassium formate HTF for secondary loops) were about 15% for typical US markets. It was also noted that maintenance costs for the secondary system should be less.

The Danish country report (Volume 2) [DEN03] compares installation costs and operating efficiencies for a cascade system and R-404A DX systems. A test system installed in a small store (30-kW cooling capacity) was estimated to cost about 20% more than a traditional DX system and to have about the same energy efficiency. With more experience for installers the premium is estimated to drop under 15%. For larger systems, the premium would drop to 10%.

The British country report (Volume 2) announced an increase in overall energy consumption of 30% with the secondary loop refrigeration system. The energy use includes compressor power, condenser fan power, pumping power, and defrost energy. Most of this increase is attributed to pumping energy [UK03]. As for capital costs, the analysis showed the secondary loop system to be approximately 28% more expensive than a conventional direct system. This was confirmed by the UK experience of increased costs, between 15% and 30% for secondary systems.



| | <i>FLUID</i> | | |
|---------------------|--|--|---|
| | <i>R404A</i> (~ 300 W tot) | <i>Propylene Glycol</i> (~ 600 W tot) | <i>CO₂</i> (~ 300 W tot) |
| <i>LIQUID</i> |  $D_{in} = 25 \text{ mm}$ |  $D_{in} = 60 \text{ mm}; \text{ th.} = 20 \text{ mm}$ |  $D_{in} = 17 \text{ mm}; \text{ th.} = 10 \text{ mm}$ |
| <i>SUCTION LINE</i> |  $D_{in} = 50 \text{ mm}; \text{ th.} = 15 \text{ mm}$ |  $D_{in} = 60 \text{ mm}; \text{ th.} = 20 \text{ mm}$ |  $D_{in} = 20 \text{ mm}; \text{ th.} = 10 \text{ mm}$ |

Figure 2.23 Comparison of liquid and suction pipes for different refrigerating fluids.

Moreover, for a plant originally constructed with a CO₂ indirect system, smaller pipes could be used for the return and liquid lines, which would compensate for the cost of the additional equipment in the secondary loop and needed safety devices [GIR03]. Figure 2.23 shows the different sizes and insulations of suction and liquid pipelines for different working fluids.

[CHR99] showed that for a cascade system using CO₂ in the low temperature system and a secondary loop using MPG for the medium temperature system, the energy consumption of a secondary loop system decreased by about 5% compared to a conventional supermarket while the investment was 20% higher.

Based on these data and on expert opinions, energy savings and cost premiums for secondary loop and distributed systems are estimated. Table 2.46 through Table 2.49 illustrate the total installed, equipment price, installation cost as well as energy consumption for each of the 5 investigated refrigeration systems.

In the following tables:

- DX: conventional direct expansion system
- DIST: distributed system with separate rooftop condenser
- SL MPG+ SL CO₂-: secondary loop system with MPG for medium-temperature system and CO₂ for the low-temperature system
- SL CO₂ + - : secondary loop systems with CO₂ as the only refrigerant for both low and medium-temperature systems
- Cascade CO₂- MPG+ : cascade system with CO₂ in low temperature system and secondary loop with MPG for medium temperature system.

Table 2.46 Total installed cost for the 5 refrigeration system components.

| Refrigeration system Components | <i>DX</i> | <i>DIST</i> | <i>SL MPG+ SL CO₂-</i> | <i>SL CO₂ + -</i> | <i>CASCADE CO₂- MPG+</i> |
|--|------------------|------------------|-----------------------------------|------------------------------|-------------------------------------|
| <i>Compressors</i> | 195,510 | 254,205 | 269,115 | 269,115 | 235,410 |
| <i>Evaporators</i> | 47,460 | 51,345 | 54,075 | 54,075 | 54,075 |
| <i>Condensers</i> | 64,050 | 92,820 | 64,050 | 64,050 | 64,050 |
| <i>Miscellaneous electronics</i> | 92,190 | 127,050 | 115,395 | 115,395 | 115,395 |
| <i>Pipelines</i> | 67,305 | 39,165 | 118,650 | 94,920 | 110,355 |
| <i>Display Cases</i> | 505,575 | 505,890 | 505,575 | 505,575 | 505,575 |
| <i>Walk-in</i> | 77,910 | 79,065 | 77,910 | 77,910 | 77,910 |
| Total Installed Cost | 1,050,000 | 1,149,540 | 1,204,770 | 1,181,040 | 1,162,770 |
| Savings% Conventional DX | 0% | 9% | 15% | 12% | 11% |

*All values are given in \$

Table 2.47 Component prices for the 5 refrigeration systems.

| Refrigeration system Components | <i>DX</i> | <i>DIST</i> | <i>SL MPG+ SL CO₂-</i> | <i>SL CO₂ + -</i> | <i>CASCADE CO₂- MPG+</i> |
|--|----------------|----------------|-----------------------------------|------------------------------|-------------------------------------|
| <i>Compressors</i> | 147,000 | 199,080 | 207,375 | 207,375 | 182,490 |
| <i>Evaporators</i> | 21,000 | 24,885 | 21,000 | 21,000 | 21,000 |
| <i>Condensers</i> | 42,000 | 66,360 | 42,000 | 42,000 | 42,000 |
| <i>Misc electronics</i> | 52,500 | 82,950 | 58,065 | 58,065 | 58,065 |
| <i>Pipelines</i> | 21,000 | 8,295 | 41,475 | 33,180 | 33,180 |
| <i>Display Cases</i> | 472,500 | 472,815 | 472,500 | 472,500 | 472,500 |
| <i>Walk-in</i> | 73,500 | 74,655 | 73,500 | 73,500 | 73,500 |
| Total equipment cost | 829,500 | 929,040 | 915,915 | 907,620 | 882,735 |
| Increase% Conventional DX | 0% | 12% | 10% | 9% | 6% |

*All values are given in \$

Table 2.48 Component installation costs for the 5 refrigeration systems.

| Refrigeration system Components | <i>DX</i> | <i>DIST</i> | <i>SL MPG+ SL CO₂-</i> | <i>SL CO₂ +-</i> | <i>CASCADE CO₂- MPG+</i> |
|--|----------------|----------------|-----------------------------------|-----------------------------|-------------------------------------|
| Compressors | 48,510 | 55,125 | 61,740 | 61,740 | 52,920 |
| Evaporators | 26,460 | 26,460 | 33,075 | 33,075 | 33,075 |
| Condensers | 22,050 | 26,460 | 22,050 | 22,050 | 22,050 |
| Misc electronics | 39,690 | 44,100 | 57,330 | 57,330 | 57,330 |
| Pipelines | 46,305 | 30,870 | 77,175 | 61,740 | 77,175 |
| Display Cases | 33,075 | 33,075 | 33,075 | 33,075 | 33,075 |
| Walk-in | 4,410 | 4,410 | 4,410 | 4,410 | 4,410 |
| Total installation cost | 220,500 | 220,500 | 288,855 | 273,420 | 280,035 |
| Increase% Conventional DX | 0% | 0% | 31% | 24% | 27% |

*All values are given in \$

Table 2.49 Component energy consumption for the 5 refrigeration systems.

| Refrigeration system Components | <i>DX</i> | <i>DIST (rooftop design)</i> | <i>SL MPG+ SL CO₂-</i> | <i>SL CO₂ +-</i> | <i>CASCADE CO₂- MPG+</i> |
|--|------------------|------------------------------|-----------------------------------|-----------------------------|-------------------------------------|
| Compressors | 55% | 50% | 66% | 60% | 54% |
| Evaporators | 0% | 0% | 0% | 0% | 0% |
| Condensers | 6% | 6% | 6% | 6% | 6% |
| Misc electronics | 0% | 0% | 0% | 0% | 0% |
| Pipelines | 0% | 0% | 0% | 0% | 0% |
| Display Cases | 30% | 30% | 30% | 30% | 30% |
| Walk-in | 9% | 9% | 9% | 9% | 9% |
| Total energy consumption (kWh/year) | 1,570,900 | 1,492,355 | 1,743,699 | 1,649,445 | 1,555,191 |
| Savings% Conventional DX | 0% | -5% | +11% | +5% | -1% |

LCC analysis results for refrigeration systems

Figure 2.24 illustrates results of LCC from simulations of direct and indirect systems. The period of study was 10 years, the interest rate was 4%, the annual price increase of electricity was 1%.

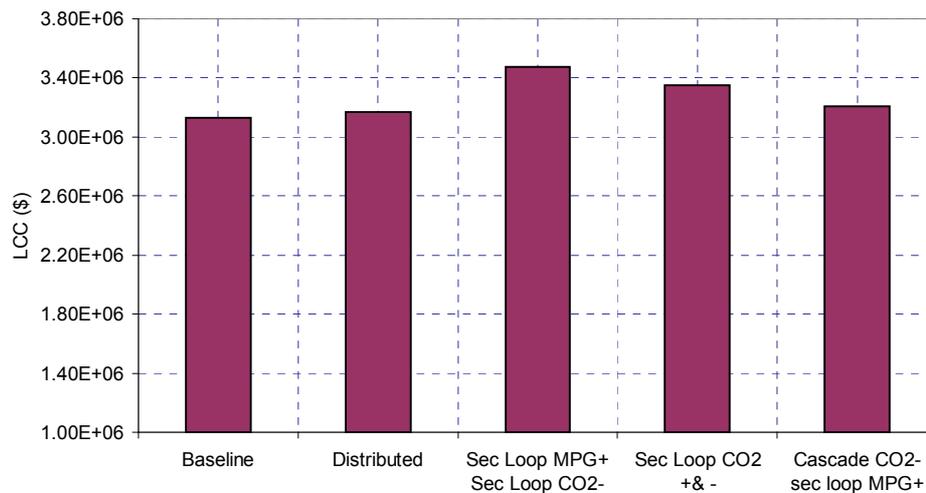


Figure 2.24 LCC distribution for investigated refrigerating systems.

Simulations results and capital costs analyses show that for indirect systems to become attractive alternatives to direct systems, design improvements need to be implemented to reduce both capital and running costs of secondary loop systems. More stringent legislation and incentives may also contribute to a wider application of secondary loop systems. This can be seen by comparing the LCC of secondary loop and distributed systems to the direct expansion system LCC (Figure 2.24). These results are identical to results proposed in the British report to IEA Annex 26 [UK03].

LCCP of indirect systems and distributed systems is essential to evaluate CO₂ emissions due to the refrigerating system operation (indirect emissions) and the direct emissions of refrigerants taking into account their GWP (global warming potential). LCCP results will underline the advantages of secondary loop systems compared to the baseline (current centralized direct expansion systems).

2.5 TEWI analysis of refrigeration systemsThe basic concept of both the Total Equivalent Warming Impact (TEWI) and the Life Cycle Climate Performance (LCCP) is, for a given product or activity, to identify rigorously all of the warming impacts due to the product use through its lifetime. The two major contributors to emissions of greenhouse gases during the lifetime of refrigerating systems in supermarkets are the "indirect" effect of carbon dioxide emissions related to the energy consumption of the product during operation (indirect emissions) and the "direct" effect of greenhouse emissions from the product taking into account their GWP.

Therefore, the contribution to global warming (TEWI) of any refrigerating systems has to be evaluated taking into account both the energy consumption and the refrigerant emissions. Five technologies of refrigeration systems have been compared:

- the baseline is the direct expansion system
- distributed system
- secondary loop system (MPG for medium-temperature display cases, and CO₂ for low-temperature display cases)
- secondary loop system (CO₂ for both medium and low-temperature display cases)
- CO₂ cascade and secondary loop (MPG) at medium temperature.

The total equivalent Warming Impact is expressed in Equation (2.24):

$$TEWI = GWP \times [Ln + m(1 - \alpha)] + nEB \quad (2.24)$$

| | |
|-------------|--|
| with | |
| <i>GWP</i> | Global Warming Potential (kg eq. CO ₂) |
| <i>L</i> | Leakage rate (kg / year) |
| <i>n</i> | Operation life of the system (years) |
| <i>m</i> | Fluid quantity charged in the system (kg) |
| <i>a</i> | Recovery rate (kg of recovered fluid/initial charge) |
| <i>E</i> | Annual energy consumption (kWh / year) |
| <i>b</i> | CO ₂ emission per electric kWh of produced power (kgCO ₂ / kWh) |
| <i>TEWI</i> | Total Equivalent Warming Impact (kg of CO ₂ produced during the lifespan of the equipment). |

The direct contribution, due to refrigerant emissions during the system lifetime is expressed in Equation (2.25):

$$Dc = M \times [a + rc(1 - fre) + ne + s(1 - sre)]GWP \quad (2.25)$$

with:

| | |
|-----|---|
| Dc | Direct contribution (kg CO ₂ eq.) |
| M | Nominal charge of refrigerant in the system (kg) |
| a | Initial charge emission rate (%) |
| rc | Remaining charge (%) at end of life, before decommissioning |
| fre | Recovery efficiency at decommissioning (%) |
| n | Operation life of the system (years) |
| e | Fugitive emission rate, including losses due to rupture, and annual maintenance (%) |
| s | Number of renewing operations asking for a complete refrigerant recovery (retrofit for example), except end of life recovery. |
| sre | Refrigerant recovery efficiency when renewing operation are conducted |
| GWP | Global Warming Impact (kg equivalent CO ₂) |

Large emissions due to tube or component ruptures have been considered in the fugitive emission rate, which is an average value for a wide number of installations.

Servicing and maintenance operations contribute to additional refrigerant emissions depending on the operation quality. This contribution is also included in the fugitive emission rate. Refrigerant losses occurred at the end of life of the system, after decommissioning, when recovery is not appropriately done. A recovery efficiency rate is defined.

Assumptions for direct emission calculations are as follows:

- lifetime of the supermarket is 30 years
- a complete maintenance operation, with refrigerant recovery is performed after 10 years (end of life of display cases)
- annual servicing, accidental ruptures, and fugitive emissions are presented under a single rate
- emission rate and recovery efficiency are presented with a lower and an upper threshold.

Table 2.50 presents assumptions for direct emission calculations of a typical supermarket with 4400 m² sales area.

Table 2.50 Assumptions for direct emission calculations.

| Refrigeration system | <i>DX</i> | <i>Distributed</i> | <i>Sec. Loop MPG+ Sec. Loop CO₂-</i> | <i>Sec. Loop CO₂ + & -</i> | <i>Cascade CO₂- Sec. Loop MPG+</i> |
|---|------------------|---------------------------|--|--|--|
| <i>R-404A charge (kg)</i> | 1370 | 600 | 400 | 400 | 210 |
| <i>CO₂ charge (kg)</i> | 0 | 0 | 700 | 1400 | 450 |
| <i>Fugitive emission rates</i> | | | | | |
| <i>Upper threshold</i> | 30% | 25% | 20% | 20% | 20% |
| <i>Lower threshold</i> | 18% | 15% | 12% | 12% | 12% |
| <i>Emission rate at initial charge</i> | | | | 5% | |
| <i>Recovery efficiency at end of life</i> | | | | L | |
| | | Lower threshold*: 70% | Upper threshold*: 30% | | |

*70% is the higher value considered for recovery efficiency leading to "the lower threshold" calculation of emissions.

The TEWI analysis is calculated for a period of 10 years, corresponding to the refrigeration system lifetime before refurbishing. GWP of R-404A is 3900 (2006 IPCC assessment report, [IPC06]), CO₂ is the reference with a GWP of 1.

2.5.1 Assumptions for indirect emission calculations

The energy consumption is calculated for each refrigeration system. The methodology is presented in Sections 0 (energy consumption) and 2.4 (LCCA analysis). Table 2.51 summarizes the annual energy consumption of a typical supermarket in CA (LA climatic zone).

Table 2.51 Annual energy consumption per supermarket, for different refrigeration systems.

| Refrigeration system | <i>DX</i> | <i>Distributed</i> | <i>Sec. Loop MPG+</i> <i>Sec. Loop CO₂-</i> | <i>Sec. Loop</i> <i>CO₂ + & -</i> | <i>Cascade CO₂-</i> <i>Sec. Loop MPG+</i> |
|--|------------------|---------------------------|---|---|---|
| <i>Total energy consumption (kWh/year)</i> | 1,570,900 | 1,493,140 | 1,743,699 | 1,648,660 | 1,553,620 |

In California, the CO₂ content of one kWh, is dependent on the energy mix in power generation. Energy Power Mix in California for year 2006 is presented in Table 2.52 based on the values of the California Energy Commission [CEC07].

Table 2.52 Energy Power Mix in California in 2006.

| <i>Energy type</i> | <i>Mix</i> |
|----------------------------|-------------------|
| <i>Coal</i> | 28.60% |
| <i>Large hydroelectric</i> | 30.50% |
| <i>Natural gas</i> | 35.40% |
| <i>Nuclear</i> | 0.40% |
| <i>Eligible renewable</i> | 5.10% |

Note: Eligible renewable consists of biomass and waste, geothermal, small hydroelectric, solar, and wind.

Power generation leads to different CO₂ factors, depending on the energy conversion process and the primary energy source. Table 2.53 gives the range of CO₂ content of one kWh produced, for different energy sources [GFE07].

*Carbon equivalent factor is converted in CO₂ equivalent factor by the ratio of molar masses (MMCO₂/MMc)

Table 2.53 Emission conversion factors.

| <i>Primary energy</i> | <i>Carbon equivalent g/kWh</i> | <i>CO₂ equivalent g/kWh</i> |
|------------------------------|---------------------------------------|---|
| <i>Gas</i> | 100 to 130 | 367 to 477 |
| <i>Coal</i> | 200 to 280 | 733 to 1026 |
| <i>Hydroelectric</i> | 1 | 3.7 |
| <i>Nuclear</i> | 2 | 7.3 |
| <i>Wind power</i> | 2 to 10 | 7.3 to 36.7 |

gives low and high thresholds of the CO₂ factor, taking into account the power energy mix in California. Thresholds correspond to efficiency variation of power generators independently of primary energy source.

Table 2.54 Calculation of the energy power mix in California.

| <i>Mix (year 2006)</i> | CO₂ emission factor (g CO₂/kWh) | | |
|--|--|-----------------------|--------------|
| | <i>Low threshold</i> | <i>High threshold</i> | |
| <i>Coal</i> | 28.60% | 209.6 | 293.4 |
| <i>Large hydroelectric</i> | 30.50% | 1.1 | 1.1 |
| <i>Natural gas</i> | 35.40% | 129.9 | 168.9 |
| <i>Nuclear</i> | 0.40% | 0.0 | 0.0 |
| <i>Eligible renewable</i> | 5.10% | 0.4 | 1.9 |
| Averaged CO₂ emission factor for year 2006 | | 341.1 | 465.3 |

2.5.2 TEWI calculation

Results of the TEWI calculation for five refrigeration systems are given in Table 2.55.

Table 2.55 TEWI calculation

| Refrigeration system | DX | Distributed | Sec. Loop MPG+ Sec. Loop CO₂- | Sec. Loop CO₂ + & - | Cascade CO₂- Sec. Loop MPG+ |
|---|-----------|--------------------|---|---|---|
| Refrigerant total emissions (metric tonnes) | | | | | |
| <i>R-404A (lower threshold)</i> | 2.9 | 1.1 | 0.6 | 0.6 | 0.3 |
| <i>R-404A (upper threshold)</i> | 4.8 | 1.8 | 1.0 | 1.0 | 0.5 |
| <i>CO₂ (lower threshold)</i> | 0.0 | 0.0 | 1.2 | 2.3 | 0.7 |
| <i>CO₂ (upper threshold)</i> | 0.0 | 0.0 | 2.0 | 4.0 | 1.3 |
| Direct CO₂ equivalent emissions (Thousands metric tonnes) | | | | | |
| <i>Lower threshold</i> | 11.2 | 4.2 | 2.4 | 2.4 | 1.2 |
| <i>Upper threshold</i> | 18.9 | 7.2 | 4.1 | 4.1 | 2.1 |
| Total energy consumption (MWh) | | | | | |
| <i>Lower threshold</i> | 15 709 | 14 931 | 17 437 | 16 487 | 15 536 |
| Indirect CO₂ equivalent emissions (Thousands metric tonnes) | | | | | |
| <i>Lower threshold</i> | 5.4 | 5.1 | 5.9 | 5.6 | 5.3 |
| <i>Upper threshold</i> | 7.3 | 6.9 | 8.1 | 7.7 | 7.2 |
| Total CO₂ equivalent emissions (Thousands metric tonnes) | | | | | |
| <i>Lower threshold</i> | 16.6 | 9.3 | 8.3 | 8.0 | 6.5 |
| <i>Upper threshold</i> | 26.2 | 14.1 | 12.2 | 11.7 | 9.4 |

DX system has a TEWI of 26,000 metric tonnes CO₂, 2 to 3 times higher than secondary loop systems. GWP of R-404A (3900) is the highest of HFCs currently used, therefore direct emissions contribute to 72% of DX system TEWI. CO₂ cascade offers the best performances.

Secondary loop and distributed systems may lower the refrigerant charge by a factor of two to four. The lower refrigerant charge can directly decrease emissions in case of ruptures and at equipment end-of-life if a systematic and efficient refrigerant recovery policy is not applied. Indirect and distributed systems lead to significantly shorter refrigerant lines, and thereby

limit the number of fittings and brazing. As a consequence, the leak tightness of the system is improved.

Figure 2.25 (lower threshold) and Figure 2.26 (upper threshold) illustrate the comparison between direct emissions and indirect emissions over a 10-year lifetime for different refrigeration systems found in typical Californian supermarkets.

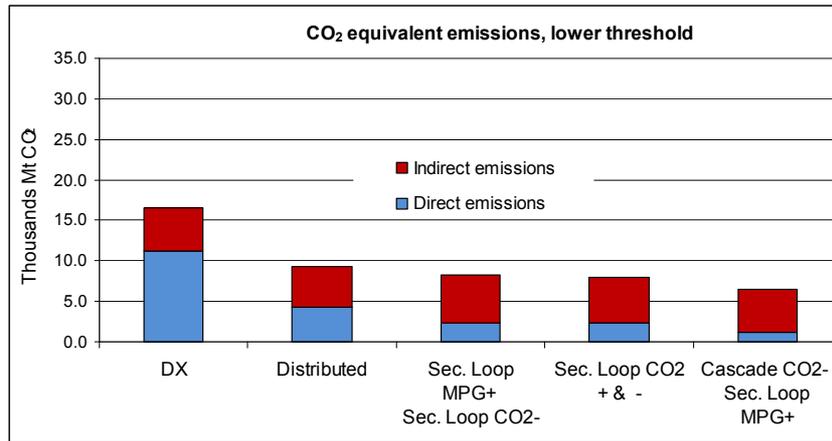


Figure 2.25 TEWI analysis, lower threshold.

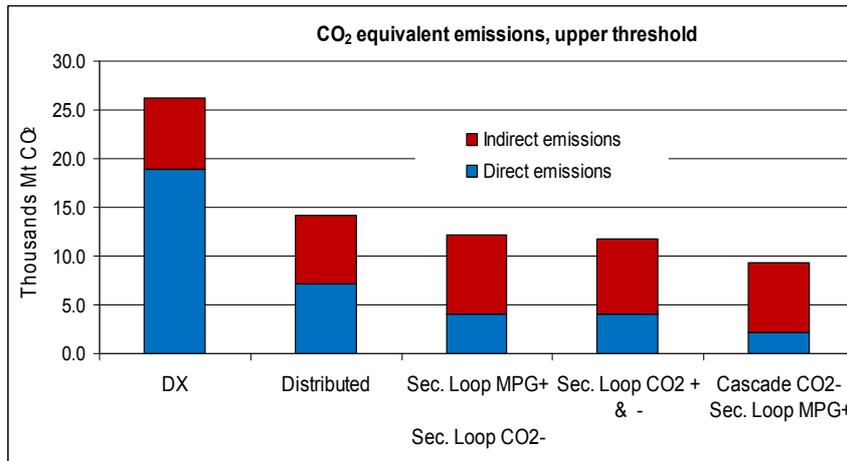


Figure 2.26 TEWI analysis, upper threshold.

2.5.3 Derivation to Californian state

Taking into account the number of supermarkets in California (~3400), TEWI is calculated at a California state level. Table 2.56 and Figure 2.27 give the equivalent CO₂ emissions and savings of alternative refrigeration systems, compared with the DX baseline.

Table 2.56 TEWI analysis in supermarkets at California state level.

| California state | <i>DX</i> | <i>Distributed</i> | <i>Sec. Loop MPG+ Sec. Loop CO₂-</i> | <i>Sec. Loop CO₂ + & -</i> | <i>Cascade CO₂- Sec. Loop MPG+</i> |
|---|-----------|--------------------|---|---|---|
| Total CO₂ equivalent emissions (Mega metric tonnes) | | | | | |
| <i>Lower threshold</i> | 56.3 | 31.7 | 28.3 | 27.2 | 22.2 |
| <i>Upper threshold</i> | 89.2 | 48.1 | 41.4 | 39.9 | 31.9 |
| CO₂ emissions savings (Mega metric tonnes) | | | | | |
| <i>Lower threshold</i> | 0.0 | -24.6 | -28.0 | -29.1 | -34.1 |
| <i>Upper threshold</i> | 0.0 | -41.1 | -47.7 | -49.2 | -57.3 |

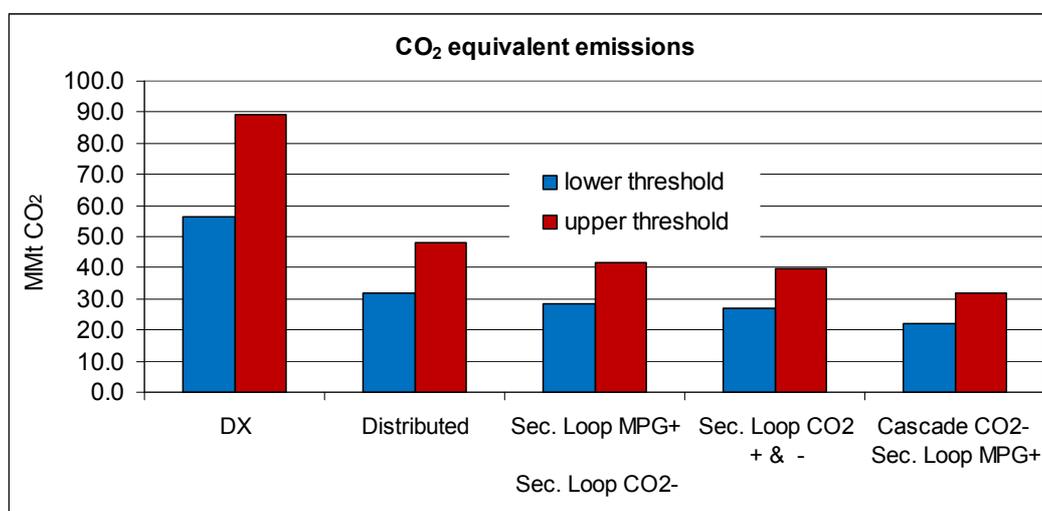


Figure 2.27 TEWI analysis in supermarkets at California state level.

2.5.4 Costs of CO₂ savings

The additional cost for different refrigeration systems has been calculated in the LCCA analysis (see section 2.4). Cost of CO₂ savings for different refrigeration systems are shown in Table 2.57.

Table 2.57 Costs of CO₂ savings.

| Refrigeration system | <i>DX</i> | <i>Distributed</i> | <i>Sec. Loop MPG+ Sec. Loop CO₂-</i> | <i>Sec. Loop CO₂ + & -</i> | <i>Cascade CO₂- Sec. Loop MPG+</i> |
|---|-----------|--------------------|---|---|---|
| LCCA per supermarket (\$) | 3,129,341 | 3,168,385 | 3,471,194 | 3,350,382 | 3,210,353 |
| Additional cost (\$) | 0 | 39,044 | 341,853 | 221,040 | 81,012 |
| CO₂ emission savings (tonnes) | 0 | -16,040 | -18,148 | -18,588 | -21,145 |
| Cost of 1 tonne CO₂ saved (\$/metric tonne) | | 3.2 | 24.4 | 15.3 | 4.8 |

Combining technical options on display cases and refrigeration system using CO₂ cascade and a secondary loop, both direct and indirect CO₂ equivalent emissions are reduced. Technical

options applied on display cases include: door installation, LED lighting, DC motor and floating head pressure.

Reduction of the cooling capacity has an impact on both energy consumption and refrigerant charge (and therefore an impact on refrigerant emissions as well).

Secondary loop system coupled with CO₂ cascade has a major impact on refrigerant direct emissions. CO₂ cascade system is more energy efficient than the baseline DX system. Savings for technical options applied to display cases, coupled with Cascade CO₂ / secondary loop systems are illustrated in Table 2.58.

Table 2.58 Savings for technical options applied to display cases, coupled with Cascade CO₂ / secondary loop systems.

| Refrigeration system | Per Supermarket | | California State | |
|--|------------------------|--|-------------------------|--|
| | <i>DX</i> | <i>Cascade CO₂- Sec. Loop MPG+ DC technical options</i> | <i>DX</i> | <i>Cascade CO₂- Sec. Loop MPG+ DC technical options</i> |
| LCCA (Thousands \$) | 3,129 | 2,679 | 10,638,600 | 9,108,600 |
| CO₂ emissions (Thousands metric tonnes) | | | | |
| <i>Lower threshold</i> | 17 | 5 | 56,295 | 15,565 |
| <i>Upper threshold</i> | 26 | 7 | 89,160 | 22,296 |
| CO₂ emission savings (Thousands metric tonnes) | | | | |
| <i>Lower threshold</i> | | 12 | | 40,729 |
| <i>Upper threshold</i> | | 20 | | 66,865 |

The life cycle cost is 15% lower for a supermarket where technical options for energy savings are applied on both display cases and refrigeration systems. The cut in CO₂ equivalent emissions is 75 – 80% compared to the baseline DX system.

SUMMARY CONCLUSIONS AND RECOMMENDATIONS

This report has established the different banks and emissions of refrigerants by sector and by refrigerant type (CFCs, HCFCs, HFCs and Ammonia) based on inventories of stationary refrigeration systems of all sectors: domestic, commercial, industrial, and air conditioning. Nevertheless, refrigerant banks of refrigerated transports and mobile air conditioning have been evaluated in order to obtain the complete California refrigerant inventory. For the commercial sector, the number of refrigeration systems is based on Californian data and on the field survey performed by the laboratory. For food industry and mobile air conditioning, Californian data were available. For other sectors, Californian numbers have been derived from U.S. numbers based on population and wealth. The total refrigerant bank is evaluated at 116,000 metric tonnes including all refrigerant types. The dominant refrigerant is still HCFC-22 representing 57% of the bank and 50 % of emissions. The refrigeration commercial sector represents only 6% of the refrigerant bank and 10% of emissions due to the dominant refrigerant bank of stationary air conditioning (60% including chillers) and mobile air conditioning (23%).

The dominant issue for the near future is the replacement of R-22 by R-404A, which has a GWP twice the one of R-22, meaning that at equal emission factor the CO₂ equivalent impact of commercial refrigeration will also be doubled. This fact leads to the evaluation of technical options capable to reduce dramatically the refrigerant charge, such as the so-called indirect systems, where the refrigerant charge can be reduced by a factor of 4 to 8 times less. Indirect system lowers the refrigerant charge because the coldness is delivered to all display cases and cold room via a heat transfer fluid. A TEWI calculation has integrated the reduction of emissions due to the reduction of the refrigerant charge and the limited increase in energy consumption due to the pumping power for the heat transfer fluid circulation. Results indicate a reduction of a factor 3 of CO₂ emissions of centralized refrigeration systems.

An in-depth survey has been made for commercial refrigeration to define an average Californian supermarket, but also typical other commercial outlets using refrigeration equipment for food preservation. The survey has detailed the type, length, and energy consumption of all types of refrigerated display cases. A calculation method has been developed taking into the 28 types of equipment, their operating conditions, and the outdoor temperatures of the eight climatic zones of California. Three main technical options have been evaluated for energy savings in supermarkets: Installing glass doors on medium temperature display cases, new technologies for auxiliary components (efficient lighting, efficient fan motors, better control of defrosting devices), and better control of the condensing pressure of the refrigeration system. Results are first the energy consumption (calculated hour by hour) for all stand alone equipment, condensing units, and supermarket centralized systems. Annual energy consumption of refrigeration systems for the year 2004 is evaluated at 5,341 GWh for all Californian grocery supermarkets and at 20,228 GWh for all Californian commercial refrigeration. If the best technologies were to be fully implemented, the possible energy gains are of 30% referred to the current energy consumption of Californian supermarkets and 20% for the entire commercial sector. The payback periods vary from a quarter to less than 4 years.

Conclusions

This study establishes the refrigerant emissions of HCFCs and HFCS used in stationary and mobile refrigeration systems, including air conditioning, which is the dominant bank of stationary applications and also the dominant emission sector, even if the emission factors are much lower for chillers and air-to air AC systems compared to commercial refrigeration. HCFC-22 is still the dominant refrigerant in the total bank of refrigerants. R-404A refrigerant which is beginning to replace R-22 in commercial and industrial refrigeration implies a higher global warming effect if refrigerant emissions are left at the same level (the GWP of R-404A is more than twice that of R-22). Some commercial chains have made improvements in reducing refrigerant emissions from about 30% per year to about 15%, but those improvements need to be consolidated. Indirect systems using CO₂ as a heat transfer fluid is a technical option limiting drastically the refrigerant charge and changes significantly the future refrigerant emissions with a very limited energy additional consumption.

Several technical options are available to limit the energy consumption of commercial refrigeration systems. The main gains are related to the redesign of display cases by adding transparent doors for all their operating temperatures. The use of LED for lighting of products in display cases as well as the use of efficient technologies for fan motors and defrosting generates significant energy gains. For the entire commercial sector, energy gains of 20% are available with a payback period between 3 months and 4 years.

REFERENCES

- [ACE04] American Council for Energy Efficient Economy. www.aceee.org: Emerging technologies and practices: Efficient fan motors for commercial refrigeration, 2004
- [ADE00] Diagnostic énergétique des installations frigorifiques industrielles, Ouvrage collectif, Guides et Cahiers Techniques, ADEME, EDF. 2000.
- [ARI05] Arias J., Doctoral thesis:"Energy Usage in Supermarkets. Modeling and Field Measurement", Division of the applied thermodynamics and refrigeration, Department of energy technology Royal institute of Technology, 2005
- [ASH98] ASHRAE Refrigeration, 1998.
- [BAX03a] Baxter V., Advanced Supermarket Recovery Systems. Volumes 1 & 2. Executive summary and Country Reports. I.H.P programs. Oak Ridge U.S.A. 2003
- [BAX03b] V.D.Baxter, D.H.Walker, IEA Annex26: Advanced supermarket refrigeration/heat recovery systems, Final report volume 1, Oakridge national laboratory, April 2003
- [BEI08] Beer Institute Website: <http://www.beerinstitute.org>, 2008
- [BIG02] Bigot G., Clodic D., Campagne de mesures détaillées sur des installations de froid alimentaire en grandes surfaces de vente. Report for Auchan, December 2002.
- [BSR02] BSRIA Market report for air conditioning – Americas. Report 15316/01.February 2002.
- [BSR05] BSRIA World Market for Air conditioning 2005, World Market Intelligence. 24/04/05.
- [BED07] Beverage Digest Fact Book 2007- Statistical Yearbook of Non-alcoholic beverages
- [CEC07] California Energy Commission. 2006. 2006 Net System Power Report.
- [CCR08] C. Crane Company, LED light bulbs online catalog, 2008., <http://www.ccrane.com/lights/led-light-bulbs/index.aspx>
- [CHR99] K.Christenssen, Danish technological institute of energy. Refrigeration systems in supermarkets with CO2 and Propane- Energy consumption and economy, 2003.
- [CLO06] Clodic D., L.Palandre, S. Barrault, A. Zoughaib, Inventories of the worldwide fleets of refrigerating and air-conditioning equipment in order to determine refrigerant emissions : the 1990 to 2003 updating
- [CLO96] Clodic D. L'efficacité énergétique des installations frigorifiques dans les entreprises agroalimentaires. Convention ADEME. Final report. September 1996.
- [DEN03] Country report from Denmark, IEA Annex26, volume 2: Advanced supermarket refrigeration and heat recovery systems.
- [DOE07] U.S. Department of Energy, Advance notice of proposed rulemaking (ANOPR)technical support document (TSD):energy efficiency standards for commercial and industrial equipment, July 2007
- [FAO08] Food and Agriculture Organization of the United States website: www.fao.org, 2008
- [FAR02] Faramarzi R., Coburn B.A., Sarhadian R. Performance and Energy Impact of Installing Glass Doors on a Open Vertical Deli-Dairy Display Case", ASHRAE Transactions 2002, Vol. 108, Pt 1.
- [FAY00] Fayolle F., Clodic D. Optimisation de fonctionnement des compresseurs de centrales de production frigorifique alimentaire par les systèmes ESM et GEFIM. Report for Auchan, February 2000.

- [FMI07] Food Marketing Institute Supermarket Facts webpage: http://www.fmi.org/facts_figs/?fuseaction=superfact
- [FOS04] Foster Miller Inc, March 2004), investigation of secondary loop supermarket refrigeration systems, California energy commission, consultant report, March 2004.
- [GAG04] C.L. Gage, D.B. Bivens, Commercial Refrigeration Systems Emissions, DuPont Fluoroproducts and US Environmental Protection Agency. Private communications from supermarket chains in Western and Eastern United States, 2004.
- [GAG97] Cynthia L. Gage, Option for reducing refrigerant emissions from supermarket systems, 1997
- [GFE07] J.M. Jancovici. Guide des facteurs d'émissions. Bilan carbone. Rapport réalisé pour l'ADEME.
- [GIR07] S.Girotto, Carbon Dioxide in Supermarket Refrigeration, Berlin, May 23rd 2007
- [GRA03] Granryd E., Lundqvist P. Refrigerating engineering, Parts 1 and 2. Department of Energy technology, Royal Institute of Technology, Stockholm, Sweden, 2003
- [IPC05] IPCC / TEAP group of experts, IPCC / TEAP special report : safeguarding the ozone layer and the global climate system
- [IPC06a] IPCC Guidelines 2006
- [IPC06b] IPCC 4th Assessment Report, 2006
- [KAM95] Kaminski W. Le froid et l'économie alimentaire mondiale. IIF-IIR, 1995.
- [LIT02] A. D. Little, Inc., "Global Comparative Analysis of HFC and Alternative Technologies for Refrigeration, Air Conditioning, Foam, Solvent, Aerosol Propellant, and Fire Protection Applications", report for the Alliance for Responsible Atmospheric Policy, Washington, D.C., March 21, 2002.
- [LIT96] A. D. Little Inc, Energy Savings Potential for Commercial Refrigeration Equipment. June 1996
- [NMF07] Annual Commercial Landing Statistics, August 6, 2007, <http://www.st.nmfs.noaa.gov/>
- [ORL01] David H. Walker. Oak Ridge National Laboratory, Foster-Miller Inc. Development and Demonstration of an Advanced Supermarket Refrigeration System. September 2001
- [ORL04] Oak Ridge National Laboratory, Foster-Miller Inc., Investigation of Energy Efficient Supermarket Display Cases. December 2004 (David H. Walker Principal Investigator Southern California Edison RTTC Ramin T. Faramarzi Principal Investigator Oak Ridge National Lab Van D. Baxter)
- [PAL02] Palandre, L, Choquart F., Mahfoud M., Clodic D. Inventaire et prévisions des fluides frigorigènes et de leurs émissions - Année 2000. ADEME, ARMINES, May 2002.
- [Pal 04] Palandre, K, Clodic D. Evaluation of the Vintaging Model for Refrigerating and AC Systems Based on RIEP methodology. US EPA report 2004.
- [RGF02] Revue générale du froid. April 2002, N° 1022.
- [SCN08] Statistical Information, Yearly Chocolate Statistics, Science and Nutrition, <http://www.chocolateusa.org>, 2008
- [TEA04] Report of the TEAP Chiller Task Force, UNEP, May 2004. ISBN 92-807-2461-4.
- [TOC 06] UNEP, 2006 Report of the refrigeration, air conditioning and heat pumps Technical Options Committee

- [TOC03] 2002 Report of the Refrigeration, Air Conditioning and Heat Pumps Technical Option Committee (RTOC). 2002 Assessment. March 2003. ISBN 92-807-2288-3.
- [TOC07] 2006 Report of the Refrigeration, Air Conditioning and Heat Pumps Technical Option Committee (RTOC). 2006 Assessment. January 2007.
- [USC01] 1997 NAICS Definitions, 312 Beverage and tobacco product manufacturing, <http://www.census.gov>
- [USD01] Meat Animals Production, Disposition, and Income Annual Summary, 04.25.2008, <http://usda.mannlib.cornell.edu>
- [USD02] United States Department of Agriculture, National Agricultural Statistics Service website: <http://www.nass.usda.gov/>, 2008
- [USD03] Capacity of Refrigerated Warehouses, 01.29.2008, <http://usda.mannlib.cornell.edu>
- [WAL03] Walker D.H., Faramarzi, R.T., Baxter V.D., Investigation of Energy-Efficient Supermarkets Display cases. 21st International Congress of Refrigeration, Washington D.C, U.S.A. 2003
- [WIN08] Wine Institute website: <http://www.wineinstitute.org>, 2008

GLOSSARY

Air enthalpy

Enthalpy is a thermodynamic property, a measure of the energy content or heat content of a system per unit mass. Air enthalpies changes according to temperature and moisture content, and are defined on psychometric charts.

Anti-sweat heaters

Many surfaces of display cases are at temperatures lower than the air dew point. In order to avoid fogging and also water droplets on the products in display cases, anti-sweat heaters are installed in the display cases in order to warm the surface above the dew point.

Article 5 Country, Non-Article 5 Country

Article 5 of the Montreal Protocol defines the countries where the consumption of CFC and HCFC are lower than 0.3 kg/ inhabitant meaning usually the developing countries.

Non Article 5 countries are developed countries with CFC and HCFC consumption higher than the threshold.

Auxiliary components

All electric components integrated in display cases: lighting, fans, anti-sweat heaters, electric resistance for defrosting, ...

Bank (of refrigerant)

The sum of all refrigerants stored in refrigeration systems. Banks are grouped by refrigerant type: CFC, HFC, HCFC, and ammonia, and by application sector.

Bottom-up approach (for inventory or consumption estimates)

The method, defined in IPCC Guidelines, is opposed to Top-down method. The Bottom-up method describes refrigeration systems for each sector in order to evaluate the refrigerant banks. Top-down method is based only on the overall quantities of refrigerant sold by refrigerant manufacturers.

Cascade system

A refrigeration system architecture used for low-temperature application where a first refrigerant adapted to the low temperature is used in the low temperature system releasing the heat to a second high temperature refrigeration system using another refrigerant.

Centralized system

Refrigeration system where several racks of compressors are located in the machinery room, connected on one side to many evaporators installed in display cases in the sales area and to the other side to air condenser usually installed on the roof of the machinery room.

Charge (of refrigerant)

The quantity of refrigerant charged (added) initially in the refrigeration system and necessary to its operation. The charge of refrigerant is generally measured in pounds or kilograms, and depends on the refrigeration capacity of the system and on its design.

Chiller

A refrigeration system that cools water on one side and rejects heat usually also on a water cooled condenser. Chillers are usually large systems with refrigeration capacity above 1 MW. Many of them use centrifugal compressors. Chillers are often used to air condition large buildings.

Coefficient of performance

For the refrigeration system, it is the ratio of the cooling capacity to the compressor input power.

Compressor rack or unit

For commercial refrigeration system, the usual design of the machinery room is to have several racks of compressors (a rack including 3 to 5 identical compressors). The split of compressor power in several compressors allows better control of the refrigeration capacity.

Condensing unit

A part of a small refrigeration system with a refrigerating capacity between 1 and 10 kW, comprising an air condenser and one or two compressors installed on the same structure.

Critical pressure and temperature

are thermodynamic fundamental properties. Under the critical pressure, the refrigerant will undergo a phase change (liquid to vapor and vice versa); above critical temperature and pressure, the refrigerant will be in dense gas phase only.

Direct expansion system

A refrigeration system where the refrigerant is directly expanded in evaporators through an expansion valve. Direct systems can be of various sizes, from domestic refrigerators to large centralized commercial refrigeration systems.

Distributed system

Is a direct expansion system opposed to centralized commercial refrigeration system because smaller systems are disseminated near the display cases. The compressor and the condenser are installed in sound-proof boxes.

Entrapped air

The quantity of air infiltrated from the store inside the refrigerated display cases.

Evaporator

Evaporators are heat exchangers where the refrigerant evaporates usually in tubes or in plates. On the other side of the tube or the plate, air or liquid circulates and the refrigerant absorbs heat from them.

Floating head pressure

The current control of expansion valve used in commercial refrigeration system is to maintain a minimum level of condensing pressure (head pressure) in order to control easily the refrigerant mass flow rate. The drawback of this control is to maintain high condensing pressure even if the outdoor temperature is low. Floating head pressure changes this control by changing the expansion valve in order to accept much lower head pressure, which leads to significant energy savings.

Heat dissipation load

The fraction of heat dissipated by lightings installed in refrigerated display cases.

Indirect system

Opposed to direct expansion system, indirect systems comprise a primary evaporator installed in the machinery room where the refrigerant cools a heat transfer fluid that circulates back and forth from the machinery room to the display cases. The heat transfer fluid can be a single-phase liquid such as Mono-Propylene-Glycol or a phase-change one such as CO₂.

Infiltration heat load

It is the thermal load related to air infiltration in the display case.

Inner heat exchange coefficient

For a tube-and-fin heat exchanger such as those used in refrigerated display cases, the inner heat exchange coefficient is the heat exchange coefficient on the refrigerant side.

Internal radiation coefficient

Transfer coefficient taking into account exchange between the different surfaces of the display case at different temperatures.

Outer heat transfer coefficient

For a tube-and-fin heat exchanger such as those used in refrigerated display cases, the outer heat exchange coefficient is the heat exchange coefficient on the air circulating side.

Overall heat exchange coefficient

For heat exchangers, the heat exchange depends on the heat exchange coefficient on each side, and also slightly on the conductivity of the tubes. The overall heat exchange coefficient integrates the two heat exchange coefficients and the tube conductivity.

Parc (equipment "fleet")

Is the French word corresponding to the installed base of equipment, meaning all equipment of a given type whatever their vintage.

Radiation heat load

Is the heat load due to radiative heat transfers.

Recovery Efficiency

Is the ratio of the recovered refrigerant to the refrigerant stored in the refrigeration system.

Secondary loop system

Is identical to indirect systems, the secondary loop being the circuit where the heat transfer fluid circulates.

Stand-alone equipment

Can also be called plug-in system. It is a refrigeration system completely integrated in the refrigeration equipment. Domestic refrigerators are typical stand-alone equipment as well as vending machines, ice machines, and also some display cases.

Stefan Boltzmann's constant

Is a constant used for the calculation of radiative heat transfers.

Surface emissivity

Is a property of a surface related to radiative heat transfer. For opaque surface, the higher the emissivity, the higher the heat absorption.

Thermal conductivity

Is the property of a material to transfer heat by conduction. It is expressed in W/m.K.

Top-down approach (for inventory or consumption estimates)

See Bottom-up approach.

Unitary AC system

Corresponds to stationary air-conditioning system of refrigeration capacity varying from 1 to 15 kW. Those systems are so called air-to-air meaning that the evaporator as well as the condenser are refrigerant-to-air heat exchangers.

Volumetric air flow rate

Flow rates can be expressed either as mass flow rates or volumetric flow rates. Their respective units are kg/s and m³/s.

ABBREVIATIONS AND ACRONYMS

Abbreviations

| | |
|-----------------|---|
| AEO | Annual Energy Outlook |
| AFEAS | Alternative Fluorocarbons Environmental Acceptability Study |
| ANOPR | Advanced Notice of Proposed Rulemaking |
| ASH | Anti-sweat heater |
| BAU | Business as usual |
| BSRIA | Building Services Research and Information Association |
| CDB | Country Data Base |
| CEC | California Energy Commission |
| CEP | Center for Energy and Processes |
| CFC | Chlorofluorocarbon |
| CO ₂ | Carbon dioxide |
| COP | Coefficient of performance |
| CRF | Common Reporting Format |
| CSD | Carbonated soft drink |
| DC | Display case |
| DEF | Defrost control |
| DOE | Department of Energy |
| DX | Direct expansion |
| ECM | Electronically commutated permanent magnet motor |
| Eco | Energy consumption |
| EIA | Energy Information Agency |
| FAO | Food and Agricultural Organization (of the United Nations) |
| FHP | Floating head pressure |
| FHPC | Floating head pressure control |
| GDP | Gross Domestic Product |
| GHG | Greenhouse gas |
| GWh | Giga-watt hour (one billion [10 ⁹] watt hour) |
| GWP | Global warming potential |
| HC | Hydrocarbon |
| HCFC | Hydrochlorofluorocarbon |
| HFC | Hydrofluorocarbon |
| HTF | Heat transfer fluid |
| HVAC | Heating, ventilation, & air-conditioning |
| IEA | International Energy Agency |
| IPCC | Intergovernmental Panel on Climate Change |
| kJ | Kilojoules |
| kWh | kilo-watt hour (one thousand watt hour) |
| LCC | Life-cycle cost |
| LCCP | Life-cycle Climate Performance |
| LED | Light-emitting diode |
| MFR | Mass flow rate |
| MPa | Mega-pascals (one million [10 ⁶] pascals) |
| MPG | Mono-propylene glycol |
| MWh | Mega-watt hour (one million [10 ⁶] watt hour) |
| NOAA | National Oceanic and Atmospheric Administration |
| ODS | Ozone-depleting substance(s) |
| OECD | Organization for Economic Co-operation and Development |
| PBP | Payback period |
| PLC | Program logic circuit |
| PSC | Permanent split capacitor |
| RIEP | Refrigerant Inventories and Emission Previsions |

| | |
|--------|---|
| SA | Stand-alone |
| SAR | Second Assessment Report (of the IPCC) |
| SDT | Saturated discharge temperature |
| SST | Saturated suction temperature |
| TAR | Third Assessment Report (of the IPCC) |
| TEWI | Total Equivalent Warming Impact |
| TWh | Tera-watt hour (one trillion [10^{12}] watt hour) |
| UHT | Ultra-high temperature |
| UNEP | United Nations Environment Programme |
| UNFCCC | United Nations Framework Convention on Climate Change |
| USDA | U.S. Department of Agriculture |
| VOPMT | Vertical open medium temperature case |
| WI | Walk-in cooler |

NOMENCLATURE

| Symbol | Term | Units of expression |
|---------------------------|--|----------------------------------|
| A | surface area | m^2 |
| F | internal radiation coefficient | |
| h | air enthalpy | kJ/kg |
| h_i | inner heat exchange coefficient | $\text{W/m}^2\cdot\text{K}$ |
| h_o | outer heat transfer coefficient | $\text{W/m}^2\cdot\text{K}$ |
| k | thermal conductivity | $\text{W/m}\cdot\text{K}$ |
| nd | number of air exchanges in room per 24 hours | |
| Q_{defrost} | extra heat from defrost | W |
| Q_{fan} | fan motor input power | W |
| $Q_{\text{heat-wires}}$ | input power of anti-sweat heaters | W |
| $Q_{\text{infiltration}}$ | Infiltration heat load | W |
| Q_{lighting} | heat dissipation load | W |
| Q_{load} | total heat load | W |
| $Q_{\text{radiation}}$ | Radiation heat load | W |
| Q_{wall} | conduction heat load | W |
| T | temperature | $^{\circ}\text{C}$ or K |
| t | insulation thickness | m |
| U | overall heat exchange coefficient | $\text{W/m}^2\cdot\text{K}$ |
| V | volumetric air flow rate | m^3/s |

Greek symbols

| | | |
|---------------|-----------------------------|-----------------|
| ε | surface emissivity | |
| ρ | density | kg/m^3 |
| σ | Stefan Boltzmann's constant | |

Subscript

| | |
|-----------|--------------------------------|
| air,ent | entrapped air |
| air,ex | air infiltration |
| c | condensation (or cold for COP) |
| $case$ | display cabinet |
| CR | cold room |
| e | evaporation |

APPENDICES

CONTENTS

ANNEX 1

List of visited stores

ANNEX 2

Inventories of the worldwide fleets of refrigerating and air-conditioning equipment in order to determine refrigerant emissions. The 1990 to 2003 updating. ADEME/ARMINES Agreement 04 74 C0067–

Excerpts from the Final Report of December 2005 – Version 3, July 2006
Section 1 and Annexes 1 and 2 to Section 1

ANNEX 3

End of life curves

Lifetime of equipments is defined as a retirement function [KOO98].

ANNEX 4

Method of calculations of the refrigerating capacity of the food industry

ANNEX 5

Annex to some figures of Part I of the report

ANNEX 1 – List of visited stores

| Store Category | Major Brands | Number of stores visited |
|---------------------------------|---|--------------------------|
| Large Supermarket | Costco Wholesale | 2 |
| | Target | 2 |
| | Walmart | 7 |
| | Walmart Supercenter | 4 |
| | Total | 15 |
| Grocery Store | Albertson | 6 |
| | Stater Bros | 3 |
| | Bristol Farms | 3 |
| | Food 4 less | 3 |
| | Raleys | 3 |
| | Ralphs | 3 |
| | Safeway | 3 |
| | Vons | 4 |
| | Wholefoods | 5 |
| | SuperAfood | 3 |
| | SuperSuperWarehouse | 2 |
| Total | 38 | |
| Minimarket | Smart &Final | 3 |
| | Total | 3 |
| Convenience store | 7/11 | 5 |
| | AM-PM | 3 |
| | Local Convenience stores | 4 |
| Total | 12 | |
| Liquor Store | local liquor stores(B&B Jr Market, Village liquor store, Picomarket, Sam's Liquor,...) | |
| Total | 5 | |
| Pharmacy | CVS | 3 |
| | RiteAid | 3 |
| | Walgreen | 4 |
| Total | 10 | |
| Gas Station | Small Gas Station (76, Chevron, Mobile, Exxon, Arco) | 14 |
| | Large Gas Station (Mobil, Walmart Center) | 4 |
| Total | 18 | |
| Hotel | Best Western, Hilton, Marriott, Holiday Inn | |
| Total | 8 | |
| Motel | America's Best Value Inn, Super 8 Motel, Comfort Inn | |
| Total | 5 | |
| Bakery | Total | 1 |
| Butchery | Total | 4 |
| Fishmonger | Total | 2 |
| Bar & Restaurants | Bar, Restaurants, FastFood, Cinema, Bowling | 1 |
| Number of stores visited | | 122 |

ANNEX 2

Inventories of the worldwide fleets of refrigerating and air-conditioning equipment in order to determine refrigerant emissions. The 1990 to 2003 updating. ADEME/ARMINES Agreement 04 74 C0067–

Excerpts from the Final Report of December 2005 – Version 3, July 2006

Section 1 and Annexes 1 and 2 to Section 1

CONTENTS

| | | |
|----------------------|---|-----|
| 1.1 | Calculation method for refrigerant emission prevision..... | 127 |
| 1.2 | Refrigerants and regulations..... | 129 |
| 1.3 | Refrigerant GWPs from the Third Assessment Report of the IPCC..... | 131 |
| 1.4 | Consistency and improvement of data quality | 132 |
| 1.5 | Tools for refrigerant inventories and emission prevision | 134 |
| 1.5.1 | Refrigeration equipment and refrigerant bank database | 135 |
| 1.5.2 | Country Data Base..... | 136 |
| 1.6 | Review processes..... | 137 |
| References | | 137 |
| Annex 1 to Chapter 1 | - Equations used for the calculation method..... | 139 |
| Annex 2 to Chapter 1 | - List of Countries and country groups for refrigerant inventories..... | 145 |

Method of calculation, data and databases

1.1 Calculation method for emission prevision of refrigerants

The Tier 2 method, as defined in the IPCC guidelines [IPCC96, IPCC 06] proposes a calculation for HFC refrigerant emissions from equipment:

- during the manufacturing process,
- during the lifetime, and
- at the end of life of equipment.

This approach of looking at refrigerating equipment from cradle to grave (see Figure 1.1) covers all possible emissions but needs to be further worked out in order to give consistent results.

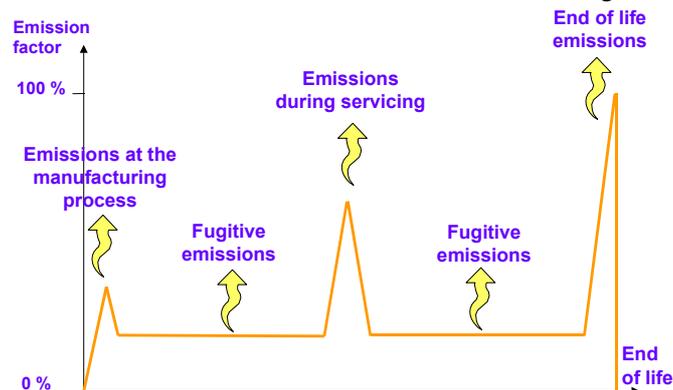


Figure 1.1 – Types of emissions from cradle to grave from refrigerating equipment.

The equations are coming from the draft version of the 2006 IPCC Guidelines (second draft, August 2006) and have taken into account the work done by the CEP (Center for Energy and Processes) during the last eight years. They are presented in Annex 1.

The same method is being used for the refrigerant inventories and emission forecasts for the French Government [BAR05, PAL04a, PAL04b, and PAL03a] delivered to the CITEPA, which is the technical body in charge of French inventories of greenhouse gases to be delivered to UNFCCC.

◆ Emissions at the manufacturing process

When equipment is mass-produced, the direct emissions are usually very small. For field-assembled systems, the emissions during the installation phase are higher but not substantial. The main source of emissions related to charging and topping up of refrigerating equipment are mainly **the emissions due to refrigerant handling**.

One will find refrigerant handling in more than just the manufacturing process of the equipment. There needs to be included:

- splitting the bulk refrigerant in large containers into smaller volumes of refrigerant,
- losses related to connecting the smaller refrigerant volumes to the equipment, and
- **capacity "heels"**.

The capacity "heels" represent the main loss during refrigerant handling. The "heels" consist in fact by of the vapor inside the container, which cannot be extracted due to the pressure equilibrium between the vapor (the vapor heel) and the liquid phase remaining in the refrigerant

volume (the liquid heel). Based on the recovery policy and the experience of the main refrigerant distributor in France, it can be derived that those "heels" represent between **2 and 10 % of the total amount of refrigerant sales**. This includes the charge of new equipment and the recharge of all the existing fleets of refrigerating equipment.

Note: the English word **fleet** covers the total number of equipment, e.g., for mobile air conditioning in cars, for refrigerating trucks, for reefers and refrigerating containers. It seems to be much more difficult to use the word fleet for domestic refrigerators, for refrigerating equipment in industrial processes and for stationary air conditioning systems. It is therefore proposed to use the French word "parc", which is easily understood in English and the following definition then applies: **"parc" is the total number of pieces of equipment in a category or sub-domain independent of their vintage.**

One of the improvements applied to the 1996 Tier 2 method of the IPCC Guidelines is the inclusion of the emissions from the container heels in the total sales of refrigerant.

Note: this improvement has been included in the 2006 IPCC Guidelines.

◆ **Emissions during the lifetime of the equipment**

Leaks during the lifetime of equipment depend on the type of application, e.g., domestic refrigerators show very low emission rates during their lifetime. On the contrary, many commercial, centralized refrigeration equipment and refrigerated transport systems are highly emissive. **Emission provisions need to be based on feedback via field data**, and field data from each country will substantially improve a number of global assumptions made in this study. In large commercial facilities or in industrial processes, the most precise approach for the determination of emissions is the collection of receipts and/or invoices for refrigerant delivered for system maintenance and for recharges.

In order to yield accurate results, the mobile air conditioning systems require very sophisticated methods. It is very common to form groups of vehicles of different vintages where the remaining refrigerant is carefully recovered from the system and subsequently measured by accurate weighing. By determining the difference between the initial refrigerant charge and the recovered charge, average levels of refrigerant emissions can be established.

◆ **Emissions from equipment at end of life**

Emissions from equipment at end of life depend on one hand on the regulatory policies in different countries, on the other hand on the recovery efficiency. For the inventory determination method, it is essential to have correct information regarding the lifetime of equipment, and annual market data for a number of years in the past, equal to the lifetime of the product. This point is crucial for almost every type of application due to:

- The rapid change in the application of refrigerant types, which changes are related to changing Montreal Protocol control schedules, and particularly to more stringent regional or national regulations,
- The rapid market growth of certain types of equipment, e.g. mobile air conditioning systems during recent years in Europe, or the rapid annual growth in China,
- The change in how recycling policies at the end of life of the equipment are regulated.

Taking into account

- (1) the large numbers of equipment,
- (2) the large variation in equipment type,

(3) the refrigerant charge amounts, and
 (4) the different refrigerant types and their GWPs,
a large database has to be constructed, on an application by application basis. For each application, **the "parc" has to be derived for all the years covering the lifetime of this type of equipment.** Moreover, as the determination of inventories is performed on an annual basis, the updating of the database is a necessary factor to take into account.

1.2 Refrigerants and regulations

The use of CFCs, HCFCs or HFCs and other refrigerants is related to control schedules, which have been continuously adjusted since the Montreal Protocol has been ratified. For the developed countries (the non-Article 5 countries as defined in the Montreal Protocol), the phase-out of CFCs and HCFCs will be earlier than in the developing countries (the Article 5 countries). Moreover, where it concerns non-Article 5 countries, the European Union has accepted a much tighter control schedule for phasing out (CFCs in the past and) HCFCs.

The rapid CFC phase out in Europe and also the interdiction of use of CFCs for servicing have led to a significant uptake of intermediate blends (HCFC-based blends) for the retrofit of a number of refrigerating systems using CFCs. The retrofit allows to keep the residual value of equipment until its usual end of life. It is likely that the same behavior of equipment owners will be followed for the progressive phase out of HCFCs, which will be replaced by intermediate blends of HFCs. Based on these facts, RIEP includes retrofit options where the refrigerant can be changed during the equipment lifetime.

◆ Non-Article 5 countries

The CFC phase-out schedule as valid for the non-Article 5 countries is presented in Figure 1.2. Via the EU regulation 3093/94 CFCs were phased out one year before the phase-out defined in the Montreal Protocol, i.e. on 31 December 1994.

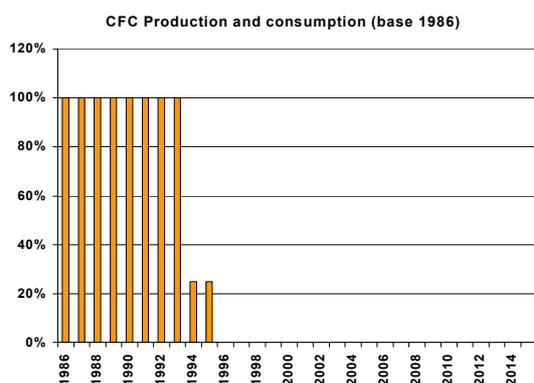


Figure 1.2 – CFCs phase out in non Article 5 countries.

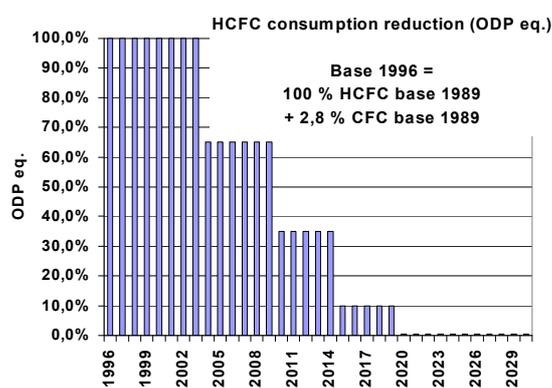


Figure 1.3 – HCFCs phase out in non Article 5 countries (except EU).

As indicated in Figure 1.3, the HCFC consumption base levels refer to the 1989 HCFC consumption plus 2.8% 1989 CFC consumption, ODP-weighted. On the basis of a certain ODP for HCFC-22 and CFCs (0.055 and 1.0 respectively), the factor of 2.8% means that if all CFCs would be replaced by HCFC-22, about 55% of the CFC consumption in tonnes would be replaced by HCFC-22.

Figure 1.3 clearly shows that, even for non-Article 5 countries, brand-new equipment can be manufactured, charged with HCFC-22 and sold until 31 December 2009. Typically, the U.S. and many developed countries continue to use HCFC-22 for air-conditioning equipment.

As indicated in Figure 1.4, the EU regulation has changed the baseline level for the HCFC consumption by reducing the additional quantities of ODP weighted CFCs by nearly 30% (from 2.8 to 2.0%). Moreover, the time of the HCFC phase-out is being brought forward by about 7 years.

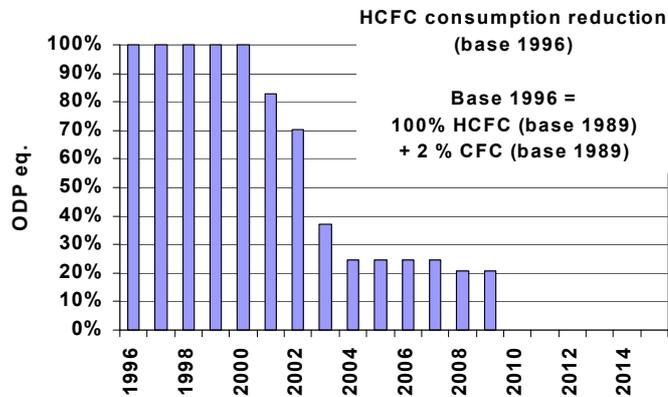


Figure 1.4 - European Union - (European regulation 2037/2000).

◆ **Article 5 Countries**

The CFC consumption and production (see Figure 1.5) for Article 5 countries has a delay compared to non-Article 5 countries of actually 14 years (1996 compared to 2010). There is an additional possibility of production and consumption of 10% compared to the 1996 level for Basic Domestic Needs of the developing countries where production can take place in the developed countries.

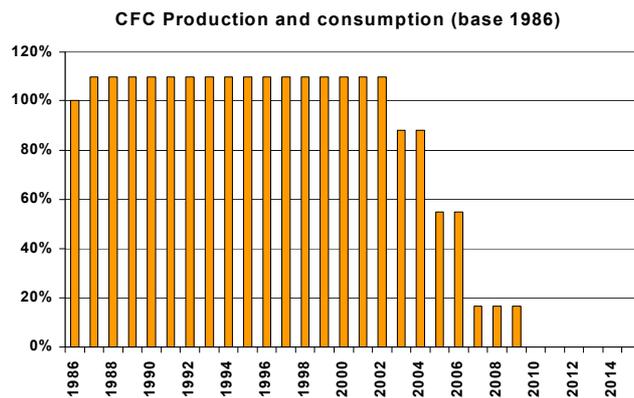


Figure 1.5 - CFC phase-out for Article 5 Countries.

For the HCFC phase-out the Montreal Protocol schedules are a bit more complicated. Where it concerns the freeze in consumption, Article 5 countries have a delay of about 15 years (freeze by 2016). Where it concerns the phase-out it actually is a 10-year delay period (phase-out in 2040 versus 2030) for the developing compared to the developed countries.

All these different constraints based upon global control schedules and more stringent regional and national regulations imply different refrigerant choices in countries and country groups. The refrigerant choices need to be taken into account on an application by application basis. In this project additional data have been used that have been derived from country reports as well as data that were available in publications.

1.3 Refrigerant GWPs from the Second and the Third Assessment Report of the IPCC

Table 1.1 lists the main refrigerant types in use: CFCs, HCFCs, HFCs, ammonia, and different blends, many of them being intermediate blends used for retrofit of CFC equipment. Table 1.1 has been updated taking into account all new blends as declared to ASHRAE 34. The most used of those blends are R-401A, R-409A, and R-413A for the replacement of CFC-12, R-402A and B, and R-408A for the replacement of R-502. The use of those blends can be verified at the global level by the declarations of sales by AFEAS of HCFC-124 and HCFC-142b, which are specific components of those intermediate blends. The list is nearly exhaustive, and takes into account more than 99% of all refrigerant types used. **The GWP values as given in the Second Assessment Report of the IPCC (SAR)** are used for the calculations of the equivalent CO₂ emissions of refrigerants.

Table 1.1 – GWP, physical of refrigerants [TOC03, IPCC06].

| Number | Refrigerant Chemical formula or blend composition – common name | Physical data | | | | GWP | | |
|--------|---|----------------|----------|---------|----------|--------------------|--------------------|-----|
| | | Molecular mass | NPB (°C) | TC (°C) | Pc (Mpa) | GWP | GWP | % |
| | | | | | | 2 nd AR | 3 rd AR | |
| 11 | CCl3F | 137.37 | 23.7 | 198.0 | 4.41 | 3 800 | 4 600.0 | 21 |
| 12 | CCl2F2 | 120.91 | -29.8 | 112.0 | 4.14 | 8 100 | 10 600.0 | 31 |
| 22 | CHClF2 | 86.47 | -40.8 | 96.2 | 4.99 | 1 500 | 1 700.0 | 13 |
| 32 | CH2F2-methylene fluoride | 52.02 | -51.7 | 78.1 | 5.78 | 650 | 550.0 | -15 |
| 115 | CF3CClF2 | 154.47 | -38.9 | 80.0 | 3.12 | 9 300 | 7 200.0 | -23 |
| 116 | CF3CF3-perfluoroethane | 138.01 | -78.2 | 19.9 | 3.04 | 9 200 | 9 200.0 | 0 |
| 123 | CHCl2CF3 | 152.93 | 27.8 | 183.8 | 3.66 | 90 | 120.0 | 33 |
| 124 | CHClFCF3 | 136.48 | -12.0 | 122.3 | 3.62 | 470 | 620.0 | 32 |
| 125 | CHF2CF3 | 120.02 | -48.1 | 66.2 | 3.63 | 2 800 | 3 400.0 | 21 |
| 134 a | CH2FCF3 | 102.03 | -26.1 | 101.1 | 4.06 | 1 300 | 1 300.0 | 0 |
| 143 a | CH3CF3 | 84.04 | -47.2 | 72.9 | 3.78 | 3 800 | 4 300.0 | 13 |
| 152 a | CH3CHF2 | 66.05 | -24.0 | 113.3 | 4.52 | 140 | 120.0 | -14 |
| 245 fa | CHF2CH2CF3 | 134.05 | 15.1 | 154.1 | 4.43 | 820 | 950.0 | 16 |
| 290 | CH3CH2CH3 - propane | 44.10 | -42.1 | 96.7 | 4.25 | 20 | 20.0 | 0 |
| 401 A | R-22/152a/124(53/13/34)-MP39 | 94.44 | -34.4 | 105.3 | 4.61 | 973 | 1 127.4 | 16 |
| 401 B | R-22/152a/124(61/11/28)-MP66 | 92.84 | -35.7 | 103.5 | 4.68 | 1 062 | 1 223.8 | 15 |
| 402A | R-125/290/22(60/2/38)-HP80 | 101.55 | -49.2 | 76.0 | 4.23 | 2 250 | 2 686.4 | 19 |
| 402B | R-125/290/22(38/2/60)-HP81 | 94.71 | -47.2 | 83.0 | 4.53 | 1 796 | 2 108.4 | 17 |
| 403A | R-290/22/218(5/75/20) | 92 | -47.8 | 87 | 4.7 | | 3 000 | |
| 403B | R-290/22/218(5/56/39) | 103.2 | -49.2 | 79.7 | 4.32 | | 4 300 | |
| 404A | R-125/143a/134a(44/52/4) | 97.60 | -46.6 | 72.1 | 3.74 | 3 260 | 3 784.0 | 16 |
| 405A | R-22/152a/142b/C318(45/7/5.5/42.5) | 111.9 | -32.6 | 106.1 | 4.29 | | 5 200 | |
| 406A | R-22/600a/142b(55/4/41) | 89.9 | -32.5 | 116.8 | 4.96 | | 1 900 | |
| 407A | R32/125/134a(20/40/40) | 90.1 | -45 | 82.3 | 4.52 | | 2 000 | |
| 407B | R32/125/134a(10/70/20) | 102.9 | -46.5 | 75 | 4.13 | | 2 700 | |
| 407C | R-32/125/134a(23/25/52) | 86.20 | -43.8 | 87.3 | 4.63 | 1 526 | 1 652.5 | 8 |
| 407D | R-32/125/134a(15/15/70) | 91 | -39.2 | 91.4 | 4.47 | | 1 500 | |
| 407E | R-32/125/134a(25/15/60) | 83.8 | -42.7 | 88.5 | 4.7 | | 1 400 | |
| 408A | R-125/143a/22(7/46/47)-FX-10 | 87.01 | -45.5 | 83.3 | 4.42 | 2 649 | 3 015.0 | 14 |
| 409A | R-22/124/142b(60/25/15)-FX-56 | 97.43 | -35.4 | 106.9 | 4.69 | 1 288 | 1 535.0 | 19 |

| Refrigerant | | Physical data | | | | GWP | | |
|-------------|---|----------------|----------|---------|----------|------------------------|------------------------|----------------------------------|
| Number | Chemical formula or blend composition – common name | Molecular mass | NPB (°C) | TC (°C) | Pc (Mpa) | GWP 2 nd AR | GWP 3 rd AR | % |
| | | | | | | 1996 | 2001 | 2 nd /3 rd |
| 410A | R-32/125(50/50)-Suva9100;AZ-20 | 72.58 | -51.6 | 72.5 | 4.95 | 1 730 | 1 975.0 | 14 |
| 411A | R-1270/22/152a(1.5/87.5/11) | 82.4 | -39.5 | 99.1 | 4.95 | | 1 500 | |
| 412A | R-22/218/142b(70/5/25) | 92.2 | -38 | 107.2 | 4.9 | | 2 200 | |
| 413A | R-218/134a/600a(9/88/3) | 104 | -30.6 | 98.5 | 4.07 | | 1 900 | |
| 414A | R-22/124/600a/142b(51/28.5/4/16.5) | 96.9 | -32.9 | 112.7 | 4.68 | | 1 400 | |
| 415A | R-22/152a(82/18) | 81.9 | -37.2 | 102 | 4.96 | | 1 400 | |
| 416A | R-134a/124/600(59/39.5/1.5) | 111.9 | -24 | 107 | 3.98 | | 1 000 | |
| 417A | R-125/134a/600(46.6/50/3.4) | 106.7 | -39.1 | 87 | 4.04 | | 2 200 | |
| 418A | R-290/22/152a(1.5/96/2.5) | 84.6 | -41.6 | 96.2 | 4.98 | | 1 600 | |
| 419A | R-125/134a/E170-77/19/4) | 109.3 | -43.8 | 79.2 | 4 | | 7 900 | |
| 420A | R-134a/142b(80.6/19.4) | 101.7 | -24.2 | 107.2 | 4.11 | | 1 500 | |
| 421A | R-125/134a(58/42) | 111.7 | -35.5 | 82.4 | 3.88 | | 2 520 | |
| 422A | R-125/134a/600a(85.1/11.5/3.4) | 113.5 | -43.2 | 75.4 | 3.92 | | 3 040 | |
| 500 | R-12/152a(73.8/26.2) | 99.30 | -33.6 | 102.1 | 4.17 | 6 014 | 7 854.2 | 31 |
| 502 | R-22/115(48.8/51.2) | 111.63 | -45.3 | 80.7 | 4.02 | 5 494 | 4 516.0 | -18 |
| 503 | R-23/13(40.1/59.9) | 87.25 | -87.5 | 18.4 | 4.27 | 11 700 | 13 198 | 13 |
| 504 | R-32/115(48.2/51.8) | 79.25 | -57.7 | 62.1 | 4.44 | 5 131 | 3 994.7 | -22 |
| 505 | R-12/31(78.0/22.0) | 103.48 | -30.0 | 117.8 | 4.73 | 6 318 | 8 268.0 | 31 |
| 506 | R-31/114(55.1/44.9) | 93.69 | -12.3 | 142.2 | 5.16 | 4 131 | 4 400.0 | 7 |
| 507A | R-125/143a(50/50)-AZ-50 | 98.86 | -47.1 | 70.9 | 3.79 | 3 300 | 3 850.0 | 17 |
| 600a | CH(CH3)2-CH3 - isobutane | 58.12 | -11.6 | 134.7 | 3.64 | 20 | 20.0 | 0 |
| 717 | NH3 - ammonia | 17.03 | -33.3 | 132.3 | 11.33 | < 1 | < 1 | |
| 744 | CO2 | 44 | -78.4 | 31 | 7.38 | | 1 | |

NBP = normal boiling point; Tc = critical temperature; Pc = critical pressure; GWP = global warming potential (for 100 yr integration).

The GWP calculation for blends is based on the GWP values of the pure refrigerants, and their mass concentration in the blend. It has been preferred to not round the GWP numbers for blends so that their origin can still be traced. For propane and isobutane no official GWP values have been presented in the IPCC Third Assessment Report, and the rounded value of methane (23) has been taken for all HCs.

1.4 Consistency and improvement of data quality

Using the Tier 2 method, the consistency in the emission forecast cannot be directly verified. **The first essential cross check can be done via deriving the annual market of the different refrigerant types** based on the initial charge of brand-new equipment (on an application by application basis) and on the recharge at servicing of the different "parcs" of equipment. By merging those two data series, it should be possible to derive the size of the market for every refrigerant type **and to compare those data to the official data submitted by manufacturers and distributors.**

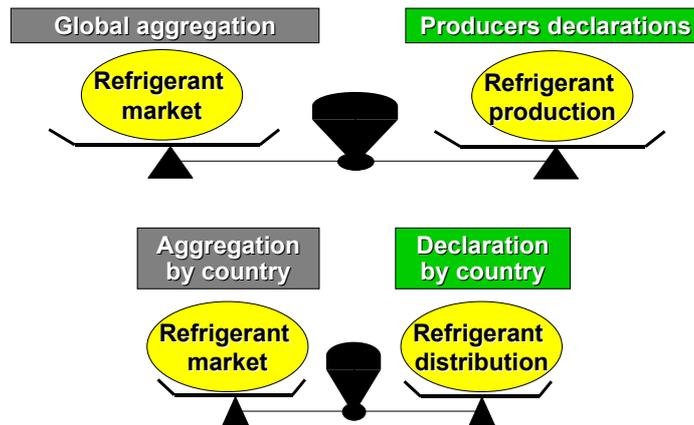


Figure 1.6 – Cross check of the annual refrigerant market derived from the initial charges and the recharges with the declarations made by refrigerant producers.

The cross-checks can be performed both on a country by country basis and globally (see Figure 1.6).

If the refrigerant inventories and the related emissions are adequately determined, the difference between the figures submitted and the calculated refrigerant sales will be small. If not, additional analyses are required.

◆ **Consistency for refrigerating equipment at the global level**

To reach a high accuracy in the sizes of the refrigerant inventories, the first step required is to gather reliable data for the equipment numbers. Fortunately, annual statistical data are available for nearly all mass-produced equipment. Some data have been published by manufacturer associations, and some (marketing studies) can be purchased from specialized companies. The data on annual equipment sales allow deriving figures on production and sale at the national level for nearly all the OECD countries, and also at the global level, when they are based on production data (see Figure 1.7).

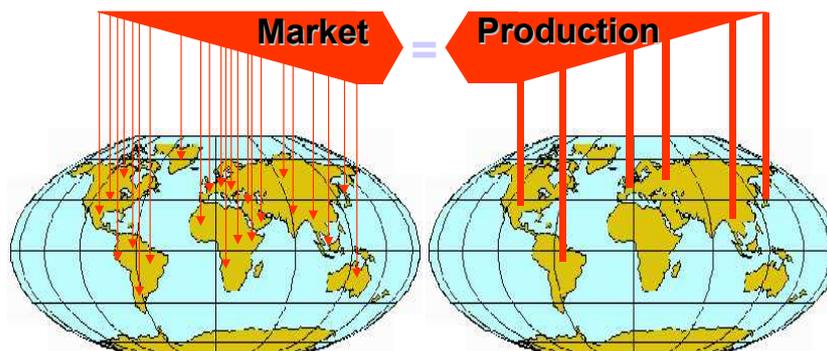


Figure 1.7 – Cross check between markets and production quantities.

At the global level, for a given year one can postulate “Production = Sales” (except for the small amount of equipment produced but not yet sold). For domestic refrigerators, stationary air conditioning systems, chillers, cars, trucks, buses, reefers... annual numbers of production and sales are available. Application of these numbers avoids double counting, which would happen easily when national inventories are merged, particularly if methods of determination are different.

◆ Inventories of all refrigerant types and the method of aggregation

The schedule for phasing out CFCs and HCFCs depends for the larger part on country regulations (see section 1.2). Even if only HFC inventory reporting is required under the UN Framework Convention on Climate Change (UNFCCC), it is required to have information on the emission predictions and on the changes in refrigerant use. Only in this way the size of the "banks" of all types of refrigerants charged in the different types of equipment can be determined. The --changing-- trends in the selection of the refrigerant need to include the quantities of hydrocarbons (HCs) and ammonia, which are both being used as HFC replacement options in the European Union.

As shown in Figure 1.8 the bottom-up approach used defines:

- the annual sales of brand-new equipment and the amount of refrigerants charged in this equipment,
- the determination (dependent on their lifetime) of all the fleets or parcs, which yields a cumulative value for the refrigerant bank for the specific application,
- the determination of the refrigerant market for servicing (dependent on the leak factor), and thereafter all the different domains are aggregated
- refrigerant by refrigerant,
- country by country,
- by country groups and globally.

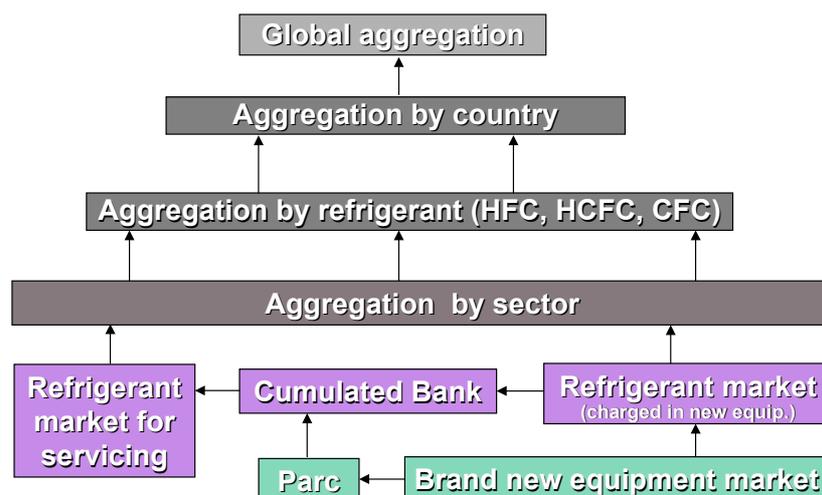


Figure 1.8 – Determination of the refrigerant markets.

This method of cross-check has been adopted in the quality assurance process of the updated version of the IPCC Guidelines 2006.

1.5 Tools for refrigerant inventories and emission previsions

To determine the annual emission forecasts for all categories of refrigerating equipment, it is necessary to create the tools that allow cumulative improvements in the data quality. The large number of data to be handled necessitates:

- to program in a database language
- to perform calculations based on reality data
- to create user friendly interfaces

- to transfer the results to tables written in spreadsheet language, which tables are based on the prescribed Common Reporting Format (CRF) of the IPCC for HFCs.

For the first year, such a database needs to “create” the "parcs" of all the different categories and sub-categories of refrigerating equipment. For the years thereafter the updating process requires less efforts and basically consists of the following input data:

- the annual equipment market for each category in the reference year
- the type of refrigerant used in brand-new equipment, and possibly also information on conversion from CFCs or HCFCs to HFCs or other refrigerants
- the emission factors.

All those elements allow to perform:

- calculations of emissions from all existing parcs of equipment,
- calculations of emissions from all types of decommissioned equipment
- a calculation of the amount of refrigerants which are recovered or reclaimed
- a calculation of the refrigerant banks per category of equipment
- a calculation of the annual refrigerant market sales, per refrigerant type.

As soon as better data become available, the database can be updated in a transparent manner. National, regional or global data reviews are necessary in order to control the quality of the inventory determinations.

A database enables the development of data acquisition in a single way: **improvement**, because it creates storage of data on the refrigerants in use inside the parcs of equipment that have been calculated.

1.5.1 Refrigeration equipment and refrigerant bank database

RIEP is connected to another database, CDB (Country Data Base), which has been developed as the source for economic, demographic, and technical data for both countries and country groups (see Annex 1).

RIEP is written in the ACCESS language, and deals with the separate countries, for any given year. Based on inputs from the user interface, RIEP can calculate the emissions during the equipment lifetime (see Figure 1.9). For these calculations, data have to be used for each year of the lifetime of a given equipment type or category.

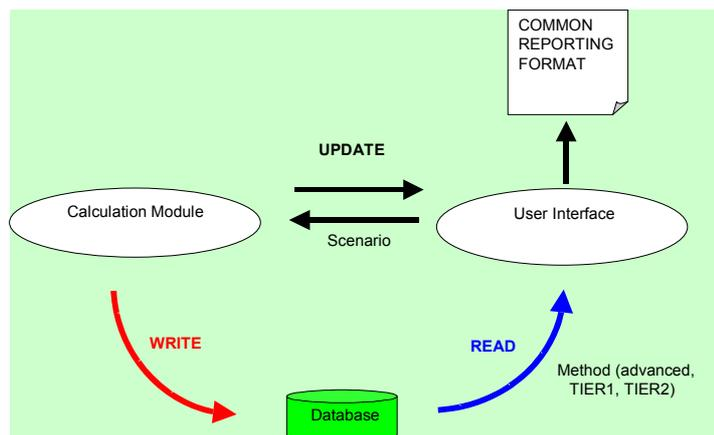


Figure 1.9 – Scheme of the application of the RIEP program.

1.5.2 Country Data Base

As indicated in Figure 1.10, if one selects a certain year and either the national or the regional level, the CDB can produce data on:

- demography,
- energy production and consumption,
- agriculture, and
- economy, including commerce.

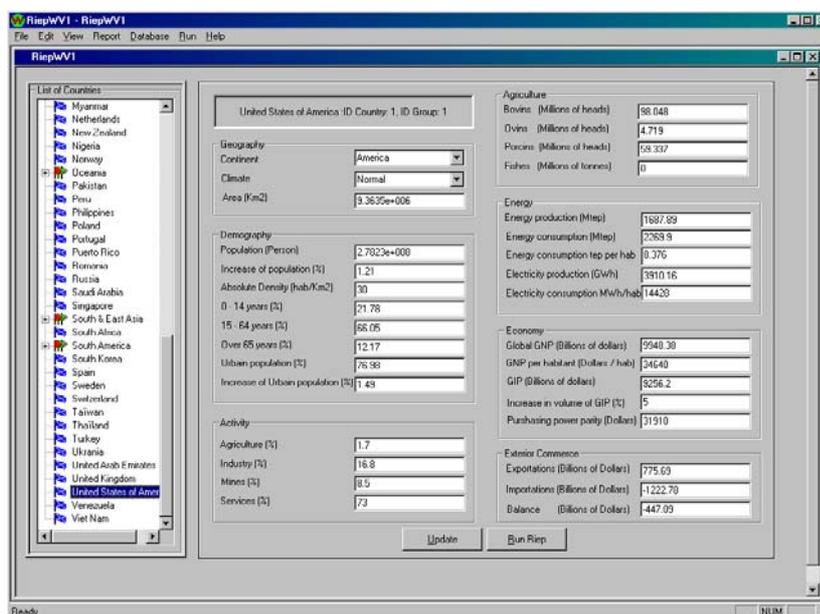


Figure 1.10 – Example of a screen of the United States of America CDB.

The Country Data Base (CDB), which has been constructed for the determination of global inventories, covers 62 countries and 8 regions, each region containing a portion of the remaining 110 countries (see annex 1).

For countries where only few specific equipment data is available, some of the general data mentioned above can be used to create ratios between refrigerating equipment, national economy and population. From the CDB, it is possible to run the RIEP program. The CDB is also written in Access and interfaces are handled in the C++ language.

India and Brazil are analyzed per se because of their economic growth. Moreover taking into account the integration of the 10 new European countries, Europe is followed as Europe 25. Russia is also followed per se, Oceania has been merged with other Asia and Australia is followed per se. The database has been used for the Supplementary Report [UNE05] and specific groupings have been done for non Article 5 countries and Article 5 countries.

1.6 Review process

The results of the previous report on inventories of the worldwide fleets of refrigerating and air-conditioning equipment [PAL03b] have been thoroughly used in the IPCC TEAP report [IPC05] and in the Supplement to the IPCC/TEAP report [UNE05]. Data have been analyzed by a number of experts, among them L. Kuijpers, A. MacCulloch, M. Mc Farland, S. Solomon, F. Keller, N. Campbell, and many others. Their comments have been fruitful and the main changes or improvements have been as follows:

- The distribution assigned between CFC-11 and CFC-12 for chillers in many countries was not well set in the previous version with a too high share of CFC-12; in fact the "US model" where CFC-11 was predominant had a strong influence in all Asian countries.
- R-502, which was significantly used in commercial refrigeration in Europe was much less used in the U.S. So HCFC-22 was underestimated in the U.S. inventory, and R-502 overestimated. Corrections have been done and as it is seen in Section 2 the correction has been effective due to the quite good match between AFEAS data on CFC-115 (CFC only used in R-502) and RIEP calculations.
- The phase in of HFCs in stationary air conditioning in the U.S. has been overestimated whereas HCFC-22 was nearly the only refrigerant in use until the end of 2005.

Independently of those modifications, the main other modifications based on new data are:

- the integration of retrofit blends for the replacement of CFCs,
- a new method of calculation for the number of refrigerate trucks based on the evolution of food products followed by the FAO database,
- modification of the emission model for mobile air conditioning systems, which is no longer taking into account a percentage, but the value expressed in g/yr because it has been demonstrated that emissions are not directly related to the refrigerant charge.

One of the best review processes is that the document is used by international experts and that the emissions as presented are compared to atmospheric concentration. This work has begun with the two papers published in the *International Journal of Refrigeration* with P. Ashford, A. Mc Culloch and L. Kuijpers [ASH04a, ASH04b, ASH04c]. Other review papers are under preparation in order to develop the correlation between atmospheric concentration and emissions of refrigerants.

References

- [ASH04a] Ashford, P., D. Clodic, A. McCulloch, L. Kuijpers, 2004a: Emission profiles from the foam and refrigeration sectors compared with atmospheric concentrations, part 1 - Methodology and data. *International Journal of Refrigeration*, **27**(7), 687–700
- [ASH04b] Ashford, P., D. Clodic, A. McCulloch, L. Kuijpers, 2004b: Emission profiles from the foam and refrigeration sectors compared with atmospheric concentrations, part 2 - Results and discussion. *International Journal of Refrigeration*, **27**(7), 701–716
- [ASH04c] Ashford, P., D. Clodic, A. McCulloch, L. Kuijpers, 2004c: Determination of Comparative HCFC and HFC Emission Profiles for the Foam and Refrigeration Sectors until 2015. Part 1: Refrigerant Emission Profiles (L. Palandre and D. Clodic, Armines, Paris, France, 132 pp.), Part 2: Foam Sector (P. Ashford, Caleb Management Services, Bristol, UK, 238 pp.), Part 3: Total Emissions and Global Atmospheric Concentrations (A. McCulloch, Marbury Technical Consulting, Comberbach, UK, 77 pp.). Reports prepared for the French ADEME and the US EPA.

- [BAR05] Barrault, S., Palandre, L., D. Clodic. Inventaires et prévisions des fluides frigorigènes et de leurs émissions – Année 2003. Report for the French Agency for Energy Management and Environment. December 2005.
- [IPC05] IPCC TEAP, 2005: *IPCC/TEAP Special Report on Safeguarding the ozone Layer and the Global Climate System: Issues related to Hydrofluorocarbons and Perfluorocarbons*. Prepared by Working Group I and III of the Intergovernmental Panel on Climate Change and the Technology and Economic Assessment Panel under the Montreal Protocol (Metz, B., L. Kuijpers, S. Solomon, S.O. Andersen, O. Davidson, J. Pons, D. de Jager, T. Kestin, M. Manning, and L.A. Meyer (editors)). Cambridge University Press, Cambridge, UK, and New York, NY, USA, 488 pp
- [IPC06] Draft version of the Revised 2006 Guidelines for National Greenhouse Inventories: OECD / IEA Paris.
- [IPC96] Revised 1996 Guidelines for National Greenhouse Inventories: OECD / IEA Paris.
- [PAL04a] Palandre, L., S. Barrault, D. Clodic. Inventaires et prévisions des fluides frigorigènes et de leurs émissions – Année 2002. Report for the French Agency for Energy Management and Environment. August 2004.
- [PAL04b] Palandre, L., and D. Clodic. Projections of the HCFC-22 demand for the period 2004-2015. In: Proceedings of 15th annual Earth Technologies Forum and Mobile Air Conditioning Summit, Washington D.C., USA, 13-15 avril 2004 [CD Rom].
- [PAL03a] Palandre, L., S. Barrault, D. Clodic. Inventaires et prévisions des fluides frigorigènes et de leurs émissions – Année 2001. Report for the French Agency for Energy Management and Environment. May 2003.
- [PAL03b] Palandre, L., A. Zoughaib, D. Clodic. Inventories of the worldwide fleets of refrigerating and air conditioning equipment in order to determine refrigerant emissions for years 1990 – 2000. June 2003. Report for GGECC and ADEME.
- [UNE05] UNEP, 2005: Supplement to the IPCC/TEAP Report, November 2005.
- [UNE03] 2002 Report of the Refrigeration, Air Conditioning and Heat Pumps Technical Option Committee (RTOC). 2002 Assessment. March 2003. ISBN 92-807-2288-3.

Equations used for the Calculation Method

The calculation method complements the Tier 2 method as recommended by the IPCC, by cross checking:

- the sum of refrigerant quantities charged in brand-new equipment and those recharged for servicing purposes in all the different refrigerating systems, with
- the annual national market sales of refrigerants as declared by the refrigerant manufacturers and distributors.

The method includes the following calculations:

- the refrigerant « bank » at year t charged into the parc of systems of each of the six system categories (taking into account the refrigerant changes as a result of regulations which could apply),
- the emissions of each system category, based on the understanding where the emissions occur (at system charge, during operation, during servicing and at the system's disposal).

The six categories of systems have been selected following the division used by the UNEP¹ Refrigeration Technical Options Committee [UNEP03]. The refrigerating chain includes:

- domestic refrigeration
- commercial refrigeration
- refrigerated transports
- refrigerated warehouses, food storage and industrial processes.

Air conditioning includes two sub-groups:

- air to air systems and water chillers
- mobile air conditioning.

All these categories must again be split in sub-groups.

Calculation method (Tier 2a) (extract from the draft of the IPCC Guideline 2006 Draft)

Note: here only HFCs are addressed. In RIEP all types of refrigerants are taken in account.

Refrigerant emissions at a year t from the six categories of refrigeration and air conditioning systems, result from:

- 1 emissions related to the management of refrigerant containers: $E_{\text{containers},t}$
- 2 emissions related to the refrigerant charge :connection and disconnection of the refrigerant container and the equipment to be charged: $E_{\text{charge},t}$
- 3 emissions from the six banks during operation (fugitive emissions and ruptures): $E_{\text{operation},t}$
- 4 emissions during servicing: $E_{\text{servicing},t}$
- 5 emissions at system disposal: $E_{\text{disposal},t}$

All these quantities are expressed in kilograms and have to be calculated for each type of HFC used in the six different application categories.

$$E_{\text{total}, t} = E_{\text{containers},t} + E_{\text{charge}, t} + E_{\text{operation}, t} + E_{\text{servicing}, t} + E_{\text{disposal}, t} \quad \text{Equation 1}$$

Methods for estimating average emission rates for the above-mentioned domains need to be calculated on a refrigerant by refrigerant basis for all equipment whatever their vintage.

Refrigerant management of containers

¹ United Nations Environment Programme

The emission related to the refrigerant container management comprises all the emissions related to the refrigerant transfers from bulk containers (typically 40 tonnes) down to small capacities where the mass varies from 0.5 kg (disposable cans) to 1 tonne (containers) and also from the remaining quantities --the so-called refrigerant "heels" (vapour and /or liquid)-- left in the various containers, which are recovered or emitted.

$$E_{\text{containers, t}} = RM_t \cdot (c) \quad \text{Equation 2}$$

where:

- $E_{\text{containers, t}}$ = emissions from all HFC containers in year t expressed in kilograms
- RM_t = the HFC market for new equipment and servicing of all refrigeration application in year t expressed in kilograms
- c = Emission factor of HFC container management of the current refrigerant market expressed in percentage

The emissions related to the complete refrigerant management of containers are estimated between 2 and 10 % of the refrigerant market.

Refrigerant charge emissions of new equipment

The emissions of refrigerant due to the charging process of new equipment are related to the process of connecting and disconnecting the refrigerant container to and from the equipment.

$$E_{\text{charge, t}} = M_t \cdot (k) \quad \text{Equation 3}$$

where:

- $E_{\text{charge, t}}$ = emissions during system manufacture/assembly in year t expressed in kilograms
- M_t = The amount of HFC charged into new equipment in year t (per application category) expressed in kilograms
- k = assembly losses of the HFC charged in new equipment (per application) expressed in percentage

Note: the emissions related to the process of connecting and disconnecting during servicing are covered in Equation 5 for servicing.

The amount charged (M_t) should include all systems which are charged in the country, including those which are produced for export. Systems that are imported pre-charged should not be considered.

Typical range for the emission factor k varies from 0.1 % to 2 %. The emissions during the charging process are very different for factory assembled systems and for field-erected systems where emissions can be up to 2 %.

Emissions during operation

Annual leakage from the refrigerant banks represent fugitive emissions, i.e. small leaks from fittings, joints, shaft seals, ... but also ruptures of pipes or heat exchangers leading to partial or full release of refrigerant to the atmosphere. The following calculation formula applies:

$$E_{\text{operation}, t} = B_t \cdot (x/100) \quad \text{Equation 4}$$

where:

- $E_{\text{operation}, t}$ = amount of HFC emitted during system operation in year t expressed in kilograms
- B_t = amount of HFC banked in existing systems (per application) in year t expressed in kilograms
- x = annual leakage rate of HFC of each application bank during operation expressed in percentage

In calculating the refrigerant “bank” (B_t) all systems in operation in the country (produced domestically and imported) have to be considered on an application by application basis.

Emissions during servicing

Equation 5 takes into account the discontinuous process of servicing. Besides component failures, such as compressor burn-out, equipment is serviced mainly when the refrigerating capacity is too low due to loss of refrigerant from fugitive emissions. Depending on the application, servicing will be done every year or every three years, or sometimes not at all during the entire lifetime such as in domestic refrigeration applications. For some applications, leaks have to be fixed during servicing and refrigerant recovery may be necessary, so the recovery efficiency has to be taken into account when the refrigerant is recovered.

$$E_{\text{servicing}, t} = \sum_{a=1}^{\frac{d}{z}} M_{t-az} \cdot s \cdot (1 - \eta_{\text{rec}}) \quad \text{Equation 5}$$

where:

- $E_{\text{servicing}, t}$ = amount of HFC emitted during system servicing in year t expressed in kilograms
- D = average equipment lifetime expressed in years
- S = residual charge of HFC in equipment requiring recharge expressed in percentage
- M_{t-az} = the amount of HFC charged into the equipment either at manufacturing or after each servicing per application domain expressed in kilograms
- a = number of recharges during the equipment lifetime d expressed in round numbers (lies in the interval $[0-d/z]$)
- Z = $\frac{1 - \frac{s}{100}}{\frac{x}{100}}$; number of years elapsed before equipment recharge expressed in round numbers
- η_{rec} = recovery efficiency, which is the ratio of recovered HFC referred to the HFC contained into the system

The importance of Equation 5 lies in deriving the annual refrigerant quantities needed for servicing. Knowing the annual refrigerant needs for servicing per application allows the determination of the national refrigerant market by adding the refrigerant quantities charged in new equipment.

When technical data are not available, Equation 5 could be simplified drastically and replaced by Equation 6.

$$E_{\text{servicing}, t} = B_t \cdot (j/100) \quad \text{Equation 6}$$

where:

- $E_{\text{servicing}, t}$ = amount of HFC emitted during system servicing in year t expressed in kilograms
- B_t = amount of HFC banked in existing systems (per application) in year t expressed in kilograms
- J = annual leakage rate of HFC of each application bank during servicing expressed in percentage

Emissions at disposal

The amount of refrigerant released from scrapped systems depends on the amount of refrigerant left at the time of disposal, and the portion recovered. From a technical point of view, the major part of the remaining fluid can be recovered, but recovery at end of life depends on regulations, financial incentives, and environmental concerns.

To estimate emissions at system disposal, the following calculation formula is applicable:

$$E_{\text{disposal}, t} = M_{(t-d)} \cdot S \cdot (1-\eta_{\text{rec}}) \quad \text{Equation 7}$$

where:

- $E_{\text{disposal}, t}$ = amount of HFC emitted at system disposal in year t expressed in kilograms
- $M_{(t-d)}$ = amount of HFC initially charged into new systems installed in year (t-d) expressed in kilograms
- S = residual charge of HFC in equipment requiring recharge expressed in percentage.
- D = average equipment lifetime expressed in years
- η_{rec} = Recovery efficiency, which is the ratio of recovered HFC referred to the HFC contained into the system

In estimating the amount of refrigerant initially charged into the systems (M_{t-d}), all systems charged in the country (for the domestic market) and systems imported precharged should be taken into account.

Quality assurance/quality control

In order to conduct a quality control for Tier 2 method, it is possible to compare the annual national HFC refrigerant market as declared by the chemical manufacturers or the refrigerant distributors with the annual HFC refrigerant needs as derived by the Tier 2 method. The following formula leads to this verification.

$$R_t = \sum_6 S_{prod} \times m_t + \left(\sum_{a=1}^{\frac{d}{z}} M_{t-az} \times ((1-s) + s(1-\eta_{rec})) \right) \quad \text{Equation 8}$$

where:

- R_t = HFC needs in year t expressed in kilograms
- S_{prod} = national production of equipment using HFC refrigerant for the six application domains
- S = residual charge of HFC in equipment requiring recharge expressed in percentage
- M_t = elementary charge of HFC in each type of equipment expressed in kilograms
- M_{t-az} = the amount of HFC charged into the equipment either at manufacturing or after each servicing expressed in kilograms
- A = number of recharges during the equipment lifetime d expressed in round numbers (lies in the interval $[0-d/z]$)
- Z = $\frac{1 - \frac{s}{100}}{\frac{x}{100}}$; number of years elapsed before equipment recharge expressed in round numbers
- η_{rec} = recovery efficiency, which is the ratio of recovered HFC in relation to the HFC contained into the system

The first Σ corresponds to the refrigerant charge of new refrigerating and air conditioning system produced in the country at the current year t including exports.

The second Σ corresponds to the refrigerant charge used for servicing.

The term $s(1-\eta_{rec})$ represents the recovered refrigerant.

The annual refrigerant market as declared by chemical manufacturers or refrigerant distributors RD is calculated by Equation 9.

$$RD_t = R_{prod_t} - R_{exp_t} + R_{imp_t} + R_{recl_t} \quad \text{Equation 9}$$

where

- R_{prod_t} = quantities of HFC refrigerant production expressed in kilograms
- R_{exp_t} = quantities of HFC refrigerant produced in the country and exported expressed in kilograms
- R_{imp_t} = quantities of imported HFC refrigerant expressed in kilograms
- R_{recl_t} = quantities of HFC refrigerant recovered and reprocessed for sale as new HFC refrigerant in kilograms

All quantities are calculated for the current year t.

Comparing R_t that is the HFC refrigerant needs as derived from the inventory method and RD_t the HFC refrigerant market as declared by refrigerant manufacturers and distributors gives a clear quality control of the inventory method, and also of the global emissions. R_t and RD_t are calculated for each HFC type.

List of Countries and country groups for refrigerant inventories

Calculations are performed independently for eighty entities: seventy countries and ten country groups.

Table A2.1 – List of countries and country groups where refrigerant inventories are performed

| | | | |
|------------------------------|-----------|----------------------------|----------------------|
| AFRICA* | Egypt | LITTLE EUROPEAN COUNTRIES* | Saudi Arabia |
| Algeria | Estonia | Luxembourg | Singapore |
| Argentine | Finland | Malaysia | Slovakia |
| Australia | France | Malta | Slovenia |
| Austria | Germany | Mexico | SOUTH & EAST ASIA* |
| BALKANS* | Greece | MIDDLE EAST* | South Africa |
| Bangladesh | Hong kong | Morocco | SOUTH AMERICA* |
| Belarus | Hungary | Myanmar | South Korea |
| Belgium | Iceland | Netherlands | Spain |
| Brazil | India | New Zealand | Sweden |
| Bulgaria | Indonesia | Nigeria | Switzerland |
| Canada | Iran | Norway | Taiwan |
| CENTRAL AMERICA & CARIBBEAN* | Ireland | PACIFIC ISLAND COUNTRIES* | Thailand |
| CENTRAL ASIA* | Israel | Pakistan | Turkey |
| Chile | Italy | Peru | Ukrania |
| China | Japan | Philippines | United Arab Emirates |
| Colombia | Kuwait | Poland | United Kingdom |
| Cyprus | Latvia | Portugal | USA |
| Czech Republic | Libya | Romania | Venezuela |
| Denmark | Lithuania | Russia | Viet Nam |

Country groups are indicated by *, and calculations are performed for the integral values of these groups.

Table A2.2 details the composition of each country group.

Table A1.2.2 – Country groups

| | |
|-----------------------------|--|
| AFRICA | Angola, Benin, Botswana, Burkina, Burundi, Cameroon, Cape Verde, Central Africa, Chad, Comoros, Congo, Congo RD, Côte d'Ivoire, Djibouti, Eritrea, Ethiopia, Gabon, Gambia, Ghana, Guinea, Guinea Bissau, Guinea Equatorial, Kenya, Lesotho, Liberia, Madagascar, Malawi, Mali, Mauritania, Mauritius, Mozambique, Namibia, Niger, Rwanda, Sao Tome, Senegal, Seychelles, Sierra Leone, Somalia, Sudan, Swaziland, Tanzania, Togo, Tunisia, Uganda, Zambia, Zimbabwe |
| BALKANS | Albania, Bosnia, Croatia, Kosovo, Macedonia, Moldova, Serbia Montenegro |
| CENTRAL AMERICA & CARIBBEAN | Antigua, Aruba, Bahamas, Barbados, Belize, Costa Rica, Cuba, Dominica, Dominican Republic, El Salvador, Grenada, Guatemala, Haïti, Honduras, Jamaica, Nicaragua, Panama, St Vincent, Trinidad & Tobago |
| CENTRAL ASIA | Afghanistan, Armenia, Azerbaijan, Georgia, Kazakstan, Kyrgyzstan, Tajikistan, Turkmenistan, Uzbekistan |
| LITTLE EUROPEAN COUNTRIES | Andorra, Liechtenstein, Monaco, San Marino |
| MIDDLE EAST | Bahrain, Irak, Jordan, Lebanon, Oman, Palestine, Qatar, Syria, Yemen |
| PACIFIC ISLAND COUNTRIES | Fiji, Kiribati, Mariannes, Marshall Islands, Micronesia, Nauru, Niue, Palau, Papua New Guinea, Tonga, Vanuatu, West Samoa |
| SOUTH & EAST ASIA | Bhutan, Brunei, Cambodia, DP N Korea, Lao, Macao, Maldives, Mongolia, Nepal, Sri Lanka |
| SOUTH AMERICA | Bolivia, Ecuador, Guyana, Paraguay, Surinam, Uruguay |

ANNEX 3

End of life curves

Lifetime of equipments is defined as a retirement function [KOO98].

The retirement function, also known as survival curve, is used to estimate the rate of retirement of equipments. In the linear function, no equipment retire in the first 2/3 of their average life time, and all units are retired by 4/3 of their average life time. The relation between age/average lives and appliance survival factor is shown in Figure 1.2. Expressed as equations, this function is as follows:

- If age < $[2/3 \times (\text{average life})]$ then 100% survive
- If age > $[2/3 \times (\text{average life})]$ and age < $[4/3 \times (\text{average life})]$
then $[2 - 1.5 \times (\text{age}) / (\text{average life})]$ survive
- If age > $[4/3 \times (\text{average life})]$ then 0% survive

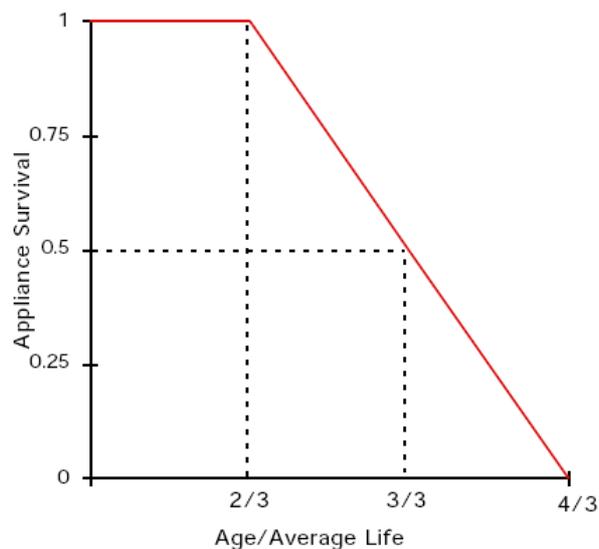


Figure 1.2: Appliance survival function.

ANNEX 4

Method of calculations of the refrigerating capacity of the food industry

A4.1 Global cooling capacity for all meats

The refrigerant inventory for the meat sub-domain has been determined using meat production figures. The FAO database gives a very detailed description of the meat demand and production for all the countries since 1961.

Cooling process for meat

The vast majority of four-footed animals are slaughtered in commercial slaughterhouses under supervision. The small portion still slaughtered on the farm has not been taken into account.

After killing, bleeding, skinning, evisceration, the meats (M1) are cooled, then either cut and packaged for frozen meat (M2) or stored in one piece if for fresh meat (M3) (see Figure A6.1).

The quantities M1, M3 and M4 are known from the FAO database. For frozen meat, the quantities are directly included in the frozen food demand, which has been analysed as one specific entity (see section 6.6).

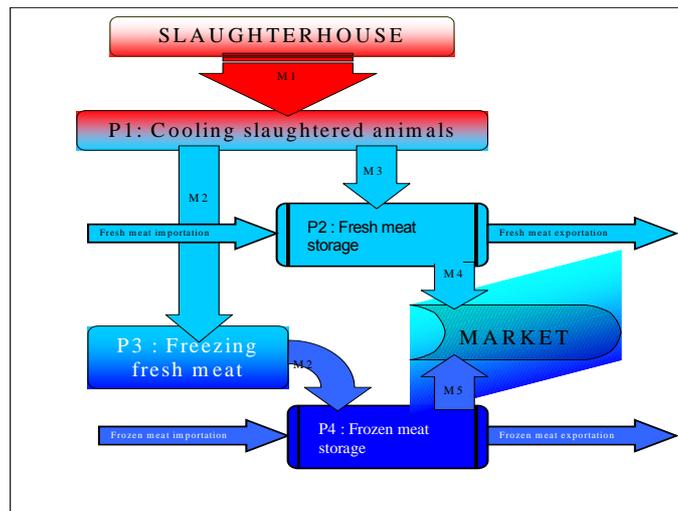


Figure A4.1- Cooling and freezing for production and storage

Based on the different meat masses, the following refrigerating capacities are defined:

- P1 and P2 are the cooling capacities for fresh meat chilling and storage, respectively
- P3 and P4 are the cooling capacities for meat freezing and frozen meat storage, respectively.

A4.1.1 Cooling Model for Beef

The cooling capacity for meat is based on the maximum needed capacity at peak load, which in fact is the design criterion for refrigerating equipment. Peak load occurs at the beginning of meat chilling, just after the slaughter when carcasses have their highest temperature.

Figure A4.2 shows the exponential curve of beef carcass temperature drop. The chill rate is $\Delta\theta / \Delta t$, but the peak load corresponds to the maximum slope $\alpha \cdot (\Delta\theta / \Delta t)$, which is required for sanitary issues.

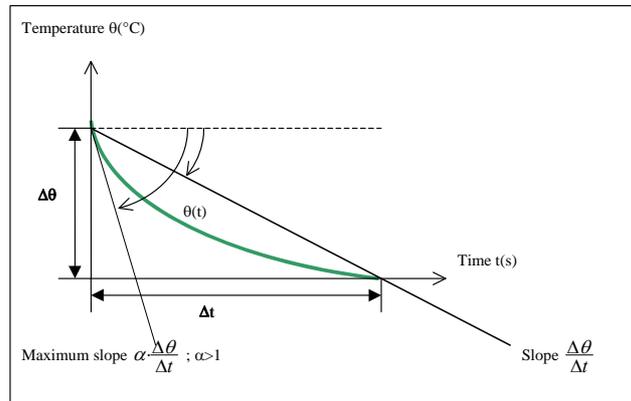


Figure A4.2 - Cooling model of beef

From Figure A4.2 the maximum product cooling capacity P_{meat} can be calculated, i.e., by using the equation below.

$$P_{meat} = \frac{\alpha \cdot M \cdot c \cdot \Delta\theta}{\Delta t} \quad (A6.1)$$

where:

P_{meat} meat maximum cooling capacity (kW)

α coefficient for the determination of the maximum rate of chill (see Figure A4.2),

c average heat capacity (kJ/kg K)

$\Delta\theta / \Delta t$ temperature difference for a given time difference (K/s).

The water evaporated from the beef carcass condenses and freezes on the evaporator coils requiring additional capacity due to frost formation. The rate of water evaporation is proportional to the rate of meat being cooled; and the corresponding cooling capacity can be calculated by the equation below:

$$P_{frost} = \beta \cdot \frac{\alpha \cdot M}{\Delta t} \cdot H_{sol} \quad (A4.2)$$

where :

$\frac{\alpha \cdot M}{\Delta t}$ maximum rate of chilled meat

H_{sol} = ice heat of solidification = 335 kJ/kg

$\beta < 1$, part of water lost from the chilled meat

Miscellaneous loads such as conveyors, air infiltration, personnel, fan motors, lights, and equipment heat losses need to be taken into account. The latter loads are proportional to the maximum cooling capacity M .

$$P_{misc} = \gamma \cdot M \quad (A4.3)$$

where:

γ (W/kg) is the factor for maximum miscellaneous losses.

The total cooling capacity is :

$$P_{tot} = P_{meat} + P_{frost} + P_{misc}$$

$$\Rightarrow P_{tot} = \frac{\alpha \cdot M \cdot c \cdot \Delta\theta}{\Delta t} + \beta \cdot \frac{\alpha \cdot M}{\Delta t} \cdot H_{fusion} + \gamma \cdot M$$

Thus the cooling capacity per unit of mass is:

$$p = \frac{P_{tot}}{M} = \frac{\alpha \cdot c \cdot \Delta\theta}{\Delta t} + \beta \cdot \frac{\alpha}{\Delta t} \cdot H_{fusion} + \gamma \quad (A4.4)$$

where

p specific cooling capacity (W/kg).

◆ **Coefficient values for chill and holding coolers**

Chilling of the beef carcass is performed in two different coolers. First the rapid cooling is performed in the chill cooler, and then cooling takes place at a reduced rate in the holding cooler. The density of the carcass is significantly lower in the holding cooler (45kg/m^3) than in the chill cooler (60kg/m^3). So, if referred to the mass of a chilled carcass, the ratios of miscellaneous heat losses are different. Taking into account that for large storage the volumetric G factor amounts to 30 W/m^3 , this leads to

$\gamma_1 = 0.5\text{ W/kg}$ for chill cooler, and

$\gamma_2 = 0.677\text{ W/kg}$ for holding cooler.

◆ **Coefficient for chill cooler**

Dressed beefs are split into half carcasses (the average half carcass mass is around 150 kg) and the average specific heat c is around 3.14 kJ/kg K [ASH98].

α is determined according to the curve of average carcass temperature of meat cooling versus time (Figure 4.3),

$\Delta t = 20\text{ h}$ and $\Delta\theta = 28^\circ\text{C}$, the first 4 hours ($= 0.2\Delta t$) the temperature decreases by 11.2 K ($= 0.4\Delta\theta$) therefore $\alpha = 2$.

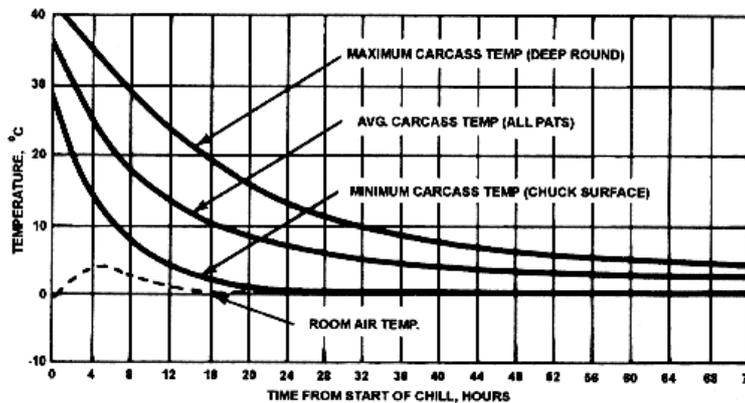


Figure A4.3 - Beef chilling curves [ASH98]

$\beta = 0.03$ represents typically 3% of the chilled mass [ASH98] ; $\gamma = 0.5\text{ W/kg}$ (see above).

In summary, for $\Delta t = 20\text{h} = 72\,000$ seconds and $\Delta\theta = 28^\circ\text{C}$, $\alpha = 2$, $\beta = 0.03$, $\gamma = 0.5$.

And $p_1 = 3.2214\text{ W/kg}$ (ratio 1)

◆ **Holding cooler coefficient**

Equation (1) is applicable here. The temperature drop is lower for a longer time, and the water evaporation speed is low, leading to the following coefficient.

($\alpha = 1.2$, $\beta = 0.0035 = 0.35\%$, $\gamma = 0.667\text{ W/kg}$, $\Delta\theta / \Delta t = 4.17\text{ K/24h}$)

$$p_2 = 0.866 \text{ W/kg} \quad (\text{ratio 2})$$

A6.1.2 Cooling capacity for ancillaries

Besides cooling, freezing, storing, many other operations are needed in meat processes, like cutting, packing, examining, expedition.... The cooling needs here are proportional to the size of the slaughterhouse and so also proportional to the annual capacity of meat being processed.

Based on a detailed case study of a large French slaughterhouse [CLO96], the typical ancillary cooling capacities are presented in Table A4.1.

Table A4.1 – Ancillary cooling capacities

| Designation | Nb | Unit Capacity (kW) |
|------------------------|----|--------------------|
| Offal process room | | 16 |
| Offal refrigeration | 2 | 27 |
| White offal storage | | 26.5 |
| Wastes | 3 | 16.5 |
| Blood tank | | 16 |
| Hides | 3 | 13.5 |
| Exam | | 7 |
| Pre-check room | | 10.5 |
| Check room | | 10.5 |
| Input room | | 7 |
| Food for animals | | 4 |
| Complement storage | 2 | 22 |
| Large part cutting | 3 | 13 |
| Expeditions | 3 | 16.5 |
| Storage before cuts | 2 | 16.5 |
| Offal process room (2) | | 13 |
| Cutting room 1 | | 46.5 |
| Cutting room 2 | | 13 |
| Offal storage room | | 13 |
| Offal packing room | | 16.5 |
| Packaging | | 14 |
| Vacuum storage | | 14 |
| Packaging consignment | | 12.5 |
| Consignment | 3 | 12.5 |
| Passageways | 3 | 4 |
| Total | | 599 kW |

30,000 tons are processed in this slaughterhouse annually. From this case study the ancillary ratio is fixed.

$$p_3 = \frac{599}{30000} = 0.02 \text{ kW/at}^* \quad (\text{ratio 3})$$

* *at* : is the meat annual production in tons

p_3 is calculated and it is based on the total quantity of processed meat, not taking into account the characteristics of the different cooling rooms, and this ratio is therefore used for the annual meat production.

A4.1.3 Generalization to all types of meat

Meat cooling, whatever the type of meat, is very similar due to the sanitary specifications. The carcass shall be cooled down as quickly as possible, the limit is linked to the meat hardness.

Due to physiological changes after slaughtering, heat is generated inside the body and tends to increase its temperature to around 41°C when the carcass enters the chilling cooler.

HACCP (Hazard Analysis and Critical Control Point) [ASH98] recommends that red meat carcasses be chilled to 5°C within 24 hrs, and that this temperature be maintained during storage, shipping, and product display.

Heat capacities of meats vary with the percentage of fat and moisture, but an average heat capacity 3,1 kJ/(kg. K) is used for calculations of all meats [ASH98].

Meats are divided in three groups according to the carcass size that influences the cooling time:

- first group with an average mass per carcass of 150 kg, e.g. beef, veal, horse
- second group with an average mass per carcass of 60 kg, e.g. pig, mutton, lamb, goat ...
- third group with an average mass per poultry of 4 kg, e.g. turkey, chicken, duck, goose....

The beef cooling model is used as a general model and the different coefficients for each group are given in Table A4.2.

Table A4.2 - Physical properties and ratios for cooling capacity calculations

| | Group I | Group II | Group III |
|-----------------------------------|------------------------|-------------------------|---|
| Parameters/ratios | Beef, veal, horse meat | Goat, Mutton, lamb, Pig | Chicken, duck, goose, birds, rabbit, turkey |
| α | 2 | 1.5** | 1.2** |
| C (J/(kg.K)) | 3,140 | 3,140 | 3,140 |
| $\Delta\theta$ (K) | 30 | 30 | 30 |
| Δt (h) | 20 | 12** | 6** |
| β | 0.03 | 0.03 | 0.03 |
| γ (W/kg) | 0.5 | 0.5** | 0.5** |
| Fresh meat cooling ratio (W/kg) | 3.326 | 4.05 | 5.733 |
| Fresh meat storage ratio (W/kg) | 0.866 | 0.866** | 0.866** |
| Ancillary cooling capacity kW/at* | 0.02 | 0.02** | 0.02** |

*at = annual ton **Estimation

A4.1.4 Calculation of the national installed cooling capacity for meat

The FAO web-site presents statistics on the annual production, imports and exports of meat. Production figures relate to animals slaughtered within national boundaries regardless of their origin. These figures are used as inputs in the country database for all countries, years and types of meats. The format is a uniform table of countries by year and it is adopted for all types of meat. Table A4.3 shows other constants needed to estimate the installed cooling capacity.

Table A4.3 –Working time assumptions

| | Constants |
|--|-----------|
| Slaughterhouse coefficient of use | 0.8 |
| Warehouse coefficient of use | 0.6 |
| Residence time in the warehouse (days) | 2 |
| Working days per year (slaughterhouse) | 300 |
| Working days per year (warehouse) | 360 |

The national installed cooling capacity is calculated based on the national demand of all countries and for all types of meat.

The installed cooling capacity takes into account three terms:

- meat cooling
- meat storage, and
- ancillary cooling capacities.

◆ National fresh meat cooling capacity

The national installed cooling capacity for fresh meat cooling is calculated by the following equation:

$$P_1 = \frac{M_p \cdot p_1}{\tau \cdot \lambda}$$

Where:

- P_1 national installed cooling capacity for fresh meat (kW)
- M_p annual meat production obtained from the FAO database per country (annual tons)
- p_1 ratio of fresh meat cooling (W/kg) (see Table A4.2)
- τ working days per year (slaughterhouse) (see Table A4.3)
- λ coefficient of use of the slaughterhouse (see Table A4.3).

◆ National cooling capacity for fresh meat storage

The national installed cooling capacity for fresh meat storage is calculated by the following equation:

$$P_2 = \frac{M_p \cdot p_2 \cdot \sigma'}{\tau' \cdot \lambda'}$$

Where:

- P_2 national installed cooling capacity for fresh meat storage (kW)
- M_p annual meat production obtained from the FAO database per country (annual tons)
- p_2 ratio of fresh meat storage (W/kg) (see Table A4.2)
- σ' Storage residence time (day)
- τ' working days per year of the warehouse (see Table A4.3)
- λ' coefficient of use of the warehouse (see Table A4.3).

◆ **National installed cooling capacity for ancillaries**

The national installed cooling capacity for ancillaries is calculated by the following equation:

$$P_3 = \frac{M_p \cdot p_3 \cdot \lambda}{\lambda}$$

Where:

- P₃ national installed cooling capacity for fresh meat storage (kW)
- M_p annual meat production obtained from FAO database per country (annual tons)
- p₃ capacity ratio of ancillaries (kW/annual tons) (see Table 4.2)
- λ coefficient of use of the factory (see Table 4.3)

◆ **Verification with the French Inventory report [PAL02]**

After aggregation of all installed parcs for all groups of meat, the total installed parc for France is listed in Table A4.4

Table A4.4 - France refrigerating parc for meat industry

| | 1991 | 1992 | 1993 | 1994 | 1995 | 1996 | 1997 | 1998 | 1999 | 2000 |
|---------------------------------------|--------|--------|--------|--------|--------|--------|--------|---------------|--------|--------|
| Total installed cooling capacity (MW) | 341.84 | 351.69 | 355.14 | 367.39 | 378.44 | 389.98 | 393.25 | <u>398.32</u> | 392.94 | 384.99 |

In Inventory Reports for France issued previously, another method was used to determine the installed cooling capacity.

If the energy consumption in refrigeration for the meat industry is known (i.e., 1228 GWh per year), assuming a COP of 2, a factory working time of 300 days per year and 16 hours per day, the calculated installed capacity is 512 MW for the year 1998. Referred to the installed cooling capacity listed in Table 4.4, the error made is 22.15%.

A4.2 Global cooling capacity for dairy industry

A4.2.1 Calculation of installed cooling capacity

The refrigerant inventory for the dairy sub domain is determined using the dairy production and sales. The FAO database gives a very detailed description of the dairy demand and production for all the countries since 1961.

Frozen dairy products are not considered in this section, they are aggregated in the frozen product domain.

Figure A4.4 gives the link between different figures available in FAO Database for dairy process.

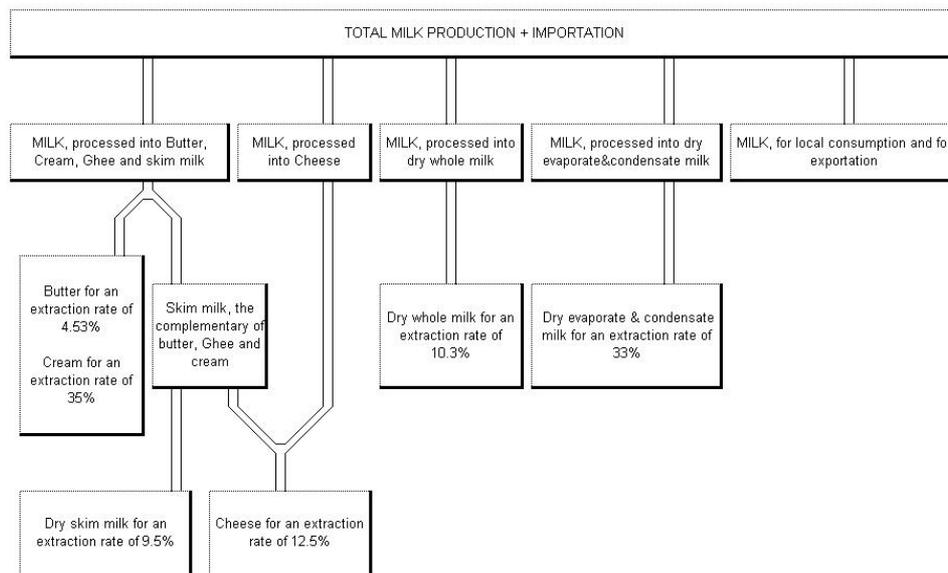


Figure A4.4 - The FAO link between different dairy processes

Milk undergoes the cooling in the farm, is transported by insulated trucks, and is treated in the factory where it will be processed into different dairy products.

The major refrigerated process for milk are:

- farm refrigeration (milk tank)
- bacteria treatment (pasteurization, UHT...)
- fermentation (depending on dairy product).

A4.2.2 Milk tank installed cooling capacity

For the milk cooling at the farm, the following rules for cooling are applied:

- cooling from 35 to 5°C in 2 hours
- no frosted milk in the tank, even partial
- allowable temperature increase equal to 5K if a second milking is added to the milk tank.

To avoid every risk of the milk temperature decreasing below the frosting point, 4°C is the lowest controlled temperature for direct expansion milk tanks (which are the most widespread). Some milk tanks use ice accumulation technology to maintain a lower temperature, between 0 and +1°C. The above mentioned two types of milk tanks show similar performances. For both types, the law for cooling can be considered as linear.

At 4°C, the milk cannot be conserved in milk tanks at the farm longer than two days, because of bacteria proliferation.

The cooling model for a milk tank is similar to the cooling model for meat:

$$p_{milk} = \frac{\alpha \cdot c \cdot \Delta\theta}{\Delta t} + \gamma \quad (\text{A4.5})$$

with :

$\Delta\theta = 30^\circ\text{C}$ pour $\Delta t = 2\text{h} = 7200 \text{ sec}$

$\alpha = 1$ (temperature curve is linear cause of cooling time is short in respect of temperature drop)

$c = 4 \text{ kJ}/(\text{kg}\cdot\text{K})$ [ASH98].

Calculation of miscellaneous heat losses

γ has been evaluated taking into account the insulation of typical milk tanks. Calculations show that $\gamma = 0.033 \text{ W/kg}$, which is negligible and it is therefore not taken into account in the formula. Based on those assumptions, the milk capacity ratio p_{milk} can be derived as follows:

$$p_{milk} = 16,7 \text{ W/kg} \quad (\text{ratio 4})$$

Milk capacity ratio verification

For France the average milk tank volume installed amounts to 3000 L. Data sheets of a standard milk tank are obtained from literature [INTVMZ]. This reference gives the nominal volume of a typical direct expansion milk tank and its installed compressor power (2500 l; 15.47 kW). Assuming a COP of 2.5, the cooling capacity amounts to 38.67 kW. The milk capacity ratio calculated with the data mentioned yields a figure of 15.47 W/kg. The difference with the milk capacity ratio calculated using (equation 4.5) is about 8%, which is acceptable.

The milk capacity ratio will therefore be calculated using a ratio of 4.

Installed cooling capacity for Average National Daily Milk Production (ANDMP)

To establish the world installed cooling capacity for milk tanks, it is necessary to determine the Average National Daily Milk Production. Knowing the annual milk production from the FAO, (i) with a maximum residence time of two days, (ii) in which a maximum of four milkings are considered (two milkings a day), and (iii) a maximum filling ratio of 0.7 of the milk tank, (which is an average value taking into account the annual variation from 0.6 to 0.8), the Average National Daily Milk Production for a given country is calculated as follows:

$$M_{ANDMP} = \frac{M_p \cdot \sigma}{n \cdot \tau \cdot \rho}$$

where:

| | |
|-------------|---|
| M_{ANDMP} | average national daily milk production (ANDMP) (kg) |
| M_p | annual milk production obtained from FAO database (annual kg) |
| σ | maximum residence time (days) |
| n | number of milkings in a milk tank |
| τ | number of days per year |
| ρ | filling ratio |

| Parameters | |
|--------------------------|------|
| Days per year | 360 |
| Max residence time (day) | 2 |
| Cooling ratio W/kg | 16.7 |
| Number of milkings | 4 |
| Filling ratio | 0.7 |

Table 4.5 – ANDMP parameters

The national installed cooling capacity for milk tanks is then:

$$P_{milk} = M_{ANDMP} \cdot P_{milk}$$

A4.2.3 Milk bacterial process and cooling

For pathogenic bacteria elimination, several milk processes are applied: pasteurisation, UHT.... This process consists of:

- heating the milk;
- maintaining it at high temperature during the necessary time for complete pathogenic bacteria elimination,
- cooling it to 4°C.

Refrigeration is only related to the milk cooling from 35°C to 4°C, since the milk cooling from temperatures higher than 35°C is done either by cold water or, better, by regeneration in a milk / milk heat exchanger.

Several cooling techniques are used, chilled water being the most widespread for large milk facilities.

Pasteurization and cooling take place in the same heat exchanger, which includes three zones:

- a heating zone for the pasteurization,
- a central zone where the homogenized cold milk is heated by the counter current of pasteurized hot milk (regeneration process),
- a cooling zone where the milk is cooled by chilled water.

To determine the cooling capacity for the national pasteurization, the following formula is used:

$$P_{past} = \eta \times \left(\frac{M_p}{\tau'} \right) \times C_p \times \Delta\theta$$

$$P_2 = \frac{\eta}{\lambda} \times \left(\frac{M_p}{\tau'} \right) \times C_p \times \Delta\theta = \frac{M_p \times P_{past}}{\lambda} \quad (4.6)$$

Where

P_{past} national cooling capacity for pasteurization (kW)

η heat loss factor

λ coefficient of use

M_p milk annual production obtained from FAO database (annual tons)

τ' factory working time in seconds

C_p heat capacity of milk

$\Delta\theta$ temperature drop (°C)

$\frac{M_p}{\tau'}$ average mass flow rate of the factories

Table A4.6 - Cooling parameters after pasteurization

| | |
|---|-----|
| Factory working days per year (days) | 300 |
| Factory working hours per year (hours) | 16 |
| Temperature drop (°C) | 31 |
| C_p (kJ/kg.K) | 4 |
| Heat loss factor η (Indirect systems + Other installations) | 1.4 |
| Coefficient of use λ (real mass flow rate / dimensional mass flow rate) | 0.8 |

$$\Rightarrow p_{past} = 0.01256 \text{ W/annual kg.}$$

A4.2.4 Fermentation and cooling

Some dairy products need to be stored in refrigerated rooms for fermentation, but the residence time differs from one product to another and from one country to another. Table A4.7 lists different chosen parameters for the calculation of cooling in fermentation rooms.

The national cooling capacity for fermentation rooms is calculated as follows:

$$P_{ferm} = \frac{M_p \cdot p_{ferm} \cdot \sigma}{\tau \cdot \phi}$$

where

- P_{ferm} national installed capacity for fermentation rooms (kW)
- M_p annual dairy product obtained from FAO database (annual tons)
- p_{ferm} volumetric cooling ratio for fermentation (W/m^3)
- ϕ minimum storage ratio of products in 1 m^3 of warehouse (kg/m^3)
- σ staying delay in factory warehouse (day)
- τ working days per year of factory warehouse.

Table A4.7 – Fermentation and storage parameters

| | Butter and Ghee | Cheese | Cream |
|-----------------------------|-----------------|--------|-------|
| Temperature ($^{\circ}C$) | 5 | 5 | 5 |
| Cooling ratio (W/m^3) | 30 | 30 | 30 |
| Storing ratio (kg/m^3) | 300 | 500 | 300 |
| Residence time (days) | 5 | 30 | 5 |

A4.3 Global cooling capacity for wine and beers

The FAO database includes global wine and beer production figures. In order to derive the installed cooling capacities from the wine and beer production figures, two cooling models have been developed.

A4.3.1 Wine cooling model

The wine cooling model is based on a detailed case study of a winery where the cooling capacities and production are known. From [CLO96], Table A4.8 has been established using the annual production figure of 75,000 hl.

Table A4.8 - Cooling data of the typical case

| Cooling stage | Cooling capacity (kW) | Product capacity (hl) | Ratio: cooling capacity/product capacity (W/kg) | Ratio: annual production/product capacity | Ratio: cooling capacity/annual production (W/annual kg) |
|--------------------------------------|-----------------------|-----------------------|---|---|---|
| Wine-making process | 70 | 25000 | 0.028 | 3 | 0.0093 |
| Tartaric stabilisation ultra-cooling | 50 | 25000 | 0.020 | 3 | 0.0067 |
| Storage | 175 | 75000 | 0.0233 | 1 | 0.0233 |

From Table A6.8 the total cooling ratio of wine can be derived as 0.03933 W/annual kg.

The average time for wine-making process is one week for red wine and 15 days for white wine. The average time for tartaric stabilisation is 15 days [CLO96]. For the case under study, the storage is air-conditioned because during summer the ambient temperature is very high and the storage temperature must be kept under 21°C. This case is not applicable to all wineries, therefore the storage cooling ratio has been multiplied by a factor α less than 1, $\alpha = 0.4$ (40% of wineries use air conditioning in their wine storage).

$$P_{\text{wine}} = 0.03 \text{ W/annual kg} \quad (\text{ratio 5})$$

A4.3.2 Beer cooling model

Wort cooling

The following formula is used for the national wort cooling capacity: $P_{\text{wort}} = \frac{\eta}{\lambda} \times \left(\frac{M_p}{\tau'} \right) \times C_p \times \Delta\theta$

Where

P_{wort} national wort cooling installed capacity (kW)

η losses multiplier factor ($\eta = 1.4$)

λ coefficient of use (real flow rate/ dimensioned flow rate, $\lambda=0.8$)

M_p beer annual production obtained from FAO database (annual tons)

τ' factory working time in seconds (the factory works 300 days/yr and 16 hrs/day)

C_p wort heat capacity ($C_p = 4 \text{ kJ}/(\text{kg}\cdot\text{K})$ [ASH98])

$\Delta\theta$ temperature drop (°C) ($\Delta\theta = 31^\circ\text{C}$ [ASH98])

$\frac{M_p}{\tau'}$ average wort mass flow rate.

$$P_{\text{wort}} = 0.01256 \text{ W/annual kg} \quad (\text{ratio 6})$$

Fermentation

Beer ratio fermentation amounts to 0.0033 W/annual kg which has been taken from [ASH98].

$$p_{\text{ferm}} = 0.033 \text{ W/annual kg} \quad (\text{ratio 7})$$

A4.4 Global cooling capacity for flake ice for fresh fish conservation

The cooling capacities applied and the refrigerant types used on board of fishery vessels are taken into account in considerations of the refrigerated vessel fleet. But, once the fish is delivered for sale, fresh fish conservation is essentially performed on flake ice.

The ratio of ice used for fish conservation, IFR, is:

$$\text{IFR} = \text{mass of ice} / \text{mass of fish} = 0.5 \text{ (0.25 for cooling and 0.25 for lost [RGF02])}.$$

The National Fresh Fish Annual Production (NFFAP) data are coming from the FAO database.

The capacity ratio for producing flake ice is:

$$\text{Ice Cooling Capacity Ratio, ICCR} = 6.95 \text{ W/kg [ASH98]}.$$

Average number of catches (catching days) per year: 300 catches per year.

The national installed cooling capacity for production of flake ice for fish conservation is calculated as follows:

$$P_{\text{fish}} = \frac{\text{NFFAP}}{\tau'} \times \text{ICCR} \times \text{IFR} \text{ (W)}$$

where

τ' is the number of catching days per year (300)

NFFAP (kg/yr)

ICCR (W/kg).

A4.5 Global cooling capacity for frozen food

A4.5.1 Frozen food production

Annual frozen food production is not yet available from the FAO Database, but export and import data are available, and they allow to establish the world frozen food production using the Kaminsky ratios [KAM95] for annual consumption of frozen food per capita as presented in Table A4.9, and using the equation:

$$\text{Production} = \text{Consumption} + \text{Export} - \text{Import}$$

Table A4.9 – Annual consumption of frozen food per inhabitant [KAM 95]

| Countries | USA, Denmark | UK, France, Sweden | Germany, Switzerland | Norway, Austria, Belgium, Finland, Spain, Australia, Japan, The Netherlands | Italy, Poland, ex-URSS and others | Hungary |
|----------------------------------|--------------|--------------------|----------------------|---|-----------------------------------|---------|
| Annual consumption/habitant (kg) | > 40 | 30 – 40 | 20 – 30 | 10 – 20 | < 10 | |

For each group presented in Table A4.9, linear interpolation with the mean GDP of the corresponding country allows the determination of the annual consumption per capita.

In the FAO database import and export figures are available for: Ice cream, Potato frozen, Sweet corn frozen, Cephalopods Frozen, Crustaceans Frozen, Demersal Frozen Fillets, Demersal Frozen Whole, Fish fillet chilled frozen, Fish Frozen Whole Fillet, Fish shellfish frozen, Freshwater Frozen Whole, Freshwater Frozen Fillets, Marine nes Frozen Fillet, Marine nes Frozen Whole, Mollusc Frozen, Pelagic Frozen Fillets, Pelagic Frozen Whole.

Based on previous calculations, the world frozen food production as determined is presented in Table A4.10.

Table A4.10 - World frozen food production

| Year | 1980 | 1981 | 1982 | 1983 | 1984 | 1985 | 1986 | 1987 | 1988 | 1989 | 1990 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Production (10 ⁶ t) | 26.51 | 27.28 | 27.38 | 27.34 | 27.56 | 27.04 | 27.42 | 28.35 | 28.13 | 29.71 | 29.36 |
| Year | 1991 | 1992 | 1993 | 1994 | 1995 | 1996 | 1997 | 1998 | 1999 | 2000 | |
| Production (10 ⁶ t) | 32.14 | 32.78 | 32.90 | 35.93 | 37.37 | 36.27 | 38.38 | 39.80 | 38.40 | 38.54 | |

[KAM95] estimates the world frozen food production by the beginning of 1990 at a level of 30 million tons. The calculated value for this year is 7% higher (table A4.10).

A4.5.2 Frozen food cooling model

Based on data from a manufacturer of a blast freezer [SBL], it can be given that the freezing ratio per kg of frozen food per hour is of 121.472 W/(kg h). This value has been used for all types of food.

The frozen food production is considered as continuous production during 16 hours per day and 300 days per year. The factory use coefficient equals 0.8. The national installed capacity for frozen food is calculated according to Figure A4.5.

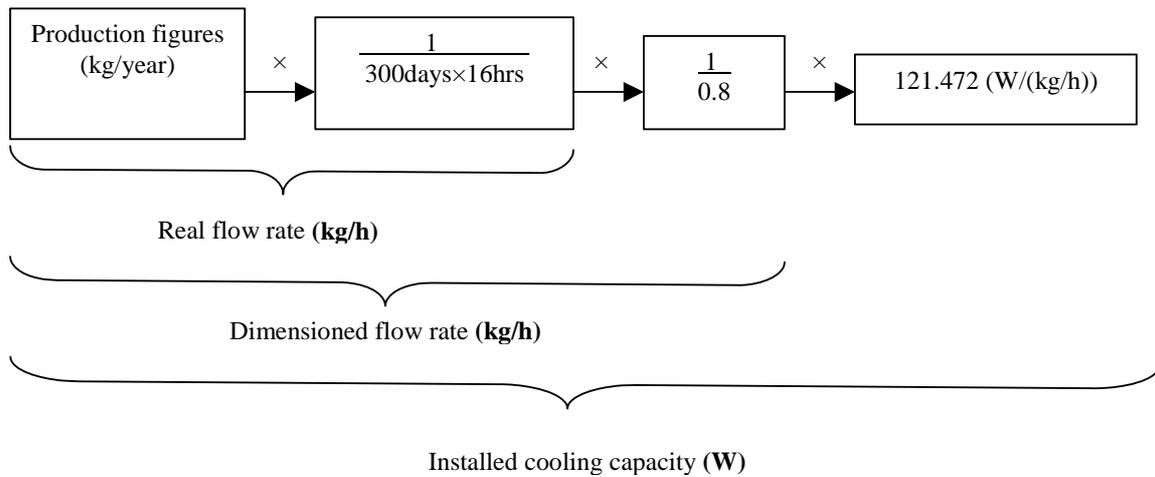


Figure A4.5 – Flow sheet for national installed capacity for frozen food.

The national installed capacity ratio $p_{\text{frozen_food}}$ is

$$p_{\text{frozen_food}} = 0.0316 \text{ W/annual kg}$$

For the factory storage, the same parameters are used.

A4.6 Installed cooling capacity for cold storage

In this section cold storage means all cold storage except the storage in food processing facilities. The refrigerated volumes correspond to low and medium temperature storage, specialised and multipurpose cold stores and fruit packing stations. The cold storage volume estimates by country are based on ratios that have been elaborated on for different developed countries [KAM95, GLO92-93]. Based upon these ratios additional calculations have been performed in order to refer the cold storage volume to the GDP. Figure A6.6 indicates the evolution of the cold storage referred to the GDP as a function of time (1930-2000).

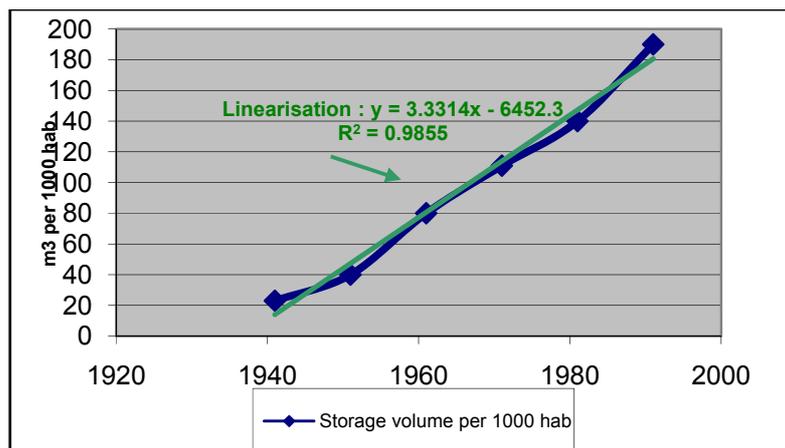


Figure A4.6 – The US typical storage volume example [KAM95]

A saturated linear extrapolation with the US storage volume per capita and the mean GDP allows the establishment of the storage volume per capita for each country (Figure A6.7). The extrapolation with the US storage increased volume per year and the GDP standard deviation makes it possible to establish the storage-increased volume for each country. Extrapolations have been done for year 1961 and have been projected to the year 1999 using the storage-increased volume per year and the population figures.

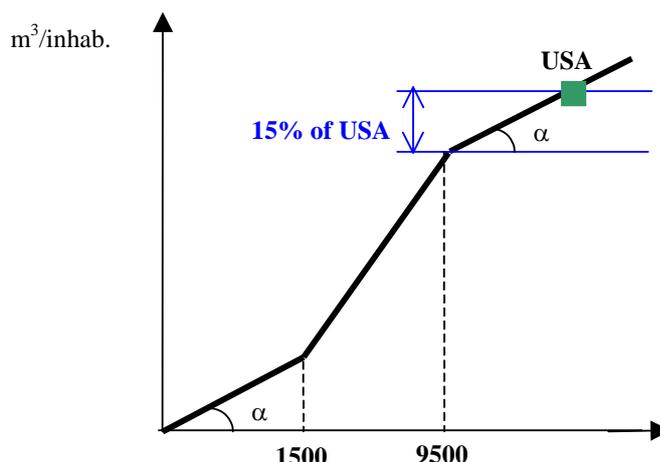


Figure A4.7 – Saturated linear extrapolation based on USA typical example

Low temperature cooling capacity over total cooling capacity is calculated taking into account the frozen food consumption per inhabitant.

Medium and low temperatures cooling capacities referred to the cold storage volume are known from the report [ADE00].

References to Annex 5

- [ADE00] Diagnostic énergétique des installations frigorifiques industrielles, Ouvrage collectif, Guides et Cahiers Techniques, ADEME, EDF. 2000.
- [ASH98] ASHRAE REFRIGERATION 1998.
- [BIL95] Billiard F. Le Froid dans les IAA au regard de l'environnement. Revue générale du froid. March 1995 N° 951.
- [CLO96] Clodic D. L'efficacité énergétique des installations frigorifiques dans les entreprises agroalimentaires. Convention ADEME. Final report. September 1996.
- [CLO02] Clodic, D., L. Palandre, A. Zoughaib, L. Kuijpers. Estimates of the World-Wide Fleets of R/AC Equipment to Determine Refrigerant Emissions; First Results for Domestic Refrigeration. Earth Technology Forum, Washington, March 2002.
- [FAO02] Food and Agriculture Organization of the United Nations website: www.fao.org
- [GLO92-93] Global Frozen Food Almanac '92 and '93 in Quick Frozen Foods International. October 1992 and October 1993.
- [INTVMZ] www.vmz.ru
- [IPC06] Draft version of the Revised 2006 Guidelines for National Greenhouse Inventories: OECD / IEA Paris.
- [IPC96] Revised 1996 Guidelines for National Greenhouse Inventories. OECD / IEA Paris.
- [KAM95] Kaminski W. Le froid et l'économie alimentaire mondiale. IIF-IIR, 1995.

- [PAL03b] Palandre, L., A. Zoughaib and D. Clodic. Inventories of the world-wide fleets of refrigerating and air-conditioning equipment in order to determine refrigerants emission for the years 1990 to 2000. Report for ADEME and GGEEC, June 2003.
- [PAL02] Palandre, L, Choquart F., Mahfoud M., Clodic D. Inventaire et prévisions des fluides frigorigènes et de leurs émissions - Année 2000. ADEME, ARMINES, May 2002.
- [RGF02] Revue générale du froid. April 2002, N° 1022.
- [UNE03] 2002 Report of the Refrigeration, Air Conditioning and Heat Pumps Technical Option Committee (RTOC). 2002 Assessment. March 2003. ISBN 92-807-2288-3.

ANNEX 5

Annex to some figures of Part I of the report (Figure referred to indicated in parentheses after table number)

Table A5.1 (Figure 1.10) Total demand in CS – Lower threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 264 | 855 | 0 | 0 | 1,118 |
| 1991 | 265 | 861 | 0 | 0 | 1,126 |
| 1992 | 264 | 915 | 0 | 0 | 1,179 |
| 1993 | 261 | 995 | 0 | 0 | 1,256 |
| 1994 | 249 | 1,073 | 0 | 0 | 1,322 |
| 1995 | 175 | 1,015 | 0 | 0 | 1,190 |
| 1996 | 131 | 1,203 | 0 | 0 | 1,334 |
| 1997 | 100 | 1,243 | 0 | 0 | 1,343 |
| 1998 | 76 | 1,272 | 0 | 0 | 1,347 |
| 1999 | 55 | 1,275 | 24 | 0 | 1,354 |
| 2000 | 37 | 1,273 | 54 | 0 | 1,364 |
| 2001 | 23 | 1,233 | 116 | 0 | 1,372 |
| 2002 | 13 | 1,126 | 167 | 0 | 1,306 |
| 2003 | 5 | 1,019 | 224 | 0 | 1,248 |
| 2004 | 0 | 893 | 240 | 0 | 1,132 |

Table A5.1 (Figure 1.11) Total demand in CS – Higher threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 264 | 855 | 0 | 0 | 1,118 |
| 1991 | 265 | 861 | 0 | 0 | 1,126 |
| 1992 | 264 | 915 | 0 | 0 | 1,179 |
| 1993 | 261 | 995 | 0 | 0 | 1,256 |
| 1994 | 249 | 1,073 | 0 | 0 | 1,322 |
| 1995 | 175 | 1,015 | 0 | 0 | 1,190 |
| 1996 | 137 | 1,239 | 0 | 0 | 1,376 |
| 1997 | 110 | 1,324 | 0 | 0 | 1,435 |
| 1998 | 87 | 1,403 | 0 | 0 | 1,490 |
| 1999 | 66 | 1,461 | 25 | 0 | 1,553 |
| 2000 | 48 | 1,523 | 59 | 0 | 1,629 |
| 2001 | 32 | 1,546 | 127 | 0 | 1,705 |
| 2002 | 18 | 1,500 | 191 | 0 | 1,709 |
| 2003 | 8 | 1,453 | 268 | 0 | 1,728 |
| 2004 | 0 | 1,374 | 305 | 0 | 1,679 |

Table A5.2 (Figure 1.12) Refrigerant demand of condensing unit (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 74 | 579 | 0 | 0 | 653 |
| 1991 | 57 | 565 | 0 | 0 | 622 |
| 1992 | 53 | 551 | 0 | 0 | 604 |
| 1993 | 49 | 544 | 0 | 0 | 593 |
| 1994 | 45 | 568 | 0 | 0 | 613 |
| 1995 | 37 | 609 | 0 | 0 | 645 |
| 1996 | 29 | 621 | 0 | 0 | 650 |
| 1997 | 22 | 626 | 0 | 0 | 648 |
| 1998 | 16 | 619 | 0 | 0 | 636 |
| 1999 | 11 | 611 | 0 | 0 | 623 |
| 2000 | 7 | 624 | 13 | 0 | 644 |
| 2001 | 4 | 604 | 23 | 0 | 632 |
| 2002 | 2 | 568 | 44 | 0 | 614 |
| 2003 | 1 | 535 | 71 | 0 | 607 |
| 2004 | 0 | 510 | 94 | 0 | 604 |

Table A5.3 (Figure 1.13) Refrigerant demand of stand-alone equipment (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 27 | 11 | 0 | 0 | 38 |
| 1991 | 26 | 10 | 0 | 0 | 36 |
| 1992 | 27 | 9 | 0 | 0 | 36 |
| 1993 | 22 | 9 | 5 | 0 | 36 |
| 1994 | 16 | 10 | 13 | 0 | 40 |
| 1995 | 3 | 11 | 29 | 0 | 43 |
| 1996 | 3 | 11 | 31 | 0 | 45 |
| 1997 | 3 | 12 | 31 | 0 | 45 |
| 1998 | 2 | 11 | 32 | 0 | 45 |
| 1999 | 2 | 8 | 35 | 0 | 45 |
| 2000 | 2 | 7 | 40 | 0 | 48 |
| 2001 | 2 | 5 | 41 | 0 | 48 |
| 2002 | 1 | 3 | 42 | 0 | 46 |
| 2003 | 1 | 2 | 43 | 0 | 46 |
| 2004 | 1 | 1 | 44 | 0 | 46 |

Table A5.4 (Figure 1.14) Total demand in commercial refrigeration (CS, CU and standalone) – Lower threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 364 | 1,445 | 0 | 0 | 1,809 |
| 1991 | 348 | 1,436 | 0 | 0 | 1,784 |
| 1992 | 344 | 1,476 | 0 | 0 | 1,819 |
| 1993 | 333 | 1,548 | 5 | 0 | 1,885 |
| 1994 | 310 | 1,651 | 13 | 0 | 1,974 |
| 1995 | 214 | 1,634 | 29 | 0 | 1,878 |
| 1996 | 162 | 1,836 | 31 | 0 | 2,028 |
| 1997 | 125 | 1,881 | 31 | 0 | 2,036 |
| 1998 | 94 | 1,902 | 32 | 0 | 2,028 |
| 1999 | 68 | 1,894 | 59 | 0 | 2,021 |
| 2000 | 46 | 1,903 | 108 | 0 | 2,057 |
| 2001 | 29 | 1,842 | 180 | 0 | 2,051 |
| 2002 | 16 | 1,697 | 253 | 0 | 1,966 |
| 2003 | 7 | 1,556 | 338 | 0 | 1,901 |
| 2004 | 1 | 1,404 | 378 | 0 | 1,783 |

Table A5.5 (Figure 1.15) Total demand in commercial refrigeration (CS, CU and standalone) – Higher threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 364 | 1,445 | 0 | 0 | 1,809 |
| 1991 | 348 | 1,436 | 0 | 0 | 1,784 |
| 1992 | 344 | 1,476 | 0 | 0 | 1,819 |
| 1993 | 333 | 1,548 | 5 | 0 | 1,885 |
| 1994 | 310 | 1,651 | 13 | 0 | 1,974 |
| 1995 | 214 | 1,634 | 29 | 0 | 1,878 |
| 1996 | 168 | 1,871 | 31 | 0 | 2,070 |
| 1997 | 135 | 1,962 | 31 | 0 | 2,128 |
| 1998 | 106 | 2,033 | 32 | 0 | 2,171 |
| 1999 | 80 | 2,080 | 60 | 0 | 2,220 |
| 2000 | 57 | 2,153 | 112 | 0 | 2,322 |
| 2001 | 37 | 2,156 | 191 | 0 | 2,384 |
| 2002 | 22 | 2,071 | 277 | 0 | 2,370 |
| 2003 | 10 | 1,990 | 382 | 0 | 2,381 |
| 2004 | 1 | 1,885 | 443 | 0 | 2,330 |

Table A5.6 (Figure 1.16) Distribution of the demand by refrigeration equipment technology | grocery supermarkets.

| | <i>Centralized systems</i> | <i>Condensing unit</i> | <i>Standalone</i> |
|------------------|----------------------------|------------------------|-------------------|
| Metric tonnes | 1,679 | 604 | 46 |
| Percent of total | 72% | 26% | 2% |

Table A5.7 (Figure 1.17) Refrigerant bank in centralized systems (grocery supermarkets) (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 523 | 1,727 | 0 | 0 | 2,250 |
| 1991 | 539 | 1,782 | 0 | 0 | 2,321 |
| 1992 | 550 | 1,848 | 0 | 0 | 2,398 |
| 1993 | 556 | 1,941 | 0 | 0 | 2,496 |
| 1994 | 550 | 2,052 | 0 | 0 | 2,602 |
| 1995 | 475 | 2,170 | 0 | 0 | 2,645 |
| 1996 | 396 | 2,402 | 0 | 0 | 2,798 |
| 1997 | 320 | 2,630 | 0 | 0 | 2,950 |
| 1998 | 253 | 2,852 | 0 | 0 | 3,104 |
| 1999 | 193 | 3,057 | 17 | 0 | 3,266 |
| 2000 | 139 | 3,247 | 52 | 0 | 3,438 |
| 2001 | 91 | 3,407 | 125 | 0 | 3,623 |
| 2002 | 53 | 3,495 | 224 | 0 | 3,773 |
| 2003 | 22 | 3,526 | 351 | 0 | 3,900 |
| 2004 | 0 | 3,491 | 474 | 0 | 3,964 |

Table A5.8 (Figure 1.18) Refrigerant bank in condensing unit systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 351 | 2,361 | 0 | 0 | 2,712 |
| 1991 | 329 | 2,356 | 0 | 0 | 2,685 |
| 1992 | 307 | 2,337 | 0 | 0 | 2,644 |
| 1993 | 284 | 2,310 | 0 | 0 | 2,594 |
| 1994 | 260 | 2,299 | 0 | 0 | 2,560 |
| 1995 | 212 | 2,319 | 0 | 0 | 2,531 |
| 1996 | 168 | 2,339 | 0 | 0 | 2,507 |
| 1997 | 128 | 2,355 | 0 | 0 | 2,483 |
| 1998 | 94 | 2,359 | 0 | 0 | 2,453 |
| 1999 | 65 | 2,354 | 0 | 0 | 2,419 |
| 2000 | 42 | 2,358 | 10 | 0 | 2,411 |
| 2001 | 25 | 2,352 | 26 | 0 | 2,403 |
| 2002 | 13 | 2,324 | 56 | 0 | 2,393 |
| 2003 | 5 | 2,280 | 102 | 0 | 2,387 |
| 2004 | 0 | 2,227 | 160 | 0 | 2,387 |

Table A5.9 (Figure 1.19) Refrigerant bank in standalone equipment (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 272 | 146 | 0 | 0 | 418 |
| 1991 | 278 | 144 | 0 | 0 | 422 |
| 1992 | 284 | 141 | 0 | 0 | 425 |
| 1993 | 284 | 138 | 4 | 0 | 426 |
| 1994 | 279 | 136 | 15 | 0 | 430 |
| 1995 | 261 | 133 | 40 | 0 | 434 |
| 1996 | 242 | 131 | 66 | 0 | 440 |
| 1997 | 223 | 129 | 92 | 0 | 444 |
| 1998 | 203 | 127 | 118 | 0 | 448 |
| 1999 | 183 | 121 | 147 | 0 | 451 |
| 2000 | 162 | 116 | 180 | 0 | 457 |
| 2001 | 141 | 109 | 213 | 0 | 463 |
| 2002 | 120 | 101 | 247 | 0 | 468 |
| 2003 | 100 | 92 | 282 | 0 | 474 |
| 2004 | 81 | 84 | 315 | 0 | 480 |

Table A5.10 (Figure 1.20) Refrigerant bank in commercial refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1,145 | 4,234 | 0 | 0 | 5,380 |
| 1991 | 1,146 | 4,281 | 0 | 0 | 5,428 |
| 1992 | 1,141 | 4,326 | 0 | 0 | 5,467 |
| 1993 | 1,124 | 4,389 | 4 | 0 | 5,517 |
| 1994 | 1,090 | 4,487 | 15 | 0 | 5,591 |
| 1995 | 948 | 4,622 | 40 | 0 | 5,610 |
| 1996 | 807 | 4,873 | 66 | 0 | 5,745 |
| 1997 | 671 | 5,114 | 92 | 0 | 5,877 |
| 1998 | 550 | 5,338 | 118 | 0 | 6,006 |
| 1999 | 441 | 5,532 | 164 | 0 | 6,136 |
| 2000 | 343 | 5,721 | 242 | 0 | 6,306 |
| 2001 | 257 | 5,868 | 364 | 0 | 6,489 |
| 2002 | 186 | 5,920 | 527 | 0 | 6,634 |
| 2003 | 127 | 5,899 | 735 | 0 | 6,761 |
| 2004 | 81 | 5,802 | 949 | 0 | 6,832 |

Table A5.11 (Figure 1.21) Distribution of the bank by refrigeration technology equipment in grocery supermarkets.

| | <i>Centralised systems</i> | <i>Condensing unit</i> | <i>Standalone</i> |
|------------------|----------------------------|------------------------|-------------------|
| Metric tonnes | 3,964 | 2,387 | 480 |
| Percent of total | 58% | 35% | 7% |

Table A5.12 (Figure 1.22) Total emissions in CS – Lower threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 220 | 701 | 0 | 0 | 921 |
| 1991 | 226 | 732 | 0 | 0 | 958 |
| 1992 | 230 | 769 | 0 | 0 | 999 |
| 1993 | 233 | 816 | 0 | 0 | 1,049 |
| 1994 | 233 | 869 | 0 | 0 | 1,101 |
| 1995 | 228 | 806 | 0 | 0 | 1,033 |
| 1996 | 188 | 857 | 0 | 0 | 1,044 |
| 1997 | 153 | 890 | 0 | 0 | 1,043 |
| 1998 | 120 | 914 | 0 | 0 | 1,034 |
| 1999 | 92 | 925 | 5 | 0 | 1,022 |
| 2000 | 69 | 927 | 14 | 0 | 1,010 |
| 2001 | 49 | 912 | 33 | 0 | 993 |
| 2002 | 29 | 858 | 54 | 0 | 940 |
| 2003 | 14 | 787 | 78 | 0 | 879 |
| 2004 | 5 | 723 | 96 | 0 | 825 |

Table A5.13 (Figure 1.23) Total emissions in CS – Higher threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 220 | 701 | 0 | 0 | 921 |
| 1991 | 226 | 732 | 0 | 0 | 958 |
| 1992 | 230 | 769 | 0 | 0 | 999 |
| 1993 | 233 | 816 | 0 | 0 | 1,049 |
| 1994 | 233 | 869 | 0 | 0 | 1,101 |
| 1995 | 228 | 806 | 0 | 0 | 1,033 |
| 1996 | 195 | 892 | 0 | 0 | 1,087 |
| 1997 | 165 | 970 | 0 | 0 | 1,135 |
| 1998 | 135 | 1,044 | 0 | 0 | 1,179 |
| 1999 | 108 | 1,109 | 6 | 0 | 1,223 |
| 2000 | 84 | 1,173 | 18 | 0 | 1,275 |
| 2001 | 63 | 1,219 | 43 | 0 | 1,325 |
| 2002 | 43 | 1,244 | 75 | 0 | 1,362 |
| 2003 | 27 | 1,251 | 117 | 0 | 1,395 |
| 2004 | 13 | 1,237 | 157 | 0 | 1,407 |

Table A5.14 (Figure 1.24) Refrigerant emissions in condensing unit systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 76 | 518 | 0 | 0 | 594 |
| 1991 | 73 | 521 | 0 | 0 | 594 |
| 1992 | 70 | 523 | 0 | 0 | 593 |
| 1993 | 68 | 524 | 0 | 0 | 591 |
| 1994 | 65 | 529 | 0 | 0 | 594 |
| 1995 | 75 | 525 | 0 | 0 | 600 |
| 1996 | 64 | 535 | 0 | 0 | 599 |
| 1997 | 52 | 534 | 0 | 0 | 586 |
| 1998 | 40 | 529 | 0 | 0 | 569 |
| 1999 | 31 | 530 | 0 | 0 | 562 |
| 2000 | 22 | 522 | 2 | 0 | 546 |
| 2001 | 15 | 516 | 5 | 0 | 536 |
| 2002 | 9 | 497 | 10 | 0 | 516 |
| 2003 | 5 | 484 | 18 | 0 | 508 |
| 2004 | 2 | 471 | 28 | 0 | 502 |

Table A5.15 (Figure 1.25) Refrigerant emissions in standalone equipment (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 17 | 11 | 0 | 0 | 28 |
| 1991 | 18 | 11 | 0 | 0 | 29 |
| 1992 | 19 | 11 | 0 | 0 | 30 |
| 1993 | 20 | 11 | 0 | 0 | 31 |
| 1994 | 20 | 12 | 1 | 0 | 33 |
| 1995 | 21 | 12 | 2 | 0 | 34 |
| 1996 | 21 | 12 | 2 | 0 | 35 |
| 1997 | 22 | 12 | 2 | 0 | 36 |
| 1998 | 22 | 12 | 3 | 0 | 37 |
| 1999 | 23 | 12 | 3 | 0 | 38 |
| 2000 | 23 | 12 | 4 | 0 | 38 |
| 2001 | 22 | 11 | 4 | 0 | 38 |
| 2002 | 22 | 11 | 4 | 0 | 37 |
| 2003 | 21 | 10 | 5 | 0 | 36 |
| 2004 | 20 | 9 | 7 | 0 | 36 |

Table A5.16 (Figure 1.26) Total emissions in commercial refrigeration (CS, CU and standalone)
– Lower threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 313 | 1,230 | 0 | 0 | 1,543 |
| 1991 | 317 | 1,264 | 0 | 0 | 1,581 |
| 1992 | 319 | 1,303 | 0 | 0 | 1,622 |
| 1993 | 320 | 1,351 | 0 | 0 | 1,671 |
| 1994 | 318 | 1,410 | 1 | 0 | 1,728 |
| 1995 | 323 | 1,343 | 2 | 0 | 1,668 |
| 1996 | 272 | 1,404 | 2 | 0 | 1,679 |
| 1997 | 227 | 1,437 | 2 | 0 | 1,666 |
| 1998 | 182 | 1,456 | 3 | 0 | 1,640 |
| 1999 | 146 | 1,467 | 8 | 0 | 1,621 |
| 2000 | 113 | 1,461 | 20 | 0 | 1,594 |
| 2001 | 87 | 1,439 | 41 | 0 | 1,567 |
| 2002 | 60 | 1,365 | 68 | 0 | 1,493 |
| 2003 | 40 | 1,281 | 101 | 0 | 1,423 |
| 2004 | 28 | 1,204 | 131 | 0 | 1,363 |

Table A5.17 (Figure 1.27) Total emissions in commercial refrigeration (CS, CU and standalone)
– Higher threshold (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 313 | 1,230 | 0 | 0 | 1,543 |
| 1991 | 317 | 1,264 | 0 | 0 | 1,581 |
| 1992 | 319 | 1,303 | 0 | 0 | 1,622 |
| 1993 | 320 | 1,351 | 0 | 0 | 1,671 |
| 1994 | 318 | 1,410 | 1 | 0 | 1,728 |
| 1995 | 323 | 1,343 | 2 | 0 | 1,668 |
| 1996 | 279 | 1,440 | 2 | 0 | 1,721 |
| 1997 | 239 | 1,517 | 2 | 0 | 1,758 |
| 1998 | 197 | 1,586 | 3 | 0 | 1,785 |
| 1999 | 162 | 1,651 | 9 | 0 | 1,822 |
| 2000 | 129 | 1,707 | 24 | 0 | 1,859 |
| 2001 | 100 | 1,747 | 52 | 0 | 1,899 |
| 2002 | 74 | 1,751 | 90 | 0 | 1,915 |
| 2003 | 53 | 1,745 | 141 | 0 | 1,939 |
| 2004 | 35 | 1,718 | 192 | 0 | 1,945 |

Table A5.18 (Figure 1.28) Distribution by refrigeration technology equipment

| | <i>Centralized systems</i> | <i>Condensing unit</i> | <i>Standalone</i> |
|------------------|----------------------------|------------------------|-------------------|
| Metric tonnes | 1,407 | 502 | 36 |
| Percent of total | 71% | 27% | 2% |

Table A5.19 (Figure 1.29) CO₂ eq. emissions (thousand of metric tonnes) in CS – Lower threshold

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1,728 | 1,052 | 0 | 0 | 2,780 |
| 1991 | 1,768 | 1,098 | 0 | 0 | 2,866 |
| 1992 | 1,794 | 1,153 | 0 | 0 | 2,947 |
| 1993 | 1,807 | 1,224 | 0 | 0 | 3,030 |
| 1994 | 1,792 | 1,303 | 0 | 0 | 3,096 |
| 1995 | 1,738 | 1,213 | 0 | 0 | 2,951 |
| 1996 | 1,430 | 1,299 | 0 | 0 | 2,729 |
| 1997 | 1,163 | 1,362 | 0 | 0 | 2,525 |
| 1998 | 906 | 1,409 | 0 | 0 | 2,315 |
| 1999 | 694 | 1,435 | 17 | 0 | 2,147 |
| 2000 | 516 | 1,447 | 47 | 0 | 2,011 |
| 2001 | 368 | 1,433 | 106 | 0 | 1,907 |
| 2002 | 212 | 1,357 | 175 | 0 | 1,744 |
| 2003 | 102 | 1,254 | 254 | 0 | 1,610 |
| 2004 | 40 | 1,156 | 315 | 0 | 1,511 |

Table A5.20 (Figure 1.30) CO₂ eq. emissions (thousand of metric tonnes) in CS – Higher threshold

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1,728 | 1,052 | 0 | 0 | 2,780 |
| 1991 | 1,768 | 1,098 | 0 | 0 | 2,866 |
| 1992 | 1,794 | 1,153 | 0 | 0 | 2,947 |
| 1993 | 1,807 | 1,224 | 0 | 0 | 3,030 |
| 1994 | 1,792 | 1,303 | 0 | 0 | 3,096 |
| 1995 | 1,738 | 1,213 | 0 | 0 | 2,951 |
| 1996 | 1,483 | 1,353 | 0 | 0 | 2,836 |
| 1997 | 1,254 | 1,484 | 0 | 0 | 2,738 |
| 1998 | 1,020 | 1,610 | 0 | 0 | 2,630 |
| 1999 | 813 | 1,721 | 20 | 0 | 2,554 |
| 2000 | 630 | 1,833 | 59 | 0 | 2,522 |
| 2001 | 467 | 1,917 | 140 | 0 | 2,525 |
| 2002 | 316 | 1,966 | 246 | 0 | 2,528 |
| 2003 | 195 | 1,990 | 384 | 0 | 2,569 |
| 2004 | 93 | 1,976 | 513 | 0 | 2,582 |

Table A5.21 (Figure 1.31) CO₂ eq. emissions (thousand of metric tonnes) in condensing units

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 617 | 777 | 0 | 0 | 1,394 |
| 1991 | 592 | 782 | 0 | 0 | 1,374 |
| 1992 | 571 | 784 | 0 | 0 | 1,355 |
| 1993 | 549 | 785 | 0 | 0 | 1,334 |
| 1994 | 526 | 794 | 0 | 0 | 1,320 |
| 1995 | 605 | 788 | 0 | 0 | 1,393 |
| 1996 | 516 | 803 | 0 | 0 | 1,318 |
| 1997 | 421 | 801 | 0 | 0 | 1,222 |
| 1998 | 323 | 793 | 0 | 0 | 1,116 |
| 1999 | 252 | 794 | 0 | 0 | 1,047 |
| 2000 | 178 | 781 | 7 | 0 | 966 |
| 2001 | 124 | 773 | 16 | 0 | 913 |
| 2002 | 74 | 744 | 34 | 0 | 851 |
| 2003 | 42 | 724 | 60 | 0 | 827 |
| 2004 | 18 | 706 | 92 | 0 | 815 |

Table A5.23 (Figure 1.32) CO₂ eq. emissions (thousand of metric tonnes) in stand-alone equipment

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 138 | 16 | 0 | 0 | 154 |
| 1991 | 145 | 16 | 0 | 0 | 161 |
| 1992 | 153 | 17 | 0 | 0 | 169 |
| 1993 | 159 | 17 | 0 | 0 | 176 |
| 1994 | 164 | 18 | 1 | 0 | 183 |
| 1995 | 166 | 18 | 2 | 0 | 187 |
| 1996 | 171 | 19 | 3 | 0 | 192 |
| 1997 | 175 | 19 | 3 | 0 | 197 |
| 1998 | 179 | 19 | 3 | 0 | 201 |
| 1999 | 182 | 19 | 4 | 0 | 205 |
| 2000 | 183 | 18 | 5 | 0 | 206 |
| 2001 | 180 | 17 | 6 | 0 | 203 |
| 2002 | 178 | 16 | 7 | 0 | 201 |
| 2003 | 173 | 15 | 8 | 0 | 196 |
| 2004 | 163 | 14 | 10 | 0 | 187 |

Table A5.24 (Figure 1.33) CO₂ eq. emissions (thousand of metric tonnes) in commercial refrigeration (CS, CU and standalone) – Higher threshold

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 2,483 | 1,845 | 0 | 0 | 4,328 |
| 1991 | 2,506 | 1,896 | 0 | 0 | 4,401 |
| 1992 | 2,517 | 1,954 | 0 | 0 | 4,471 |
| 1993 | 2,514 | 2,026 | 0 | 0 | 4,541 |
| 1994 | 2,483 | 2,114 | 1 | 0 | 4,598 |
| 1995 | 2,510 | 2,019 | 2 | 0 | 4,531 |
| 1996 | 2,170 | 2,174 | 3 | 0 | 4,346 |
| 1997 | 1,850 | 2,304 | 3 | 0 | 4,157 |
| 1998 | 1,522 | 2,422 | 3 | 0 | 3,947 |
| 1999 | 1,248 | 2,534 | 24 | 0 | 3,805 |
| 2000 | 991 | 2,632 | 71 | 0 | 3,694 |
| 2001 | 772 | 2,707 | 162 | 0 | 3,641 |
| 2002 | 568 | 2,726 | 286 | 0 | 3,580 |
| 2003 | 410 | 2,729 | 452 | 0 | 3,592 |
| 2004 | 274 | 2,696 | 615 | 0 | 3,585 |

Table A5.25 (Figure 1.34) CO₂ eq. emissions (thousand of metric tonnes) in commercial refrigeration (CS, CU and standalone) – Lower threshold

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 2,483 | 1,845 | 0 | 0 | 4,328 |
| 1991 | 2,506 | 1,896 | 0 | 0 | 4,401 |
| 1992 | 2,517 | 1,954 | 0 | 0 | 4,471 |
| 1993 | 2,514 | 2,026 | 0 | 0 | 4,541 |
| 1994 | 2,483 | 2,114 | 1 | 0 | 4,598 |
| 1995 | 2,510 | 2,019 | 2 | 0 | 4,531 |
| 1996 | 2,117 | 2,121 | 3 | 0 | 4,240 |
| 1997 | 1,760 | 2,182 | 3 | 0 | 3,944 |
| 1998 | 1,408 | 2,221 | 3 | 0 | 3,633 |
| 1999 | 1,129 | 2,248 | 21 | 0 | 3,398 |
| 2000 | 877 | 2,247 | 59 | 0 | 3,183 |
| 2001 | 673 | 2,222 | 128 | 0 | 3,024 |
| 2002 | 464 | 2,117 | 215 | 0 | 2,796 |
| 2003 | 317 | 1,993 | 322 | 0 | 2,632 |
| 2004 | 221 | 1,876 | 417 | 0 | 2,514 |

Table A5.26 (Figure 1.35) Distribution of CO₂ eq emissions (thousand of metric tonnes) by refrigeration technology equipment

| | <i>Centralised systems</i> | <i>Condensing unit</i> | <i>Standalone</i> |
|------------------|----------------------------|------------------------|-------------------|
| Metric tonnes | 2,582 | 815 | 187 |
| Percent of total | 71% | 24% | 5% |

Table A5.27 (Figure 1.36) Scenario 1 – Refrigerant bank changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 3,491 | 474 | 0 | 3,964 |
| 2005 | 0 | 3,416 | 638 | 0 | 4,053 |
| 2006 | 0 | 3,306 | 844 | 0 | 4,150 |
| 2007 | 0 | 3,165 | 1,132 | 0 | 4,298 |
| 2008 | 0 | 2,975 | 1,469 | 0 | 4,444 |
| 2009 | 0 | 2,732 | 1,861 | 0 | 4,593 |
| 2010 | 0 | 2,475 | 2,200 | 0 | 4,674 |
| 2011 | 0 | 2,205 | 2,633 | 0 | 4,838 |
| 2012 | 0 | 1,931 | 3,066 | 0 | 4,997 |
| 2013 | 0 | 1,659 | 3,499 | 0 | 5,158 |
| 2014 | 0 | 1,398 | 3,907 | 0 | 5,304 |
| 2015 | 0 | 1,144 | 4,319 | 0 | 5,463 |
| 2016 | 0 | 911 | 4,725 | 0 | 5,636 |
| 2017 | 0 | 704 | 5,067 | 0 | 5,771 |
| 2018 | 0 | 524 | 5,360 | 0 | 5,884 |
| 2019 | 0 | 377 | 5,558 | 0 | 5,935 |
| 2020 | 0 | 261 | 5,752 | 0 | 6,013 |

Table A5.28 (Figure 1.37) Scenario 2 – Refrigerant bank changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 3,491 | 474 | 0 | 3,964 |
| 2005 | 0 | 3,416 | 638 | 0 | 4,053 |
| 2006 | 0 | 3,306 | 844 | 0 | 4,150 |
| 2007 | 0 | 3,163 | 1,124 | 0 | 4,288 |
| 2008 | 0 | 2,971 | 1,442 | 0 | 4,413 |
| 2009 | 0 | 2,673 | 1,853 | 0 | 4,526 |
| 2010 | 0 | 2,300 | 2,259 | 0 | 4,559 |
| 2011 | 0 | 1,865 | 2,761 | 0 | 4,626 |
| 2012 | 0 | 1,453 | 3,206 | 0 | 4,659 |
| 2013 | 0 | 1,086 | 3,577 | 0 | 4,663 |
| 2014 | 0 | 786 | 3,870 | 0 | 4,656 |
| 2015 | 0 | 540 | 4,115 | 0 | 4,655 |
| 2016 | 0 | 348 | 4,316 | 0 | 4,664 |
| 2017 | 0 | 201 | 4,445 | 0 | 4,646 |
| 2018 | 0 | 102 | 4,512 | 0 | 4,614 |
| 2019 | 0 | 37 | 4,507 | 0 | 4,544 |
| 2020 | 0 | 0 | 4,493 | 0 | 4,493 |

Table A5.29 (Figure 1.38) Scenario 3 – Refrigerant bank changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 3,491 | 474 | 0 | 3,964 |
| 2005 | 0 | 3,416 | 638 | 0 | 4,053 |
| 2006 | 0 | 3,306 | 844 | 0 | 4,150 |
| 2007 | 0 | 3,161 | 1,116 | 0 | 4,278 |
| 2008 | 0 | 2,965 | 1,396 | 0 | 4,361 |
| 2009 | 0 | 2,667 | 1,741 | 0 | 4,408 |
| 2010 | 0 | 2,294 | 2,070 | 0 | 4,365 |
| 2011 | 0 | 1,859 | 2,460 | 0 | 4,320 |
| 2012 | 0 | 1,448 | 2,791 | 0 | 4,239 |
| 2013 | 0 | 1,082 | 3,044 | 0 | 4,126 |
| 2014 | 0 | 783 | 3,223 | 0 | 4,006 |
| 2015 | 0 | 537 | 3,349 | 0 | 3,886 |
| 2016 | 0 | 346 | 3,427 | 0 | 3,773 |
| 2017 | 0 | 200 | 3,442 | 0 | 3,642 |
| 2018 | 0 | 101 | 3,405 | 0 | 3,505 |
| 2019 | 0 | 36 | 3,315 | 0 | 3,351 |
| 2020 | 0 | 0 | 3,217 | 0 | 3,217 |

Table A5.30 (Figure 1.39) Scenario 1 – Refrigerant bank changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 81 | 5,802 | 949 | 0 | 6,832 |
| 2005 | 64 | 5,634 | 1,213 | 0 | 6,911 |
| 2006 | 48 | 5,403 | 1,536 | 0 | 6,988 |
| 2007 | 35 | 5,127 | 1,963 | 0 | 7,125 |
| 2008 | 24 | 4,791 | 2,439 | 0 | 7,254 |
| 2009 | 16 | 4,394 | 2,975 | 0 | 7,384 |
| 2010 | 9 | 3,973 | 3,496 | 0 | 7,477 |
| 2011 | 4 | 3,536 | 4,118 | 0 | 7,658 |
| 2012 | 1 | 3,095 | 4,731 | 0 | 7,826 |
| 2013 | 0 | 2,658 | 5,333 | 0 | 7,991 |
| 2014 | 0 | 2,235 | 5,941 | 0 | 8,176 |
| 2015 | 0 | 1,829 | 6,535 | 0 | 8,365 |
| 2016 | 0 | 1,459 | 7,116 | 0 | 8,575 |
| 2017 | 0 | 1,129 | 7,614 | 0 | 8,743 |
| 2018 | 0 | 844 | 8,043 | 0 | 8,887 |
| 2019 | 0 | 607 | 8,368 | 0 | 8,975 |
| 2020 | 0 | 419 | 8,662 | 0 | 9,082 |

Table A5.31 (Figure 1.40) Scenario 2 – Refrigerant bank changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 81 | 5,802 | 949 | 0 | 6,832 |
| 2005 | 64 | 5,634 | 1,213 | 0 | 6,911 |
| 2006 | 48 | 5,403 | 1,536 | 0 | 6,988 |
| 2007 | 35 | 5,125 | 1,955 | 0 | 7,115 |
| 2008 | 24 | 4,787 | 2,412 | 0 | 7,223 |
| 2009 | 16 | 4,303 | 2,999 | 0 | 7,317 |
| 2010 | 9 | 3,697 | 3,655 | 0 | 7,361 |
| 2011 | 4 | 2,997 | 4,445 | 0 | 7,446 |
| 2012 | 1 | 2,336 | 5,151 | 0 | 7,489 |
| 2013 | 0 | 1,747 | 5,749 | 0 | 7,496 |
| 2014 | 0 | 1,264 | 6,264 | 0 | 7,528 |
| 2015 | 0 | 870 | 6,687 | 0 | 7,557 |
| 2016 | 0 | 562 | 7,041 | 0 | 7,603 |
| 2017 | 0 | 326 | 7,292 | 0 | 7,618 |
| 2018 | 0 | 166 | 7,452 | 0 | 7,618 |
| 2019 | 0 | 60 | 7,524 | 0 | 7,584 |
| 2020 | 0 | 0 | 7,562 | 0 | 7,562 |

Table A5.32 (Figure 1.41) Scenario 3 – Refrigerant bank changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 81 | 5,802 | 949 | 0 | 6,832 |
| 2005 | 64 | 5,634 | 1,213 | 0 | 6,911 |
| 2006 | 48 | 5,403 | 1,536 | 0 | 6,988 |
| 2007 | 35 | 5,123 | 1,947 | 0 | 7,105 |
| 2008 | 24 | 4,781 | 2,366 | 0 | 7,171 |
| 2009 | 16 | 4,297 | 2,887 | 0 | 7,199 |
| 2010 | 9 | 3,692 | 3,467 | 0 | 7,167 |
| 2011 | 4 | 2,992 | 4,144 | 0 | 7,140 |
| 2012 | 1 | 2,332 | 4,736 | 0 | 7,069 |
| 2013 | 0 | 1,743 | 5,216 | 0 | 6,959 |
| 2014 | 0 | 1,261 | 5,617 | 0 | 6,878 |
| 2015 | 0 | 867 | 5,921 | 0 | 6,788 |
| 2016 | 0 | 560 | 6,152 | 0 | 6,712 |
| 2017 | 0 | 325 | 6,289 | 0 | 6,614 |
| 2018 | 0 | 165 | 6,344 | 0 | 6,509 |
| 2019 | 0 | 59 | 6,332 | 0 | 6,391 |
| 2020 | 0 | 0 | 6,286 | 0 | 6,286 |

Table A5.33 (Figure 1.42) Scenario 1 – Refrigerant emission changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 5 | 1,163 | 156 | 0 | 1,324 |
| 2005 | 0 | 1,137 | 210 | 0 | 1,347 |
| 2006 | 0 | 1,106 | 277 | 0 | 1,382 |
| 2007 | 0 | 1,065 | 372 | 0 | 1,436 |
| 2008 | 0 | 1,007 | 480 | 0 | 1,487 |
| 2009 | 0 | 933 | 607 | 0 | 1,540 |
| 2010 | 0 | 857 | 712 | 0 | 1,569 |
| 2011 | 0 | 775 | 856 | 0 | 1,631 |
| 2012 | 0 | 690 | 996 | 0 | 1,686 |
| 2013 | 0 | 604 | 1,136 | 0 | 1,740 |
| 2014 | 0 | 519 | 1,267 | 0 | 1,786 |
| 2015 | 0 | 436 | 1,403 | 0 | 1,840 |
| 2016 | 0 | 357 | 1,538 | 0 | 1,895 |
| 2017 | 0 | 284 | 1,653 | 0 | 1,937 |
| 2018 | 0 | 219 | 1,754 | 0 | 1,973 |
| 2019 | 0 | 163 | 1,825 | 0 | 1,988 |
| 2020 | 0 | 117 | 1,897 | 0 | 2,014 |

Table A5.34 (Figure 1.43) Scenario 2 – Refrigerant emission changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 5 | 1,163 | 156 | 0 | 1,324 |
| 2005 | 0 | 1,136 | 210 | 0 | 1,346 |
| 2006 | 0 | 1,103 | 277 | 0 | 1,380 |
| 2007 | 0 | 1,060 | 369 | 0 | 1,429 |
| 2008 | 0 | 1,000 | 471 | 0 | 1,471 |
| 2009 | 0 | 893 | 586 | 0 | 1,479 |
| 2010 | 0 | 771 | 689 | 0 | 1,460 |
| 2011 | 0 | 632 | 819 | 0 | 1,451 |
| 2012 | 0 | 491 | 917 | 0 | 1,407 |
| 2013 | 0 | 365 | 984 | 0 | 1,349 |
| 2014 | 0 | 261 | 1,022 | 0 | 1,284 |
| 2015 | 0 | 180 | 1,044 | 0 | 1,225 |
| 2016 | 0 | 118 | 1,049 | 0 | 1,167 |
| 2017 | 0 | 72 | 1,033 | 0 | 1,105 |
| 2018 | 0 | 39 | 1,001 | 0 | 1,040 |
| 2019 | 0 | 18 | 950 | 0 | 968 |
| 2020 | 0 | 5 | 897 | 0 | 901 |

Table A5.35 (Figure 1.44) Scenario 3 – Refrigerant emission changes – Centralized systems (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 5 | 1,163 | 156 | 0 | 1,324 |
| 2005 | 0 | 1,136 | 210 | 0 | 1,346 |
| 2006 | 0 | 1,103 | 277 | 0 | 1,380 |
| 2007 | 0 | 1,059 | 366 | 0 | 1,425 |
| 2008 | 0 | 998 | 454 | 0 | 1,452 |
| 2009 | 0 | 891 | 549 | 0 | 1,440 |
| 2010 | 0 | 769 | 630 | 0 | 1,399 |
| 2011 | 0 | 631 | 729 | 0 | 1,359 |
| 2012 | 0 | 489 | 799 | 0 | 1,288 |
| 2013 | 0 | 364 | 840 | 0 | 1,204 |
| 2014 | 0 | 260 | 856 | 0 | 1,116 |
| 2015 | 0 | 179 | 856 | 0 | 1,036 |
| 2016 | 0 | 117 | 842 | 0 | 959 |
| 2017 | 0 | 71 | 811 | 0 | 882 |
| 2018 | 0 | 39 | 768 | 0 | 806 |
| 2019 | 0 | 18 | 713 | 0 | 731 |
| 2020 | 0 | 5 | 656 | 0 | 660 |

Table A5.36 (Figure 1.45) Scenario 1 – Refrigerant emission changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 28 | 1,643 | 191 | 0 | 1,862 |
| 2005 | 18 | 1,600 | 259 | 0 | 1,876 |
| 2006 | 16 | 1,546 | 344 | 0 | 1,906 |
| 2007 | 13 | 1,483 | 461 | 0 | 1,958 |
| 2008 | 11 | 1,403 | 591 | 0 | 2,005 |
| 2009 | 9 | 1,305 | 741 | 0 | 2,055 |
| 2010 | 7 | 1,204 | 878 | 0 | 2,089 |
| 2011 | 5 | 1,099 | 1,054 | 0 | 2,158 |
| 2012 | 3 | 989 | 1,225 | 0 | 2,217 |
| 2013 | 1 | 876 | 1,397 | 0 | 2,275 |
| 2014 | 0 | 763 | 1,566 | 0 | 2,329 |
| 2015 | 0 | 650 | 1,735 | 0 | 2,385 |
| 2016 | 0 | 540 | 1,903 | 0 | 2,443 |
| 2017 | 0 | 437 | 2,050 | 0 | 2,486 |
| 2018 | 0 | 344 | 2,180 | 0 | 2,524 |
| 2019 | 0 | 262 | 2,280 | 0 | 2,542 |
| 2020 | 0 | 192 | 2,378 | 0 | 2,569 |

Table A5.37 (Figure 1.46) Scenario 2 – Refrigerant emission changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 28 | 1,643 | 191 | 0 | 1,862 |
| 2005 | 18 | 1,598 | 259 | 0 | 1,875 |
| 2006 | 16 | 1,544 | 344 | 0 | 1,904 |
| 2007 | 13 | 1,479 | 458 | 0 | 1,950 |
| 2008 | 11 | 1,396 | 581 | 0 | 1,989 |
| 2009 | 9 | 1,280 | 728 | 0 | 2,017 |
| 2010 | 6 | 1,133 | 879 | 0 | 2,018 |
| 2011 | 4 | 971 | 1,065 | 0 | 2,039 |
| 2012 | 2 | 768 | 1,210 | 0 | 1,980 |
| 2013 | 1 | 591 | 1,323 | 0 | 1,915 |
| 2014 | 0 | 428 | 1,402 | 0 | 1,830 |
| 2015 | 0 | 306 | 1,455 | 0 | 1,761 |
| 2016 | 0 | 208 | 1,485 | 0 | 1,693 |
| 2017 | 0 | 134 | 1,490 | 0 | 1,624 |
| 2018 | 0 | 75 | 1,462 | 0 | 1,537 |
| 2019 | 0 | 38 | 1,421 | 0 | 1,459 |
| 2020 | 0 | 13 | 1,373 | 0 | 1,385 |

Table A5.38 (Figure 1.47) Scenario 3 – Refrigerant emission changes – Commercial Refrigeration (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 28 | 1,643 | 191 | 0 | 1,862 |
| 2005 | 18 | 1,598 | 259 | 0 | 1,875 |
| 2006 | 16 | 1,544 | 344 | 0 | 1,904 |
| 2007 | 13 | 1,478 | 455 | 0 | 1,946 |
| 2008 | 11 | 1,394 | 565 | 0 | 1,970 |
| 2009 | 9 | 1,278 | 691 | 0 | 1,977 |
| 2010 | 6 | 1,131 | 820 | 0 | 1,958 |
| 2011 | 4 | 969 | 974 | 0 | 1,947 |
| 2012 | 2 | 766 | 1,092 | 0 | 1,860 |
| 2013 | 1 | 580 | 1,174 | 0 | 1,754 |
| 2014 | 0 | 419 | 1,225 | 0 | 1,644 |
| 2015 | 0 | 291 | 1,248 | 0 | 1,539 |
| 2016 | 0 | 192 | 1,247 | 0 | 1,439 |
| 2017 | 0 | 118 | 1,224 | 0 | 1,341 |
| 2018 | 0 | 64 | 1,181 | 0 | 1,245 |
| 2019 | 0 | 31 | 1,128 | 0 | 1,159 |
| 2020 | 0 | 9 | 1,068 | 0 | 1,078 |

Table A5.39 (Figure 1.48) Scenario 1 – Refrigerant CO₂ emission changes (thousand of metric tonnes) – Centralized systems.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 40 | 1,861 | 510 | 0 | 2,411 |
| 2005 | 0 | 1,819 | 686 | 0 | 2,505 |
| 2006 | 0 | 1,769 | 905 | 0 | 2,675 |
| 2007 | 0 | 1,705 | 1,216 | 0 | 2,921 |
| 2008 | 0 | 1,616 | 1,570 | 0 | 3,186 |
| 2009 | 0 | 1,500 | 1,986 | 0 | 3,486 |
| 2010 | 0 | 1,379 | 2,330 | 0 | 3,708 |
| 2011 | 0 | 1,250 | 2,799 | 0 | 4,050 |
| 2012 | 0 | 1,115 | 3,257 | 0 | 4,372 |
| 2013 | 0 | 977 | 3,717 | 0 | 4,694 |
| 2014 | 0 | 839 | 4,146 | 0 | 4,985 |
| 2015 | 0 | 705 | 4,591 | 0 | 5,296 |
| 2016 | 0 | 576 | 5,032 | 0 | 5,608 |
| 2017 | 0 | 457 | 5,408 | 0 | 5,866 |
| 2018 | 0 | 352 | 5,740 | 0 | 6,092 |
| 2019 | 0 | 261 | 5,972 | 0 | 6,233 |
| 2020 | 0 | 186 | 6,207 | 0 | 6,393 |

Table A5.40 (Figure 1.49) Scenario 2 – Refrigerant CO₂ emission changes (thousand of metric tonnes)– Centralized systems)

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 40 | 1,861 | 510 | 0 | 2,411 |
| 2005 | 0 | 1,818 | 686 | 0 | 2,504 |
| 2006 | 0 | 1,765 | 905 | 0 | 2,671 |
| 2007 | 0 | 1,698 | 1,206 | 0 | 2,904 |
| 2008 | 0 | 1,605 | 1,539 | 0 | 3,144 |
| 2009 | 0 | 1,438 | 1,888 | 0 | 3,326 |
| 2010 | 0 | 1,243 | 2,173 | 0 | 3,416 |
| 2011 | 0 | 1,021 | 2,523 | 0 | 3,544 |
| 2012 | 0 | 793 | 2,787 | 0 | 3,580 |
| 2013 | 0 | 591 | 2,970 | 0 | 3,561 |
| 2014 | 0 | 423 | 3,076 | 0 | 3,499 |
| 2015 | 0 | 292 | 3,148 | 0 | 3,440 |
| 2016 | 0 | 191 | 3,173 | 0 | 3,363 |
| 2017 | 0 | 116 | 3,139 | 0 | 3,254 |
| 2018 | 0 | 63 | 3,059 | 0 | 3,123 |
| 2019 | 0 | 30 | 2,921 | 0 | 2,951 |
| 2020 | 0 | 7 | 2,774 | 0 | 2,781 |

Table A5.41 (Figure 1.50) Scenario 3 – Refrigerant CO₂ emission changes (thousand of metric tonnes) – Centralized systems

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 40 | 1,861 | 510 | 0 | 2,411 |
| 2005 | 0 | 1,818 | 686 | 0 | 2,504 |
| 2006 | 0 | 1,765 | 905 | 0 | 2,671 |
| 2007 | 0 | 1,697 | 1,197 | 0 | 2,893 |
| 2008 | 0 | 1,601 | 1,486 | 0 | 3,088 |
| 2009 | 0 | 1,435 | 1,756 | 0 | 3,191 |
| 2010 | 0 | 1,241 | 1,959 | 0 | 3,199 |
| 2011 | 0 | 1,018 | 2,183 | 0 | 3,202 |
| 2012 | 0 | 791 | 2,338 | 0 | 3,130 |
| 2013 | 0 | 589 | 2,414 | 0 | 3,003 |
| 2014 | 0 | 421 | 2,420 | 0 | 2,842 |
| 2015 | 0 | 291 | 2,384 | 0 | 2,674 |
| 2016 | 0 | 190 | 2,303 | 0 | 2,493 |
| 2017 | 0 | 115 | 2,180 | 0 | 2,295 |
| 2018 | 0 | 63 | 2,020 | 0 | 2,082 |
| 2019 | 0 | 29 | 1,832 | 0 | 1,861 |
| 2020 | 0 | 7 | 1,639 | 0 | 1,646 |

Table A5.42 (Figure 1.51) Scenario 1 – Refrigerant CO₂ emission changes (thousand of metric tonnes) – Commercial Refrigeration

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 221 | 2,581 | 612 | 0 | 3,414 |
| 2005 | 145 | 2,512 | 830 | 0 | 3,486 |
| 2006 | 126 | 2,430 | 1,103 | 0 | 3,659 |
| 2007 | 109 | 2,333 | 1,480 | 0 | 3,921 |
| 2008 | 91 | 2,209 | 1,899 | 0 | 4,199 |
| 2009 | 73 | 2,058 | 2,384 | 0 | 4,515 |
| 2010 | 56 | 1,900 | 2,826 | 0 | 4,783 |
| 2011 | 39 | 1,736 | 3,395 | 0 | 5,171 |
| 2012 | 23 | 1,563 | 3,951 | 0 | 5,537 |
| 2013 | 9 | 1,385 | 4,509 | 0 | 5,903 |
| 2014 | 0 | 1,205 | 5,059 | 0 | 6,264 |
| 2015 | 0 | 1,026 | 5,609 | 0 | 6,635 |
| 2016 | 0 | 850 | 6,158 | 0 | 7,009 |
| 2017 | 0 | 687 | 6,638 | 0 | 7,325 |
| 2018 | 0 | 539 | 7,065 | 0 | 7,604 |
| 2019 | 0 | 409 | 7,390 | 0 | 7,800 |
| 2020 | 0 | 298 | 7,710 | 0 | 8,008 |

Table A5.43 (Figure 1.52) Scenario 2 – Refrigerant CO₂ emission changes (thousand of metric tonnes) – Commercial Refrigeration

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 221 | 2,581 | 612 | 0 | 3,414 |
| 2005 | 145 | 2,510 | 830 | 0 | 3,484 |
| 2006 | 126 | 2,426 | 1,103 | 0 | 3,655 |
| 2007 | 109 | 2,325 | 1,470 | 0 | 3,904 |
| 2008 | 91 | 2,198 | 1,868 | 0 | 4,157 |
| 2009 | 70 | 2,018 | 2,305 | 0 | 4,393 |
| 2010 | 50 | 1,787 | 2,724 | 0 | 4,562 |
| 2011 | 31 | 1,528 | 3,226 | 0 | 4,786 |
| 2012 | 17 | 1,209 | 3,618 | 0 | 4,844 |
| 2013 | 6 | 930 | 3,923 | 0 | 4,859 |
| 2014 | 0 | 673 | 4,145 | 0 | 4,818 |
| 2015 | 0 | 480 | 4,307 | 0 | 4,787 |
| 2016 | 0 | 326 | 4,411 | 0 | 4,737 |
| 2017 | 0 | 209 | 4,445 | 0 | 4,653 |
| 2018 | 0 | 117 | 4,392 | 0 | 4,509 |
| 2019 | 0 | 59 | 4,294 | 0 | 4,353 |
| 2020 | 0 | 19 | 4,173 | 0 | 4,192 |

Table A5.44 (Figure 1.53) Scenario 3 – Refrigerant CO₂ emission changes (thousand of metric tonnes) – Commercial Refrigeration

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 221 | 2,581 | 612 | 0 | 3,414 |
| 2005 | 145 | 2,510 | 830 | 0 | 3,484 |
| 2006 | 126 | 2,426 | 1,103 | 0 | 3,655 |
| 2007 | 109 | 2,324 | 1,460 | 0 | 3,893 |
| 2008 | 91 | 2,195 | 1,815 | 0 | 4,100 |
| 2009 | 70 | 2,015 | 2,173 | 0 | 4,258 |
| 2010 | 50 | 1,785 | 2,510 | 0 | 4,345 |
| 2011 | 31 | 1,526 | 2,886 | 0 | 4,443 |
| 2012 | 17 | 1,207 | 3,168 | 0 | 4,392 |
| 2013 | 6 | 913 | 3,348 | 0 | 4,267 |
| 2014 | 0 | 659 | 3,449 | 0 | 4,108 |
| 2015 | 0 | 459 | 3,468 | 0 | 3,927 |
| 2016 | 0 | 302 | 3,418 | 0 | 3,719 |
| 2017 | 0 | 185 | 3,304 | 0 | 3,489 |
| 2018 | 0 | 101 | 3,132 | 0 | 3,233 |
| 2019 | 0 | 49 | 2,930 | 0 | 2,980 |
| 2020 | 0 | 14 | 2,712 | 0 | 2,726 |

Table A5.45 (Figure 1.58) Refrigerant bank in stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 0 | 23,433 | 0 | 0 | 23,433 |
| 1991 | 0 | 25,317 | 0 | 0 | 25,317 |
| 1992 | 0 | 27,257 | 0 | 0 | 27,257 |
| 1993 | 0 | 29,265 | 0 | 0 | 29,265 |
| 1994 | 0 | 31,355 | 0 | 0 | 31,355 |
| 1995 | 0 | 33,525 | 0 | 0 | 33,525 |
| 1996 | 0 | 35,912 | 0 | 0 | 35,912 |
| 1997 | 0 | 38,293 | 0 | 0 | 38,293 |
| 1998 | 0 | 40,629 | 22 | 0 | 40,650 |
| 1999 | 0 | 43,094 | 86 | 0 | 43,180 |
| 2000 | 0 | 45,436 | 308 | 0 | 45,744 |
| 2001 | 0 | 47,451 | 590 | 0 | 48,040 |
| 2002 | 0 | 49,611 | 955 | 0 | 50,566 |
| 2003 | 0 | 51,528 | 1,396 | 0 | 52,925 |
| 2004 | 0 | 53,475 | 1,874 | 0 | 55,348 |

Table A5.46 (Figure 1.59) Refrigerant bank in chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 8,104 | 1,557 | 0 | 32 | 9,693 |
| 1991 | 8,387 | 1,602 | 0 | 33 | 10,022 |
| 1992 | 8,506 | 1,653 | 18 | 34 | 10,211 |
| 1993 | 8,637 | 1,816 | 70 | 35 | 10,557 |
| 1994 | 8,729 | 2,225 | 237 | 37 | 11,227 |
| 1995 | 8,485 | 2,940 | 674 | 38 | 12,137 |
| 1996 | 8,229 | 3,684 | 1,110 | 40 | 13,063 |
| 1997 | 7,166 | 5,085 | 1,648 | 43 | 13,942 |
| 1998 | 6,154 | 6,199 | 2,025 | 44 | 14,423 |
| 1999 | 5,151 | 7,127 | 2,307 | 45 | 14,630 |
| 2000 | 4,249 | 7,998 | 2,607 | 46 | 14,900 |
| 2001 | 3,410 | 8,779 | 2,875 | 48 | 15,112 |
| 2002 | 2,629 | 9,474 | 3,120 | 49 | 15,272 |
| 2003 | 1,868 | 10,117 | 3,340 | 50 | 15,375 |
| 2004 | 1,197 | 10,639 | 3,592 | 52 | 15,480 |

Table A5.47 (Figure 1.60) Refrigerant emissions from stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 0 | 3,181 | 0 | 0 | 3,181 |
| 1991 | 0 | 3,445 | 0 | 0 | 3,445 |
| 1992 | 0 | 3,741 | 0 | 0 | 3,741 |
| 1993 | 0 | 4,046 | 0 | 0 | 4,046 |
| 1994 | 0 | 4,397 | 0 | 0 | 4,397 |
| 1995 | 0 | 4,600 | 0 | 0 | 4,600 |
| 1996 | 0 | 4,793 | 0 | 0 | 4,793 |
| 1997 | 0 | 4,902 | 0 | 0 | 4,902 |
| 1998 | 0 | 5,063 | 5 | 0 | 5,068 |
| 1999 | 0 | 5,084 | 12 | 0 | 5,096 |
| 2000 | 0 | 5,129 | 33 | 0 | 5,163 |
| 2001 | 0 | 5,149 | 51 | 0 | 5,200 |
| 2002 | 0 | 5,293 | 74 | 0 | 5,367 |
| 2003 | 0 | 5,310 | 98 | 0 | 5,409 |
| 2004 | 0 | 5,379 | 120 | 0 | 5,499 |

Table A5.48 (Figure 1.61) Refrigerant emissions from chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1,492 | 255 | 0 | 5 | 1,752 |
| 1991 | 1,546 | 263 | 0 | 5 | 1,814 |
| 1992 | 1,569 | 272 | 3 | 6 | 1,849 |
| 1993 | 1,555 | 275 | 9 | 5 | 1,843 |
| 1994 | 1,555 | 317 | 28 | 5 | 1,905 |
| 1995 | 1,460 | 395 | 77 | 5 | 1,937 |
| 1996 | 1,373 | 462 | 108 | 5 | 1,948 |
| 1997 | 1,337 | 661 | 164 | 5 | 2,167 |
| 1998 | 1,167 | 773 | 189 | 5 | 2,135 |
| 1999 | 1,007 | 872 | 211 | 5 | 2,095 |
| 2000 | 844 | 967 | 238 | 5 | 2,055 |
| 2001 | 700 | 1,048 | 256 | 5 | 2,009 |
| 2002 | 564 | 1,116 | 277 | 5 | 1,963 |
| 2003 | 440 | 1,177 | 295 | 5 | 1,917 |
| 2004 | 316 | 1,224 | 316 | 5 | 1,861 |

Table A5.49 (Figure 1.62) CO₂ equivalent emissions (thousand of metric tonnes) from stationary AC

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 0 | 4,772 | 0 | 0 | 4,772 |
| 1991 | 0 | 5,168 | 0 | 0 | 5,168 |
| 1992 | 0 | 5,611 | 0 | 0 | 5,611 |
| 1993 | 0 | 6,069 | 0 | 0 | 6,069 |
| 1994 | 0 | 6,595 | 0 | 0 | 6,595 |
| 1995 | 0 | 6,900 | 0 | 0 | 6,900 |
| 1996 | 0 | 7,189 | 0 | 0 | 7,189 |
| 1997 | 0 | 7,353 | 0 | 0 | 7,353 |
| 1998 | 0 | 7,595 | 6 | 0 | 7,601 |
| 1999 | 0 | 7,626 | 17 | 0 | 7,642 |
| 2000 | 0 | 7,694 | 50 | 0 | 7,745 |
| 2001 | 0 | 7,723 | 79 | 0 | 7,802 |
| 2002 | 0 | 7,939 | 116 | 0 | 8,056 |
| 2003 | 0 | 7,966 | 157 | 0 | 8,122 |
| 2004 | 0 | 8,069 | 192 | 0 | 8,261 |

Table A5.50 (Figure 1. 63) CO₂ equivalent emissions (thousand of metric tonnes) from chillers

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 7,594 | 383 | 0 | 0 | 7,977 |
| 1991 | 7,870 | 394 | 0 | 0 | 8,264 |
| 1992 | 7,975 | 408 | 3 | 0 | 8,386 |
| 1993 | 7,899 | 391 | 11 | 0 | 8,301 |
| 1994 | 7,889 | 391 | 36 | 0 | 8,316 |
| 1995 | 7,406 | 391 | 100 | 0 | 7,897 |
| 1996 | 6,968 | 394 | 141 | 0 | 7,503 |
| 1997 | 6,783 | 412 | 213 | 0 | 7,407 |
| 1998 | 5,918 | 428 | 246 | 0 | 6,592 |
| 1999 | 5,106 | 428 | 274 | 0 | 5,808 |
| 2000 | 4,281 | 437 | 309 | 0 | 5,027 |
| 2001 | 3,546 | 445 | 332 | 0 | 4,323 |
| 2002 | 2,861 | 445 | 360 | 0 | 3,667 |
| 2003 | 2,229 | 450 | 383 | 0 | 3,063 |
| 2004 | 1,601 | 460 | 411 | 0 | 2,472 |

Table A5.51 (Figure 1.64) Bank in stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 53,475 | 1,874 | 0 | 55,348 |
| 2005 | 0 | 55,371 | 2,578 | 0 | 57,949 |
| 2006 | 0 | 57,047 | 3,683 | 0 | 60,730 |
| 2007 | 0 | 57,918 | 5,508 | 0 | 63,425 |
| 2008 | 0 | 57,271 | 8,879 | 0 | 66,150 |
| 2009 | 0 | 55,012 | 13,894 | 0 | 68,906 |
| 2010 | 0 | 51,081 | 20,589 | 0 | 71,671 |
| 2011 | 0 | 46,622 | 27,806 | 0 | 74,428 |
| 2012 | 0 | 41,367 | 35,819 | 0 | 77,186 |
| 2013 | 0 | 35,967 | 43,998 | 0 | 79,965 |
| 2014 | 0 | 30,570 | 52,189 | 0 | 82,758 |
| 2015 | 0 | 25,077 | 60,479 | 0 | 85,556 |
| 2016 | 0 | 19,576 | 68,784 | 0 | 88,360 |
| 2017 | 0 | 14,774 | 76,381 | 0 | 91,155 |
| 2018 | 0 | 10,764 | 83,192 | 0 | 93,955 |
| 2019 | 0 | 7,487 | 89,289 | 0 | 96,776 |
| 2020 | 0 | 4,965 | 94,640 | 0 | 99,606 |

Table A5.52 (Figure 1.65) Bank in chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 1,197 | 10,639 | 3,592 | 52 | 15,480 |
| 2005 | 561 | 11,071 | 3,886 | 56 | 15,574 |
| 2006 | 0 | 11,338 | 4,262 | 59 | 15,658 |
| 2007 | 0 | 11,136 | 4,544 | 62 | 15,742 |
| 2008 | 0 | 10,841 | 4,921 | 68 | 15,829 |
| 2009 | 0 | 10,433 | 5,422 | 73 | 15,928 |
| 2010 | 0 | 9,920 | 6,029 | 79 | 16,027 |
| 2011 | 0 | 9,381 | 6,626 | 87 | 16,094 |
| 2012 | 0 | 8,688 | 7,336 | 94 | 16,118 |
| 2013 | 0 | 7,988 | 8,013 | 102 | 16,103 |
| 2014 | 0 | 7,296 | 8,652 | 110 | 16,058 |
| 2015 | 0 | 6,627 | 9,258 | 117 | 16,001 |
| 2016 | 0 | 5,991 | 9,832 | 124 | 15,946 |
| 2017 | 0 | 5,390 | 10,370 | 130 | 15,891 |
| 2018 | 0 | 4,826 | 10,872 | 136 | 15,834 |
| 2019 | 0 | 4,296 | 11,340 | 142 | 15,778 |
| 2020 | 0 | 3,805 | 11,773 | 147 | 15,725 |

Table A5.53 (Figure 1.66) Scenario 1 - Emissions from stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 5,388 | 111 | 0 | 5,499 |
| 2005 | 0 | 5,311 | 150 | 0 | 5,461 |
| 2006 | 0 | 5,438 | 212 | 0 | 5,650 |
| 2007 | 0 | 5,514 | 316 | 0 | 5,829 |
| 2008 | 0 | 5,377 | 532 | 0 | 5,909 |
| 2009 | 0 | 5,125 | 837 | 0 | 5,961 |
| 2010 | 0 | 4,845 | 1,194 | 0 | 6,039 |
| 2011 | 0 | 4,660 | 1,517 | 0 | 6,176 |
| 2012 | 0 | 4,514 | 1,856 | 0 | 6,370 |
| 2013 | 0 | 4,283 | 2,225 | 0 | 6,508 |
| 2014 | 0 | 4,020 | 2,616 | 0 | 6,636 |
| 2015 | 0 | 3,776 | 3,041 | 0 | 6,817 |
| 2016 | 0 | 3,515 | 3,494 | 0 | 7,009 |
| 2017 | 0 | 3,279 | 3,980 | 0 | 7,259 |
| 2018 | 0 | 2,976 | 4,460 | 0 | 7,437 |
| 2019 | 0 | 2,587 | 5,177 | 0 | 7,764 |
| 2020 | 0 | 2,182 | 5,745 | 0 | 7,928 |

Table A5.54 (Figure 1.67) Scenario 2 - Emissions from stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 5,388 | 111 | 0 | 5,499 |
| 2005 | 0 | 5,311 | 150 | 0 | 5,461 |
| 2006 | 0 | 5,438 | 212 | 0 | 5,650 |
| 2007 | 0 | 5,514 | 316 | 0 | 5,829 |
| 2008 | 0 | 5,377 | 532 | 0 | 5,909 |
| 2009 | 0 | 5,125 | 837 | 0 | 5,961 |
| 2010 | 0 | 4,962 | 1,258 | 0 | 6,220 |
| 2011 | 0 | 4,818 | 1,674 | 0 | 6,492 |
| 2012 | 0 | 4,768 | 2,182 | 0 | 6,950 |
| 2013 | 0 | 4,383 | 2,698 | 0 | 7,080 |
| 2014 | 0 | 3,927 | 3,226 | 0 | 7,153 |
| 2015 | 0 | 3,512 | 3,805 | 0 | 7,318 |
| 2016 | 0 | 3,043 | 4,421 | 0 | 7,465 |
| 2017 | 0 | 2,463 | 4,977 | 0 | 7,441 |
| 2018 | 0 | 1,947 | 5,456 | 0 | 7,403 |
| 2019 | 0 | 1,449 | 6,073 | 0 | 7,522 |
| 2020 | 0 | 1,020 | 6,451 | 0 | 7,470 |

Table A5.55 (Figure 1.68) Scenario 3 - Emissions from stationary AC (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 5,388 | 111 | 0 | 5,499 |
| 2005 | 0 | 5,311 | 151 | 0 | 5,461 |
| 2006 | 0 | 5,437 | 213 | 0 | 5,650 |
| 2007 | 0 | 5,511 | 318 | 0 | 5,829 |
| 2008 | 0 | 5,373 | 535 | 0 | 5,909 |
| 2009 | 0 | 5,121 | 840 | 0 | 5,961 |
| 2010 | 0 | 4,878 | 1,257 | 0 | 6,135 |
| 2011 | 0 | 4,630 | 1,661 | 0 | 6,290 |
| 2012 | 0 | 4,417 | 2,144 | 0 | 6,561 |
| 2013 | 0 | 3,918 | 2,621 | 0 | 6,539 |
| 2014 | 0 | 3,361 | 3,092 | 0 | 6,453 |
| 2015 | 0 | 3,020 | 3,620 | 0 | 6,640 |
| 2016 | 0 | 2,637 | 4,205 | 0 | 6,842 |
| 2017 | 0 | 2,178 | 4,727 | 0 | 6,905 |
| 2018 | 0 | 1,743 | 5,240 | 0 | 6,983 |
| 2019 | 0 | 1,323 | 5,718 | 0 | 7,041 |
| 2020 | 0 | 952 | 6,217 | 0 | 7,169 |

Table A5.56 (Figure 1.69) Scenario 1 - Emissions from chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 316 | 1,224 | 316 | 5 | 1,861 |
| 2005 | 208 | 1,262 | 338 | 5 | 1,814 |
| 2006 | 104 | 1,281 | 375 | 5 | 1,766 |
| 2007 | 0 | 1,225 | 376 | 6 | 1,606 |
| 2008 | 0 | 1,164 | 398 | 6 | 1,567 |
| 2009 | 0 | 1,097 | 427 | 6 | 1,530 |
| 2010 | 0 | 1,038 | 455 | 7 | 1,500 |
| 2011 | 0 | 977 | 482 | 7 | 1,465 |
| 2012 | 0 | 922 | 513 | 7 | 1,442 |
| 2013 | 0 | 852 | 549 | 8 | 1,409 |
| 2014 | 0 | 799 | 572 | 8 | 1,380 |
| 2015 | 0 | 733 | 607 | 9 | 1,348 |
| 2016 | 0 | 671 | 629 | 9 | 1,310 |
| 2017 | 0 | 603 | 665 | 10 | 1,277 |
| 2018 | 0 | 548 | 704 | 11 | 1,263 |
| 2019 | 0 | 487 | 733 | 11 | 1,231 |
| 2020 | 0 | 434 | 779 | 12 | 1,225 |

Table A5.57 (Figure 1.70) Scenario 2 - Emissions from chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 316 | 1,224 | 316 | 5 | 1,861 |
| 2005 | 208 | 1,262 | 338 | 5 | 1,814 |
| 2006 | 104 | 1,281 | 375 | 5 | 1,766 |
| 2007 | 0 | 1,225 | 376 | 6 | 1,606 |
| 2008 | 0 | 1,164 | 398 | 6 | 1,567 |
| 2009 | 0 | 1,097 | 427 | 6 | 1,530 |
| 2010 | 0 | 1,038 | 455 | 7 | 1,500 |
| 2011 | 0 | 959 | 480 | 7 | 1,446 |
| 2012 | 0 | 944 | 527 | 7 | 1,478 |
| 2013 | 0 | 832 | 569 | 7 | 1,408 |
| 2014 | 0 | 766 | 602 | 7 | 1,375 |
| 2015 | 0 | 677 | 627 | 8 | 1,312 |
| 2016 | 0 | 607 | 644 | 8 | 1,259 |
| 2017 | 0 | 526 | 685 | 8 | 1,219 |
| 2018 | 0 | 469 | 715 | 9 | 1,193 |
| 2019 | 0 | 410 | 727 | 9 | 1,147 |
| 2020 | 0 | 362 | 740 | 9 | 1,111 |

Table A5.58 (Figure 1.71) Scenario 3 - Emissions from chillers (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 316 | 1,224 | 316 | 5 | 1,861 |
| 2005 | 208 | 1,262 | 338 | 5 | 1,814 |
| 2006 | 104 | 1,281 | 375 | 5 | 1,766 |
| 2007 | 0 | 1,225 | 376 | 6 | 1,606 |
| 2008 | 0 | 1,164 | 398 | 6 | 1,567 |
| 2009 | 0 | 1,097 | 427 | 6 | 1,530 |
| 2010 | 0 | 1,038 | 455 | 7 | 1,500 |
| 2011 | 0 | 959 | 480 | 7 | 1,446 |
| 2012 | 0 | 944 | 526 | 7 | 1,477 |
| 2013 | 0 | 832 | 563 | 7 | 1,402 |
| 2014 | 0 | 766 | 588 | 7 | 1,361 |
| 2015 | 0 | 677 | 603 | 8 | 1,288 |
| 2016 | 0 | 607 | 614 | 8 | 1,229 |
| 2017 | 0 | 526 | 632 | 8 | 1,166 |
| 2018 | 0 | 469 | 654 | 9 | 1,132 |
| 2019 | 0 | 410 | 656 | 9 | 1,075 |
| 2020 | 0 | 362 | 659 | 9 | 1,031 |

Table A5.59 (Figure 1.72) Scenario 1 - CO₂ equivalent emissions (thousand of metric tonnes) in stationary AC.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 8,082 | 180 | 0 | 8,263 |
| 2005 | 0 | 7,966 | 247 | 0 | 8,213 |
| 2006 | 0 | 8,158 | 349 | 0 | 8,507 |
| 2007 | 0 | 8,270 | 523 | 0 | 8,793 |
| 2008 | 0 | 8,065 | 893 | 0 | 8,958 |
| 2009 | 0 | 7,687 | 1,414 | 0 | 9,101 |
| 2010 | 0 | 7,268 | 2,027 | 0 | 9,295 |
| 2011 | 0 | 6,989 | 2,578 | 0 | 9,567 |
| 2012 | 0 | 6,771 | 3,158 | 0 | 9,929 |
| 2013 | 0 | 6,424 | 3,789 | 0 | 10,214 |
| 2014 | 0 | 6,030 | 4,460 | 0 | 10,490 |
| 2015 | 0 | 5,664 | 5,186 | 0 | 10,850 |
| 2016 | 0 | 5,273 | 5,963 | 0 | 11,237 |
| 2017 | 0 | 4,918 | 6,794 | 0 | 11,712 |
| 2018 | 0 | 4,465 | 7,617 | 0 | 12,082 |
| 2019 | 0 | 3,880 | 8,849 | 0 | 12,729 |
| 2020 | 0 | 3,274 | 9,826 | 0 | 13,100 |

Table A5.60 (Figure 1.73) Scenario 2 – CO₂ equivalent emissions (thousand of metric tonnes) in stationary AC.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 8,082 | 180 | 0 | 8,263 |
| 2005 | 0 | 7,966 | 247 | 0 | 8,213 |
| 2006 | 0 | 8,158 | 349 | 0 | 8,507 |
| 2007 | 0 | 8,270 | 523 | 0 | 8,793 |
| 2008 | 0 | 8,065 | 893 | 0 | 8,958 |
| 2009 | 0 | 7,687 | 1,414 | 0 | 9,101 |
| 2010 | 0 | 7,443 | 2,193 | 0 | 9,636 |
| 2011 | 0 | 7,227 | 2,985 | 0 | 10,212 |
| 2012 | 0 | 7,152 | 4,003 | 0 | 11,155 |
| 2013 | 0 | 6,574 | 5,016 | 0 | 11,590 |
| 2014 | 0 | 5,891 | 6,048 | 0 | 11,938 |
| 2015 | 0 | 5,269 | 7,186 | 0 | 12,455 |
| 2016 | 0 | 4,565 | 8,407 | 0 | 12,972 |
| 2017 | 0 | 3,695 | 9,451 | 0 | 13,146 |
| 2018 | 0 | 2,921 | 10,322 | 0 | 13,243 |
| 2019 | 0 | 2,174 | 11,377 | 0 | 13,550 |
| 2020 | 0 | 1,529 | 11,971 | 0 | 13,500 |

Table A5.61 (Figure 1.74) Scenario 3 - CO₂ equivalent emissions (thousand of metric tonnes) in stationary AC.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 0 | 8,082 | 180 | 0 | 8,263 |
| 2005 | 0 | 7,966 | 247 | 0 | 8,213 |
| 2006 | 0 | 8,156 | 351 | 0 | 8,507 |
| 2007 | 0 | 8,267 | 527 | 0 | 8,794 |
| 2008 | 0 | 8,060 | 899 | 0 | 8,959 |
| 2009 | 0 | 7,682 | 1,421 | 0 | 9,102 |
| 2010 | 0 | 7,317 | 2,191 | 0 | 9,507 |
| 2011 | 0 | 6,945 | 2,959 | 0 | 9,904 |
| 2012 | 0 | 6,625 | 3,885 | 0 | 10,510 |
| 2013 | 0 | 5,877 | 4,708 | 0 | 10,585 |
| 2014 | 0 | 5,042 | 5,455 | 0 | 10,497 |
| 2015 | 0 | 4,530 | 6,315 | 0 | 10,845 |
| 2016 | 0 | 3,956 | 7,265 | 0 | 11,221 |
| 2017 | 0 | 3,268 | 8,004 | 0 | 11,271 |
| 2018 | 0 | 2,614 | 8,648 | 0 | 11,262 |
| 2019 | 0 | 1,984 | 9,177 | 0 | 11,161 |
| 2020 | 0 | 1,428 | 9,635 | 0 | 11,063 |

Table A5.62 (Figure 1.75) Scenario 1 - CO₂ equivalent emissions (thousand of metric tonnes) in chillers.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 1,601 | 460 | 411 | 0 | 2,472 |
| 2005 | 1,054 | 458 | 441 | 0 | 1,954 |
| 2006 | 528 | 457 | 490 | 0 | 1,474 |
| 2007 | 0 | 451 | 492 | 0 | 944 |
| 2008 | 0 | 436 | 523 | 0 | 959 |
| 2009 | 0 | 413 | 565 | 0 | 977 |
| 2010 | 0 | 389 | 607 | 0 | 996 |
| 2011 | 0 | 370 | 646 | 0 | 1,016 |
| 2012 | 0 | 351 | 690 | 0 | 1,042 |
| 2013 | 0 | 331 | 742 | 0 | 1,073 |
| 2014 | 0 | 314 | 777 | 0 | 1,090 |
| 2015 | 0 | 294 | 826 | 0 | 1,120 |
| 2016 | 0 | 271 | 861 | 0 | 1,132 |
| 2017 | 0 | 248 | 913 | 0 | 1,161 |
| 2018 | 0 | 226 | 970 | 0 | 1,196 |
| 2019 | 0 | 202 | 1,013 | 0 | 1,214 |
| 2020 | 0 | 174 | 1,081 | 0 | 1,255 |

Table A5.63 (Figure 1.76) Scenario 2 - CO₂ equivalent emissions (thousand of metric tonnes) in chillers.

| | CFC | HCFC | HFC | Others | Total |
|------|-------|------|-------|--------|-------|
| 2004 | 1,601 | 460 | 411 | 0 | 2,472 |
| 2005 | 1,054 | 458 | 441 | 0 | 1,954 |
| 2006 | 528 | 457 | 490 | 0 | 1,474 |
| 2007 | 0 | 451 | 492 | 0 | 944 |
| 2008 | 0 | 436 | 523 | 0 | 959 |
| 2009 | 0 | 413 | 565 | 0 | 977 |
| 2010 | 0 | 389 | 607 | 0 | 996 |
| 2011 | 0 | 344 | 643 | 0 | 988 |
| 2012 | 0 | 384 | 732 | 0 | 1,117 |
| 2013 | 0 | 301 | 802 | 0 | 1,103 |
| 2014 | 0 | 263 | 859 | 0 | 1,122 |
| 2015 | 0 | 211 | 900 | 0 | 1,111 |
| 2016 | 0 | 174 | 932 | 0 | 1,106 |
| 2017 | 0 | 133 | 988 | 0 | 1,122 |
| 2018 | 0 | 107 | 1,032 | 0 | 1,139 |
| 2019 | 0 | 86 | 1,051 | 0 | 1,137 |
| 2020 | 0 | 67 | 1,067 | 0 | 1,133 |

Table A5.64 (Figure 1.77) Scenario 3 - CO₂ equivalent emissions (thousand of metric tonnes) in chillers.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 2004 | 1,601 | 460 | 411 | 0 | 2,472 |
| 2005 | 1,054 | 458 | 441 | 0 | 1,954 |
| 2006 | 528 | 457 | 490 | 0 | 1,474 |
| 2007 | 0 | 451 | 492 | 0 | 944 |
| 2008 | 0 | 436 | 523 | 0 | 959 |
| 2009 | 0 | 413 | 565 | 0 | 977 |
| 2010 | 0 | 389 | 607 | 0 | 996 |
| 2011 | 0 | 344 | 643 | 0 | 988 |
| 2012 | 0 | 384 | 729 | 0 | 1,114 |
| 2013 | 0 | 301 | 784 | 0 | 1,085 |
| 2014 | 0 | 263 | 825 | 0 | 1,088 |
| 2015 | 0 | 211 | 845 | 0 | 1,056 |
| 2016 | 0 | 174 | 864 | 0 | 1,038 |
| 2017 | 0 | 133 | 881 | 0 | 1,015 |
| 2018 | 0 | 107 | 908 | 0 | 1,015 |
| 2019 | 0 | 86 | 901 | 0 | 987 |
| 2020 | 0 | 67 | 899 | 0 | 966 |

Table A5.65 (Figure 1.84) Refrigerant bank in industry (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1,550 | 1,904 | 0 | 2,797 | 6,251 |
| 1991 | 1,575 | 1,886 | 0 | 2,839 | 6,299 |
| 1992 | 1,599 | 1,870 | 0 | 2,887 | 6,356 |
| 1993 | 1,631 | 1,858 | 0 | 2,960 | 6,448 |
| 1994 | 1,642 | 1,905 | 0 | 3,061 | 6,609 |
| 1995 | 1,577 | 1,966 | 20 | 3,134 | 6,696 |
| 1996 | 1,495 | 2,064 | 54 | 3,280 | 6,893 |
| 1997 | 1,409 | 2,184 | 108 | 3,480 | 7,180 |
| 1998 | 1,241 | 2,211 | 246 | 3,506 | 7,204 |
| 1999 | 979 | 2,263 | 487 | 3,568 | 7,298 |
| 2000 | 633 | 2,326 | 818 | 3,703 | 7,480 |
| 2001 | 313 | 2,360 | 1,132 | 3,801 | 7,606 |
| 2002 | 116 | 2,390 | 1,329 | 3,868 | 7,703 |
| 2003 | 34 | 2,413 | 1,403 | 3,933 | 7,783 |
| 2004 | 10 | 2,415 | 1,417 | 3,943 | 7,785 |

Table A5.66 (Figure 1.85) Refrigerant emissions in industry (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 153 | 256 | 0 | 242 | 652 |
| 1991 | 158 | 248 | 0 | 229 | 635 |
| 1992 | 165 | 246 | 0 | 230 | 641 |
| 1993 | 169 | 237 | 0 | 218 | 624 |
| 1994 | 174 | 246 | 0 | 226 | 646 |
| 1995 | 162 | 237 | 1 | 212 | 612 |
| 1996 | 168 | 251 | 4 | 224 | 647 |
| 1997 | 160 | 254 | 7 | 218 | 639 |
| 1998 | 168 | 245 | 22 | 216 | 651 |
| 1999 | 164 | 230 | 46 | 202 | 641 |
| 2000 | 161 | 230 | 83 | 211 | 686 |
| 2001 | 128 | 226 | 115 | 215 | 684 |
| 2002 | 74 | 223 | 129 | 219 | 644 |
| 2003 | 31 | 220 | 130 | 222 | 603 |
| 2004 | 9 | 216 | 127 | 221 | 574 |

Table A5.67 (Figure 1.86) CO₂ equivalent emissions (thousand of metric tonnes) in industry.

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1 031 | 384 | 0 | 0 | 1 415 |
| 1991 | 1 063 | 372 | 0 | 0 | 1 436 |
| 1992 | 1 102 | 369 | 0 | 0 | 1 471 |
| 1993 | 1 128 | 356 | 0 | 0 | 1 484 |
| 1994 | 1 153 | 370 | 0 | 0 | 1 523 |
| 1995 | 1 072 | 356 | 3 | 0 | 1 430 |
| 1996 | 1 118 | 376 | 7 | 0 | 1 502 |
| 1997 | 1 065 | 381 | 14 | 0 | 1 460 |
| 1998 | 1 105 | 368 | 34 | 0 | 1 507 |
| 1999 | 1 085 | 345 | 69 | 0 | 1 499 |
| 2000 | 1 071 | 345 | 125 | 0 | 1 542 |
| 2001 | 836 | 339 | 174 | 0 | 1 349 |
| 2002 | 476 | 335 | 198 | 0 | 1 008 |
| 2003 | 203 | 330 | 204 | 0 | 737 |
| 2004 | 63 | 324 | 203 | 0 | 590 |

Table A5.68 (Figure 1.87) California refrigerant bank per refrigerant types (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 29,961 | 31,687 | 0 | 2,828 | 64,476 |
| 1991 | 30,932 | 33,691 | 0 | 2,872 | 67,494 |
| 1992 | 31,682 | 35,761 | 86 | 2,921 | 70,450 |
| 1993 | 31,819 | 38,043 | 847 | 2,995 | 73,704 |
| 1994 | 31,333 | 40,782 | 2,372 | 3,098 | 77,585 |
| 1995 | 29,825 | 43,995 | 4,641 | 3,172 | 81,633 |
| 1996 | 28,217 | 47,597 | 6,969 | 3,320 | 86,103 |
| 1997 | 24,276 | 51,873 | 10,910 | 3,522 | 90,581 |
| 1998 | 20,004 | 55,720 | 15,127 | 3,550 | 94,401 |
| 1999 | 15,690 | 59,523 | 19,437 | 3,614 | 98,263 |
| 2000 | 11,313 | 63,128 | 24,255 | 3,750 | 102,446 |
| 2001 | 7,774 | 66,198 | 28,147 | 3,848 | 105,967 |
| 2002 | 4,956 | 69,212 | 31,529 | 3,917 | 109,614 |
| 2003 | 3,040 | 71,835 | 34,059 | 3,983 | 112,917 |
| 2004 | 1,963 | 74,263 | 35,937 | 3,995 | 116,159 |

Table A5.69 (Figure 1.89) Refrigerant emissions per refrigerant type (metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 9,721 | 5,173 | 0 | 490 | 15,384 |
| 1991 | 10,055 | 5,486 | 0 | 462 | 16,003 |
| 1992 | 10,145 | 5,854 | 14 | 465 | 16,477 |
| 1993 | 10,223 | 6,219 | 134 | 441 | 17,016 |
| 1994 | 10,237 | 6,686 | 384 | 456 | 17,764 |
| 1995 | 9,429 | 6,973 | 659 | 430 | 17,490 |
| 1996 | 9,426 | 7,384 | 1,153 | 452 | 18,415 |
| 1997 | 10,070 | 7,833 | 2,285 | 441 | 20,630 |
| 1998 | 8,878 | 8,145 | 3,445 | 437 | 20,905 |
| 1999 | 7,396 | 8,353 | 4,953 | 409 | 21,110 |
| 2000 | 5,824 | 8,717 | 6,406 | 427 | 21,374 |
| 2001 | 4,282 | 8,910 | 7,260 | 436 | 20,888 |
| 2002 | 2,685 | 8,966 | 8,192 | 442 | 20,285 |
| 2003 | 1,477 | 9,167 | 8,483 | 449 | 19,575 |
| 2004 | 658 | 9,331 | 8,362 | 448 | 18,799 |

Table A5.70 (Figure 1.91) Refrigerant emissions expressed in CO₂ equivalent (thousand of metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 73,916 | 7,760 | 0 | 0 | 81,676 |
| 1991 | 76,441 | 8,229 | 0 | 0 | 84,670 |
| 1992 | 77,057 | 8,781 | 18 | 0 | 85,856 |
| 1993 | 77,710 | 9,307 | 174 | 0 | 87,191 |
| 1994 | 77,788 | 9,946 | 499 | 0 | 88,233 |
| 1995 | 71,545 | 10,265 | 858 | 0 | 82,668 |
| 1996 | 71,790 | 10,797 | 1,500 | 0 | 84,087 |
| 1997 | 77,143 | 11,205 | 3,292 | 0 | 91,640 |
| 1998 | 68,001 | 11,533 | 5,172 | 0 | 84,706 |
| 1999 | 56,511 | 11,710 | 7,636 | 0 | 75,858 |
| 2000 | 44,305 | 12,136 | 10,005 | 0 | 66,446 |
| 2001 | 32,299 | 12,324 | 11,548 | 0 | 56,171 |
| 2002 | 19,872 | 12,323 | 13,030 | 0 | 45,225 |
| 2003 | 10,555 | 12,540 | 13,498 | 0 | 36,593 |
| 2004 | 4,346 | 12,728 | 13,194 | 0 | 30,267 |

Table A5.71 (Figure 1.93) Recovery per refrigerant type metric tonnes).

| | <i>CFC</i> | <i>HCFC</i> | <i>HFC</i> | <i>Others</i> | <i>Total</i> |
|------|------------|-------------|------------|---------------|--------------|
| 1990 | 1 | 9 | 0 | 18 | 27 |
| 1991 | 1 | 12 | 0 | 25 | 38 |
| 1992 | 6 | 19 | 0 | 32 | 58 |
| 1993 | 57 | 43 | 0 | 41 | 140 |
| 1994 | 89 | 58 | 0 | 42 | 189 |
| 1995 | 162 | 204 | 0 | 47 | 413 |
| 1996 | 226 | 349 | 0 | 48 | 623 |
| 1997 | 884 | 535 | 4 | 53 | 1,475 |
| 1998 | 903 | 754 | 8 | 55 | 1,719 |
| 1999 | 963 | 994 | 16 | 57 | 2,030 |
| 2000 | 941 | 1,139 | 28 | 59 | 2,166 |
| 2001 | 869 | 1,259 | 42 | 61 | 2,231 |
| 2002 | 745 | 1,415 | 55 | 63 | 2,278 |
| 2003 | 655 | 1,546 | 66 | 64 | 2,331 |
| 2004 | 542 | 1,667 | 75 | 66 | 2,350 |