


**Executive Order G-70-187
Exhibit 2
Figure 2A**

**TYPICAL ABOVEGROUND TANK
INSTALLATION WITH A 9000-01 MINI-JET**

See Note Below

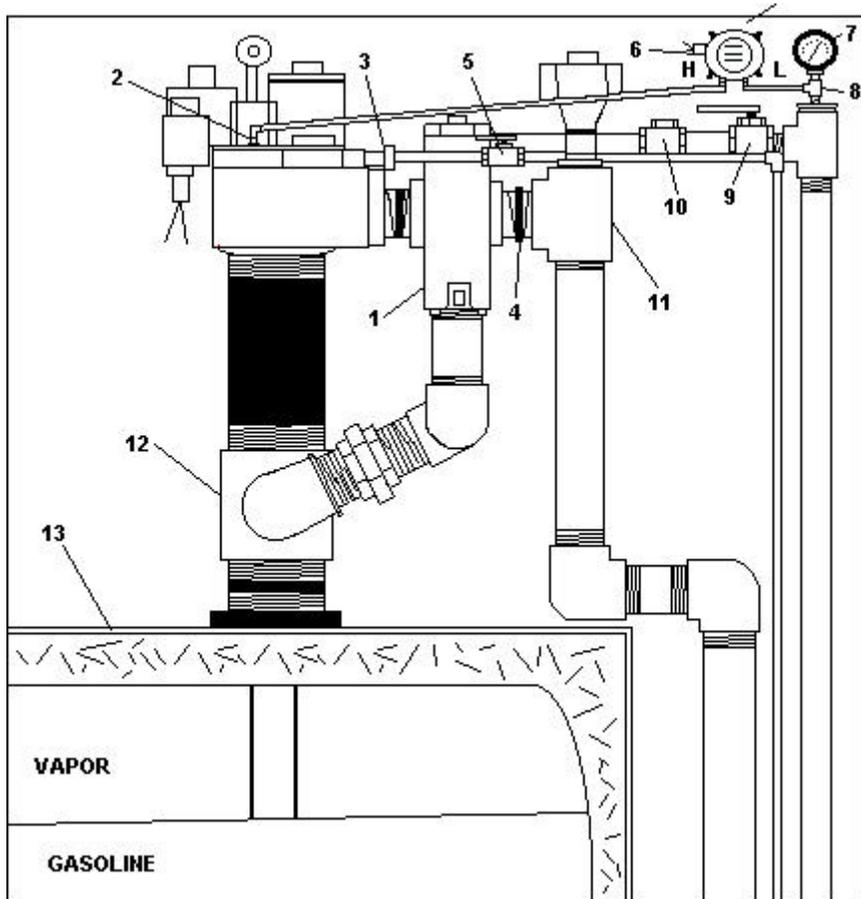

1. 9000-1 Healy Mini-Jet
2. 1/4" Tank Test Port
3. Siphon Valve, Red Jacket
4. Universal Check Valve #212BPR (or equivalent)
5. 1/4" Ball Valve, UL Listed
6. #9800-1 Pressure Switch, Healy
7. Vacuum Gauge, 0-100" WC
8. 1/4" TEE for Vacuum Gauge Port
9. 1" Ball Valve, UL Listed
10. Condensate Drain Check Valve #9466, Healy Systems
11. Leak Detector TEE Housing Red Jacket
12. 4"x2" Reducing TEE
13. Aboveground Vaulted Tank

*See executive order for system monitor requirements