


**Executive Order G-70-187**  
**Exhibit 2**  
**Figure 3**

## TYPICAL ABOVEGROUND TANK INSTALLATION WITH A VP500 VANE PUMP

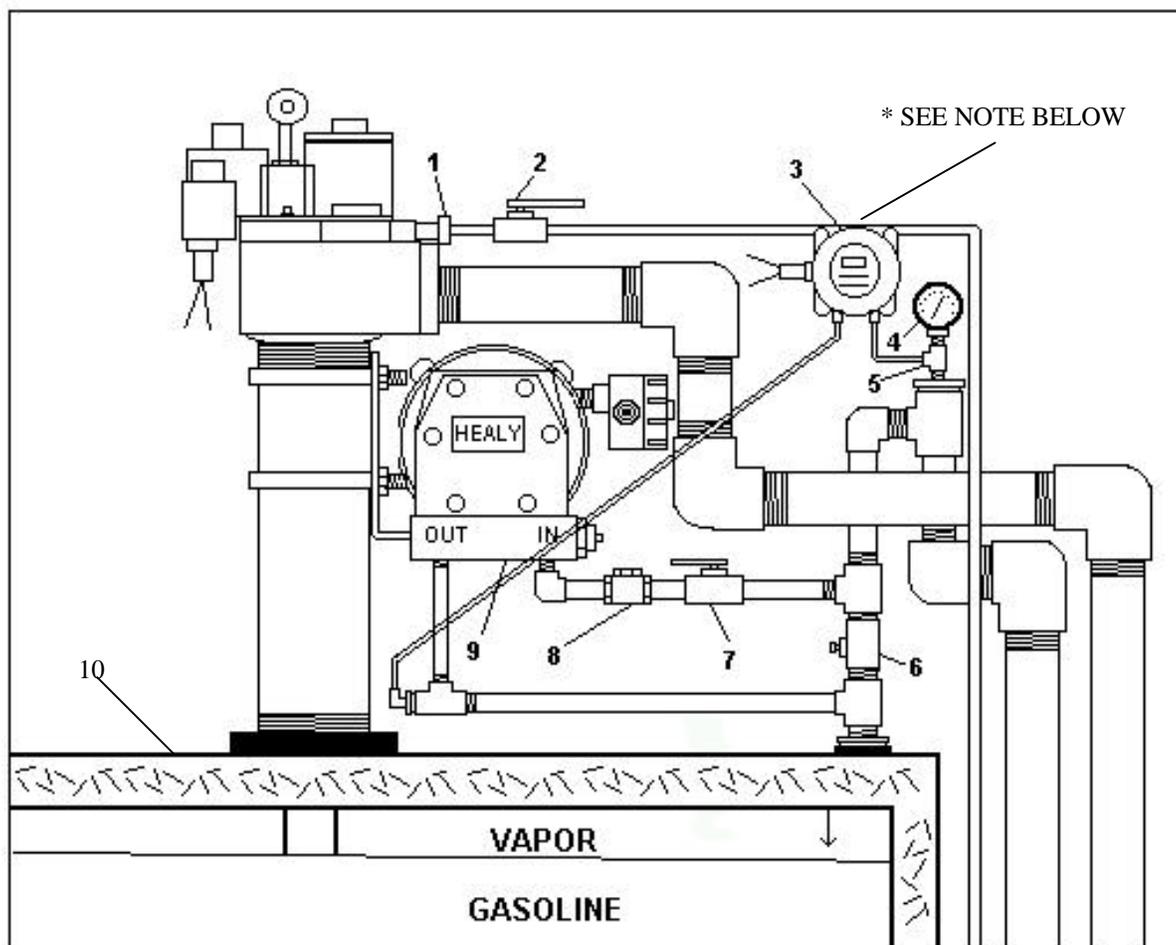

- |   |  |
|---|--|
| 1. Syphon Check Valve, Red Jacket         | 2. ¼" Ball Valve, UL Listed  |
| 3. #9800-1 Pressure Switch, Healy         | 4. W.C. Vacuum Gage 0" to 100"   |
| 5. ¼" TEE                                 | 6. 1" Ball Valve, U. L. Listed (USUALLY CLOSED, OPEN FOR TESTING ONLY) |
| 7. 1" Ball Valve, U. L. Listed            | 9. VP500 Central Vacuum Vane Pump, Healy                               |
| 8. #9466 Back-Pressure Check Valve, Healy |  |
| 10. Aboveground Vaulted Tank              |  |

- SEE CARB EXECUTIVE ORDER G-70-187 FOR SYSTEM MONITOR REQUIREMENTS ON ABOVEGROUND TANK INSTALLATIONS