


Figure 2A

Typical Vapor Return Piping Configuration
for Amoco V-1 Vapor Recovery System

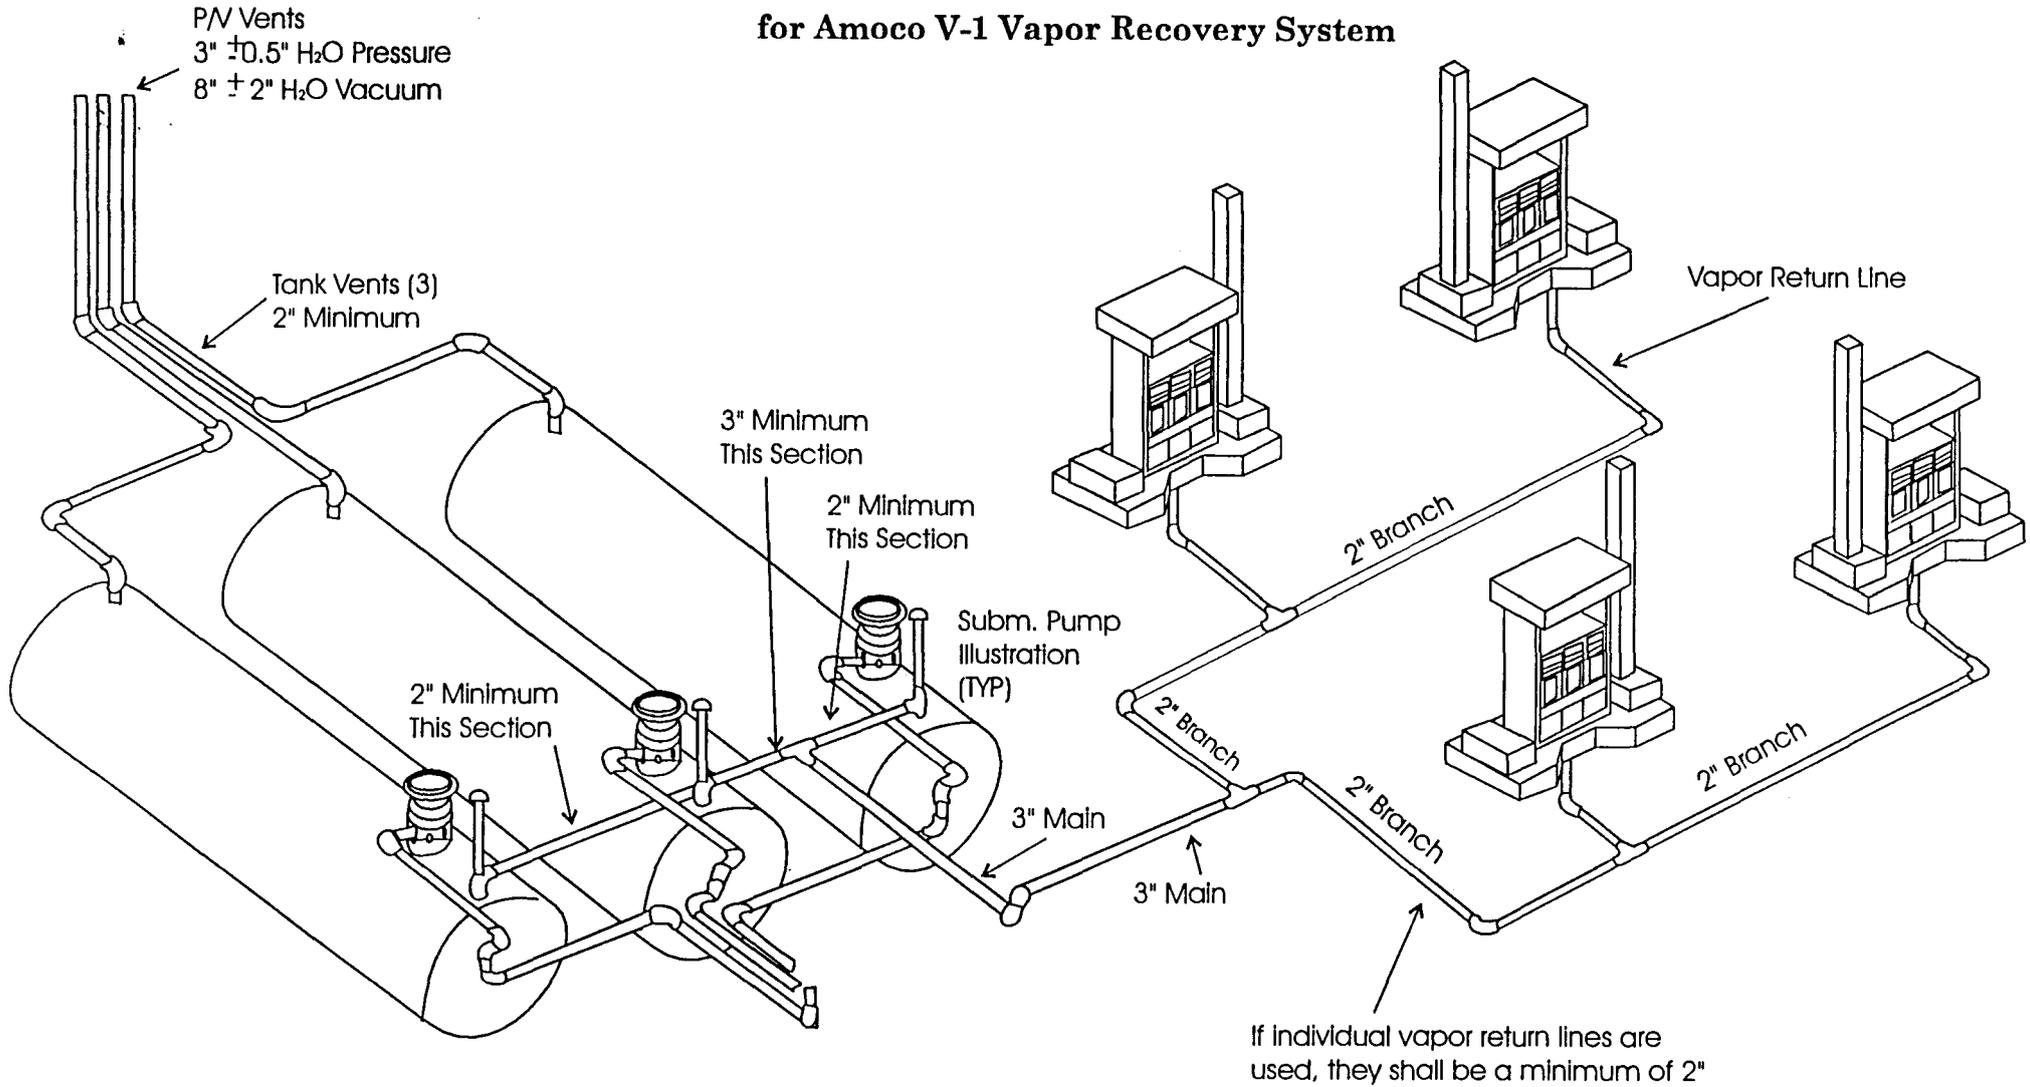

Note: Tanks may be manifolded at the vents in addition to or instead of under ground. Dedicated piping is acceptable providing the vent pipes are manifolded. At least one P/V valve shall be installed on manifolded vents. If two P/V valves are desired, they shall be installed in parallel. If the vents are manifolded, the manifold shall be at least 12 feet above the driveway surface used for Phase I