

State of California

AIR RESOURCES BOARD

Executive Order G-70-14

Relating to the Certification of the  
Red Jacket Aspirator Assist Service Station  
Phase II Vapor Recovery System

Pursuant to the authority vested in the Air Resources Board (ARB) by Health and Safety Code Section 41954; and

Pursuant to the authority vested in the undersigned by Health and Safety Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: That the Red Jacket aspirator assist, Phase II vapor collection and disposal system licensed to and marketed by Wylain, Incorporated, Red Jacket Pumps Division, is hereby certified for attendant and/or self-serve use at gasoline service stations in conjunction with Phase I vapor recovery systems which have been certified by the Air Resources Board. The system certified hereby is described in Exhibits 1 and 2 attached hereto.

IT IS FURTHER ORDERED AND RESOLVED: That compliance with the applicable certification requirements and rules and regulations of the Division of Measurement Standards, the State Fire Marshal's Office, and the Division of Industrial Safety of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That the system certified hereby shall perform in actual use with the same effectiveness as the certification test system. Compliance with this performance criterion shall be a condition of this certification, and failure to meet this criterion shall constitute grounds for revocation, suspension, or modification of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That any alteration to the equipment, parts, design, or operation of the system certified hereby, is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the undersigned.

IT IS FURTHER ORDERED AND RESOLVED: That in the event the Air Resources Board or the undersigned establishes a requirement which limits or prohibits the use of nozzle extenders, the system shall be modified within thirty (30) days and shall demonstrate such compliance to the satisfaction of the undersigned.

Executed at Sacramento, California, this 29th day  
of November, 1977.

  
William H. Lewis, Jr.  
Executive Officer

EXHIBIT 1

Executive Order G-70-14

Red Jacket Aspirator Assist Service Station  
Phase II Vapor Recovery System

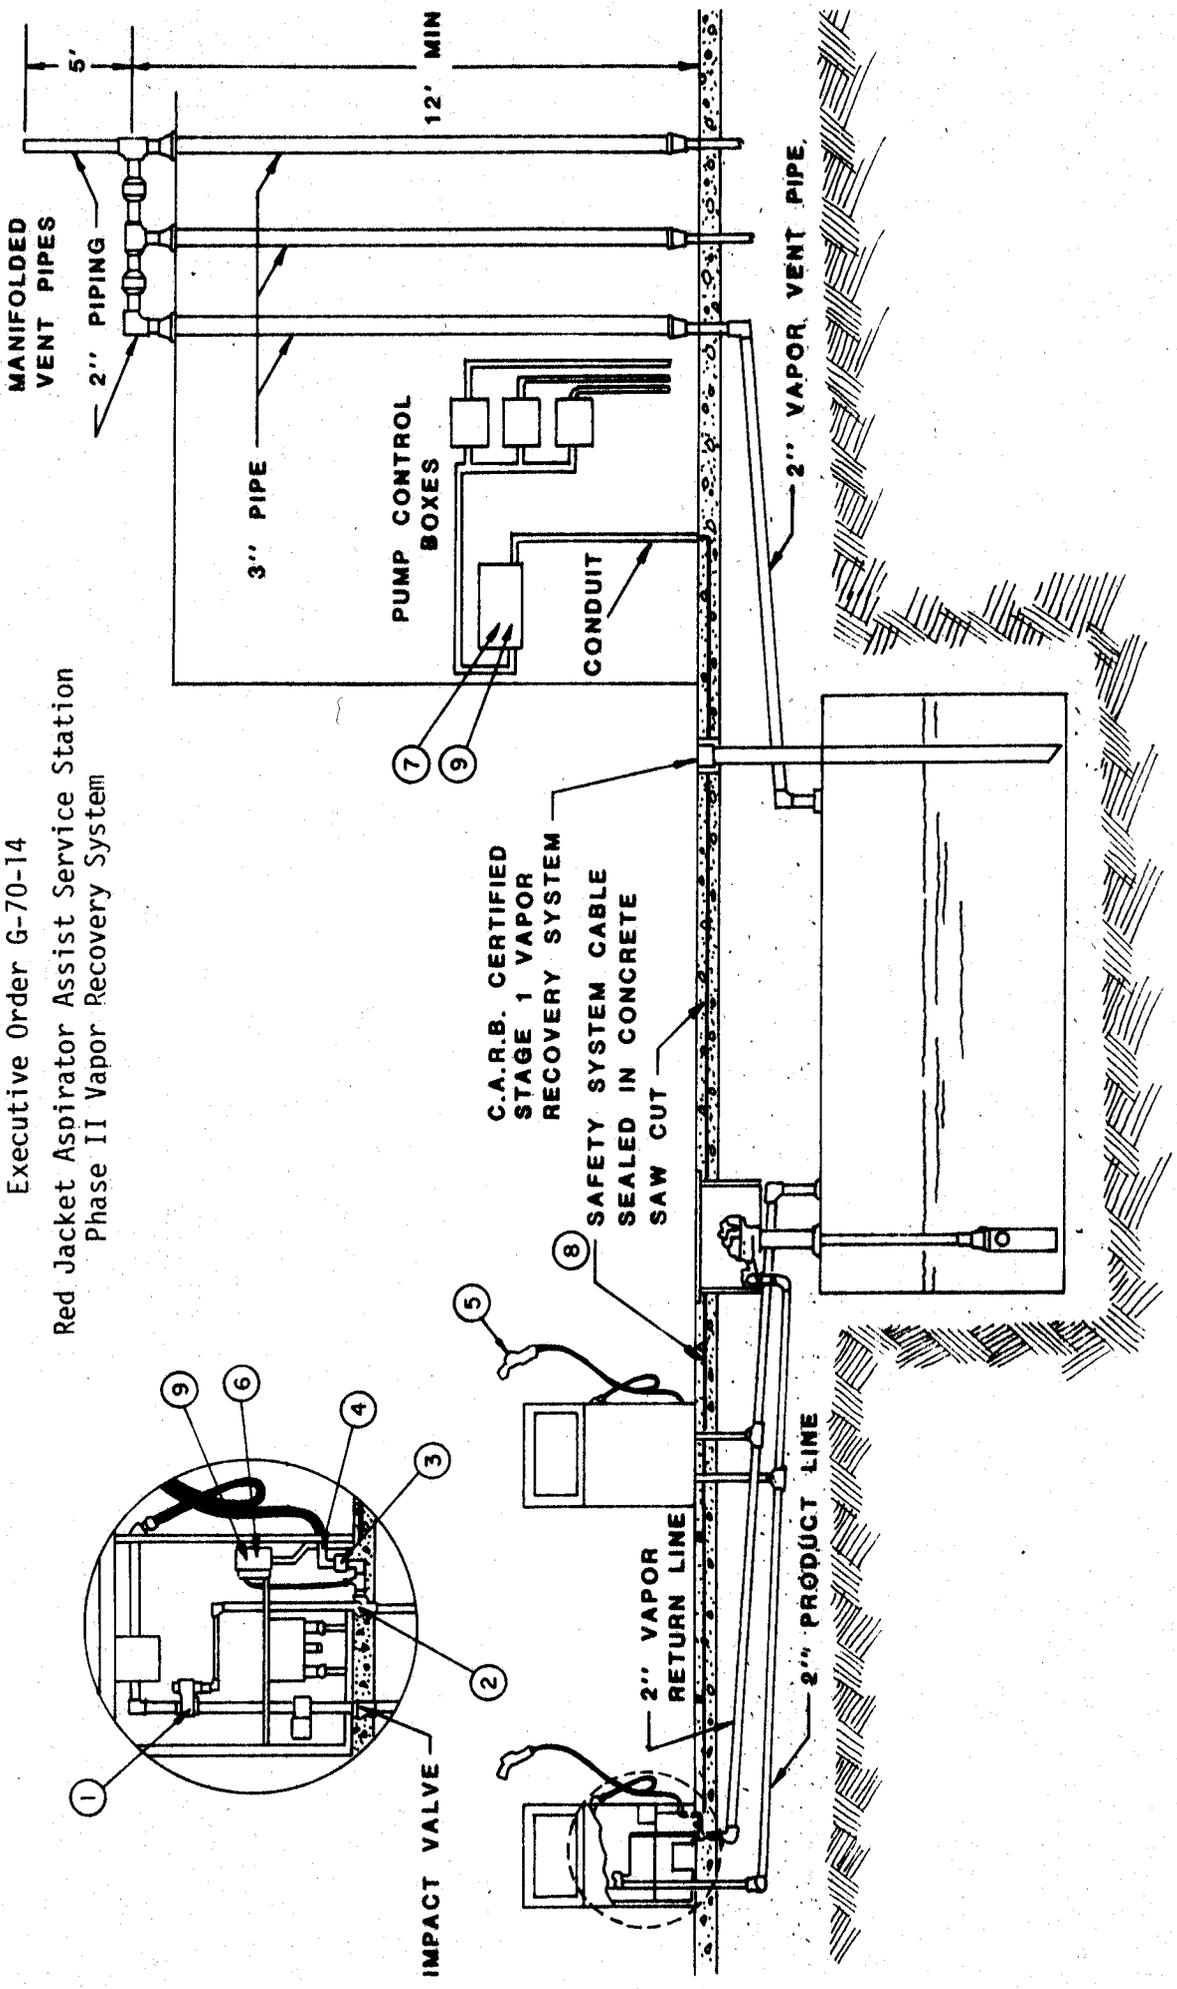


EXHIBIT 2

Executive Order G-70-14  
 Red Jacket Aspirator Assist Service Station  
 Phase II Vapor Recovery System  
 Component List

Item	Manufacturer and Model	State Fire Marshal Identification Number	Substitute Equipment	
			Manufacturer and Model	State Fire Marshal Identification Number
1. Modulating Valve	Red Jacket 188 - 185	GVRS002:001:1 188 - 185		
2. Aspirator	Red Jacket 104 - 016	GVRS002:001:1 104 - 016		
3. Vapor Check Valve	Red Jacket 188 - 184	GVRS002:001:1 188 - 184		
4. Vapor Screen	Red Jacket 176 - 032	GVRS002:001:1 176 - 032		
5. Nozzle, unleaded	OPW 158 - 013 or 158 - 014	GVRS002:001:1 158 - 013 or 158 - 014		
Nozzle, leaded	OPW 158 - 012	GVRS002:001:1 158 - 012		
6. Transducer Package	Red Jacket 001 - 001 - K	GVRS002:001:1 001 - 001 - K		
7. Safety System Control	Red Jacket 002 - 002 - K	GVRS002:001:1 002 - 002 - K		
7 Conductor Flat	Spectra Strip 001 - 002 - F	--		
Connector (inside box)	Alpha 009 - 001 - D	--		