


Executive Order G-70-153-AC

Exhibit 2

Figure 2A-2

Typical Installation of the
Dresser Wayne WayneVac Phase II Vapor Recovery
System
With Two-Point Phase I System

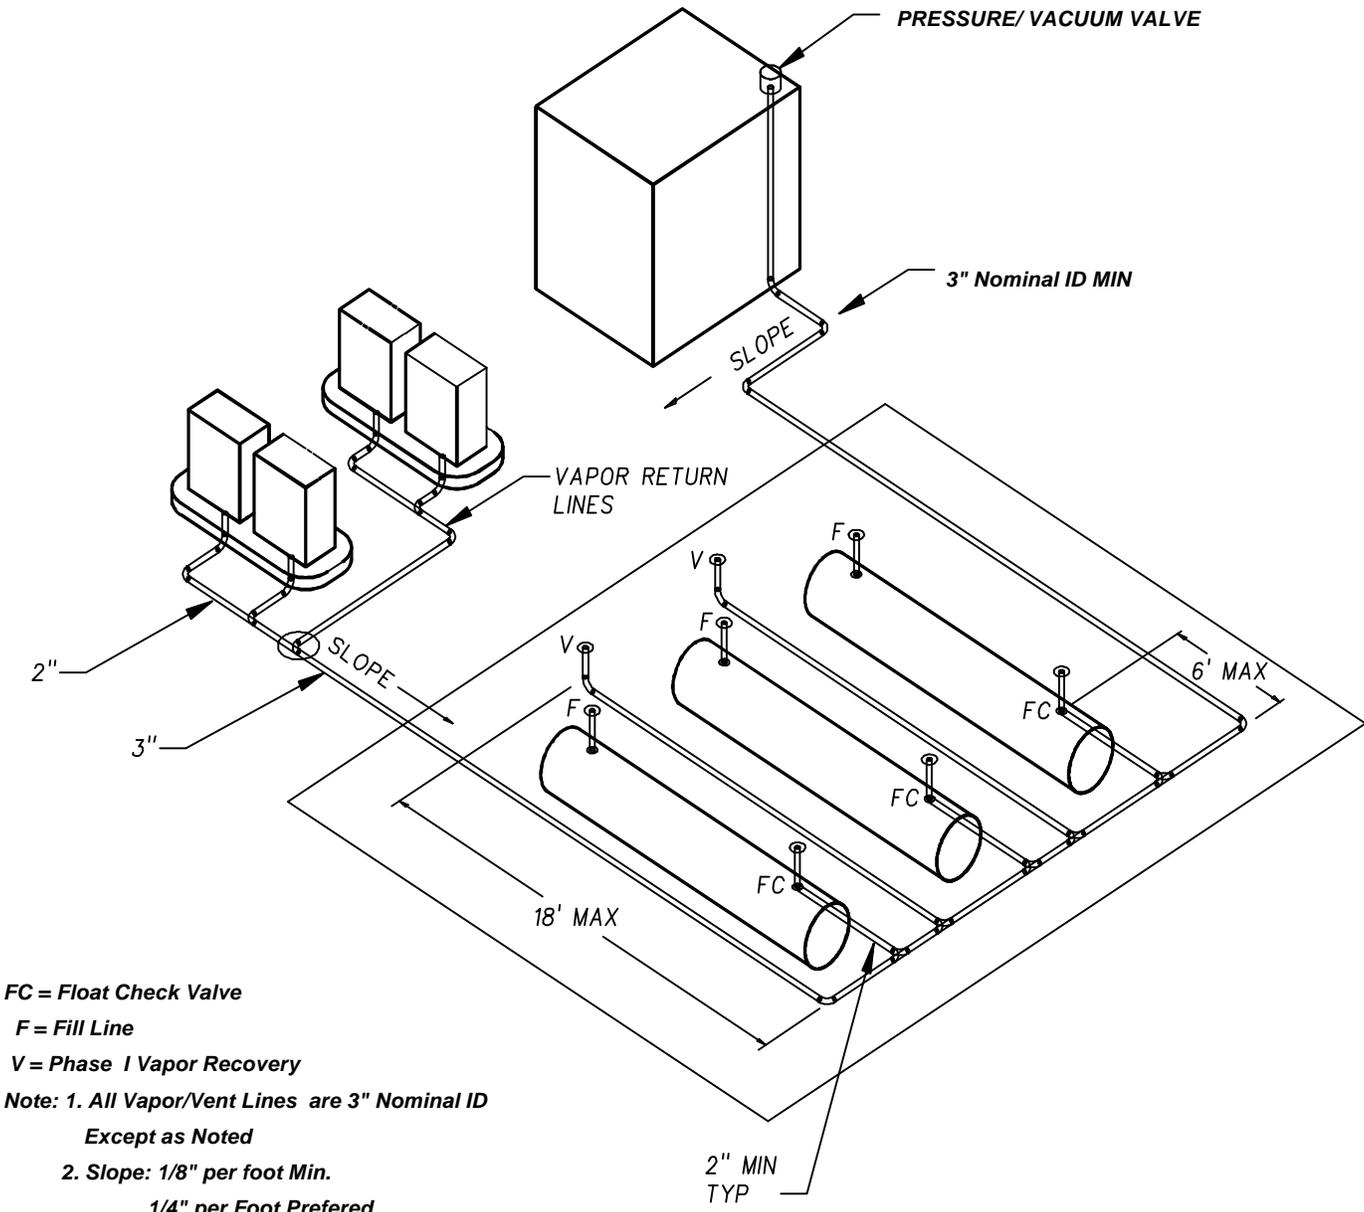

- FC = Float Check Valve**
- F = Fill Line**
- V = Phase I Vapor Recovery**
- Note: 1. All Vapor/Vent Lines are 3" Nominal ID**
Except as Noted
- 2. Slope: 1/8" per foot Min.**
1/4" per Foot Preferred
- 3. Maintain 2'0" Clearance Between Fill Line and**
Phase I Vapor Return Line to Delivery Truck
- 4. No less than one vapor return hose must be**
connected for each product being delivered