


**Executive Order  
G-70-153-AC**

**Exhibit 2**

**Figure 2A-4**

**Typical Installation of the  
Dresser Wayne WayneVac Phase II Vapor Recovery System  
With Two-Point Phase I System**

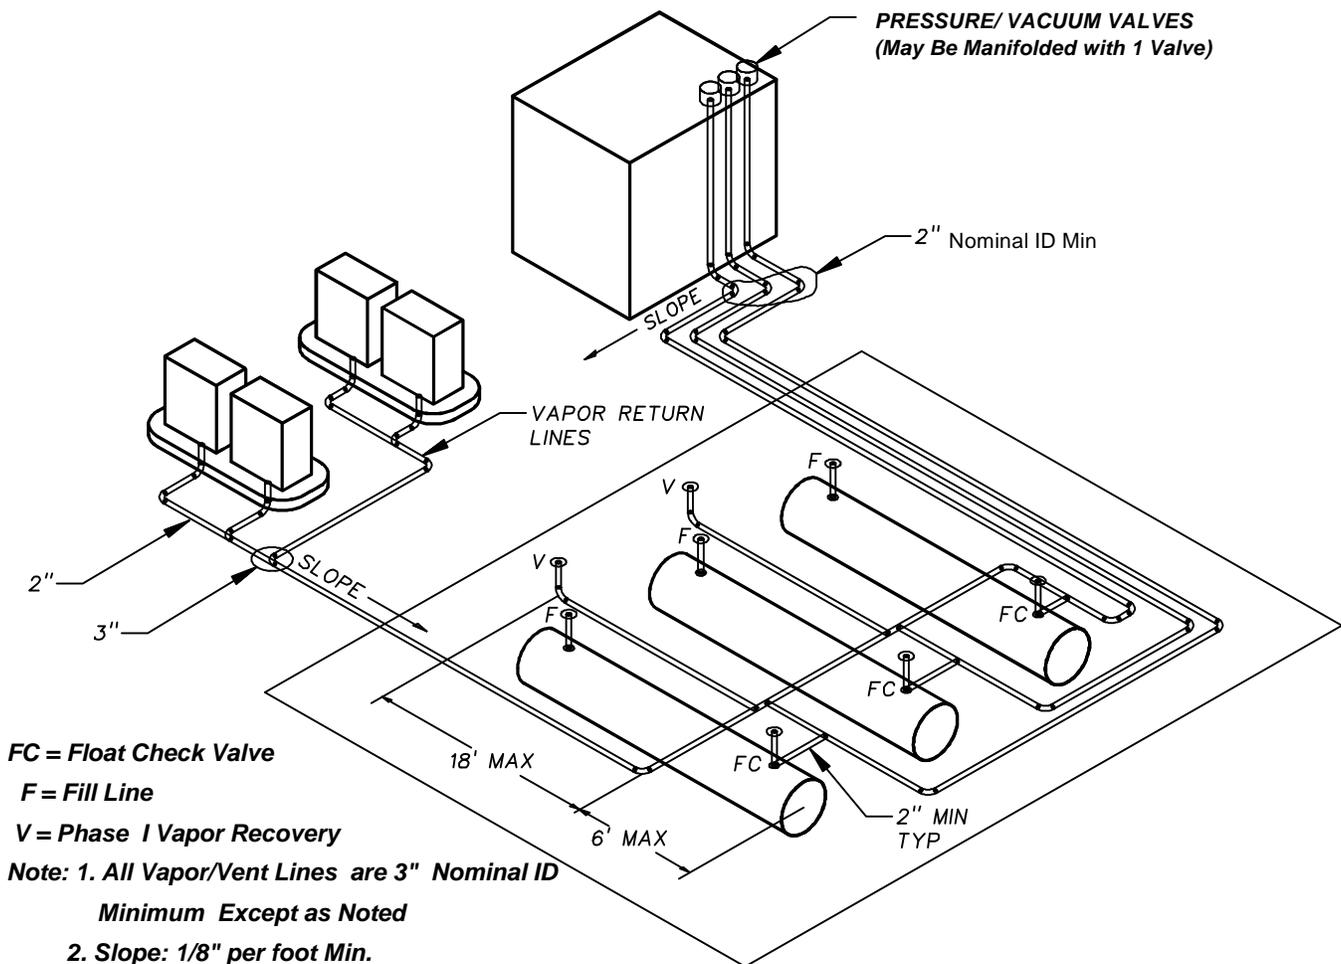

**FC = Float Check Valve**

**F = Fill Line**

**V = Phase I Vapor Recovery**

**Note: 1. All Vapor/Vent Lines are 3" Nominal ID**

**Minimum Except as Noted**

**2. Slope: 1/8" per foot Min.**

**1/4" per Foot Preferred**

**3. Maintain 2'0" Clearance Between Fill Line and  
Phase I Vapor Return Line to Delivery Truck**

**4. No less than one vapor return hose must be  
connected for each product being delivered**