

**State of California
AIR RESOURCES BOARD**

Executive Order G-70-154

**Certification of the
Tokheim MaxVac Phase II Vapor Recovery System**

WHEREAS, the California Air Resources Board ("the Board" or "CARB") has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, certification procedures for systems designed for the control of gasoline vapor emissions during motor vehicle fueling operations (Phase II vapor recovery systems) in its "Certification Procedures for Gasoline Vapor Recovery Systems at Service Stations" (the "Certification Procedures") as last amended December 4, 1981, incorporated by reference in Title 17 California Code of Regulations section 94001;

WHEREAS, the Board has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, test procedures for determining the compliance of Phase II vapor recovery systems with emission standards in its "Test Procedures for Determining the Efficiency of Gasoline Vapor Recovery Systems at Service Stations" (the "Test Procedures") as last amended September 1, 1982, incorporated by reference in Title 17 California Code of Regulations section 94000;

WHEREAS, Tokheim Corporation ("Tokheim"), has requested certification of the MaxVac Phase II vapor recovery system ("MaxVac system") pursuant to the Certification Procedures and Test Procedures;

WHEREAS, the MaxVac system has been evaluated pursuant the Board's Certification Procedures;

WHEREAS, Section VIII-A of the Certification Procedures provides that the Executive Officer shall issue an order of certification if he or she determines that the vapor recovery system conforms to all of the requirements set forth in Sections I through VII of the Certification Procedures; and

WHEREAS, I, James D. Boyd, Air Resources Board Executive Officer, find that the MaxVac system conforms with all the requirements set forth in Sections I through VII of the Certification Procedures, and results in a vapor recovery system which is at least 95 percent effective for attendant and/or self-serve use at gasoline service stations when used in conjunction with a Phase I vapor recovery system which has been certified by the Board.

///

NOW, THEREFORE, IT IS HEREBY ORDERED that the MaxVac system is certified to be at least 95 percent effective in attended and/or self-serve mode when used with a CARB-certified Phase I vapor recovery system as specified in Exhibit 2 of this Order. Fugitive emissions which may occur when the underground storage tanks are under positive pressure have not been quantified and were not included in the calculation of system effectiveness. Exhibit 1 contains a list of the equipment certified for use with the MaxVac system. Exhibit 2 contains installation and performance specifications.

IT IS FURTHER ORDERED that the maximum dispensing rate for installations of the MaxVac system shall not exceed ten (10.0) gallons per minute in compliance with the limitation imposed by United States Environmental Protection Agency as specified in the Federal Register, Volume 58, Number 55, page 16019.

IT IS FURTHER ORDERED that compliance with the certification requirements and rules and regulations of the Division of Measurement Standards of the Department of Food and Agriculture, the State Fire Marshal's Office, and the Division of Occupational Safety and Health of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED that each vapor pump and the electronic circuitry with which it is to operate shall be matched and 100 percent performance checked at the factory, including verification that the vapor recovery system performance is within the range specified in Exhibit 2 of this Order. Vapor pumps and electronic components sold separately as replacement parts shall be tested after field installation to verify that the combination results in vapor recovery system performance within the range specified in Exhibit 2 of this Order.

IT IS FURTHER ORDERED that the following requirements are made a condition of certification. The MaxVac system shall be installed only in facilities which are capable of demonstrating on-going compliance with the vapor integrity requirements of the local air pollution control district ("district") with jurisdiction over the installation. The owner or operator of the installation shall conduct, and pass, a static pressure decay test at least once in each twelve month period. The district may elect to impose more stringent test frequency requirements. The test shall be conducted in accordance with a CARB-approved or district-approved test procedure, and the results shall be made available to the district upon request within fifteen days after the test is conducted. (The most current draft procedure TP-201.3 may be used until a static pressure decay test procedure is adopted by the Board.) Alternative test procedures may be used if determined by the Executive Officer to yield comparable results.

IT IS FURTHER ORDERED that all nozzles approved for use with the MaxVac system shall be 100 percent performance checked at the factory, including checks of the integrity of the vapor path and the proper functioning of all automatic shut-off mechanisms.

IT IS FURTHER ORDERED that installations of the system certified hereby shall perform in actual use with the same effectiveness as the certification test systems. Failure to demonstrate compliance with stricter procedures or performance standards adopted by local districts in accordance with the California Health and Safety Code section 41954 (g) does not necessarily mean that the MaxVac system has violated the terms and conditions of this Executive Order. If, in the judgment of the Executive Officer, a significant fraction of installations fail to meet any of the specifications of this certification, or if a significant portion of the vehicle population is found to have configurations which significantly impair the system's collection efficiency, the certification itself may be subject to modification, suspension or revocation.

IT IS FURTHER ORDERED THAT revision to the certification and/or test procedures relevant to this certification may be the basis for evaluation of the system and may constitute grounds for modification, suspension or revocation of this certification.

IT IS FURTHER ORDERED that the certified MaxVac system shall be performance tested during installation for ability to dispense gasoline and collect vapors without difficulty in the presence of the station manager or other responsible individual. The station manager, owner or operator shall also be provided with instructions on the proper use of the MaxVac system, its repair and maintenance, and where system replacement and system components can be readily obtained.


IT IS FURTHER ORDERED that the certified MaxVac system shall be warranted in writing to the ultimate purchaser and each subsequent purchaser that the vapor recovery system is, for at least three years, designed, built and equipped so as to conform at the time of original installation or sale with the applicable regulations and is free from defects in materials and workmanship which would cause the vapor recovery system to fail to conform with applicable regulations. Copies of the manufacturer's warranty for the MaxVac system shall be made available to the station manager, owner or operator. Hoses, nozzles and breakaway couplings shall be warranted to the ultimate purchaser as specified above for at least one year, or for the expected useful life, whichever is longer.

IT IS FURTHER ORDERED that the certified MaxVac system shall, at a minimum, be operated in accordance with the manufacturer's recommended maintenance intervals and shall use the manufacturer's recommended operation, installation, and maintenance procedures.

///

IT IS FURTHER ORDERED that any alteration of the equipment, parts, design, or operation of the systems certified hereby is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the Executive Officer or his/her designee.

Executed at Sacramento, California, this 9th day of June, 1994

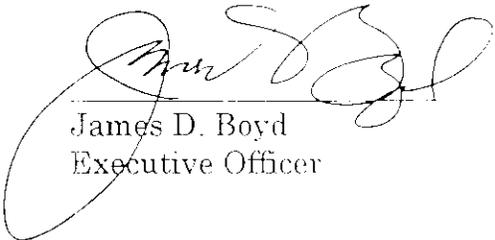

James D. Boyd
Executive Officer

Attachments

Executive Order G-70-154

Exhibit 1

MaxVac System Equipment List

<u>Component</u>	<u>Manufacturer/Model</u>	<u>State Fire Marshal Identification Number</u>
Nozzle	Husky V34 Model 6200-5 (with vapor valve and ECD*) * ECD: Efficiency Compliance Device - see Figure 2-D)	005:021:008
	OPW 11VAI-xx (with vapor valve and ECD*) xx = 63 (15/16 OD spout, hold open latch (HOL)) 68 (13/16" OD spout, HOL) 83 (15/16" OD spout, no HOL) 88 (13/16" OD spout, no HOL) * ECD: Efficiency Compliance Device - see Figure 2-D) OR Any inverted coaxial nozzle CARB-certified for use with the MaxVac system.	005:008:050
Inverted Coaxial Hose	Dayco 7282 Superflex 2000	005:033:005
	Goodyear Flexsteel Thermoid Hi-Vac OR Any inverted coaxial hose CARB-certified for use with the MaxVac system.	005:036:002 005:037:003
Pressure/Vacuum Valve	OPW 523LP, 523LPS (settings as specified below)	005:008:051
	Hazlett H-PVB-1 Gold label (settings as specified below) OR Any CARB-certified valve with the following pressure and vacuum settings, in inches water column (wc): <u>Pressure</u> : three plus or minus one-half inches (3.0 ± 0.5") water column. <u>Vacuum</u> : eight plus or minus two inches (8 ± 2") water column.	005:017:004

Breakaway Couplings	Catlow AV200 (no vapor valve)	005:030:005
	AV200-1 (no vapor valve)	005:030:005
	AV2001 (with vapor valve)	005:030:006
	Husky 4034 (with vapor valve)	005:021:009
	OPW 66CI (no vapor valve)	005:030:005
	66CIP (with vapor valve)	005:030:006
	Richards Industries	
	VA-50 (with vapor valve)	005:031:007
	VA-51 (no vapor valve)	005:031:007

OR

Any inverted coaxial breakaway CARB-certified for use with the MaxVac system.

Vapor Pumps Nuovo Pignone positive displacement roller pump/motor assembly
Model Number: NFB 459002060

Dispensers Premier Series Dispensers:
HxxxBR/suffix/MV where
"H" = High hose, "B" = Premier Series
"R" = Remote Dispenser, "MV" = MaxVac.
"xxx" = 311, 312, 322, 324, 411, 413, 414, 422, 426, 428
"suffix" = B3 for 3 product , B5 for 5 product blender.
EB for Electronic Blender

MaxVac Retrofit Kits Kit Model Numbers:
prefix/xxx/y/MVK-GR/z
"prefix" = H or blank, "MVK" = MaxVac Kit.
"GR" = Group
"xxx" = 300, 400 or 600
"y" = A for TCS-A or B for Premier
"z" may be 1 to 10

Note: KITS SHALL BE USED ONLY WITH:

Premier Series Dispensers as listed above without the "MV" designation,

OR

TCS-A Series Dispensers:
prefix/xxxAR/suffix
"prefix" = H or blank, "A" = TCS-A Series,
"R" = Remote Dispenser
"xxx" = 311, 312, 322, 324, 411, 413, 422, 426, 614, 628
"suffix" = B3 for 3 product blender, B5 for 5 product blender, EB for Electronic Blender.

Executive Order G-70-154

Exhibit 2

Specifications for the MaxVac Bootless Nozzle System

Figures 2A contain drawings of a typical installation of the MaxVac system. Figures 2B and 2C depict the operation and location of component parts of the MaxVac system. Figure 2D depicts the nozzles approved for use with the system.

Nozzles

1. An efficiency compliance device (ECD) shall be installed on the nozzle at the base of the spout, as shown in Figure 2D. Any nozzle with an ECD which is missing, or which is damaged such that at least one-fourth (1/4) of the diameter is missing, or which has cumulative damage equivalent to at least 1/4 of the diameter missing, is defective and shall be immediately removed from service.
2. Failure mode testing demonstrated that blockage of some of the vapor collection holes in the spout has negligible effect on the operation of the system until only one hole remains unblocked. Any Husky V34 or OPW 11VAI nozzle which is found to have less than two unobstructed vapor collection holes is defective and shall be immediately removed from service.
3. The nozzle shall have an integral vapor valve which prevents the loss of vapor from the underground storage tanks, ensures proper operation of the system and prevents the ingestion of air into the system when another nozzle which is connected to the same vapor pump is used. Any nozzle with a defective vapor valve will substantially impair the effectiveness of the other nozzles associated with the same vapor pump. Therefore, any nozzle with a defective vapor valve, and all nozzles at the same fueling point (dispenser side), shall be immediately removed from service and the vapor path shall be closed as soon as possible.

NOTE: A defective vapor valve will also impair the integrity of the system and may result in vapor loss from or air ingestion into the underground storage tanks.

4. Nozzles shall be 100 percent performance checked at the factory, including checks of the integrity of the vapor path at a pressure of at least two inches water column and at a vacuum of at least twenty inches water column.
5. Leaded and unleaded spouts are interchangeable.

Inverted Coaxial Hoses

1. The length of hose which may be in contact with the island and/or ground when the nozzle is properly mounted on the dispenser is limited to six inches (6").
2. The hose configuration shall comply with Figure 2B; there may be 1 to 4 hoses on each side of the dispenser. Within the constraints of the configurations, the maximum allowable length of the hose shall be fifteen feet (15').

Breakaway Couplings

1. Breakaway couplings are optional but, if installed, only certified breakaways may be used.
2. The following section does not apply to breakaways that contain a valve which closes the vapor path when it is separated. Operation of the system when a breakaway coupling is separated will substantially reduce the effectiveness of the other nozzles at that fueling point (dispenser side). Separated breakaways shall be recoupled, or the vapor path plugged, as soon as possible. Other nozzles at the fueling point shall not be used when such a breakaway is separated.
NOTE: A separated breakaway will also impair the integrity of the system and may result in vapor loss from or air ingestion into the underground storage tanks.

MaxVac System

1. The normal operating range of the system, as measured by air-to-liquid (A/L) ratio testing, is 1.00, plus or minus 0.10 (0.90 to 1.10). The A/L ratio of the system shall be measured at a flowrate between seven and ten gallons per minute (7 - 10 gpm). Any fueling point not capable of demonstrating compliance with this performance standard shall be deemed defective and removed from service. The A/L ratio shall be determined by a CARB-approved or district-approved test procedure. (Draft procedure TP-201.5 may be used until an A/L ratio test procedure is adopted by the Board. Alternative test procedures may be used if they are determined by the Executive Officer to yield comparable results.)

NOTE: this test procedure returns air rather than vapor to the storage tank, and normally causes an increase in storage tank pressure which may result in vent emissions. This is a temporary condition due to the test and should not be considered an indication of malfunction or noncompliance.

2. The MaxVac system shall be equipped with electronic safeguards designed to ensure that no fuel is dispensed unless the MaxVac system is operating properly. An error code is indicated on the sales display of the dispenser which identifies the problem as being related to the MaxVac system.

The following conditions shall halt or inhibit the operation of the one side of the dispenser, with an error code indicated, while allowing the other side to operate.

- Excessive vapor pump motor current (possible causes include bearing failure, locked rotor, motor winding shorts or fluid in pump cavity for more time than required to clear a blockage).
- Failure of the vapor pump to start while fuel is being dispensed (possible causes include control electronics failure, disconnected or severed motor wiring, or locked rotor).
- Failure or loss of the MaxVac system power supply.
- Open circuit breaker.
- Cabling/wiring missing or disconnected (tampering).

Vapor Lines and Underground Storage Tank (UST) Vents

1. The recommended maximum pressure drop through the system, measured at a flow rate of 60 SCFH with dry Nitrogen gas, is 0.02 inches water column (0.03 inches water column if the measurement includes an impact valve). The maximum allowable pressure drop through the system shall never exceed one-half inch (0.5") water column at 60 SCFH. The pressure drop shall be measured from the dispenser riser to the UST with pressure/vacuum valves installed and with the poppeted Phase I vapor connection open.
2. The dispenser shall be connected to the riser with either flexible or rigid material which is listed for use with gasoline. The dispenser-to-riser connection shall be installed so that any liquid in the lines will drain toward the UST. The internal diameter of the connector, including all fittings, shall be not less than five-eighths inch (5/8").
3. The recommended nominal inside diameter of the underground Phase II plumbing is as indicated in Figures 2A-1 through 2A-4. Smaller vapor return lines are not recommended but may be used provided the above-specified pressure drop criteria is met. The vapor return lines shall be manifolded as shown in Figures 2A-1 through 2A-4.
Exception: For installations with a vapor return line directly to only one tank, and for which a manifold on the tank vents will be used to provide part of the vapor return path to other tanks, the vent manifold may be used as an

alternative to the underground manifold only in existing installations where the vapor piping is already installed, and shall not be used in "new" installations where vapor piping is being installed. For installations with dedicated vapor piping directly to each tank, the vent manifold is approved for both new and existing installations and an additional tank manifold below grade is optional but not required.

4. All vapor return lines shall slope a minimum of 1/8 inch per foot. A slope of 1/4 inch or more per foot is recommended wherever feasible.
5. A pressure/vacuum (P/V) valve shall be installed on each tank vent. Vent lines may be manifolded provided the manifold is installed at a height not less than 12 feet above the driveway surface used for Phase I tank truck filling operations. At least one P/V valve shall be installed on manifolded vents. If two P/V valves are desired, they shall be installed in parallel, so that each can serve as a backup for the other if one should fail to open properly. The P/V valve shall be CARB-certified as specified in Exhibit 1. The outlets shall vent upward and be located to eliminate the possibility of vapors accumulating or traveling to a source of ignition or entering adjacent buildings.
6. All vapor return and vent piping shall be installed in accordance with the manufacturer's instructions and all applicable regulations.

Underground Storage Tank (UST) and Phase I System

WARNING: Phase I fill caps should be opened with caution because the UST may be under pressure.

1. A threaded tap shall be installed at which the UST pressure may be monitored. The tap may be in the dispenser riser connection or on the vent line, and shall be accessible for connection to a pressure gauge. One tap is adequate for manifolded systems. The tap shall remain plugged and vapor tight except when test equipment is being connected to or removed from it. If located on the vent line, the tap shall be at least six feet (6') and not more than eight feet (8') above grade.
NOTE: Frequent venting (except when caused by air ingested into the system during the performance of the A/L ratio test, Phase I activities or other events not specifically caused by the Phase II system) may indicate system malfunction. Observation of rapid pressure decay when no vehicles are fueling may indicate leaks in the system; a static pressure decay test may be used to determine compliance with the vapor integrity requirements.
2. The Phase I vapor and fill caps provide an additional seal which may prevent vapor emissions when they are in place. However, the caps must be removed during Phase I operations and may result in loss of vapor from the UST. Therefore, compliance with static pressure decay test criteria shall be demonstrated with these caps removed. Prior to pressurizing the system, verify

that the liquid level in the USTs is at least eight inches (8") above the highest opening at the bottom of the submerged drop tube.


3. Spill containment manholes which have drain valves shall demonstrate compliance with the static pressure decay criteria with the drain valves installed as in normal operation. Manholes with cover-actuated drain valves shall demonstrate compliance with static pressure decay test criteria both with the cover open and with the cover closed.
4. Coaxial Phase I vapor recovery systems and manholes with cover-actuated drain valve certified prior to the effective date of this Order shall not be used with the MaxVac Phase II system; only CARB-certified non-coaxial Phase I systems shall be installed. Where the MaxVac system installation is made by retrofitting previously installed equipment, local districts may elect to allow the existing coaxial Phase I systems to remain in use for a specifically identified period of time provided the following conditions are met:
 - The existing coaxial Phase I system is a poppeted, CARB-certified system;
 - installation of the Phase II system requires no modification of the UST(s) and/or connections; and
 - the existing coaxial Phase I equipment is in good working order and has demonstrated compliance with static pressure decay test criteria when tested with all fill caps removed.
5. The Phase I vapor recovery system shall be operated during product deliveries so as to minimize the loss of vapors from the facility storage tank which may be under pressure. There shall be no less than one vapor return hose connected for each product being delivered. Provided it is not in conflict with established safety procedures, this may be accomplished in the following manner:
 - The Phase I vapor return hose is connected to the delivery tank and to the delivery elbow before the elbow is connected to the facility storage tank;
 - the delivery tank is opened only after all vapor connections have been made, and is closed before connection of any vapor return hoses;
 - the existing coaxial Phase I equipment is in good working order and has demonstrated compliance with static pressure decay test criteria when tested with all fill caps removed; and
 - the vapor return hose is disconnected from the facility storage tank before it is disconnected from the delivery tank.

Executive Order G-70-154

Exhibit 2

Figure 2A-1

Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

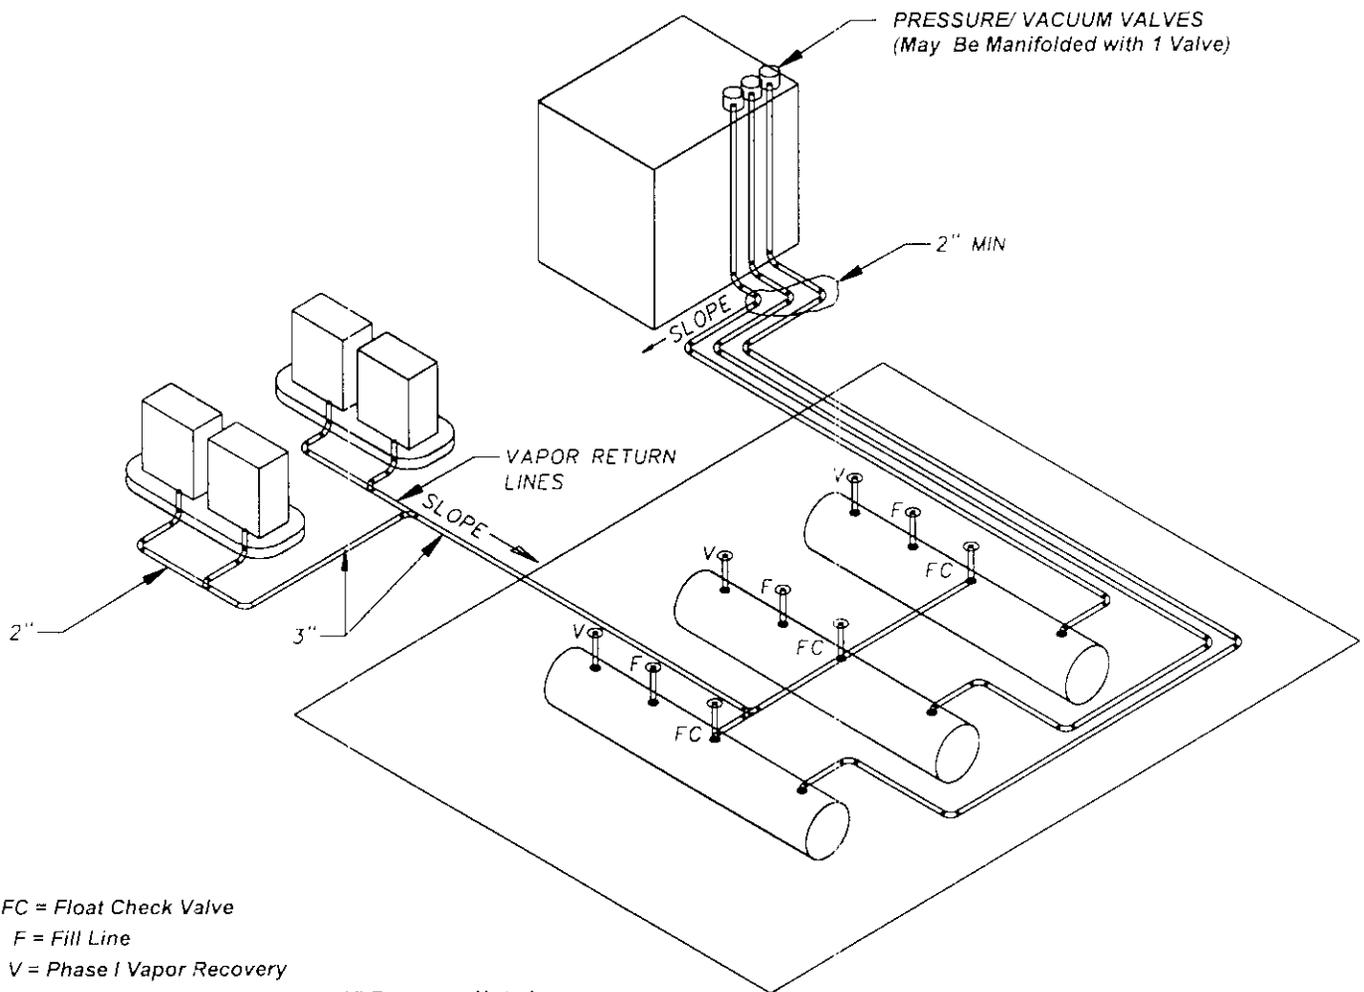

FC = Float Check Valve

F = Fill Line

V = Phase I Vapor Recovery

Note: 1. All Vapor/Vent Lines are 3" Except as Noted

2. Slope: 1/8" per foot Min.

1/4" per Foot Preferred


3. Maintain 2'0" Clearance Between Fill Line and
Phase I Vapor Return Line to Delivery Truck

Executive Order G-70-154

Exhibit 2

Figure 2A-2

Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

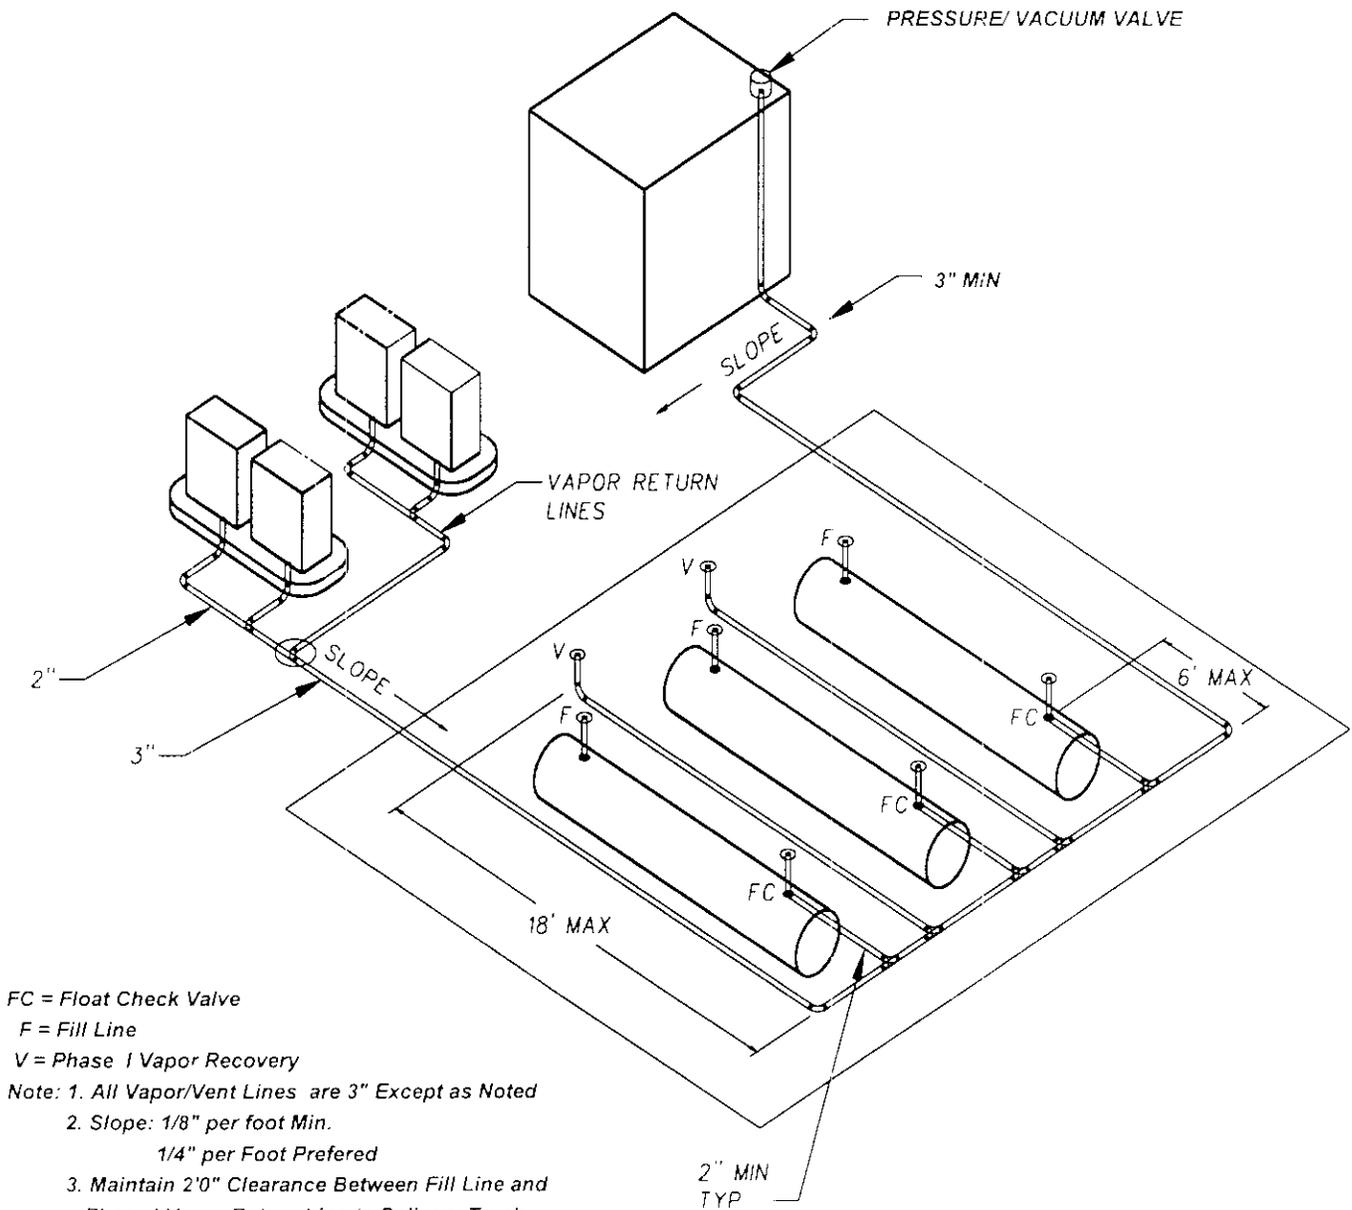


Executive Order G-70-154

Exhibit 2

Figure 2A-3

Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

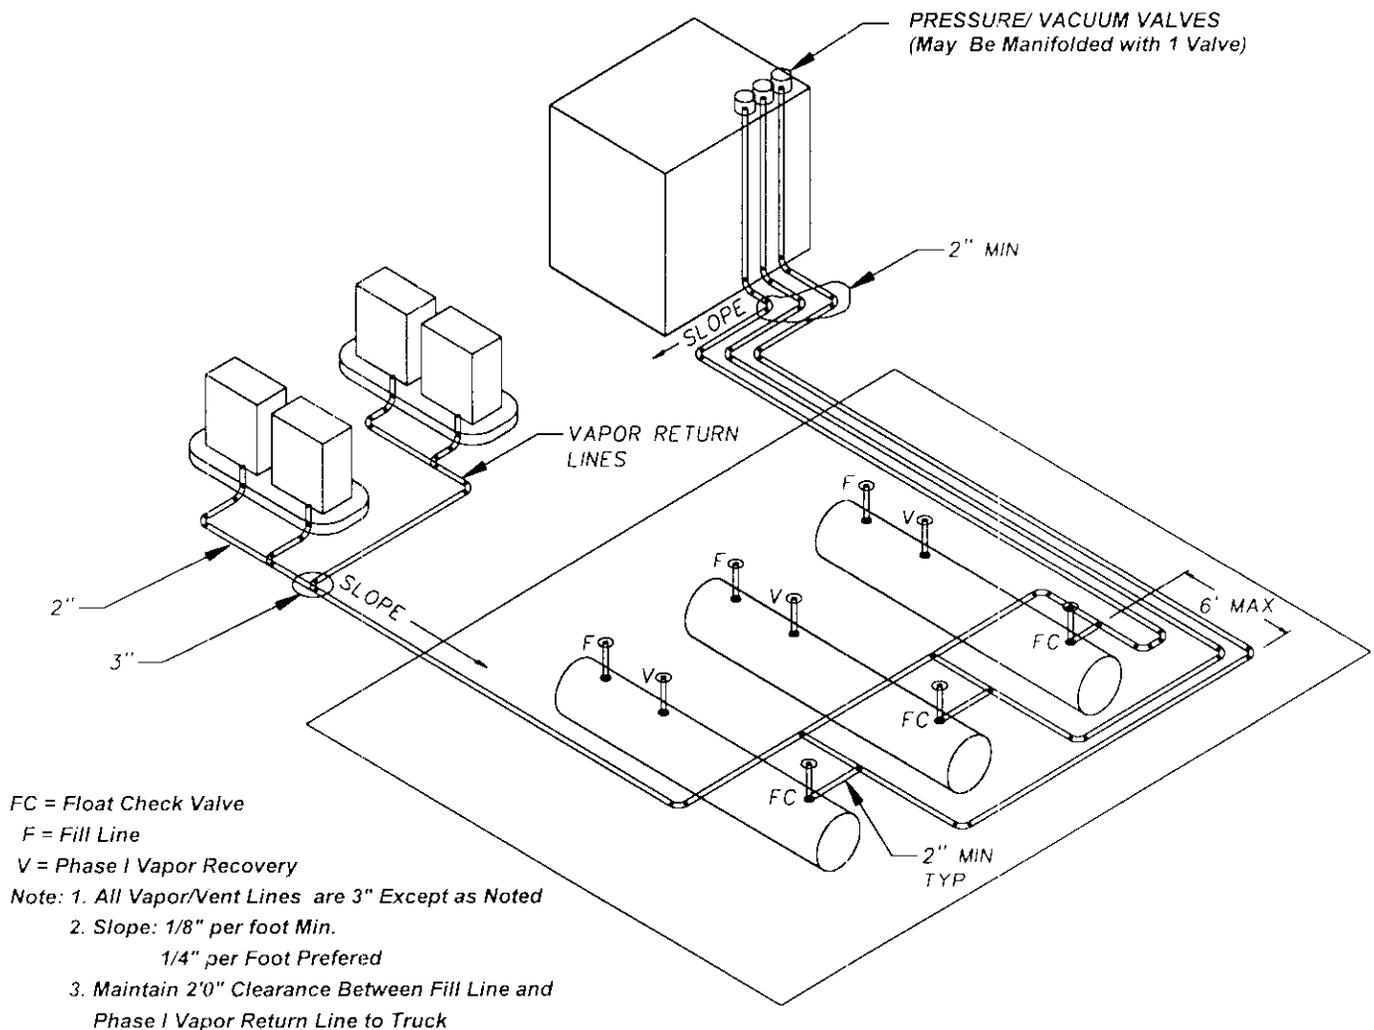


Executive Order G-70-154

Exhibit 2

Figure 2A-4


Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

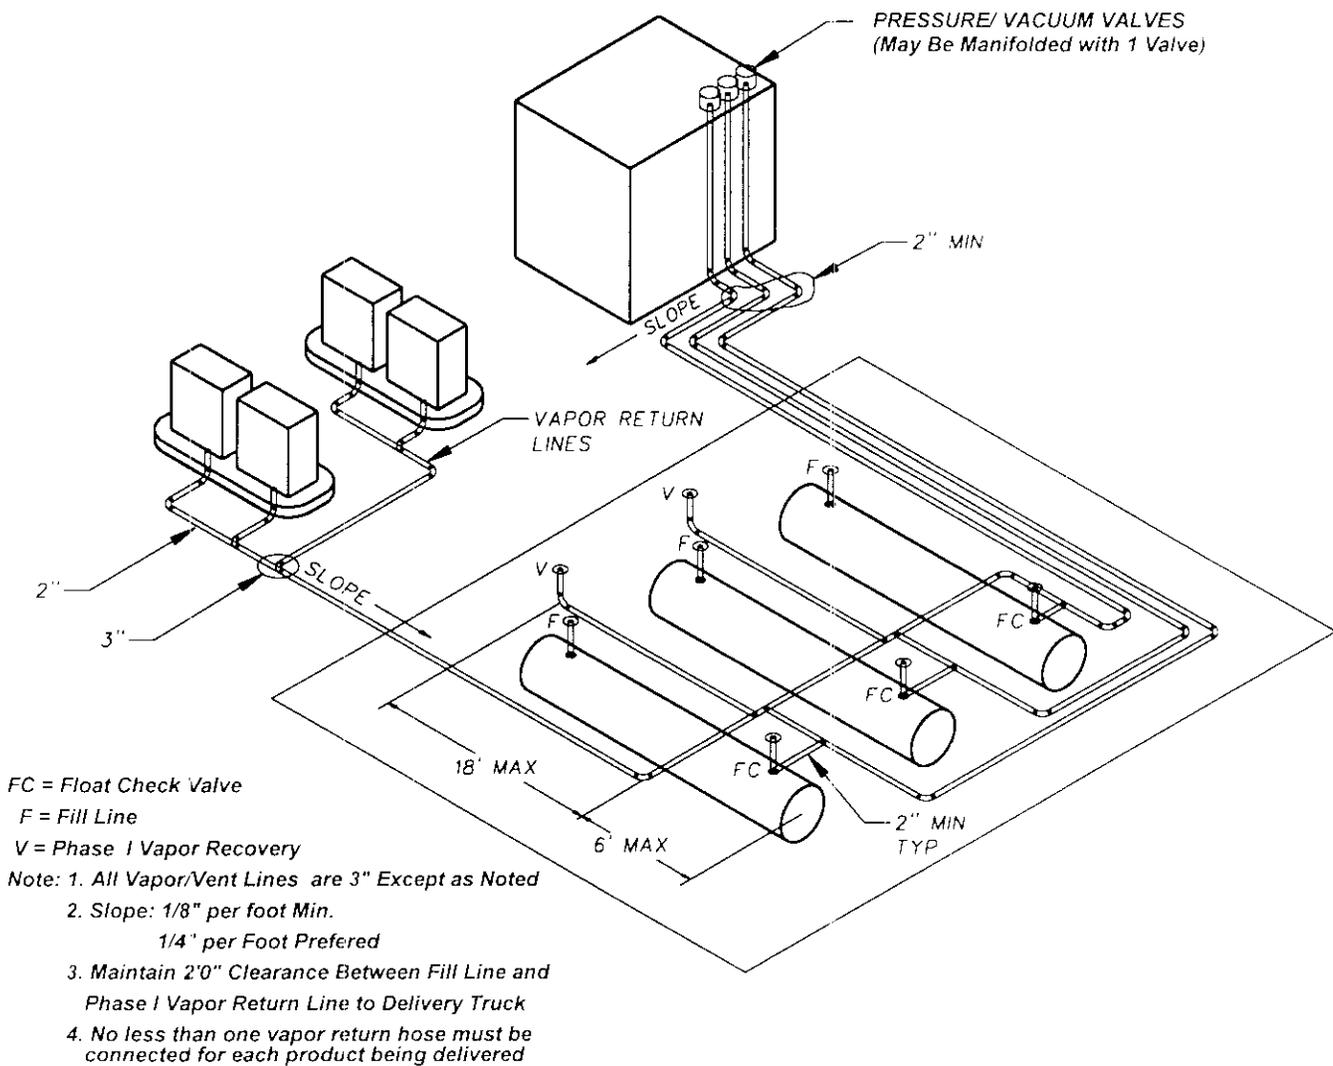

MaxVac System Operational Diagram

MaxVac[®]

STAGE II Vacuum Assist System

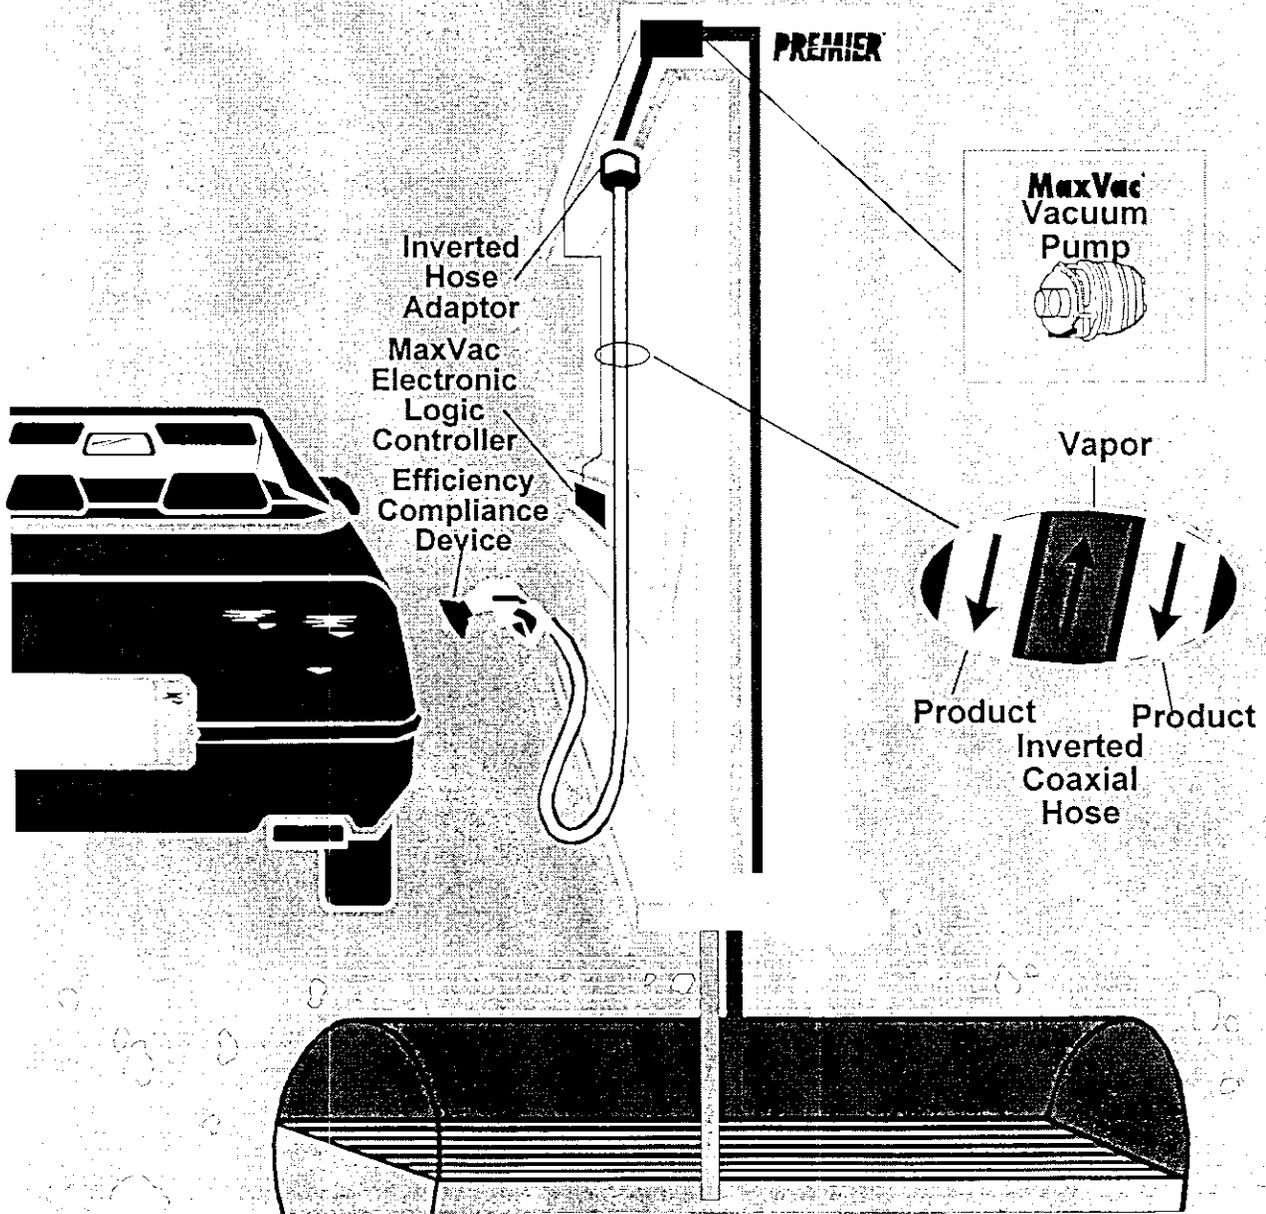


Executive Order G-70-154

Exhibit 2

Figure 2C

Possible Configurations - MaxVac System

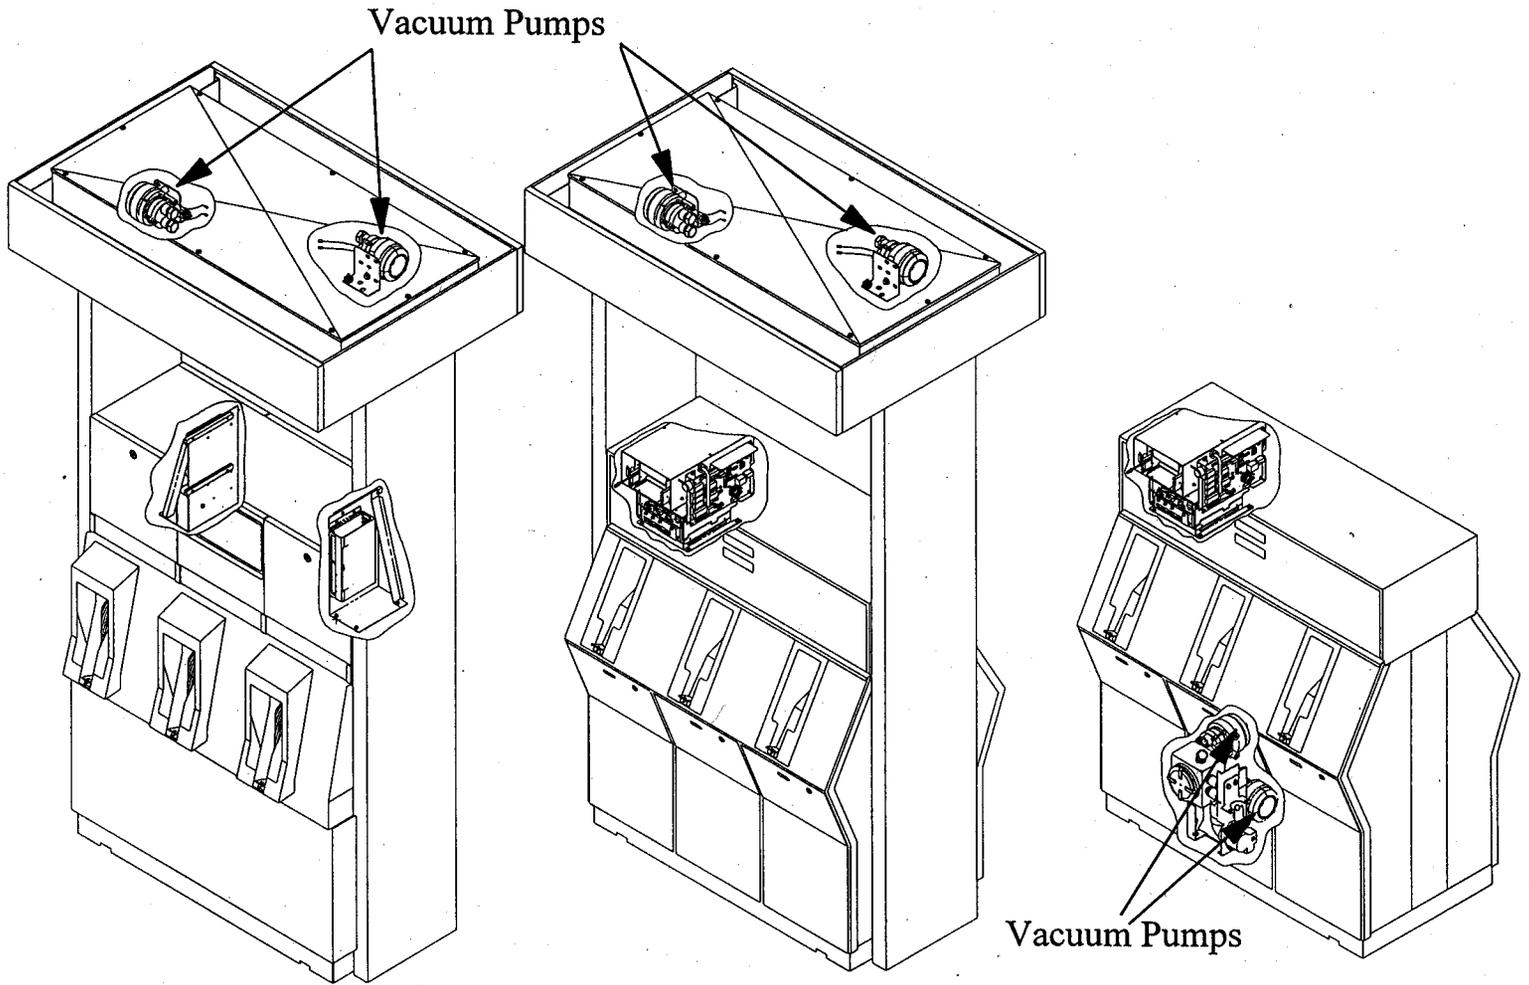

**Premier Dispenser
Production & Retrofit
Models**

**TCS-A Dispenser
Retrofit
High Hose Models**

**TCS-A Dispenser
Retrofit
Low Hose Models**


Dispenser can be One, Two, Three, or Four Hoses per Dispenser Side

Executive Order G-70-154

Exhibit 2

Figure 2D-1

HUSKY MODEL V34 6200-5
FOR TOKHEIM MAXVAC SYSTEM

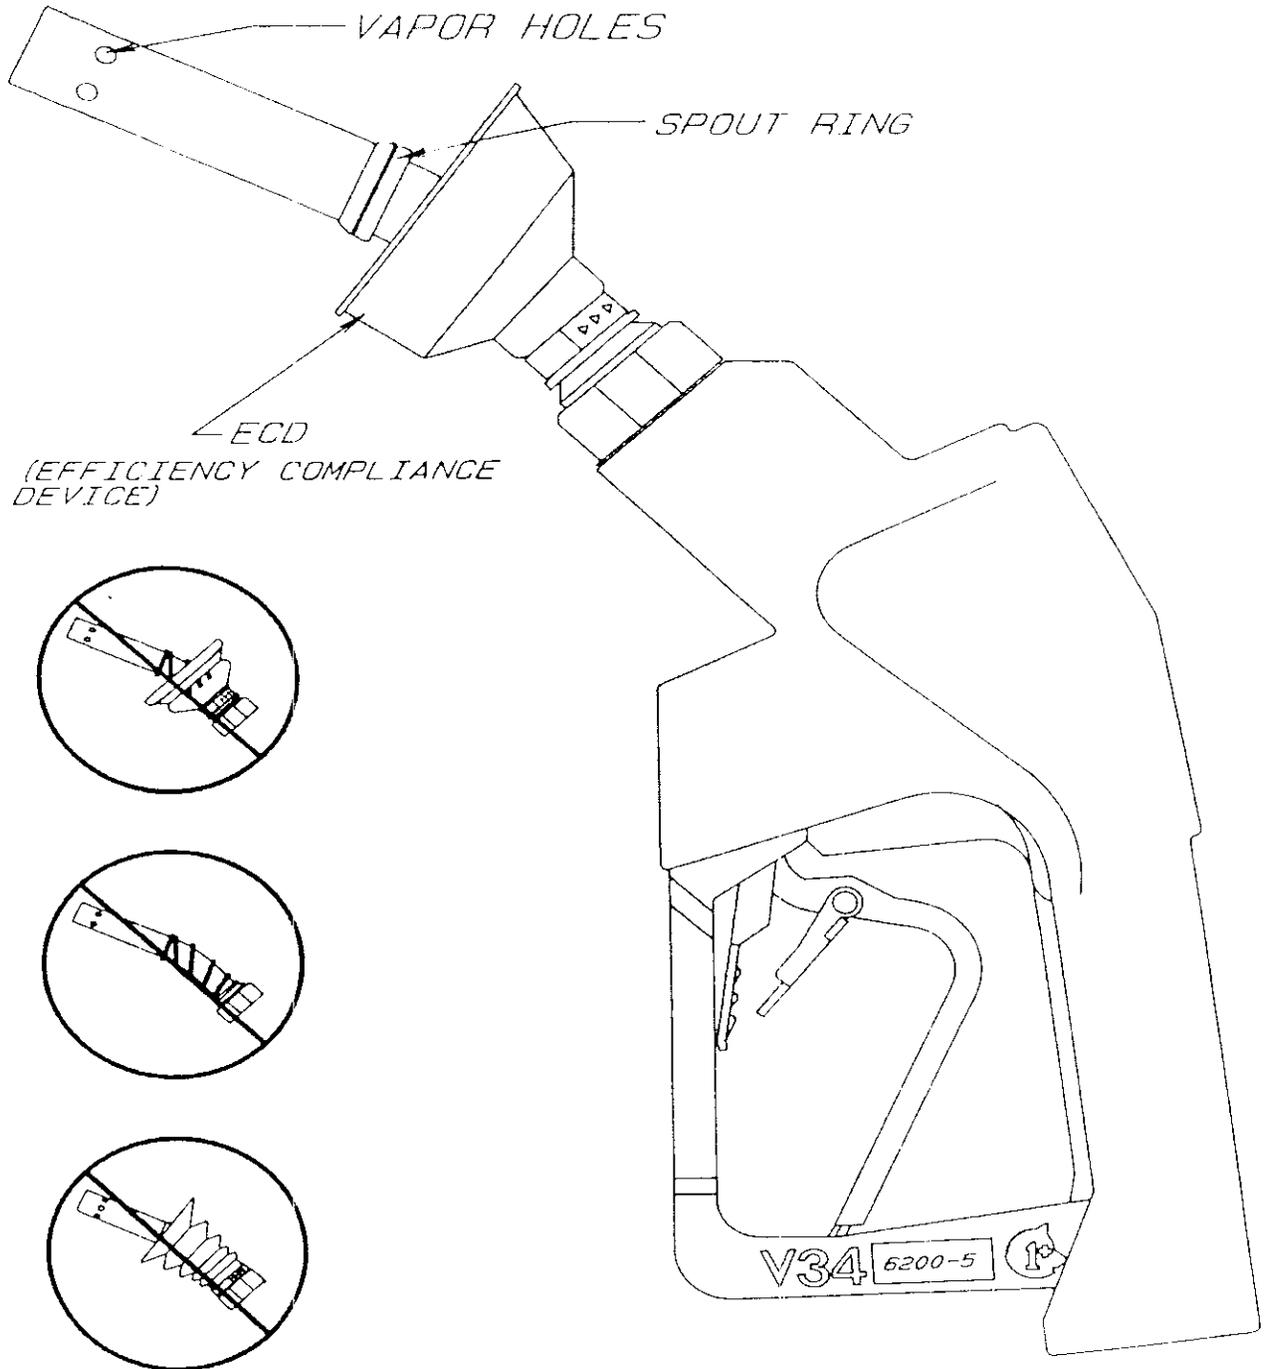

Executive Order G-70-154

Exhibit 2

Figure 2D-2

