

**State of California
AIR RESOURCES BOARD**

Executive Order G-70-159

**Certification of the Saber Nozzle for Use with the
Gilbarco VaporVac Phase II Vapor Recovery System**

WHEREAS, the California Air Resources Board ("the Board" or "CARB") has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, certification procedures for systems designed for the control of gasoline vapor emissions during motor vehicle fueling operations (Phase II vapor recovery systems) in its "Certification Procedures for Gasoline Vapor Recovery Systems at Service Stations" (the "Certification Procedures") as last amended December 4, 1981, incorporated by reference into Title 17, California Code of Regulations, Section 94001;

WHEREAS, the Board has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, test procedures for determining the compliance of Phase II vapor recovery systems with emission standards in its "Test Procedures for Determining the Efficiency of Gasoline Vapor Recovery Systems at Service Stations" (the "Test Procedures") as last amended September 1, 1982, incorporated by reference into Title 17, California Code of Regulations, Section 94000;

WHEREAS, Saber Equipment Corporation ("Saber"), has requested certification of the Saber Flow Nozzles ("Saber Nozzles") for use with the Gilbarco VaporVac ("Vapor Vac") System pursuant to the Certification Procedures and Test Procedures;

WHEREAS, the Saber Nozzles have been evaluated in conjunction with the VaporVac system pursuant the Board's Certification Procedures;

WHEREAS, Section VIII-A of the Certification Procedures provides that the Executive Officer shall issue an order of certification if he or she determines that the vapor recovery system conforms to all of the requirements set forth in Sections I through VII of the Certification Procedures; and

WHEREAS, I, James D. Boyd, Air Resources Board Executive Officer, find that Saber Nozzles used in conjunction with the VaporVac System conform with all the requirements set forth in Sections I through VII of the Certification Procedures, and result in a vapor recovery system which is at least 95 percent effective for attendant and/or self-serve use at gasoline service stations when used in conjunction with a Phase I vapor recovery system which has been certified by the Board.

NOW, THEREFORE, IT IS HEREBY ORDERED that the Saber Nozzles/ VaporVac system is certified to be at least 95 percent effective in attended and/or self-serve mode when used with a CARB-certified Phase I vapor recovery system as specified in Exhibit 2 of the most current revision of Executive Order G-70-150. Fugitive emissions which may occur when the underground storage tanks are under positive pressure have not been quantified and were not included in the calculation of system effectiveness. Exhibit 1 contains a list of the equipment certified for specific use with the Saber Nozzle/VaporVac system. Refer to the most current

revision of Executive Order G-70-150 for certified dispensers, dispenser retrofit kits, vapor pumps, pressure/ vacuum valves, underground piping and Phase I equipment. Exhibit 2 contains installation and performance specifications for the equipment listed in Exhibit 1.

IT IS FURTHER ORDERED that the maximum dispensing rate for installations of the Saber Nozzles system shall not exceed ten (10.0) gallons per minute in compliance with the limitation imposed by United States Environmental Protection Agency as specified in the Federal Register, Volume 58, Number 55, page 16019.

IT IS FURTHER ORDERED that compliance with the certification requirements and rules and regulations of the Division of Measurement Standards of the Department of Food and Agriculture, the State Fire Marshal's Office, and the Division of Occupational Safety and Health of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED that the following requirements are made a condition of certification. The Saber Nozzles shall be installed only in facilities which are capable of demonstrating on-going compliance with the vapor integrity requirements of the local air pollution control district ("district") with jurisdiction over the installation. The owner or operator of the installation shall conduct, and pass, a static pressure decay test at least once in each twelve month period. The test shall be conducted in accordance with the procedure contained in Exhibit 3 of this Order, and the results shall be made available to the district upon request within fifteen days after the test is conducted, or within fifteen days of the request. Alternative test procedures may be used if determined by the Executive Officer to yield comparable results.

IT IS FURTHER ORDERED that the Saber Nozzles shall be 100 percent performance checked at the factory, including checks of the integrity of the vapor path and the proper functioning of all automatic shut-off mechanisms.

IT IS FURTHER ORDERED that the system, as installed, shall comply with the procedures and performance standards which the test installation was required to meet during certification testing. Local districts may adopt stricter procedures or performance standards in accordance with the California Health and Safety Code section 41954 (g). Failure to demonstrate compliance with district procedures or performance standards which are stricter than those imposed during certification testing does not per se constitute failure of the Saber Nozzles/VaporVac system to meet the terms and conditions of this Executive Order. If, in the judgment of the Executive Officer, a significant fraction of installations fail to meet the specifications of this certification, or if a significant portion of the vehicle population is found to have configurations which significantly impair the system's collection efficiency, the certification itself may be subject to modification, suspension or revocation.

IT IS FURTHER ORDERED that the certified Saber Nozzles shall be performance tested during installation for ability to dispense gasoline and collect vapors without difficulty in the presence of the station operator, owner or designee. The station operator, owner or designee shall be provided with copies of the installation and maintenance manuals for the Saber Nozzles, to be maintained at the station, and shall also be provided with instructions in the proper use of the Saber Nozzles, their repair and maintenance, where and how system and/or component replacements can be readily obtained.

IT IS FURTHER ORDERED that the certified Saber Nozzles shall, at a minimum, be operated in accordance with the manufacturer's recommended maintenance intervals and shall use the manufacturer's recommended operation, installation, and maintenance procedures.

IT IS FURTHER ORDERED that the certified Saber Nozzles shall be warranted in writing, for at least one year, to the ultimate purchaser and each subsequent purchaser, that the vapor recovery system is designed, built and equipped so as to conform at the time of original installation or sale with the applicable regulations and is free from defects in materials and workmanship which would cause the vapor recovery system to fail to conform with applicable regulations. Copies of the manufacturer's warranty for the Saber Nozzles shall be made available to the station manager, owner or operator. Hoses, shall be warranted to the ultimate purchaser as specified above for at least one year, or for the expected useful life, whichever is longer.

IT IS FURTHER ORDERED that any alteration of the equipment, parts, design, or operation of the systems certified hereby is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the Executive Officer or his/her designee.

Executed at Sacramento, California, this 29th day of December, 1994.



James D. Boyd
Executive Officer

Attachments

Executive Order G-70-159

Exhibit 1

Saber Nozzle

Refer to the latest version of Executive Order G-70-159 Exhibit 1 for a list of certified dispensers and dispenser retrofit kits and VaporVac system components, underground piping configurations and Phase I equipment .

<u>Component</u>	<u>Manufacturer/Model</u>	<u>State Fire Marshal Identification Number</u>
Nozzle	Saber Flow Nozzle N11110 with Fill Guard* (not optional)	005:051:001
	Saber Flow Nozzle N21110 with Fill Guard* (not optional)	005:051:001
	* Fill Guard - see Figure 2-A	
Inverted Coaxial Hose	Saber H1AXXX XXX = 085, 090, 095, 100, 105, 110, 115, 120, 125, 130, 135, 140, 145, 150	005:051:001
	Saber H1BXXX XXX = 085, 090, 095, 100, 105, 110, 115, 120, 125, 130, 135, 140, 145, 150	005:051:001
	Saber H1CXXX XXX = 100, 105, 110, 115, 120, 125, 130, 135, 140, 145, 150	005:051:001

Note: "XXX" represents hose length in inches.

Required Electronics For Saber Gilbarco VaporVac System

Power Supply P11000 1.0 Power Supply, 120 V	005:051:001
Electrical Adapter A01200	005:051:001
AC Cable Z00002	005:051:001
DC Cable D00212	005:051:001
Note: to be used with the CARB-certified Gilbarco Advantage single hose (1 side) or two hose (2 side) dispensers listed in the most current revision of G-70-150.	

Required Electronics For Saber Gilbarco VaporVac System (cont.)

DC Cable D00213 005:051:001
Note: to be used with CARB-certified Gilbarco Advantage
and MPD (1 side) dispensers listed in the most
current revision of G-70-150.

DC Cable D00216 005:051:001
Note: to be used with CARB certified Gilbarco Advantage
and MPD (2 sides) dispensers listed in the most
current revision of G-70-150.

Executive Order G-70-159

Exhibit 2

Specifications for the Saber Nozzle

Figure 2A depicts an approved Saber nozzle. Figures 2B depicts a typical installation of the Saber Nozzle with the Gilbarco VaporVac System.

Nozzles

1. A Fill Guard shall be installed on the nozzle at the base of the spout, as shown in Figure 2A. Any nozzle with a Fill Guard which is missing, or which is damaged such that at least one-fourth (1/4) of the outer edge of the Guard is missing, or which has cumulative damage equivalent to at least 1/4 of the outer edge missing, is defective and shall be immediately removed from service.
2. Saber Nozzle has a total of 14 holes, which are arranged in pairs with two holes per vapor passage, or slot. Failure mode testing demonstrated that blockage of some of the vapor collection holes in the spout has negligible effect on the operation of the system until only four (4) holes remains unblocked. Any Saber nozzle which is found to have less than four unobstructed vapor collection holes is defective and shall be immediately removed from service.
3. Nozzles shall be 100 percent performance checked at the factory, including checks of the integrity of the vapor path at a pressure of at least two inches water column and at a vacuum of at least twenty inches water column.

Inverted Coaxial Hoses

1. The length of hose which may be in contact with the island and/or ground when the nozzle is properly mounted on the dispenser is limited to six inches (6").
2. The hose configuration shall comply with the current revision of Executive Order G-70-150 Figure 2B; there may be 1 to 4 hoses on each side of the dispenser. Within the constraints of the configurations, the maximum allowable length of the hose shall be fifteen feet (15').

Breakaway Couplings

The breakaway coupling is an integral part of the Saber Nozzle located at the base of the spout (see Figure 2A). The installation of any additional breakaway in the hose path is prohibited.

Saber Nozzle/Vapor/Vac System


1. The normal operating range of the system, as measured by air-to-liquid (A/L) ratio testing, is 0.90 plus or minus 0.10 (0.80 to 1.00). The A/L ratio of the system shall be measured at a flowrate between six and ten gallons per minute (6 - 10 gpm). Any fueling point not capable of demonstrating compliance with this performance standard shall be deemed defective and removed from service. The A/L ratio shall be determined by a test procedure which has been adopted by CARB or by a local district. (Draft procedure TP-201.5 may be used until an A/L ratio test procedure is adopted by the Board.) Alternative test procedures may be used if they are determined by the Executive Officer to yield comparable results.

NOTE: this test procedure returns air rather than vapor to the storage tank, and normally causes an increase in storage tank pressure which may result in vent emissions. This is a temporary condition due to the test and should not be considered an indication of malfunction or noncompliance.

Executive Order G-70-159

Figure 2A


Saber Nozzle

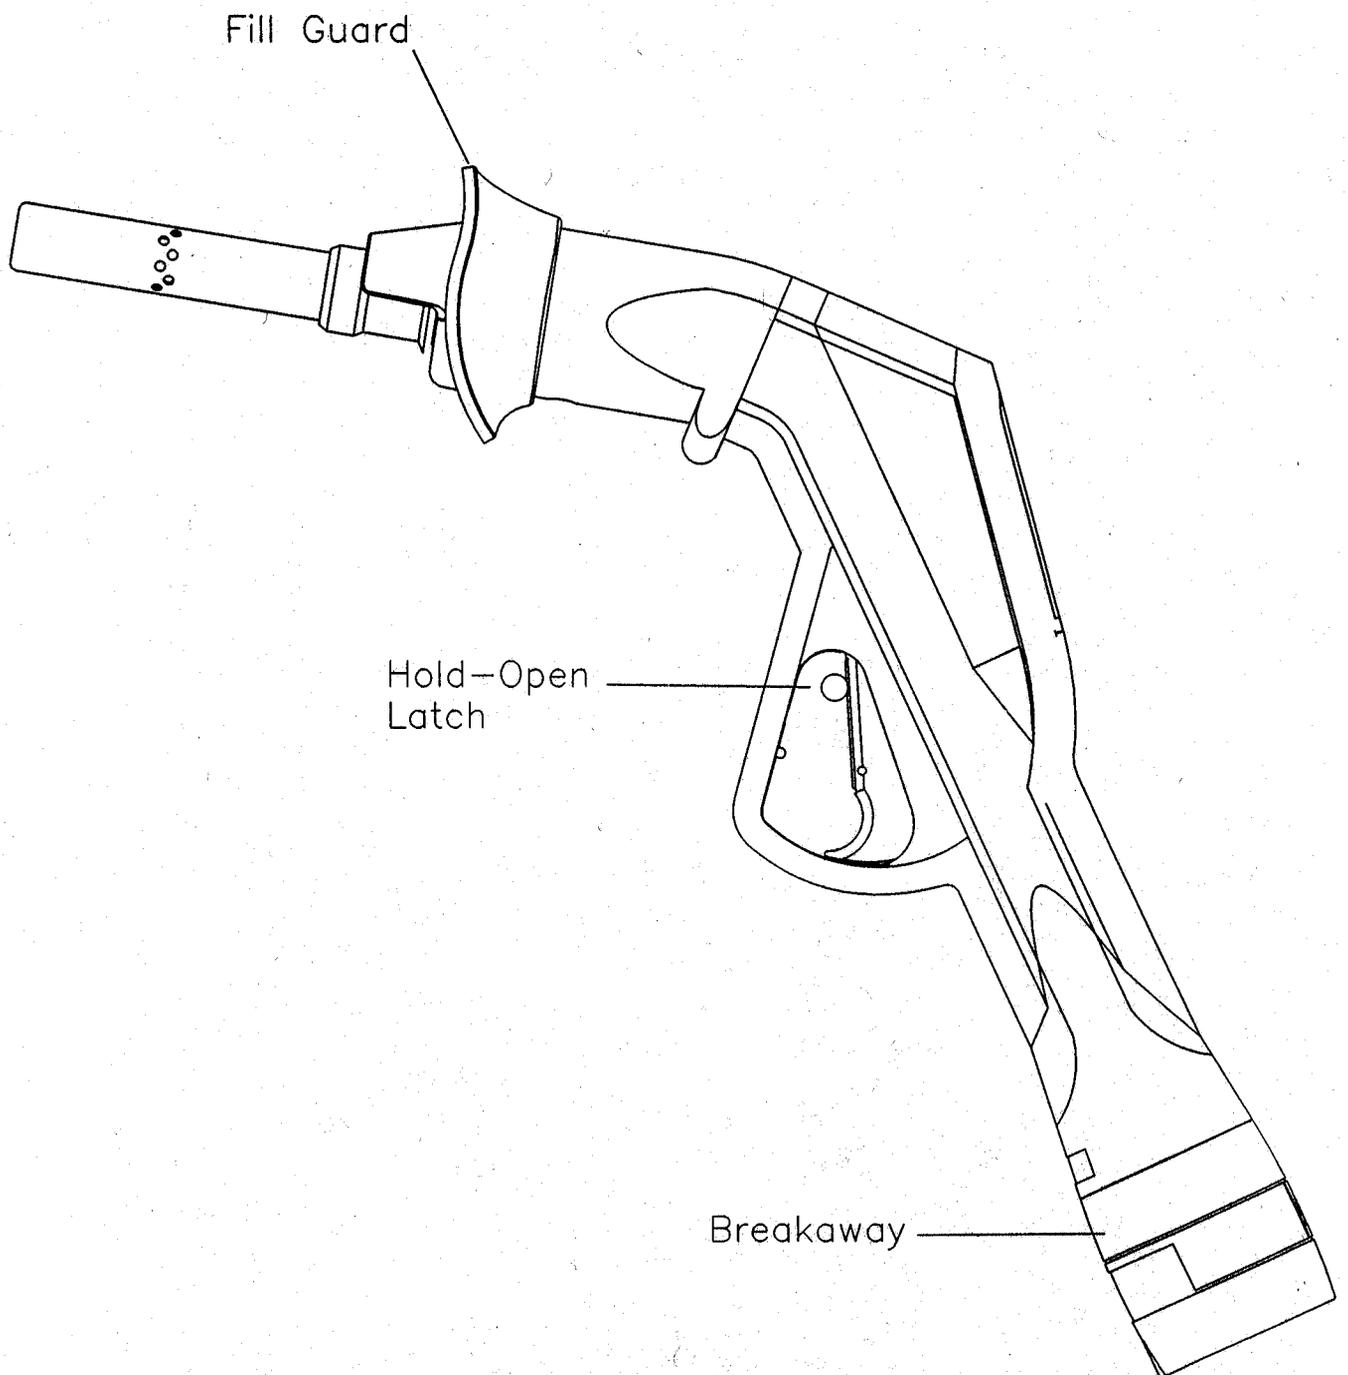

Executive Order G-70-159

Figure 2B

Approved Equipment For Saber/Gilbarco System

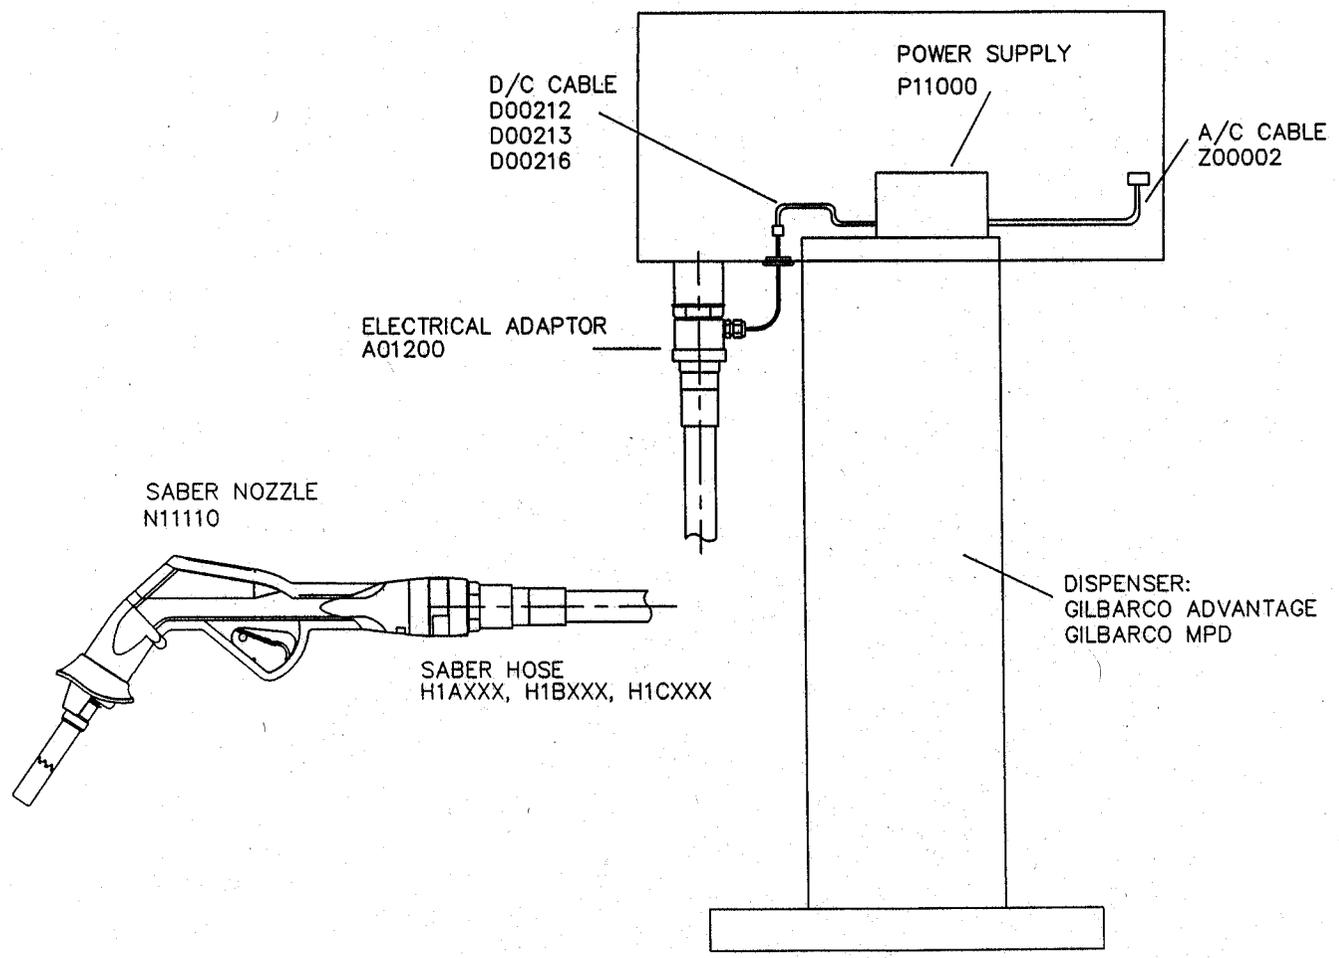

Executive Order G-70-159

Saber/VaporVac Phase II Vapor Recovery System

Exhibit 3

STATIC PRESSURE INTEGRITY TEST UNDERGROUND STORAGE TANKS*

1. Applicability

- 1.1 This test procedure is used to quantify the vapor tightness of vapor recovery systems installed at any gasoline dispensing facility (GDF) equipped with pressure/vacuum (P/V) valves with designed pressure settings specified in Exhibit 1 of this Order. Excessive leaks in the vapor recovery system will increase the quantity of fugitive hydrocarbon emissions and lower the overall efficiencies of both the Phase I and Phase II vapor recovery systems.

2. Principle

- 2.1 The entire vapor recovery system is pressurized with nitrogen to two (2.0) inches H₂O. The system pressure is then allowed to decay and the pressure after five (5) minutes is compared with an allowable value. The minimum allowable five-minute final pressure is based on the system ullage and pressure decay equations. For the purpose of compliance determination, this test shall be conducted after all back-filling, paving, and installation of all Phase I and Phase II components, including P/V valves, has been completed.
- 2.2 For GDF equipped with a coaxial Phase I system this test shall be conducted at a Phase II vapor riser. For GDF which utilize a two-point Phase I system this test may be conducted at either a Phase II riser or a Phase I vapor coupler, provided that the criteria set forth in Section 6.8 have been met. If the integrity criteria for two-point systems specified in Section 6.8 are met, it is recommended that this test be conducted at the Phase I vapor coupler.

3. Range

- 3.1 If mechanical pressure gauges are employed, the full-scale range of the pressure gauges shall be 0-2.0, 0-1.0, and 0-0.50 inches H₂O column. Maximum incremental graduations of the pressure gauge shall be 0.05 inches H₂O and the minimum accuracy of the gauge shall be three percent of full scale. The minimum diameter of the pressure gauge face shall be 4 inches.
- 3.2 If an electronic pressure measuring device is used, the full-scale range of the device shall not exceed 0-10 inches H₂O with a minimum accuracy of 0.5 percent of full-scale. A 0-20 inches H₂O device may be used, provided the equivalent accuracy is not less than 0.25 percent of full scale.

*Reference Bay Area Air Quality Management District Source Test Procedure ST-30

- 3.3 The minimum and maximum total ullages shall be 500 and 25,000 gallons, respectively. These values are exclusive of all vapor piping volumes.
- 3.4 The minimum and maximum nitrogen feed-rates, into the system, shall be one (1) and five (5) CFM, respectively.

4. Interferences


- 4.1 Introduction of nitrogen into the system at flowrates exceeding five (5) CFM may bias the results of the test toward non-compliance.

5. Apparatus

- 5.1 Nitrogen. Use commercial grade nitrogen in a high pressure cylinder, equipped with a two-stage pressure regulator and a one psig pressure relief valve.
- 5.2 Pressure Measuring Device. Use 0-2.0, 0-1.0, and 0-0.50 inches H₂O pressure gauges connected in parallel, a 0-2 inches H₂O manometer, or an electronic pressure measuring device to monitor the pressure decay in the vapor recovery system. The pressure measuring device shall, at a minimum, be readable to the 0.05 inches H₂O.
- 5.3 "T" Connector Assembly. See Figure 3-1 for example.

Figure 3-1


"T" Connector Assembly

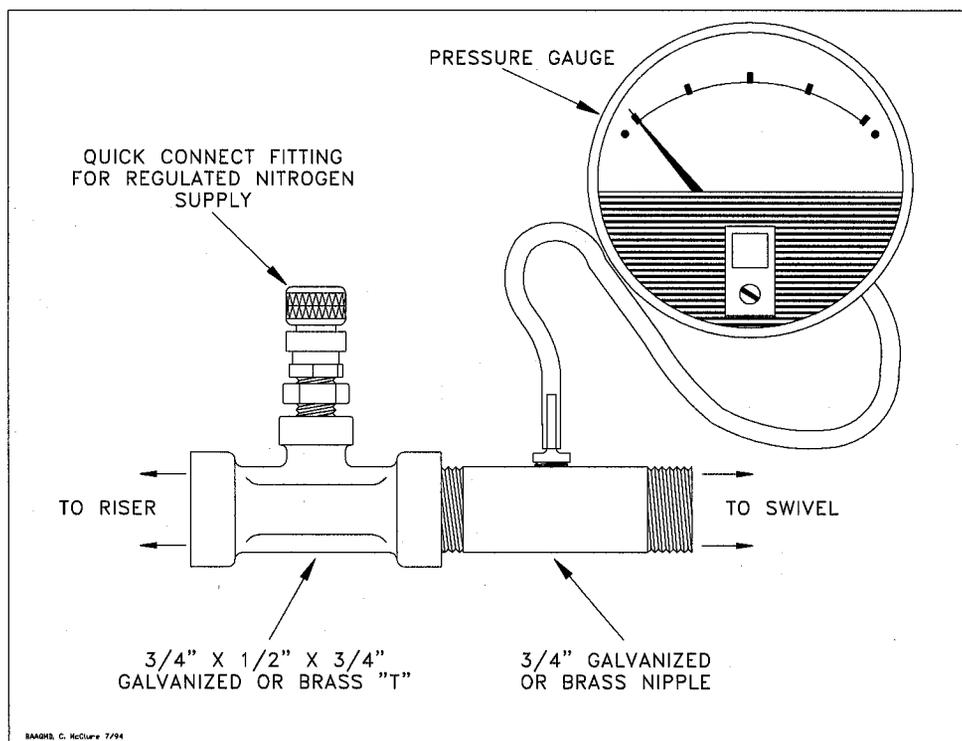

- 5.4 Vapor Coupler Integrity Assembly.** Assemble OPW 633-A, 633-B, and 634-A adapters, or equivalent, as shown in Figure 3-2. If the test is to be conducted at the storage tank Phase I vapor coupler, this assembly shall be used prior to conducting the static leak test in order to verify the pressure integrity of the vapor poppet. The internal volume of this assembly shall not exceed 0.1 cubic feet.

Figure 3-2

Vapor Coupler Integrity Assembly

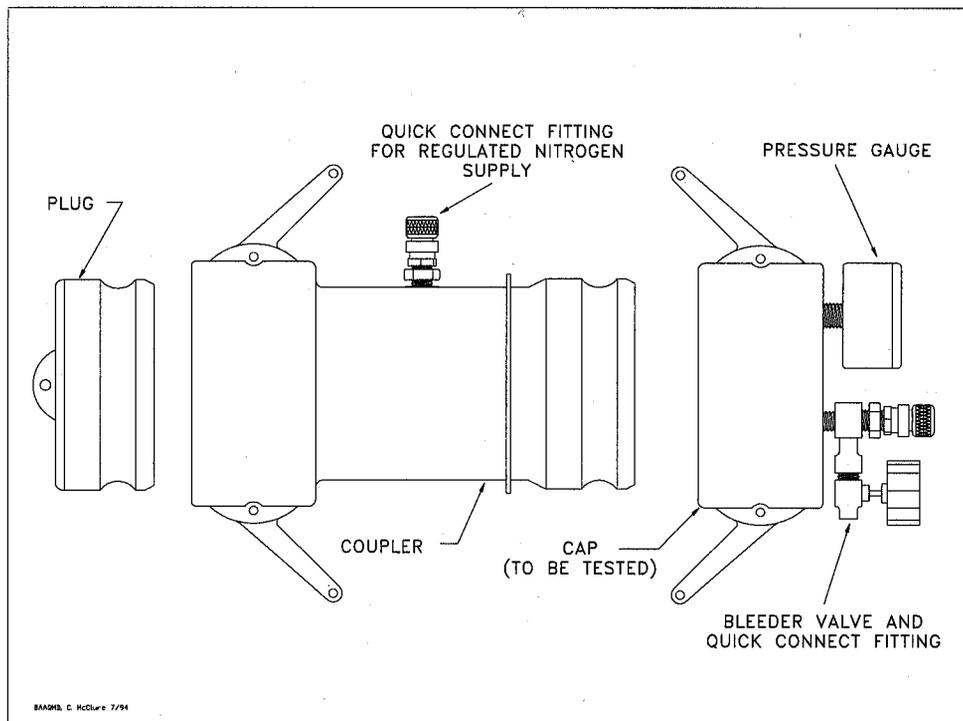


- 5.5 Vapor Coupler Test Assembly.** Use a compatible OPW 634-B cap, or equivalent, equipped with a center probe to open the poppet, a pressure measuring device to monitor the pressure decay, and a connection for the introduction of nitrogen into the system. See Figure 3-3 for example.
- 5.6 Stopwatch.** Use a stopwatch accurate to within 0.2 seconds.
- 5.7 Flowmeter.** Use a Dwyer flowmeter, Model RMC-104, or equivalent, to determine the required pressure setting of the delivery pressure gauge on the nitrogen supply pressure regulator. This pressure shall be set such that the nitrogen flowrate is between 1.0 and 5.0 CFM.
- 5.8 Combustible Gas Detector.** A Bacharach Instrument Company, Model 0023-7356, or equivalent, may be used to verify the pressure integrity of system components during this test.

- 5.9 Leak Detection Solution.** Any liquid solution designed to detect vapor leaks may be used to verify the pressure integrity of system components during this test.

Figure 3-3

Vapor Coupler Test Assembly

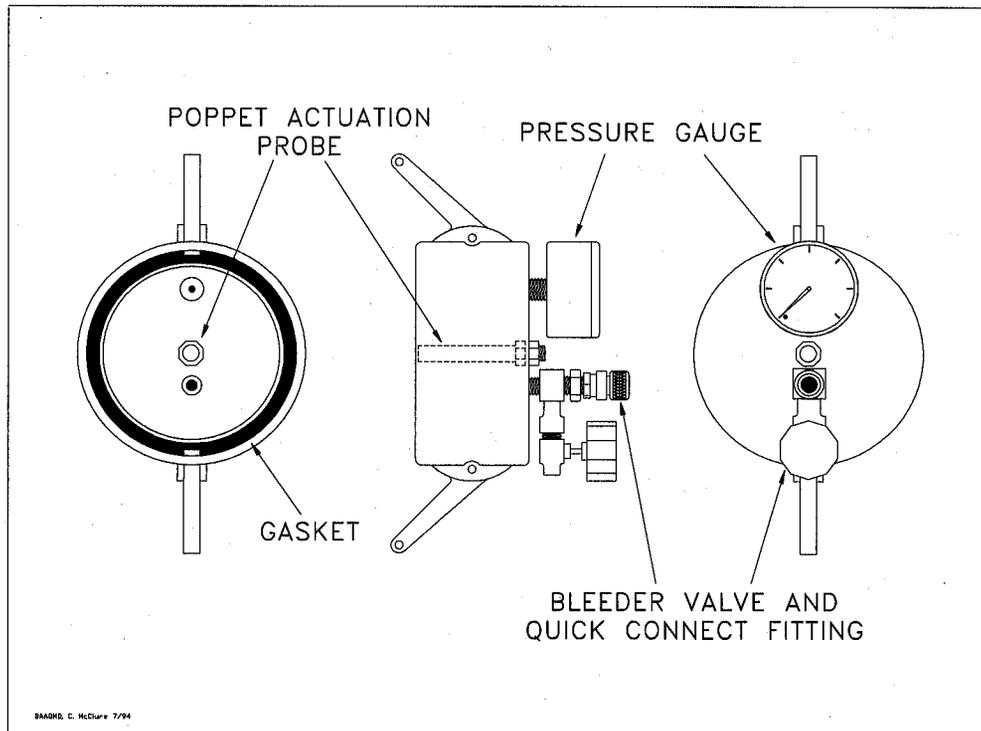

6. Pre-Test Procedures

- 6.1** The following safety precautions shall be followed:
- 6.1.1** Only nitrogen shall be used to pressurize the system.
 - 6.1.2** A one psig relief valve shall be installed to prevent the possible over-pressurizing of the storage tank.
 - 6.1.3** A ground strap should be employed during the introduction of nitrogen into the system.
- 6.2** Product dispensing shall not occur during the test. There shall have been no Phase I deliveries into or out of the storage tanks within the three hours prior to the test.

- 6.3** Measure the gallons of gasoline present in each underground storage tank and determine the actual capacity of each storage tank from facility records. Calculate the ullage space for each tank by subtracting the gasoline gallonage present from the actual tank capacity. The minimum ullage during the test shall be 25 percent of the tank capacity or 500 gallons, whichever is greater. The total ullage shall not exceed 25,000 gallons.
- 6.4** For two-point Phase I systems, this test shall be conducted with the dust cap removed from the vapor coupler. This is necessary to determine the vapor tightness of the Phase I vapor poppet. See Section 6.7 if this test is to be conducted at the Phase I vapor coupler.
- 6.4.1** For coaxial Phase I systems this test shall be conducted with the dust cap removed from the Phase I coupler. This is necessary to insure the vapor tightness of the Phase I vapor poppet.
- 6.4.2** Verify that the liquid level in the storage tank is at least four (4) inches above the highest opening at the bottom of the submerged drop tube.
- 6.5** If the Phase I containment box is equipped with a drain valve, the valve assembly may be cleaned and lubricated prior to the test. This test shall, however, be conducted with the drain valve installed and the manhole cover removed. See subsection 7.4.1 for further details regarding containment box drain valves.
- 6.6** If the test is to be conducted at a Phase II vapor riser, disconnect the dispenser end of one vapor recovery hose and install the "T" connector assembly (see Figure 3-1). Connect the nitrogen gas supply (do not use air) and the pressure measuring device to the "T" connector.
- 6.6.1** For those Phase II systems utilizing a dispenser mounted remote vapor check valve, the "T" connector assembly shall be installed on the vapor riser side of the check valve.
- 6.7** If this test is to be conducted at the Phase I vapor coupler on a two-point Phase I system, the procedures set forth in subsections 6.7.1 and 6.7.2 shall be successfully completed prior to testing. The static pressure integrity test shall not be conducted at the Phase I coupler at facilities equipped with coaxial Phase I systems.
- 6.7.1** Connect the Vapor Coupler Integrity Assembly to the Phase I vapor coupler. Connect the Vapor Coupler Test Assembly. Connect the nitrogen supply to the assembly and carefully pressurize the internal volume of the assembly to two (2.0) inches H₂O. Start the stopwatch. Record the final pressure after one minute.

- 6.7.2** If the pressure after one minute is less than 0.25 inches H₂O, the leak rate through the Phase I vapor poppet precludes conducting the static leak test at this location. If the pressure after one minute is greater than or equal to 0.25 inches H₂O, the static leak test may be conducted at this location. This criteria assures a maximum leak rate through the Phase I vapor poppet of less than 0.0004 cubic feet per minute.
- 6.7.3** Disconnect the Vapor Coupler Integrity Assembly from the Phase I vapor coupler. If the requirements of subsection 6.7.2 were met, install the Vapor Coupler Test Assembly to the Phase I vapor coupler.
- 6.8** All pressure measuring device(s) shall be bench calibrated using either a reference gauge or incline manometer. Calibration shall be performed at 20, 50, and 80 percent of full scale. Accuracy shall be within two percent at each of these calibration points. Calibrations shall be conducted on a frequency not to exceed 90 days.
- 6.9** Use the flowmeter to determine the nitrogen regulator delivery pressures which correspond to nitrogen flowrates of 1.0 and 5.0 CFM. These pressures define the allowable range of delivery pressures acceptable for this test procedure. Also record which regulator delivery pressure setting, and the corresponding nitrogen flowrate, will be used during the test. As an alternative, the flowmeter may be connected, in-line between the nitrogen supply regulator and Vapor Coupler Test Assembly, during the test.
- 6.10** Use Equation 9.3 to calculate the approximate time required to pressurize the system ullage to the initial starting pressure of two (2.0) inches H₂O. This will allow the tester to minimize the quantity of nitrogen introduced into those systems which cannot comply with the static leak standards.
- 6.11** Attach the Vapor Coupler Test assembly to the Phase I poppet or the "T" connector assembly to the Phase II vapor riser. Read the initial pressure of the storage tank and underground piping. If the initial pressure is greater than 0.5 inches H₂O, carefully bleed off the pressure, in accordance with all applicable safety procedures, in the storage tank and underground piping to less than 0.5 inches H₂O column.

7. Testing

- 7.1** Oper the nitrogen gas supply valve and set the regulator delivery pressure within the allowable range determined in Section 6.9, and start the stopwatch. Pressurize the vapor system (or subsystem for individual vapor return line systems) to **at least 2.2 inches H₂O** initial pressure. It is critical to maintain the nitrogen flow until the pressure stabilizes, indicating temperature and vapor pressure stabilization in the tanks. Check the test equipment using leak detecting solution or a combustible gas detector to verify that all test equipment is leak tight.

- 7.1.1** If the time required to achieve the initial pressure of two (2.0) inches H₂O exceeds twice the time derived from Equation 9.3, stop the test and use liquid leak detector, or a combustible gas detector, to find the leak(s) in the system. Failure to achieve the initial starting pressure within twice the time derived from Equation 9.3 demonstrates the inability of the system to meet the performance criteria. Repair or replace the faulty component(s) and restart the test pursuant to Section 7.1.
- 7.2** Close and disconnect the nitrogen supply. Start the stopwatch when the pressure has decreased to the initial starting pressure of two (2.0) inch H₂O.
- 7.3** At one-minute intervals during the test, record the system pressure. After five minutes, record the final system pressure. See Table 3-I (or Equation 9.1) to determine the acceptability of the final system static pressure results. For intermediate values of ullage in Tables 3-I, linear interpolation may be employed.
- 7.4** If the system failed to meet the criteria set forth in Table 3-I (or the appropriate equation in Section 9), repressurize the system and check all accessible vapor connections using leak detector solution or a combustible gas detector. If vapor leaks in the system are encountered, repair or replace the defective component and repeat the test. Potential sources of leaks include nozzle check valves, pressure/vacuum relief valves, containment box drain valve assemblies, and plumbing connections at the risers.
- 7.4.1** If the facility fails to comply with the static leak test standards and the Phase I system utilizes a non-CARB-certified drain valve equipped containment box, which was installed prior to July 1, 1992, for which a CARB-certified replacement drain valve assembly is not marketed, the following two subsections shall apply:
- 7.4.1.1** The drain valve may be removed and the port plugged. Reset the system. If the facility complies with the static leak test standards under these conditions, the facility shall be considered complying with the requirements, provided that the manufacturer and model number of the containment box and the date of installation are submitted with the test results.
- 7.4.1.2** The criteria set forth in subsection 7.4.1.1 shall not apply after July 1, 1996.
- 7.5** After the remaining system pressure has been relieved, remove the "T" connector assembly and reconnect the vapor recovery hose, if applicable.

- 7.6 If the vapor recovery system utilizes individual vapor return lines, repeat the leak test for each gasoline grade. Avoid leaving any vapor return line open longer than is necessary to install or remove the "T" connector assembly.
- 7.7 If the applicable CARB Executive requires the test to be conducted with and without the containment box cover in place, repeat the test with the cover in place. In these cases clearly specify, on Form 3-1, which results represent the pressure integrity with and without the cover in place.

8. Post-Test Procedures

- 8.1 Use Table 3-1 or, or Equations 9.1, to determine the compliance status of the facility by comparing the final five-minute pressure with the minimum allowable final pressure.

9. Calculations

- 9.1 The minimum allowable five-minute final pressure, with an initial pressure of two (2.0) inches H₂O, shall be calculated as follows:

[Equation 9-1]

$$P_f = 2 e^{\frac{-500.887}{V}} \quad \text{if } N = 1-6$$

$$P_f = 2 e^{\frac{-551.614}{V}} \quad \text{if } N = 7-12$$

$$P_f = 2 e^{\frac{-562.455}{V}} \quad \text{if } N = 13-18$$

$$P_f = 2 e^{\frac{-592.412}{V}} \quad \text{if } N = 19-24$$

$$P_f = 2 e^{\frac{-624.483}{V}} \quad \text{if } N > 24$$

Where:

- N = The number of affected nozzles. For manifolded systems, N equals the total number of nozzles. For dedicated plumbing configurations, N equals the number of nozzles serviced by the tank being tested.
- P_f = The minimum allowable five-minute final pressure, inches H₂O
- e = A dimensionless constant approximately equal to 2.718
- 2 = The initial starting pressure, inches H₂O

- 9.2** The minimum time required to pressure the system ullage from zero (0) to two (2.0) inches H₂O gauge pressure shall be calculated as follows:

$$t_2 = \frac{V}{[1522]F} \quad \text{[Equation 9-2]}$$

Where:

- t_2 = The minimum time to pressurize the ullage to two inches H₂O, minutes
- V = The total ullage affected by the test, gallons
- F = The nitrogen flowrate into the system, CFM
- 1522 = The conversion factor for pressure and gallons

- 9.3** If the policy of the local district requires an allowable tolerance for testing error, the minimum allowable five-minute final pressure, including testing error, shall be calculated as follows:

$$P_{f-E} = 2 - \left[1 + \left(\frac{E}{100} \right) \right] [408.9 - (P_f + 406.9)] \quad \text{[Equation 9-3]}$$

Where:

- P_{f-E} = The minimum allowable five-minute final pressure including allowable testing error, inches H₂O
- E = The allowable testing error, percent
- P_f = The minimum allowable five-minute final pressure calculated in Equations 9-1 or 9-2, inches H₂O
- 2 = The initial starting pressure, inches H₂O
- 408.9 = Atmospheric pressure plus the initial starting pressure, inches H₂O
- 406.9 = Atmospheric pressure, inches H₂O

10. Reporting

- 10.1** The calculated ullage and system pressures for each five-minute vapor recovery system test shall be reported as shown in Form 3-1. Be sure to include the Phase I system type (two-point or coaxial), the Phase II system type, whether the system is manifolded, and the one-minute pressures during the test.

Executive Order G-70-159

TABLE 3-1

**PRESSURE DECAY LEAK RATE CRITERIA
INITIAL PRESSURE OF 2 INCHES OF H₂O**

MINIMUM PRESSURE AFTER 5 MINUTES, INCHES OF H₂O

ULLAGE, GALLONS	NUMBER OF AFFECTED NOZZLES				
	<u>01-06</u>	<u>07-12</u>	<u>13-18</u>	<u>19-24</u>	<u>> 24</u>
500	0.73	0.69	0.65	0.61	0.57
550	0.80	0.76	0.72	0.68	0.64
600	0.87	0.82	0.78	0.74	0.71
650	0.93	0.88	0.84	0.80	0.77
700	0.98	0.94	0.90	0.86	0.82
750	1.03	0.98	0.94	0.91	0.87
800	1.07	1.03	0.99	0.95	0.92
850	1.11	1.07	1.03	1.00	0.96
900	1.15	1.11	1.07	1.03	1.00
950	1.18	1.14	1.11	1.07	1.04
1,000	1.21	1.18	1.14	1.10	1.07
1,200	1.32	1.28	1.25	1.22	1.19
1,400	1.40	1.37	1.34	1.31	1.28
1,600	1.46	1.43	1.41	1.38	1.35
1,800	1.51	1.49	1.46	1.44	1.41
2,000	1.56	1.53	1.51	1.49	1.46
2,200	1.59	1.57	1.55	1.53	1.51
2,400	1.62	1.60	1.58	1.56	1.54
2,600	1.65	1.63	1.61	1.59	1.57
2,800	1.67	1.65	1.64	1.62	1.60
3,000	1.69	1.68	1.66	1.64	1.62
3,500	1.73	1.72	1.70	1.69	1.67
4,000	1.76	1.75	1.74	1.72	1.71
4,500	1.79	1.78	1.77	1.75	1.74
5,000	1.81	1.80	1.79	1.78	1.77
6,000	1.84	1.83	1.82	1.81	1.80
7,000	1.86	1.85	1.85	1.84	1.83
8,000	1.88	1.87	1.86	1.86	1.85
9,000	1.89	1.89	1.88	1.87	1.87
10,000	1.90	1.90	1.89	1.88	1.88
15,000	1.93	1.93	1.93	1.92	1.92
20,000	1.95	1.95	1.94	1.94	1.94
25,000	1.96	1.96	1.96	1.95	1.95

Note: For manifolded Phase II Systems, the "Number of Affected Nozzles" shall be the total of all gasoline nozzles. For dedicated return configurations, the "Number of Affected Nozzles" shall be the total of those nozzles served by the tank being tested.