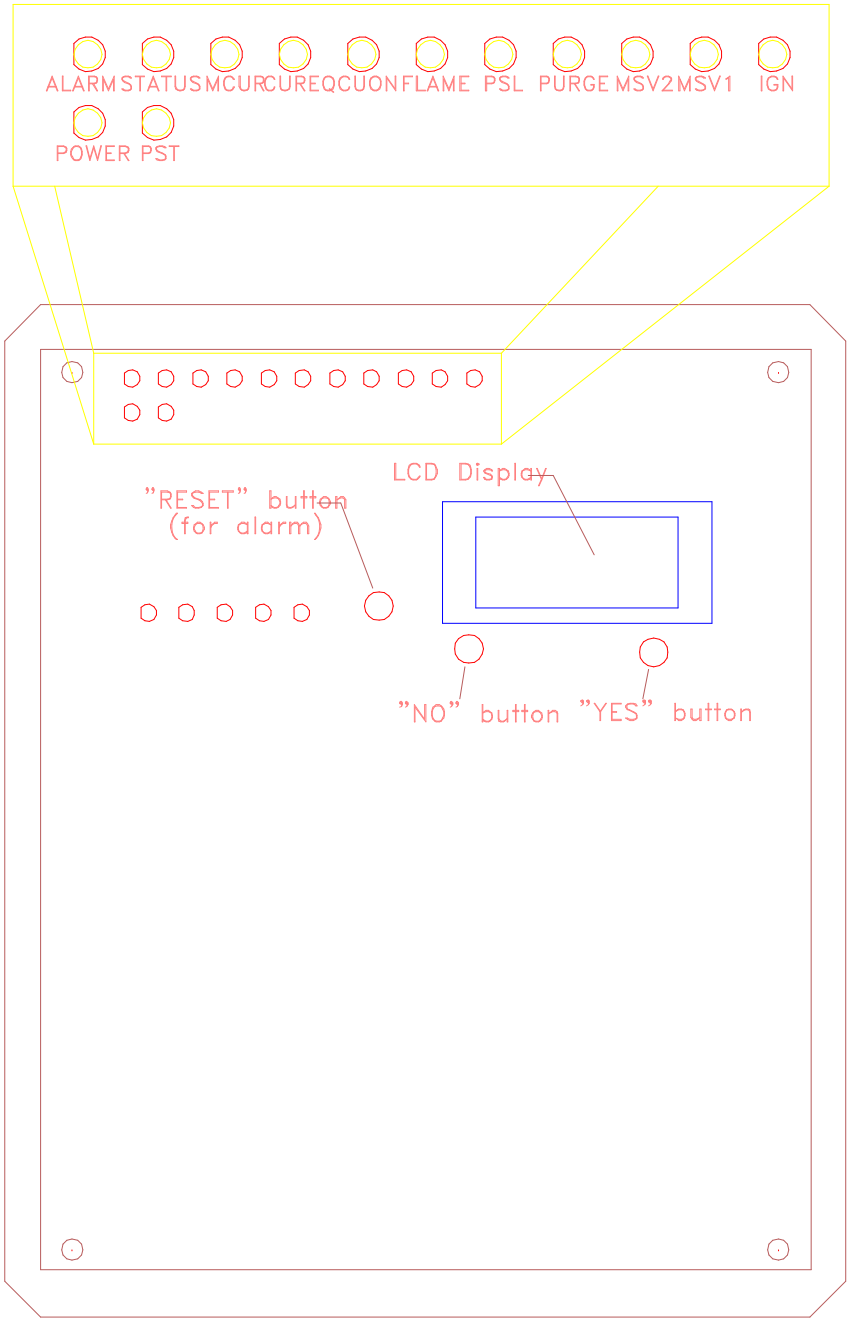

CONTROL PANEL

Key to LEDs:

ALARM =>ALARM CONDITION
CUON =>COLLECTION UNIT ACTIVE
CUREQ =>DISPENSER ACTIVE
FLAME =>PROCESSING VAPORS
MSV2 =>SECONDARY PROCESSOR VALVE OPEN
IGN =>INITIATE PROCESSING
MCUR =>COLLECTION UNIT SENSOR
MSV1 =>MAIN PROCESSOR VALVE OPEN
POWER =>PANEL POWER
PSL =>PROCESSOR PRESSURE
PST =>TANK ULLAGE PRESSURE
PURGE =>CLEARING LINES
STATUS =>NOT USED

Executive Order G-70-164-AA
Figure 8
Control Panel