


Executive Order G-70-177

Exhibit 2

Figure 2A

Typical Installation of the
VCS400-7 Vacuum Assist
Phase II Vapor Recovery System

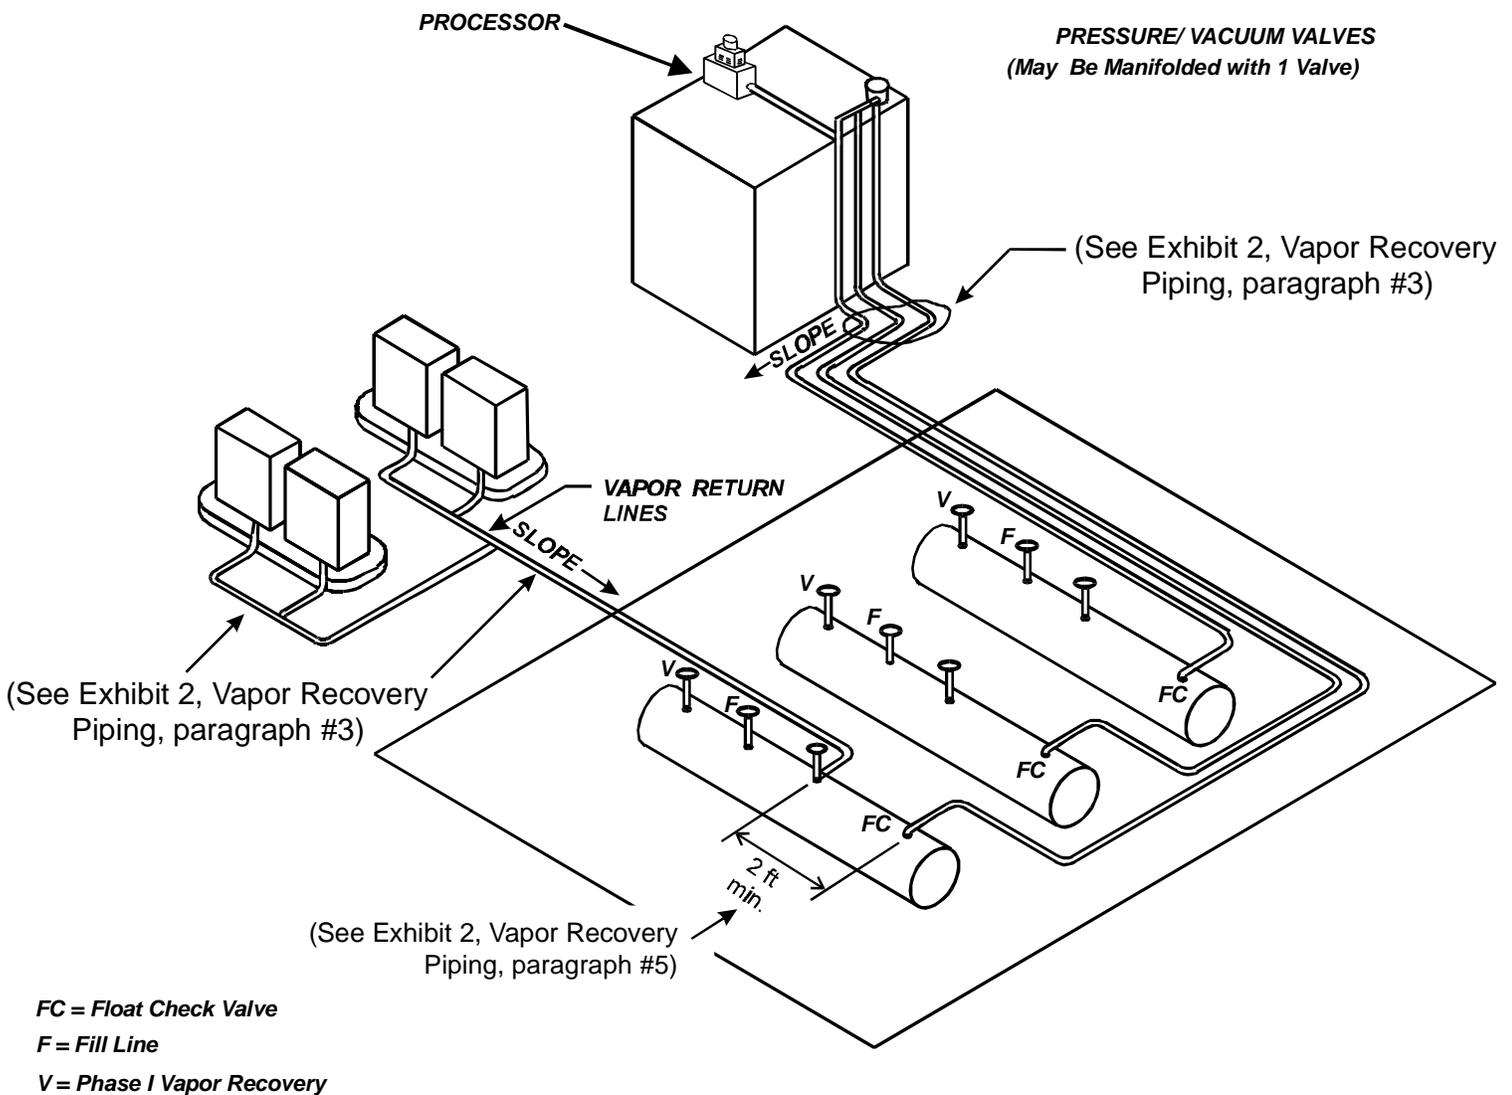

Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum Except as Noted

2. Slope: 1/8" per foot Min.
1/4" per Foot Preferred

3. Maintain 2'0" Clearance Between Fill Line and
Phase I Vapor Return Line to Delivery Truck