


Executive Order G-70-177-AA

Exhibit 2

Figure 2E

The Gage used may be up to a +/- 10 inch water column pressure

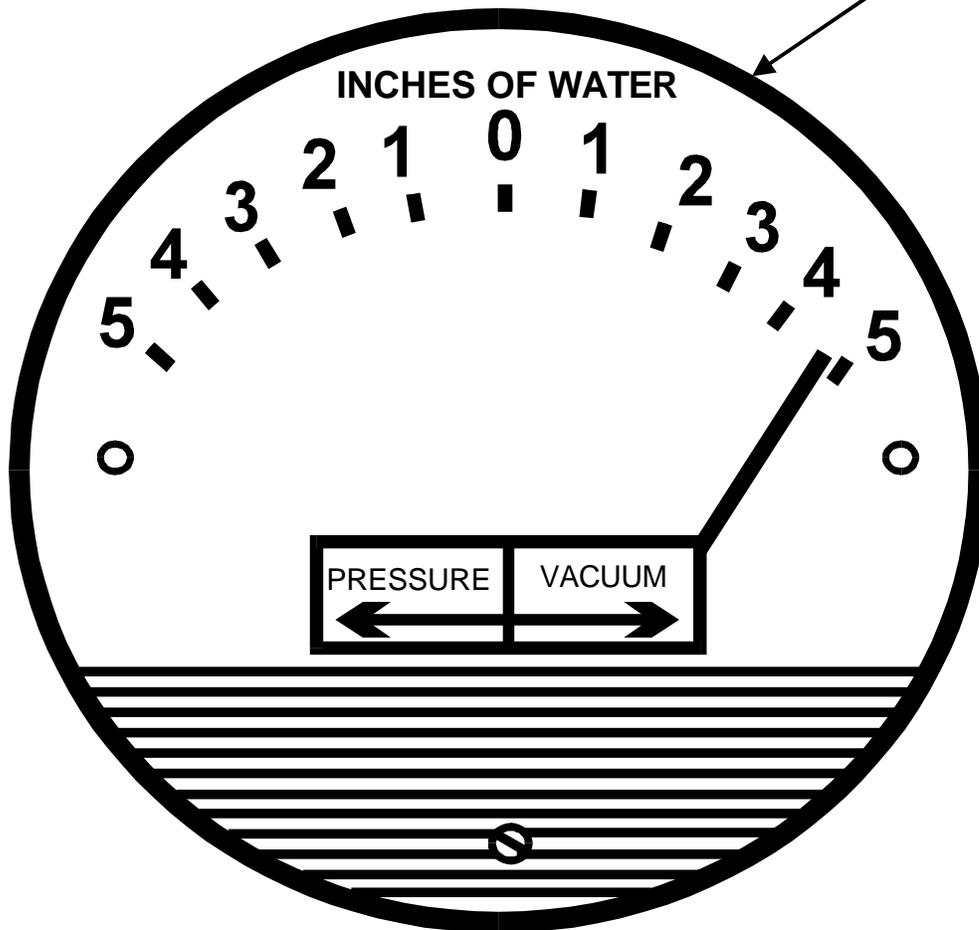

Note Pressure/Vacuum Gage is usually installed in the dispenser house located furthest from the vent riser