


# Executive Order G-70-177-AA

## Exhibit 2

### Figure 2G

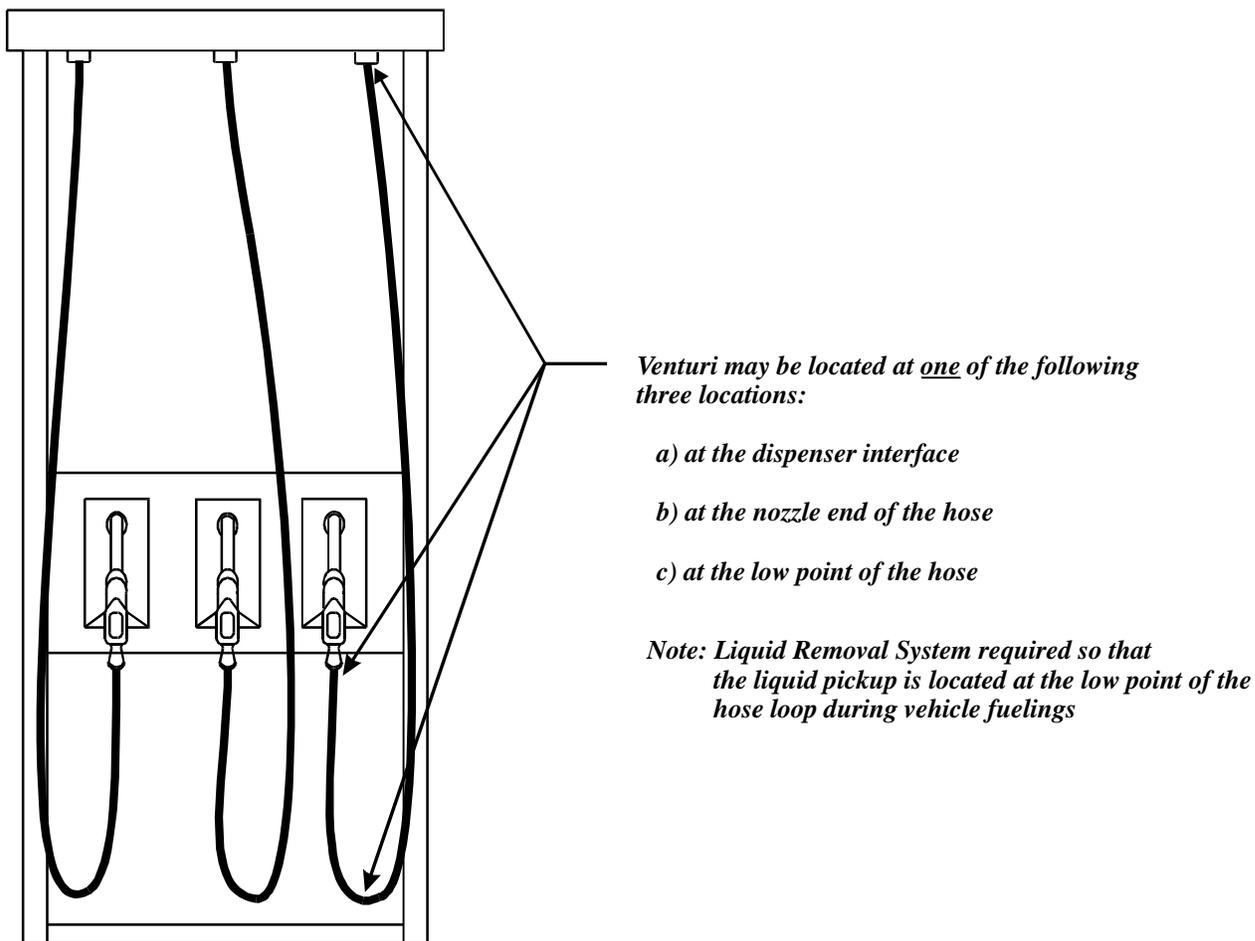

#### NOTES:

1. Use 1 inch or larger inside diameter galvanized pipe for riser.
2. The maximum length of the hose assembly is 10-1/2 feet.
3. An ARB certified Liquid Removal System must be installed and maintained according to the manufacturer's current specifications.
4. A Flow Limiter is required on all dispensers that have a maximum flowrate in excess of 10gpm.
5. The hose may not touch the island or the ground when not in use. In the case of a dogbone island where the wider island ends protect the hose from damage by vehicle tires, the hose may touch the vertical face of the dogbone island at the option of the local air pollution control district.