


Executive Order G-70-183-AA

Exhibit 2

Figure 2A-2

Typical Installation of the  
Healy Model 600 Phase I Vapor Recovery System  
with Franklin Electric VP-1000 Vapor Pump

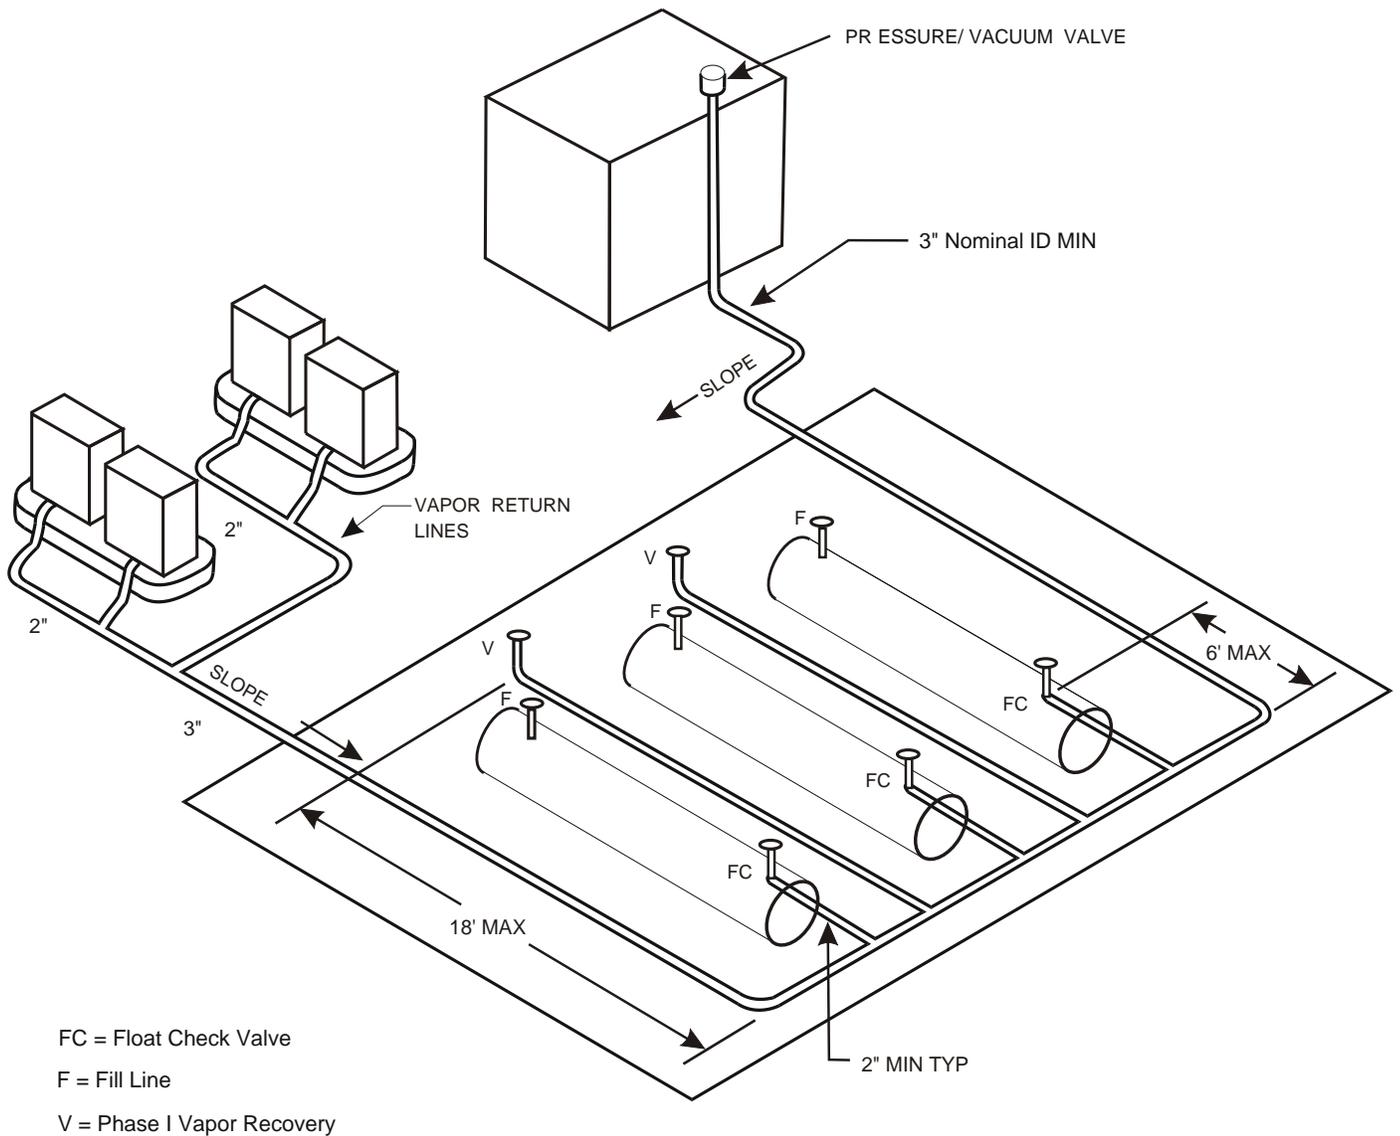

Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum  
Except as Noted in Exhibit 2 under Vapor Recovery Piping Configurations

2. Slope: 1/8" per foot Min.  
1/4" per Foot Preferred