


Executive Order G-70-186
Exhibit 2
Figure 5D

Typical Installation of the
 Healy 400 ORVR Phase II Vapor Recovery System
 Utilizing the VP-500 Vane Pump
 With Two-Point Phase I System

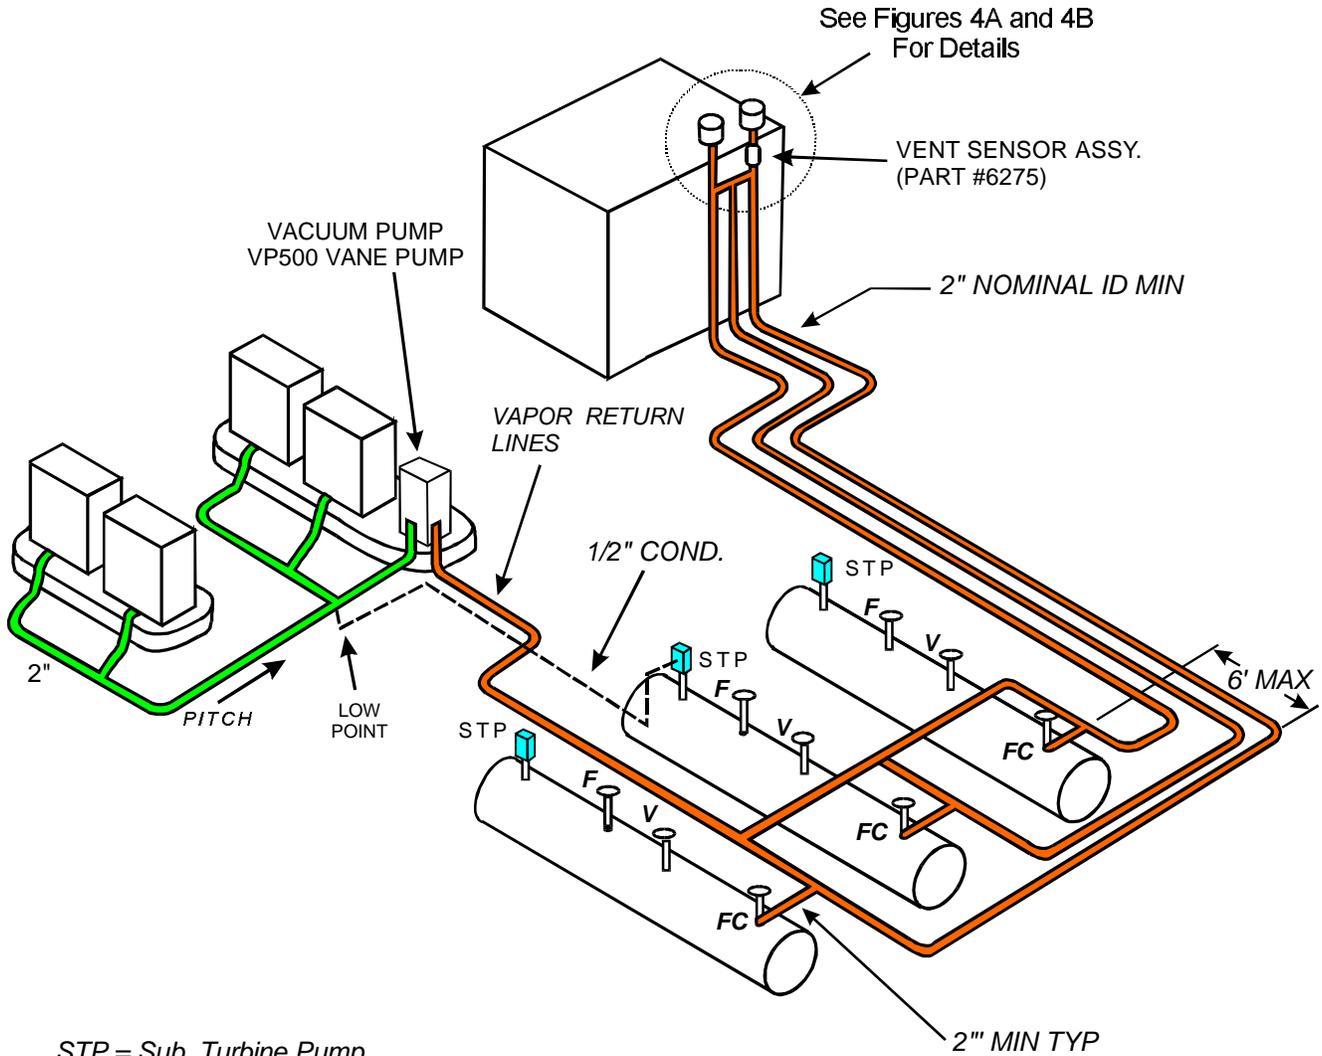

STP = Sub. Turbine Pump
 FC = Float Check Valve
 F = Fill Line
 V = Phase I Vapor Recovery

- Note: 1. All Vapor/Vent Lines are 2" Nominal ID Minimum Except as Noted
 2. Slope: 1/8" per foot Min.
 1/4" per Foot Preferred
 3. Maintain 2'0" Clearance Between Fill Line and
 Phase I Vapor Return Line to Delivery Truck