


# Executive Order G-70-186

## Exhibit 2 Figure 5E

### Typical Installation of the Healy 400 ORVR Phase II Vapor Recovery System Utilizing the VP-500 Vane Pump With Two-Point Phase I System

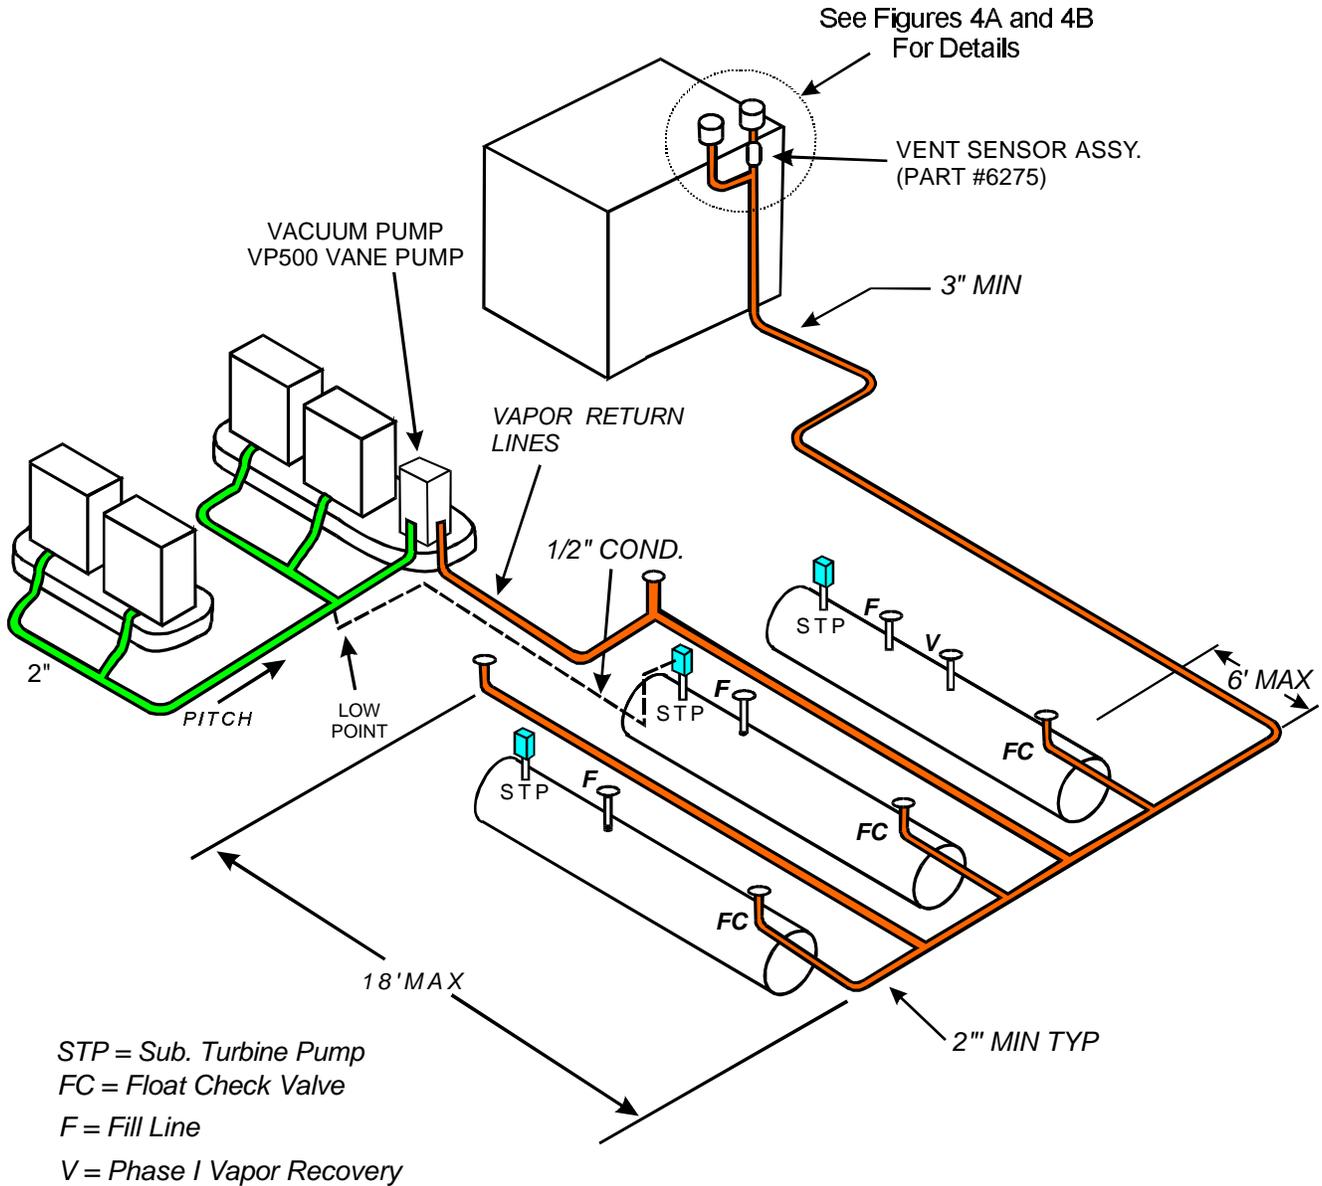

Note: 1. All Vapor/Vent Lines are 3" Except as Noted

2. Slope: 1/8" per foot Min.

1/4" per Foot Preferred

3. Maintain 2'0" Clearance Between Fill Line and  
Phase I Vapor Return Line to Delivery Truck

4. No Less than one vapor return hose must be  
connected for each product being delivered