ExecutiveOrderG-70-188

Exhibit 2

Figure2C-3

Typical Installation o f the
Catlow ICVN Nozzle withSpecifiedPhaseII
VaporRecovery System
with Two-Point Phase I System

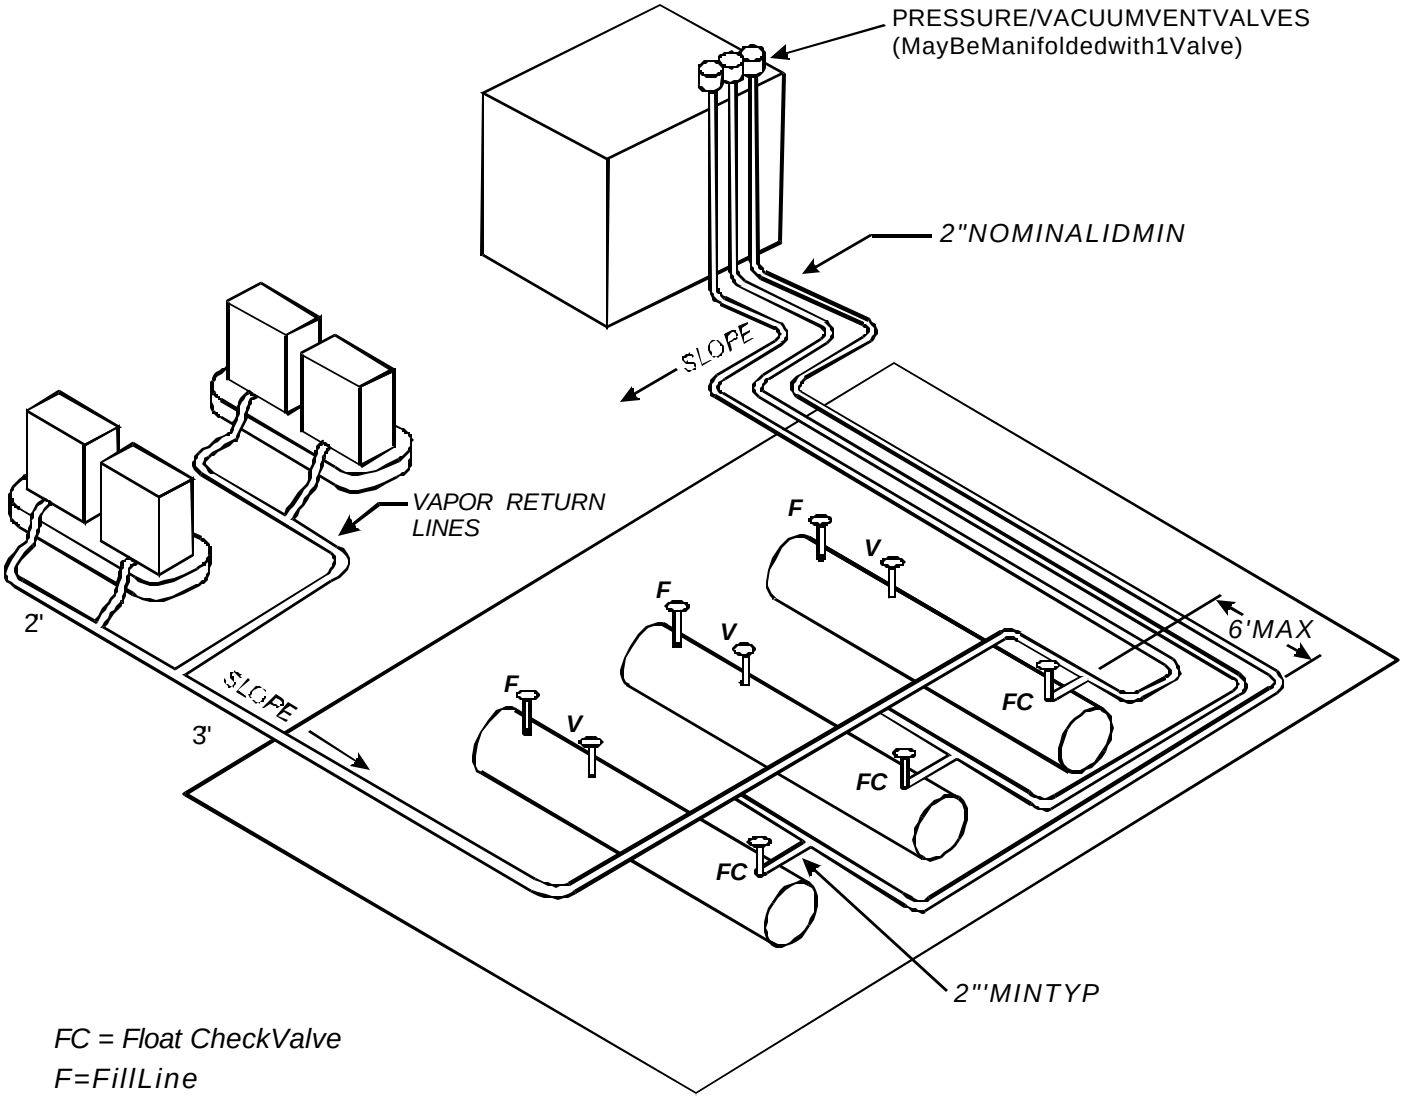

FC = Float CheckValve
F=FillLine
V = PhaseIVaporRecovery

Note:1.AllVapor/VentLines are3"NominalIDMinimumExceptasNoted

2.Slope:1/8"perfootMin.

1/4"perFootPrefered

3.Maintain2'0"ClearanceBetweenFillLineand

PhaseIVaporReturnLinetoDeliveryTruck