


Executive Order G-70-196

Figure 2A-1

High-Hang Coaxial Hose Configuration With Liquid Removal System For New and Existing Installations (Single Hose Multi-Product Dispensers included)

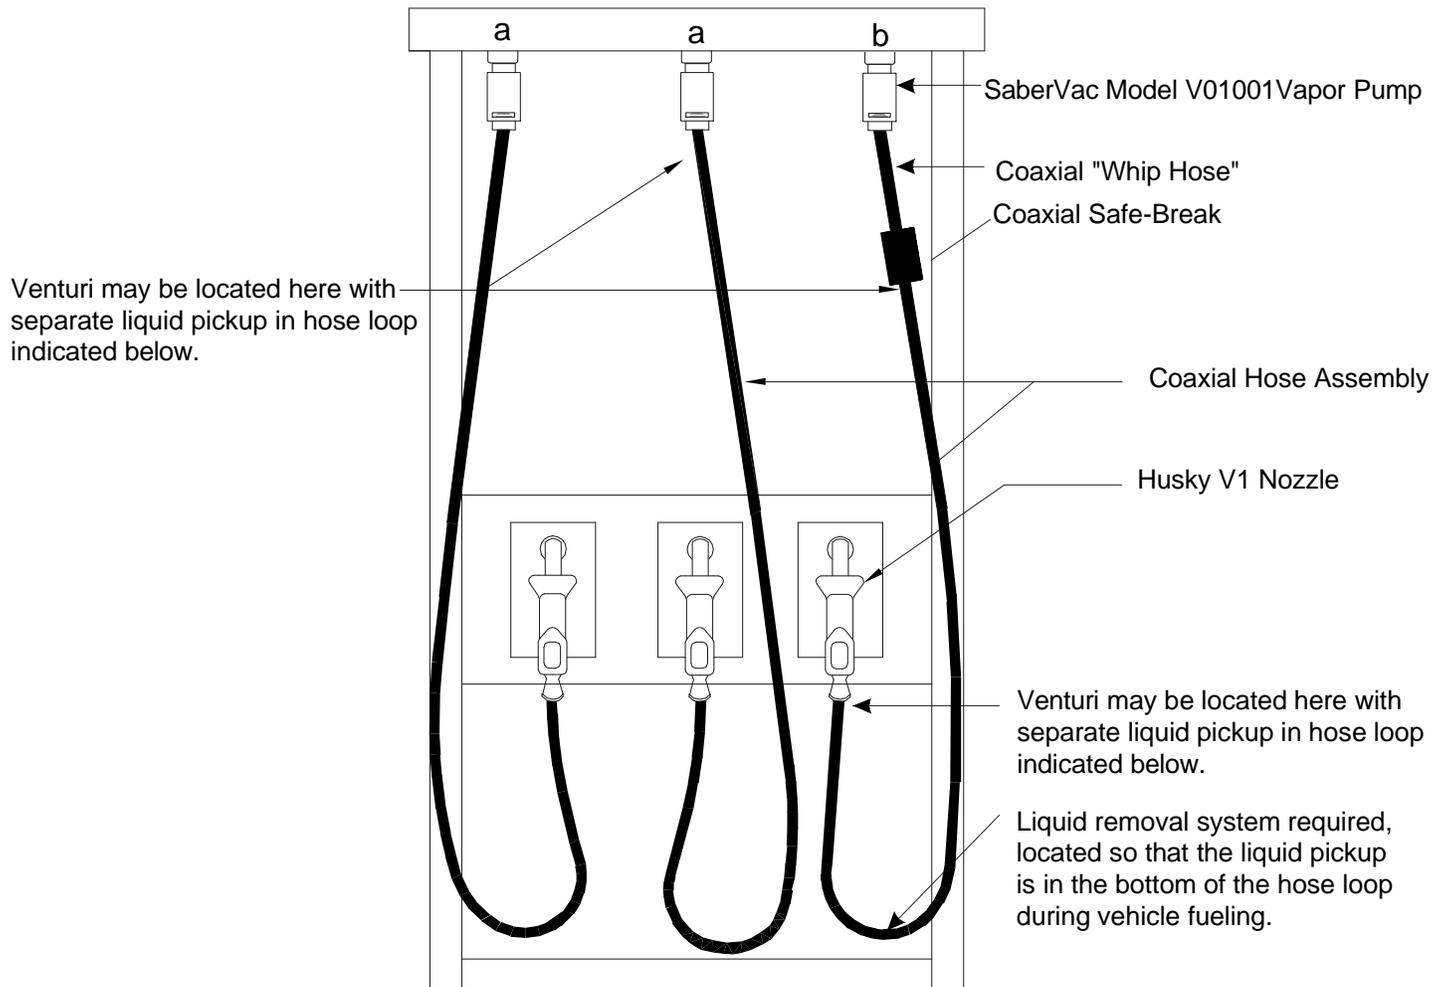

Notes:

1. Use 1 inch or larger inside diameter galvanized pipe for riser.
2. The maximum length of the hose assembly is 10-1/2 feet.
3. An ARB certified liquid removal system must be installed and maintained according to the manufacturer's specifications.
4. A flow limiter is required on all dispensers that have a maximum flowrate in excess of 10gpm. A flow limiter may be required on all gasoline dispensers at the option of the local air pollution control district.
5. The hose may not touch the island or the ground when not in use. In the case of a dogbone island where the wider island ends protect the hose from damage by vehicle tires, the hose may touch the verticle face of the dogbone island at the option of the local airpollution control district.