


Executive Order G-70-196
Figure 2A-2
High-Hang Coaxial Hose Configuration
With Retractor
For New and Existing or New Installations
(Single Hose/Multi-Product Dispensers
Included)

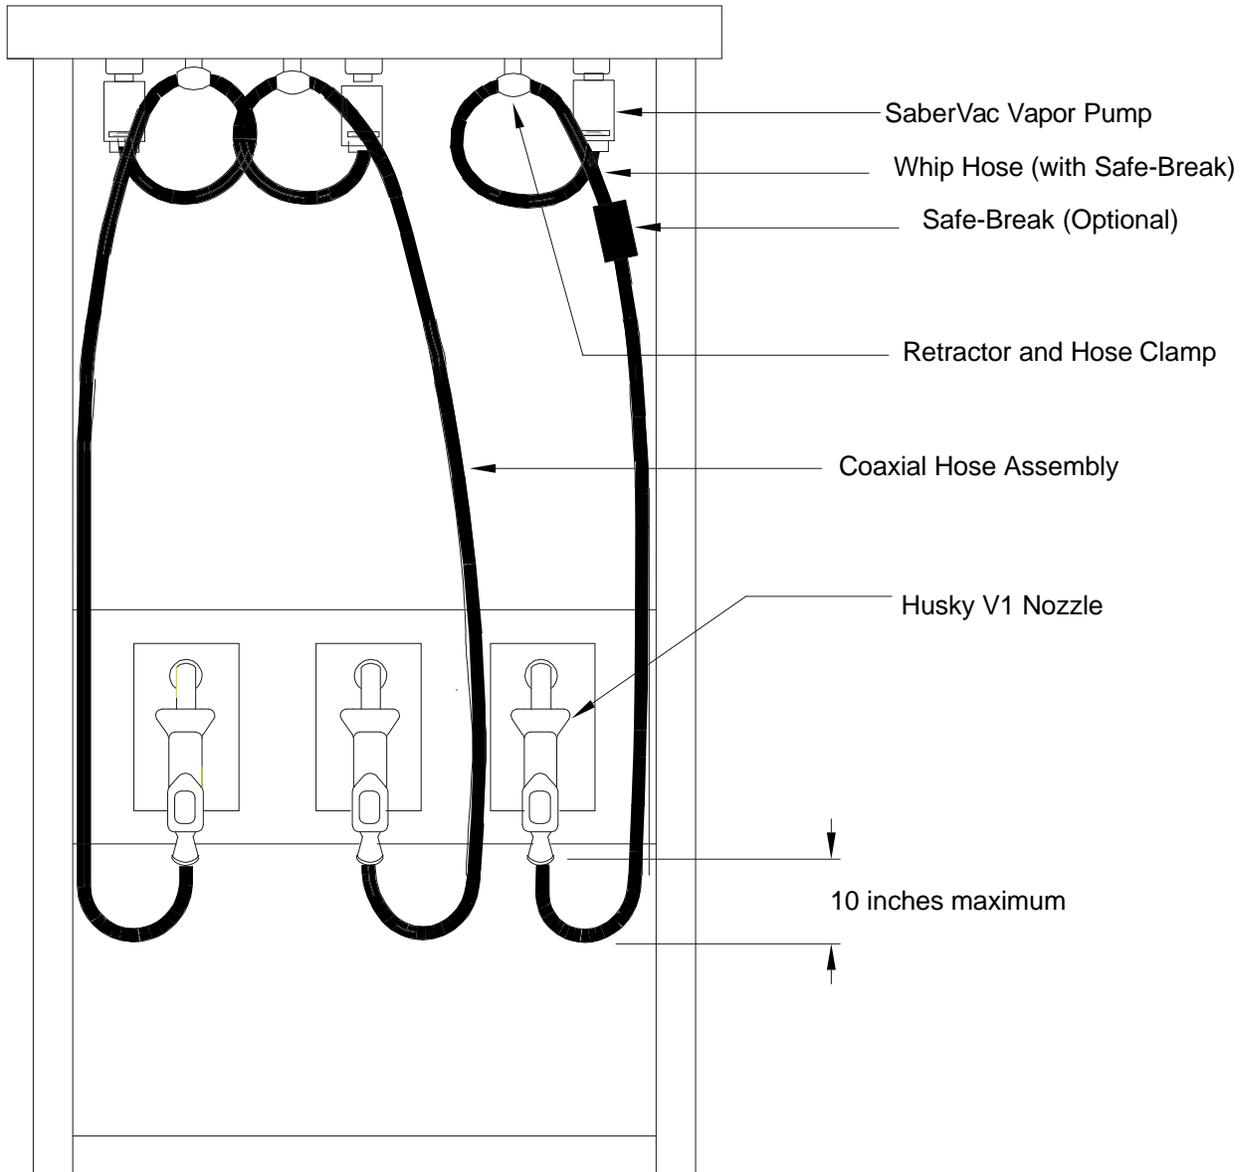

Notes:

1. Use 1 inch or larger inside diameter galvanized pipe for riser.
2. The maximum length of the hose assembly is 10-1/2 feet.
3. If hose loop is greater than 10 inches, an ARB certified liquid removal system must be installed and maintained according to the manufacturer's specifications.
4. A flow limiter is required on all dispensers that have a maximum flowrate in excess of 10gpm. A flow limiter may be required on all gasoline dispensers at the option of the local air pollution control district.
5. If a Safe-Break is used, the whip hose must be installed so that the safe-break is downstream of the retractor hose clamp.
6. The hose may not touch the island or the ground when not in use. In the case of a dogbone island where the wider island ends protect the hose from damage by vehicle tires, the hose may touch the verticle face of the dogbone island at the option of the local airpollution control district.
7. Retractor must retract coaxial hose to top of dispensers when not in use.
8. Tension on hose clamp must not be excess of that required to return hose to top of dispenser.