


**Executive Order G-70-196
Figure 2A-4**

**Coaxial Hose Side-Mount
High-Retractor Configuration
For New and Existing Installations**

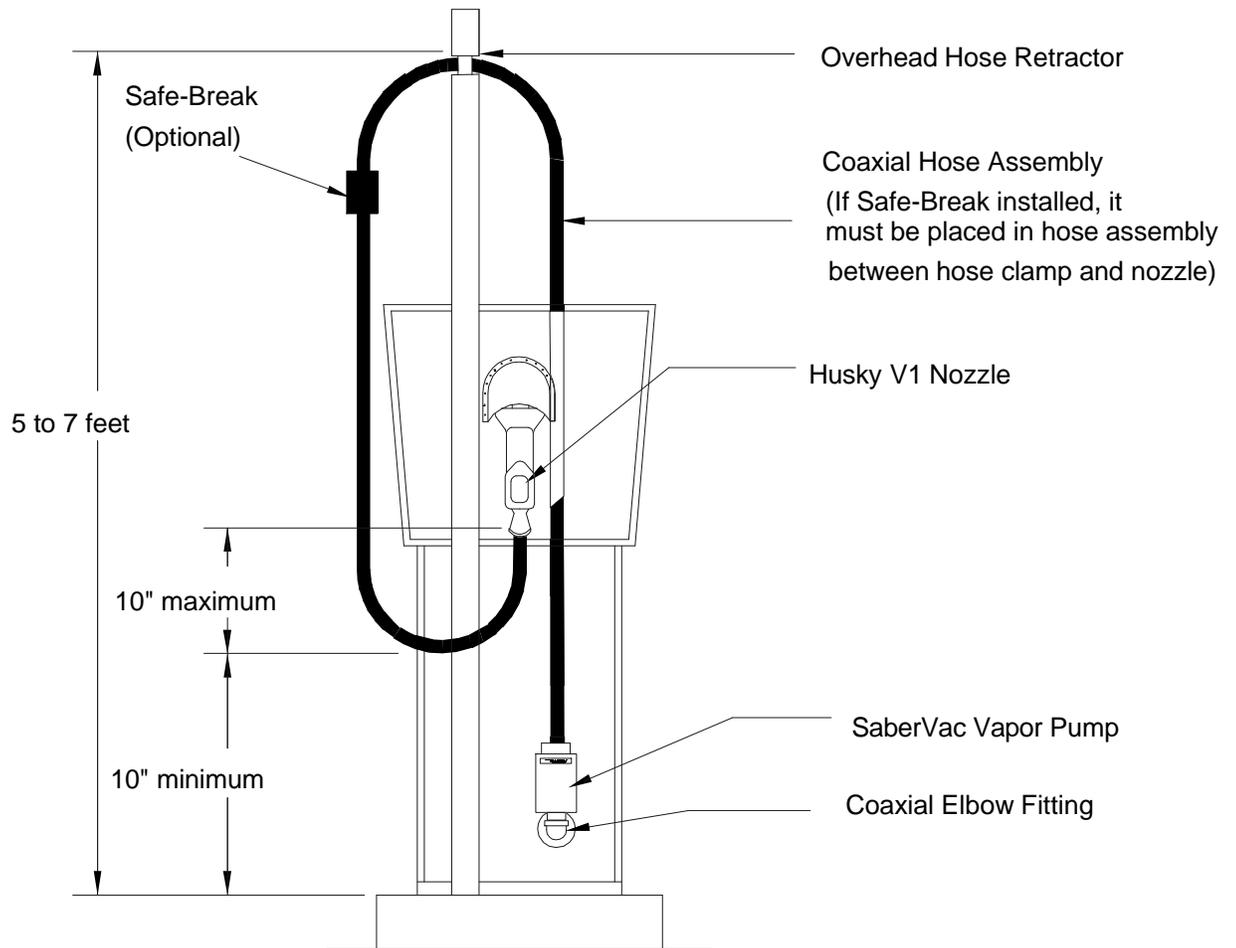

Notes:

1. Use 1 inch or larger inside diameter galvanized pipe for riser.
2. The maximum length of the hose assembly is 10-1/2 feet.
3. If hose loop is greater than 10 inches, an ARB certified liquid removal system must be installed and maintained according to the manufacturer's specifications.
4. A flow limiter is required on all dispensers that have a maximum flowrate in excess of 10 gpm. A flow limiter may be required on all gasoline dispensers at the option of the local air pollution control district.
5. If a safe-break is used, it must be placed in hose assembly between retractor hose clamp and nozzle.
6. The hose may not touch the island or the ground when not in use.
7. Retractor must retract coaxial hose to top of support assembly when not in use.
8. Tension on hose clamp must not be in excess of that required to return hose to top of support assembly.