State of California

AIR RESOURCES BOARD

EXECUTIVE ORDER G-70-2

Relating to the Certification of the OPW System A, Type 5, Vapor Recovery System for Underground Storage Tanks at Gasoline Service Stations

Pursuant to the authority vested in the Air Resources Board by Health and Safety Code Section 39068.6 (as added by Chapter 1042, Statutes of 1975); and

Pursuant to the authority vested in the undersigned by Health and Safety Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: That, except as provided below, the Dover Corporation, OPW Division, System A, Type 5, vapor recovery system, with or without a pressure-vacuum valve, is hereby certified for use on underground gasoline storage tanks at service stations. The system certified hereby is shown in Exhibit 1, attached.

IT IS FURTHER ORDERED AND RESOLVED: That use of the pressure-vacuum valve be subject to approval of the local fire chief, and that the tanks and piping be in compliance with the appropriate General Industry Safety Orders and in particular the provisions in Articles 144, 145 and 146 thereof.

Executed at Sacramento, California, this 13 day of August, 1976.

William H. Lewis, Jr.
Executive Officer

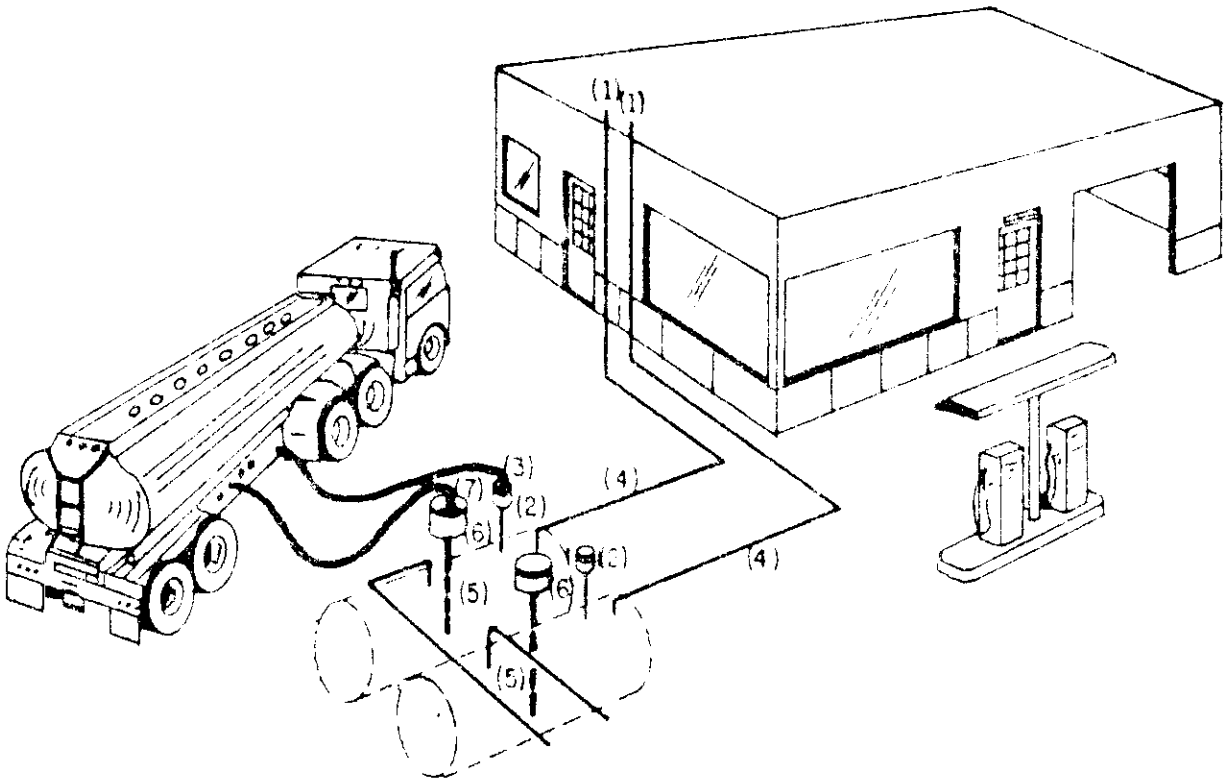

PARTS LIST

(1) VAREC 2010-81 P/V Valve or OPW 523 P/V Valve (Optional).

(2) OPW 1611-AV3" Dry break with an OPW 1711T or OPW 1711TK Locking cap.

(3) OPW 1711-V3" Elbow.

(4) 2" Vent pipe.

(5) Aluminum drop tube (extend to within 6" bottom of tank).

(6) OPW 61AS Adapter or OPW 633T Adapter

(7) OPW 60 Elbow or OPW 60T Elbow

Note: Vent pipes may be manifolded.

EXHIBIT 1

OPW SYSTEM A TYPE 5
VAPOR RECOVERY SYSTEM