

State of California

AIR RESOURCES BOARD

Executive Order G-70-23

Relating to the Certification of the  
Exxon Balance  
Phase II Vapor Recovery System

Pursuant to the authority vested in the Air Resources Board (ARB) by Health and Safety Code Section 41954; and

Pursuant to the authority vested in the undersigned by Health and Safety Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: That the Exxon Balance, Phase II vapor collection and disposal system is hereby certified for attendant and/or self-serve use at gasoline service stations in conjunction with Phase I vapor recovery systems which have been certified by the Air Resources Board. The piping arrangement for the system hereby certified is described in Exhibit 1 attached. A listing of certified system components is hereby presented in Exhibit 2 attached hereto.

IT IS FURTHER ORDERED AND RESOLVED: That compliance with the applicable certification requirements and rules and regulations of the Division of Measurement Standards, the State Fire Marshal's Office, and the Division of Industrial Safety of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That the system certified hereby shall perform in actual use with the same effectiveness as the certification test system. Compliance with the applicable performance criterion shall be a condition of this certification, and failure to meet this criterion shall constitute grounds for revocation, suspension, or modification of this certification.

IT IS FURTHER ORDERED AND RESOLVED: That any alteration to the equipment, parts, design, or operation of the system certified hereby, is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the undersigned.

IT IS FURTHER ORDERED AND RESOLVED: That in order for vapor return hoses longer than 8 feet in length to be used, the system shall incorporate a liquid blockage detector which is acceptable to the undersigned.

Executed at Sacramento, California this 4th day of August 1978.

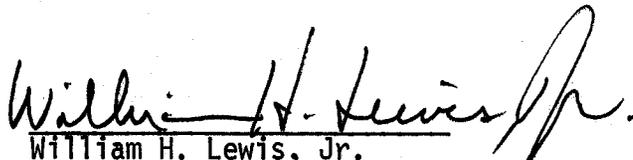
  
William H. Lewis, Jr.  
Executive Officer

Exhibit 1

Executive Order G-70-23

Exxon Balance Phase II

Vapor Recovery System

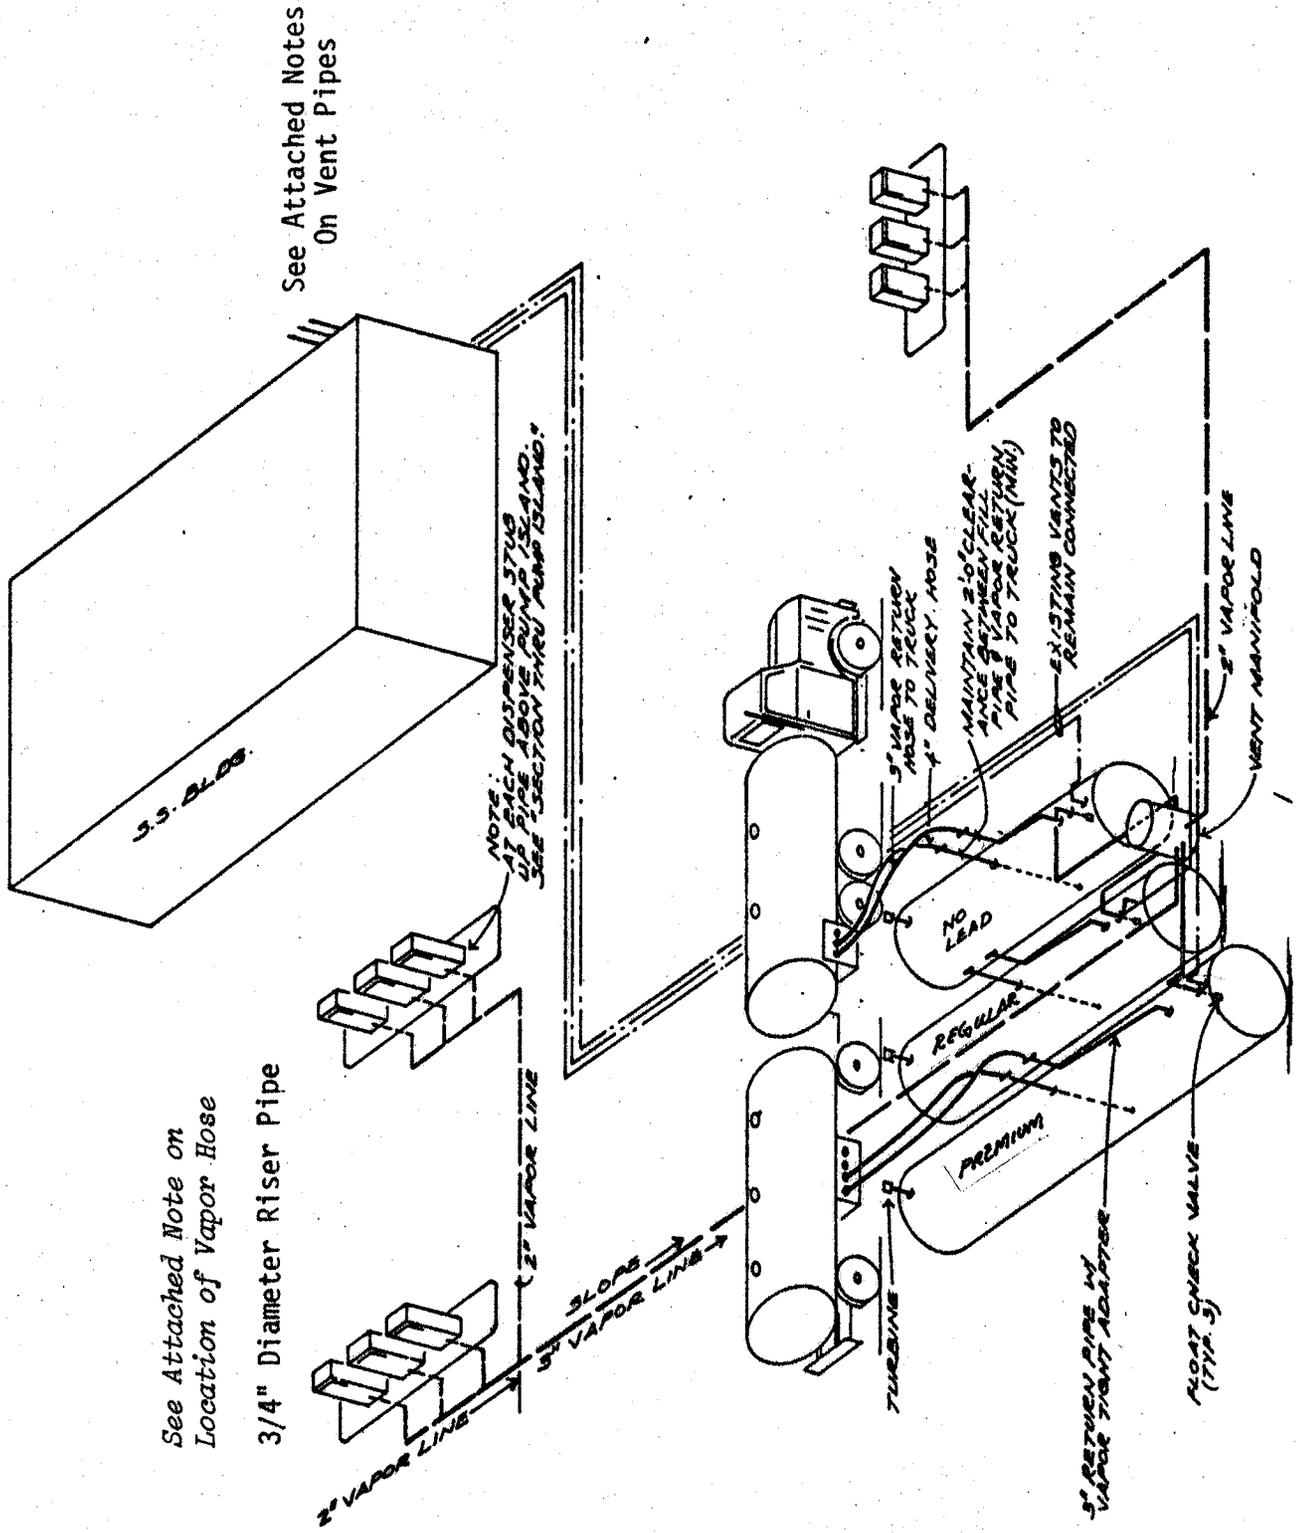


EXHIBIT 2

Executive Order G-70-23

Exxon Balance

Vapor Recovery System

Component List

Item	Manufacturer and Model	State Fire Marshal Identification Number	Substitute Equipment	
			Manufacturer and Model	State Fire Marshal Identification Number
1. Nozzle	Emco Wheaton A3003 ( <i>Extended Spout</i> ) Vapor Recovery Nozzle	GVRC 001:007:2		
2. Liquid Hose	5/8 inch ID by 13 9 feet		3/4 in by 13 9 ft	
3. Vapor Hose	5/8 inch ID by 13 8 feet		3/4 in by 13 8 ft	
4. Riser	3/4 inch diameter Galvanized Pipe			
5. Swivels	OPW 43	GVRC 005:008:6		
a. Nozzle	Single Plane			
b. Island	OPW 36-E	GVRC 005:008:8		
	Double Plane 90			
6. Flow Limiter	Emco Wheaton A-10	GVRC 001:007:1		
7. Recirculation Trap	Emco Wheaton A 008-001	GVRC 001:007:4		

Pressure Drop Through the System  
(Includes Nozzle, Vapor Hoses and Underground piping)

Flow (CFH)	$\Delta$ ("H <sub>2</sub> O)
20	0.10
60	0.40
100	0.96