

State of California
AIR RESOURCES BOARD
EXECUTIVE ORDER G-70-4

Relating to the Certification of the Emco Wheaton
Coaxial Vapor Recovery System for Underground
Storage Tanks at Gasoline Service Stations


Pursuant to the authority vested in the Air Resources Board by Health and Safety Code Section 39068.6 (as added by Chapter 1042, Statutes of 1975); and


Pursuant to the authority vested in the undersigned by Health and Safety Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: That, except as provided below, the Emco Wheaton Corporation, Coaxial, vapor recovery system, with or without a pressure-vacuum valve, is hereby certified for use on underground gasoline storage tanks at service stations. The system certified hereby is shown in Exhibit 1, attached.

IT IS FURTHER ORDERED AND RESOLVED: That use of the pressure-vacuum valve be subject to approval of the local fire chief, and that the tanks and piping be in compliance with appropriate General Industry Safety Orders and in particular the provisions in Articles 144, 145 and 146 thereof.

Executed at Sacramento, California, this 7th day of October, 1976.

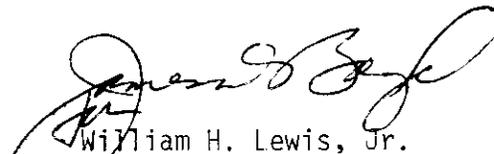
William H. Lewis, Jr.
Executive Officer

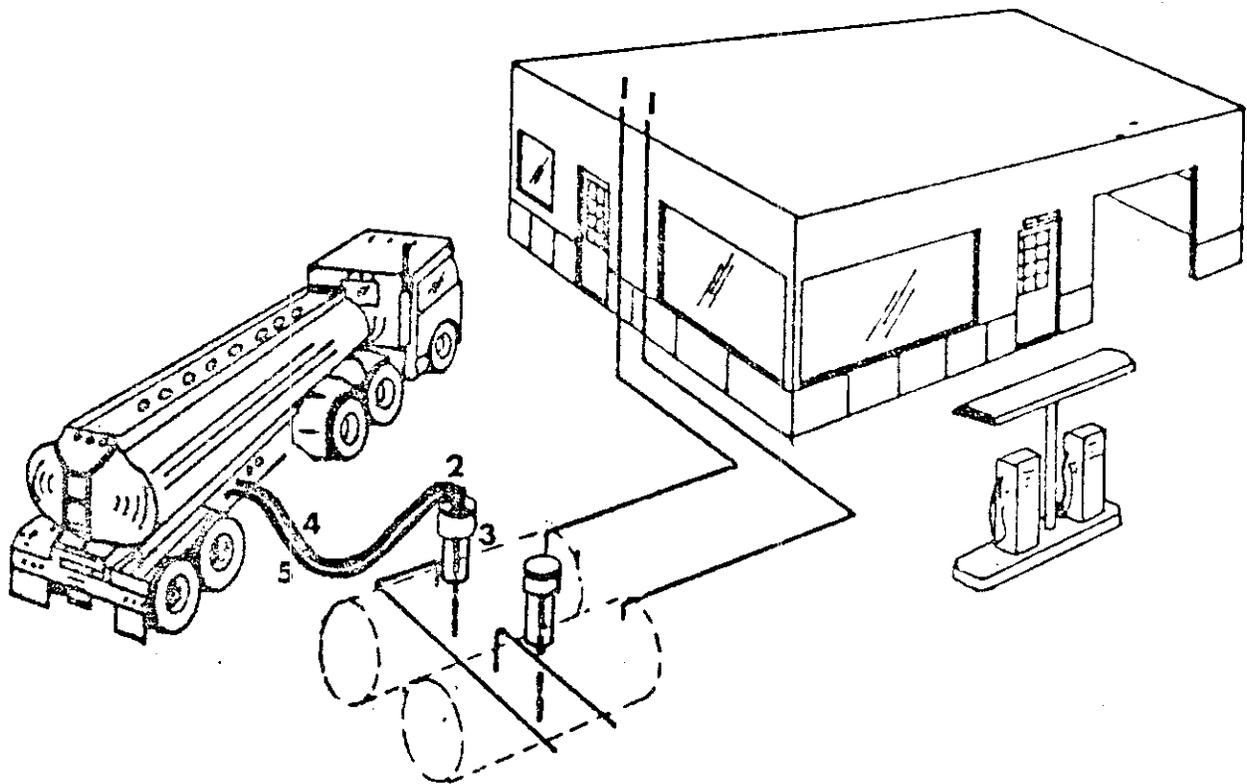

PARTS LIST

- | | | | |
|---|---|---|----------------------|
| 1 | 2" OPEN VENT PIPE (P/V VALVE
OPTIONAL) | 4 | 3" VAPOR RETURN HOSE |
| 2 | EMCO WHEATON F298 COAXIAL FITTING | 5 | 4" PRODUCT HOSE |
| 3 | EMCO WHEATON A70 COAXIAL TUBE AND
ADAPTER WITH ANDREW 54LC CAP (DROP
TUBE EXTENDED TO WITHIN 6" OF THE
BOTTOM OF THE TANK) | | |

Note: Vent pipes may be manifolded.

EXHIBIT I

EMCO WHEATON COAXIAL PHASE I

VAPOR RECOVERY SYSTEM