


EXHIBIT 5  
Executive Order G-70-52-AM  
Coaxial Hose Side-Mount High-Retractor Configuration  
For New and Existing Installations

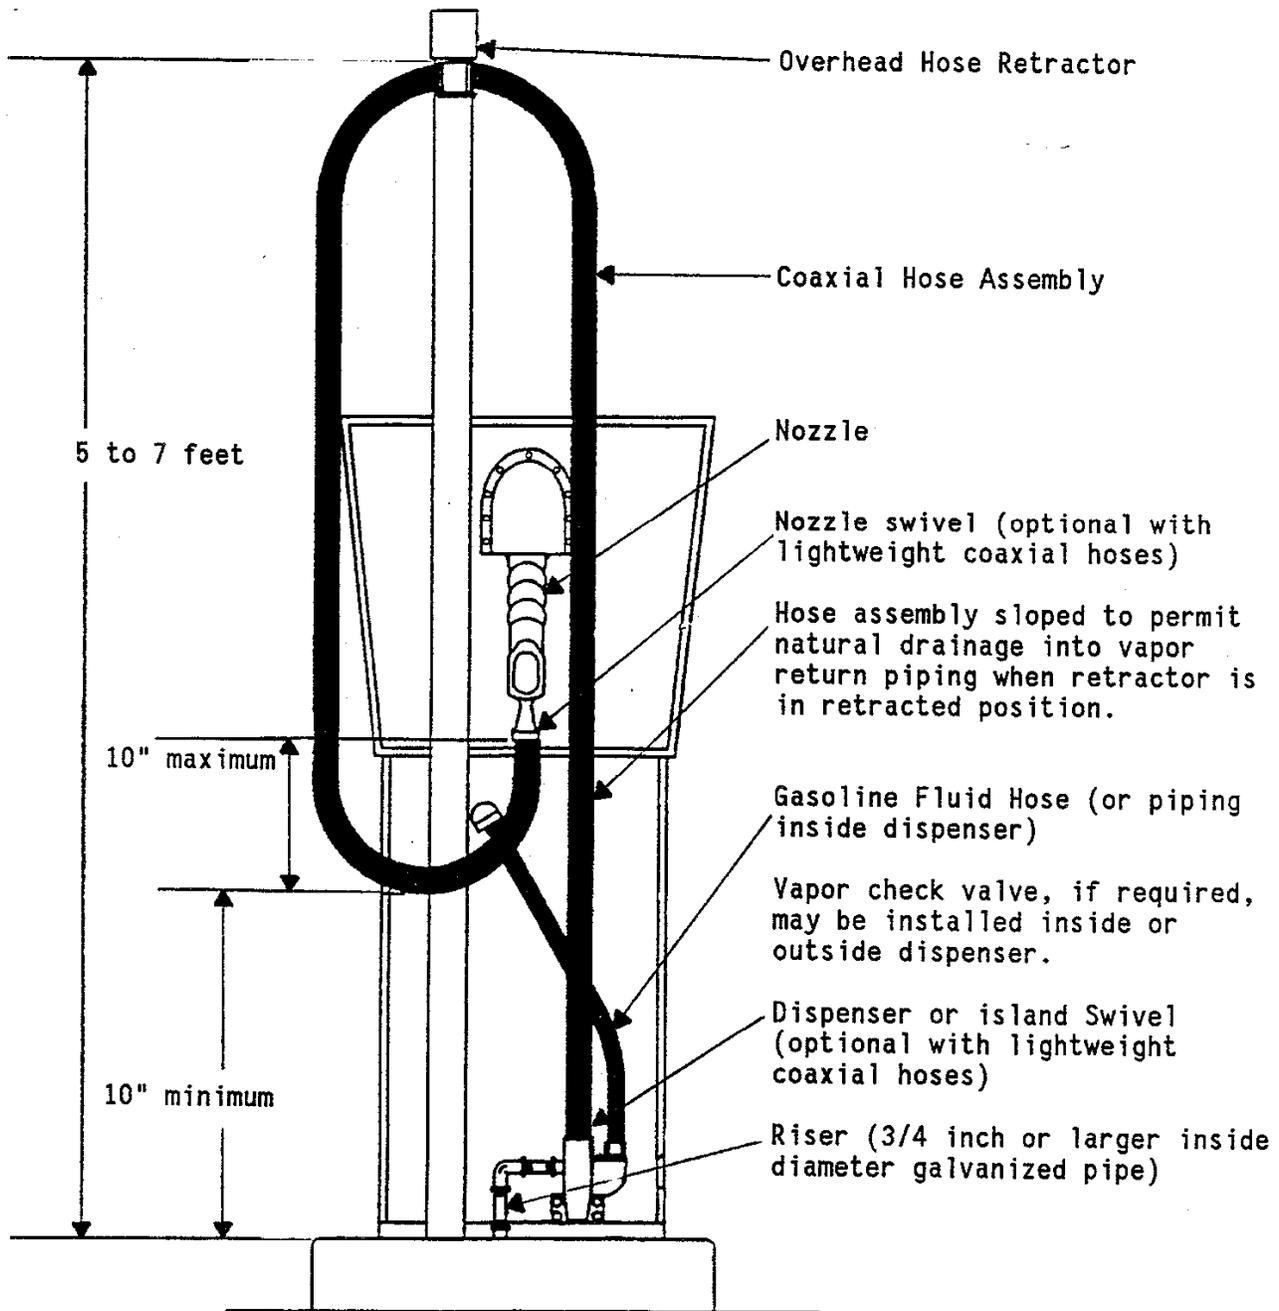

- Notes:
1. See Exhibit 2 for the component list.
  2. A flow limiter is required on dispensers that have a maximum flowrate in excess of 10 gpm. A flow limiter may be required on all gasoline dispensers at the option of the local air pollution control district.
  3. Vapor return piping may be installed on the inside or on the outside of the dispenser cabinet.
  4. The Emco Wheaton and EZ-flo A4001 and A4003 nozzles are permitted only when used in conjunction with approved vapor check valves.
  5. Nozzle and dispenser or island swivels are required with hardwall coaxial hoses, and are optional with lightweight coaxial hoses.