


EXHIBIT 6
Executive Order G-70-52-AM
Dual and Coaxial Hose Dispenser-Mount High-Retractor Configuration

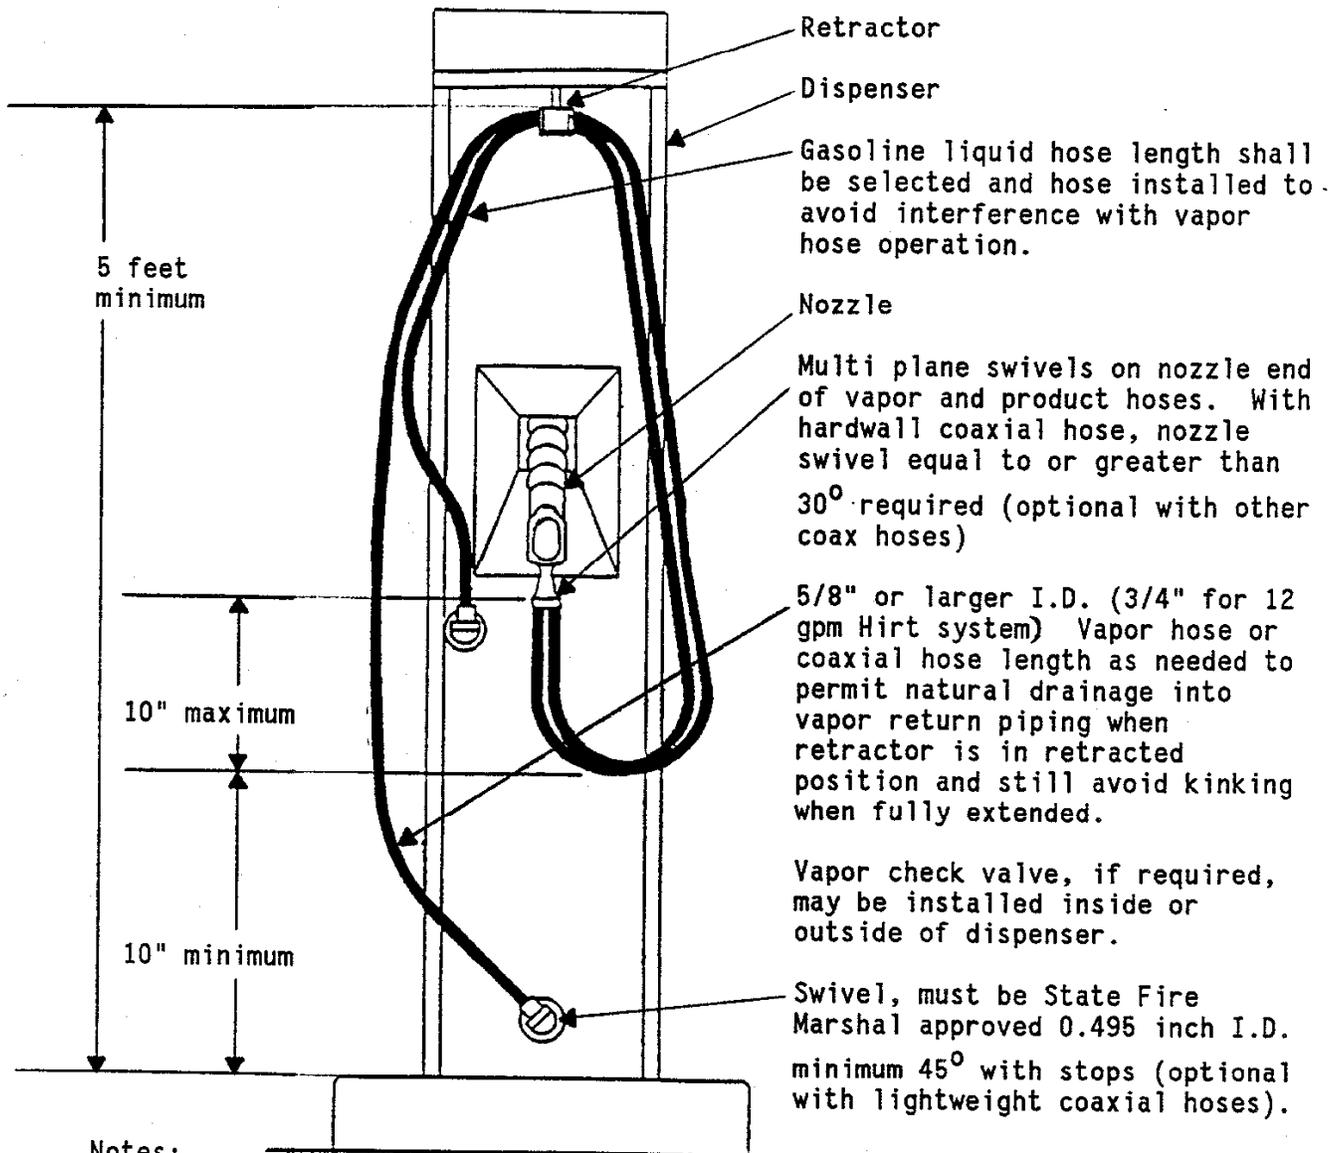

Notes:

1. See Exhibit 2 for the component list.
2. A flow limiter is required on dispensers that have a maximum flowrate in excess of 10 gpm (12 gpm for dispensers with the Hirt system provided that 3/4" ID vapor hoses are used), and may be required on any gasoline dispenser at the discretion of the local air pollution control district.
3. Use appropriate hose ties.
4. Vapor return piping may be installed inside or outside dispenser cabinet.
5. Riser shall be 3/4 inch or larger inside diameter galvanized pipe.
6. The Emco Wheaton and EZ-flo A4000, A4001, A4002 and A4003 nozzles are permitted only when used in conjunction with approved vapor check valves.
7. The coaxial hose dispenser-mount high-retractor configuration can be used for all new and existing installations. The dual hose dispenser-mount high-retractor configuration may not be used for new installations.
8. Nozzle and dispenser swivels are required with dual hoses and with hardwall coaxial hoses, and are optional with lightweight coaxial hoses.