Executive Order VR-201-A
Healy Phase II EVR System
Not Including ISD

Exhibit 8

Items to Consider in Conducting TP-201.3

The instructions below are required when conducting TP-201.3 for this system. The tester shall document that each step was followed as indicated below and shall include this page of the Exhibit with the submission of TP-201.3 test results. Note that districts may require use of an alternate form to meet these requirements, provided the alternate form includes the same minimum parameters.

1. Prior to conducting TP-201.3, all four ball valves on the Healy Clean Air Separator (CAS) shall be closed, as shown in Figure 1, to isolate it from the UST system to permit the pressurization of the UST system.

2. Conducting TP-201.3 with any dispenser piping test valve in the closed position is **not** permitted. Any dispenser with a dispenser piping test valve in the closed position while conducting TP-201.3 will bias the test towards compliance.

3. After conducting TP-201.3, the four ball valves on Healy Clean Air Separator (CAS) shall be locked in their normal operating positions as shown in Figure 2B-5 of Exhibit 2.

Required Steps	Verification (please circle)
1. All four CAS ball valves closed before conducting TP-201.3	Yes No
2. All dispenser piping test valves open before conducting TP-201.3	Yes No
3. All four CAS ball valves in normal operating positions after conducting TP-201.3.	Yes No

Test Company:_____ Facility Name:_____

_____
Print Name (Tester) Signature Date

Figure 1
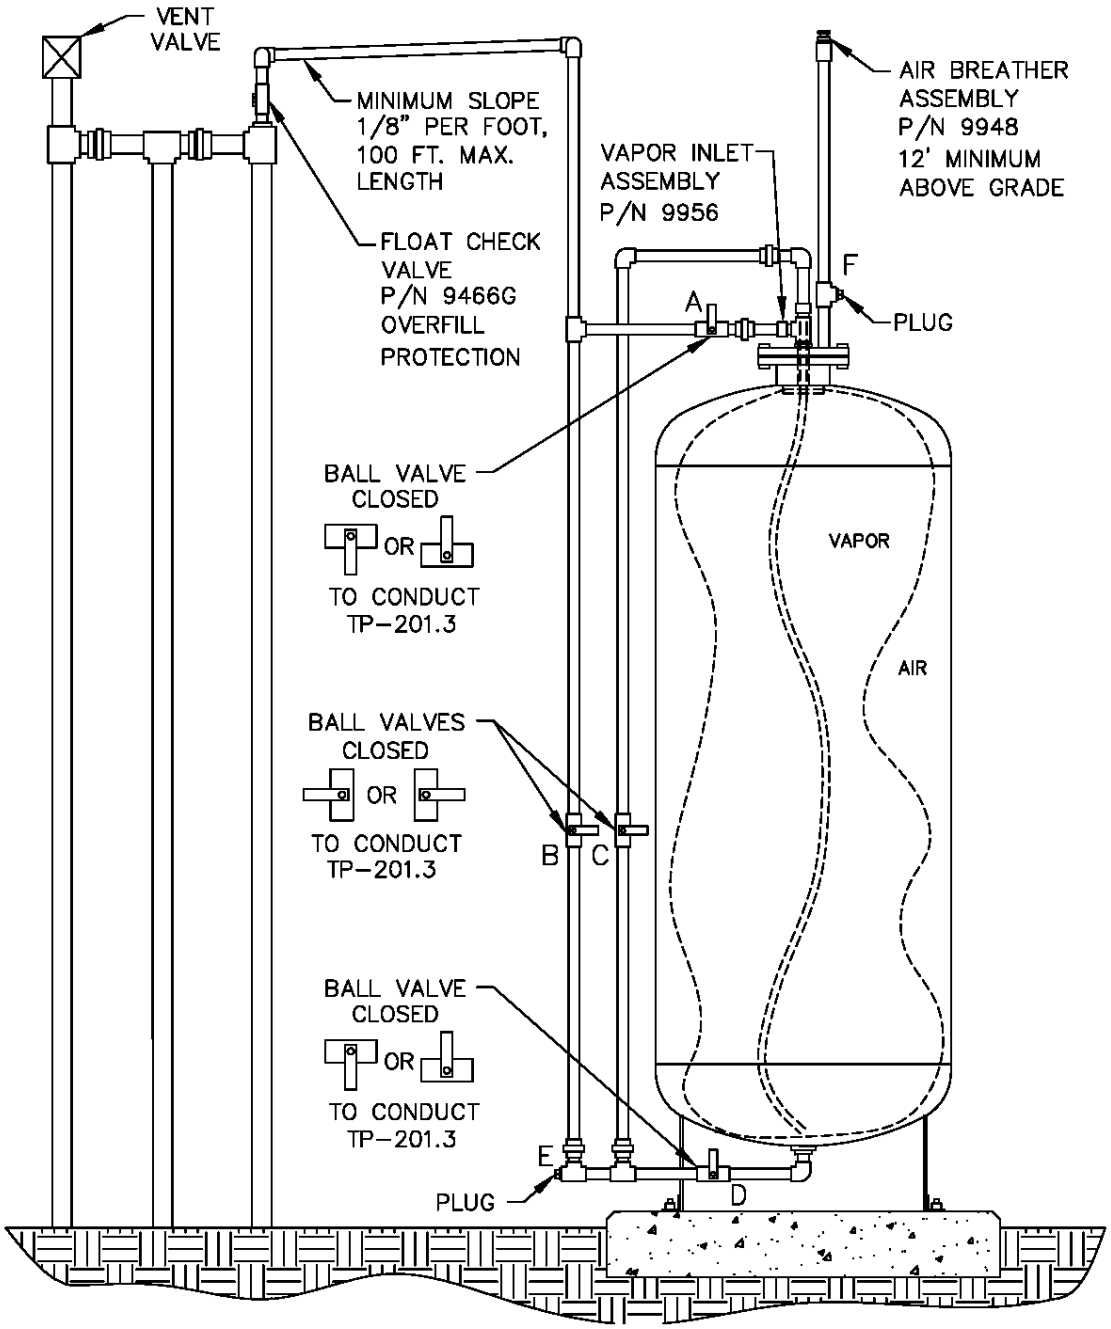
Configuration of Healy Clean Air Separator to Conduct TP-201.3