


Figure 1

Configuration of VST Membrane Processor to Conduct TP-201.3

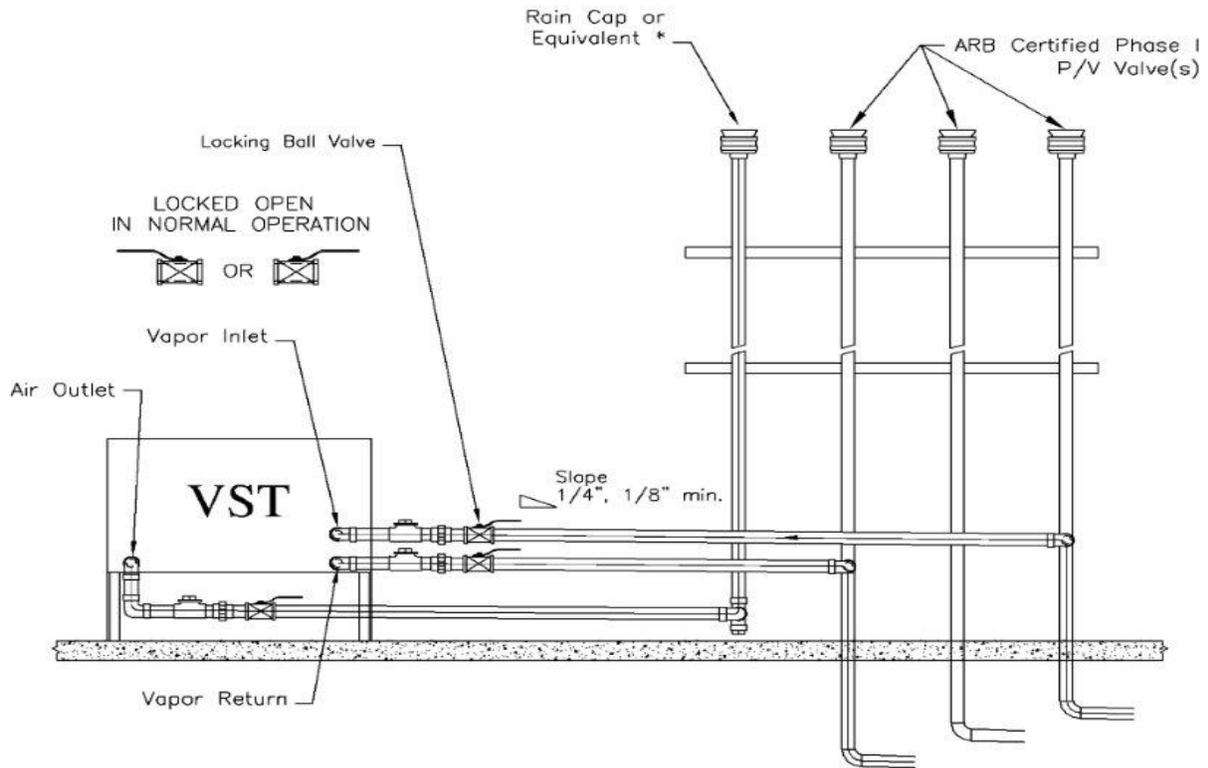


CAUTION: THE HANDLES ON THE LOCKING BALL VALVES MUST NOT BE REMOVED

* If a P/V valve is used, the internal components MUST be removed to allow open venting to the atmosphere.

Figure 2

Configuration of Veeder-Root Vapor Polisher to Conduct TP-201.3

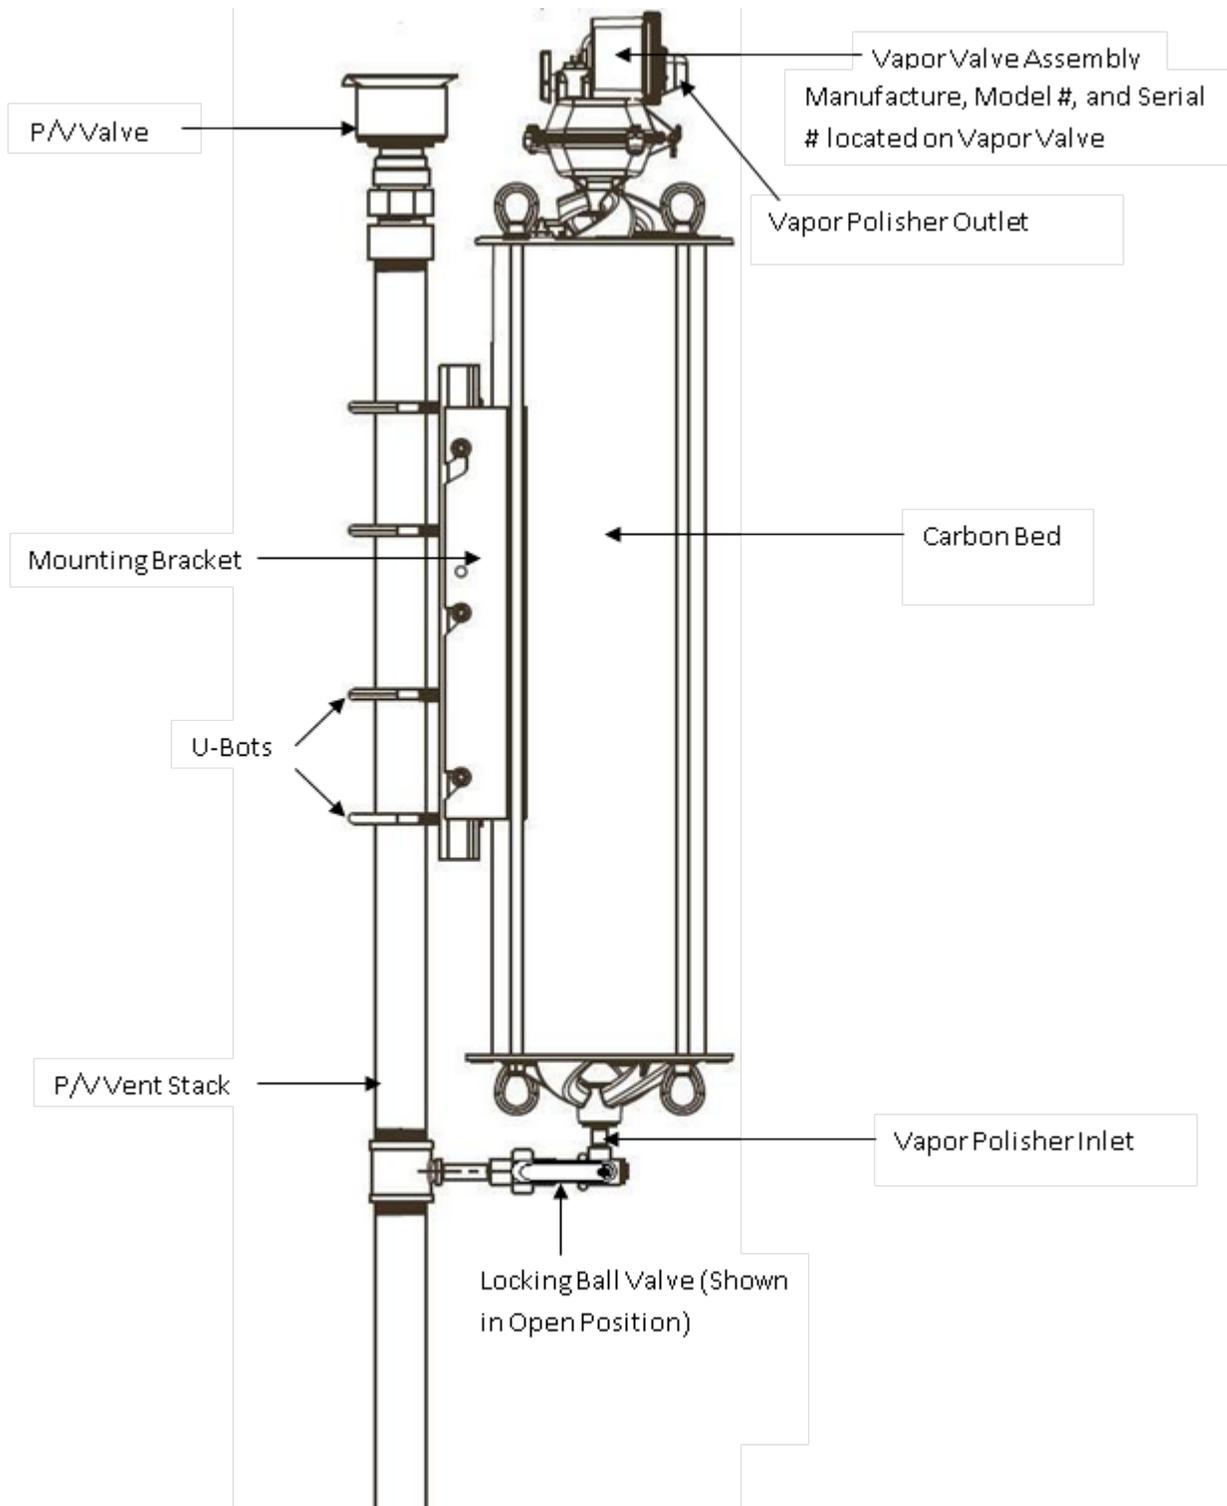

Franklin Fueling System Clean Air Separator Installed

1. Prior to conducting TP-201.3, all four ball valves on the CAS shall be closed, as shown in Figure 3 or Figure 3H, to isolate it from the UST system to permit the pressurization of the UST system.
2. After conducting TP-201.3, the four ball valves on the Healy Clean Air Separator (CAS) shall be locked in their normal operating positions as shown in Figure 2B-16 or Figure 2B-16H, Exhibit 2.

Required Steps	Verification (please circle)
1. All four CAS ball valves closed before conducting TP-201.3	Yes No
2. All four CAS ball valves in normal operating positions after conducting TP-201.3.	Yes No

Test Company: _____ Facility Name: _____

Print Name (Technician)

Signature

Date

Technician Certification Number and Expiration Date
(ICC or District Training Certification, as applicable)

Figure 3

Configuration of Healy Clean Air Separator to Conduct TP-201.3

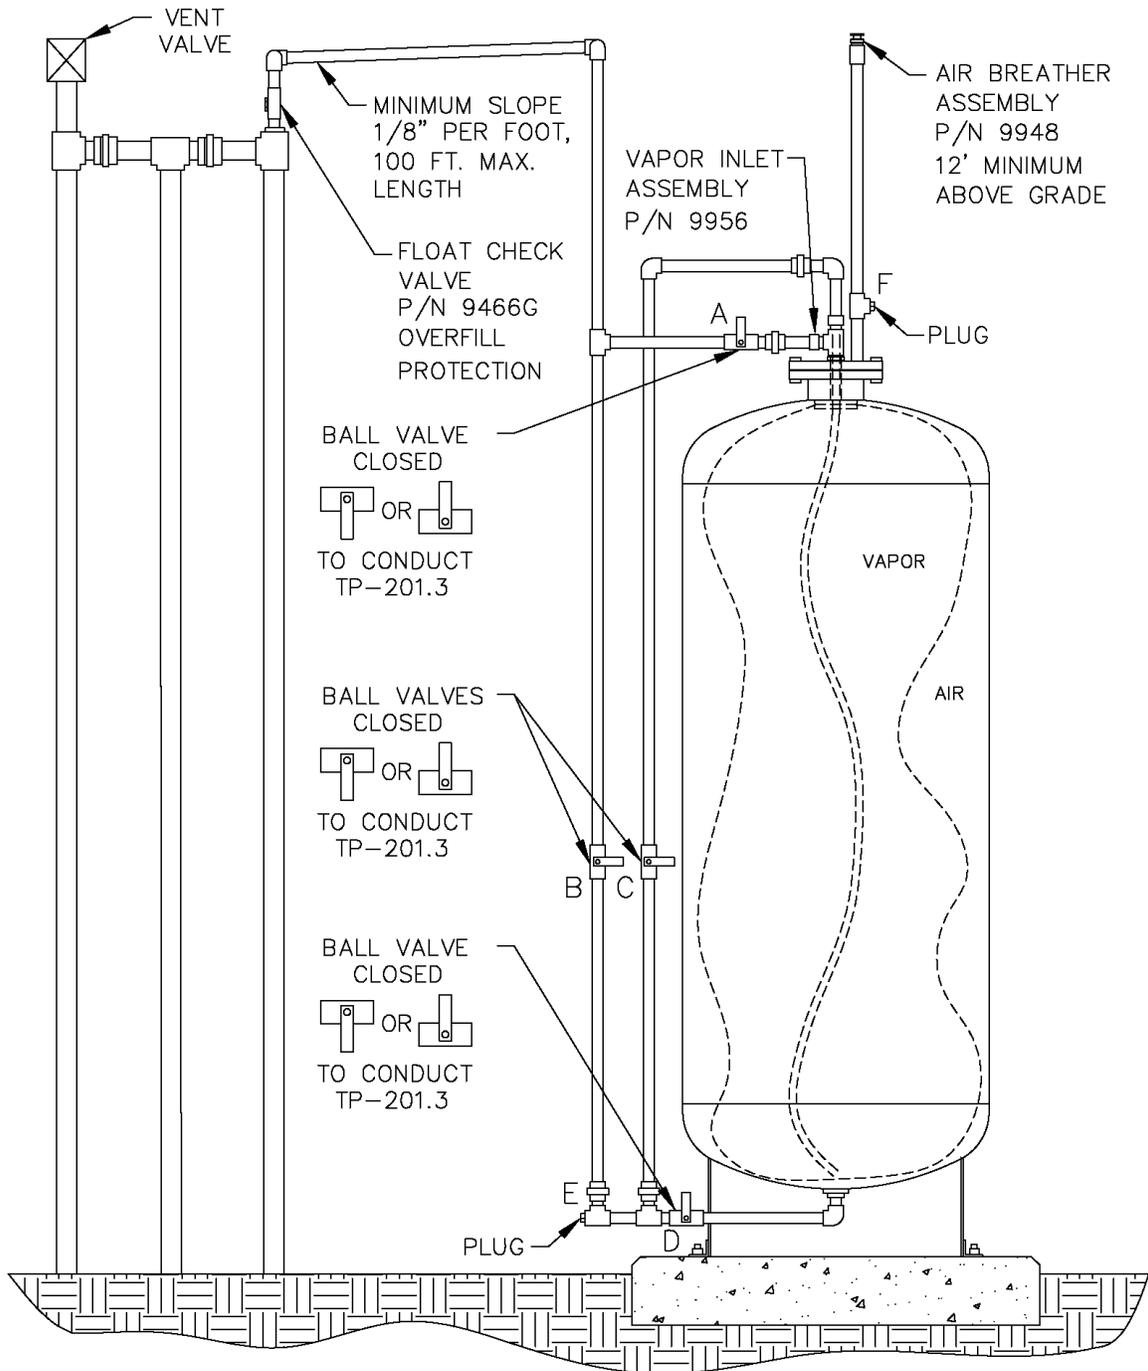


Figure 3H

Configuration of Healy Clean Air Separator to Conduct TP-201.3

