


Figure 1

Configuration of VST Membrane Processor to Conduct TP-201.3

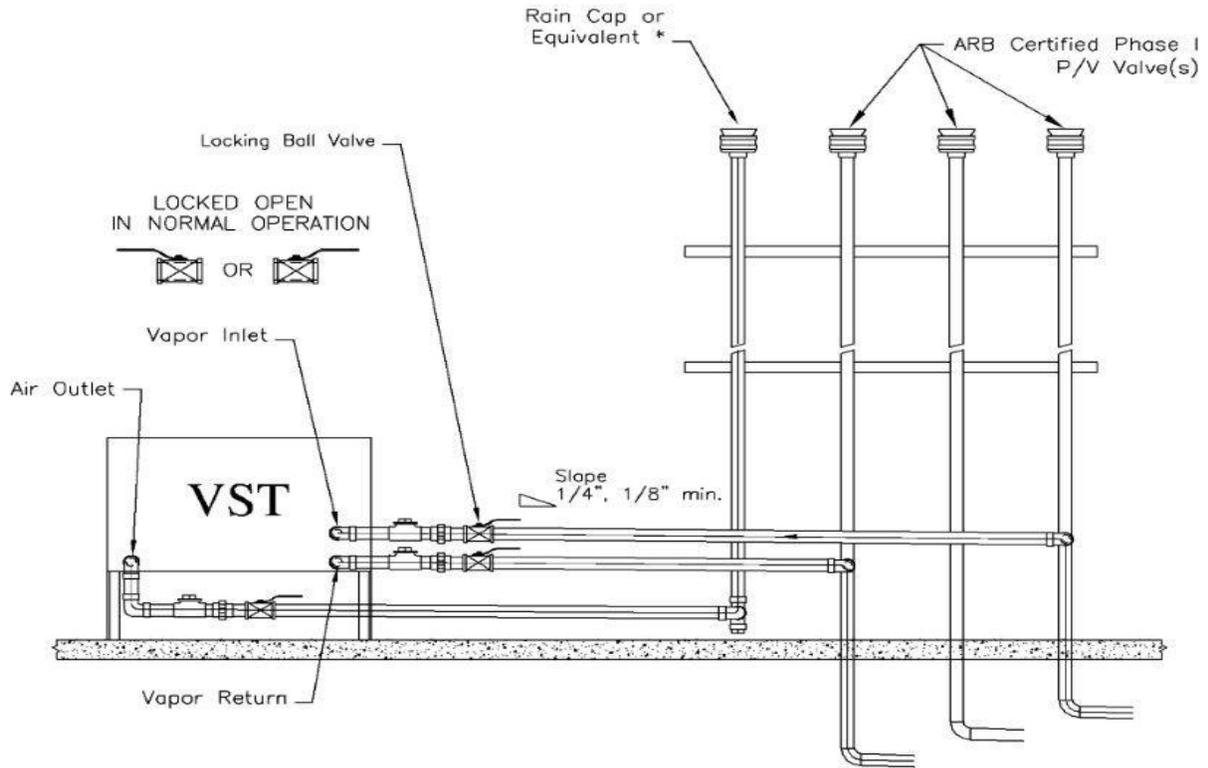


CAUTION: THE HANDLES ON THE LOCKING BALL VALVES MUST NOT BE REMOVED

- * If a P/V valve is used, the internal components MUST be removed to allow open venting to the atmosphere.

Figure 2

Configuration of Veeder-Root Vapor Polisher to Conduct TP-201.3

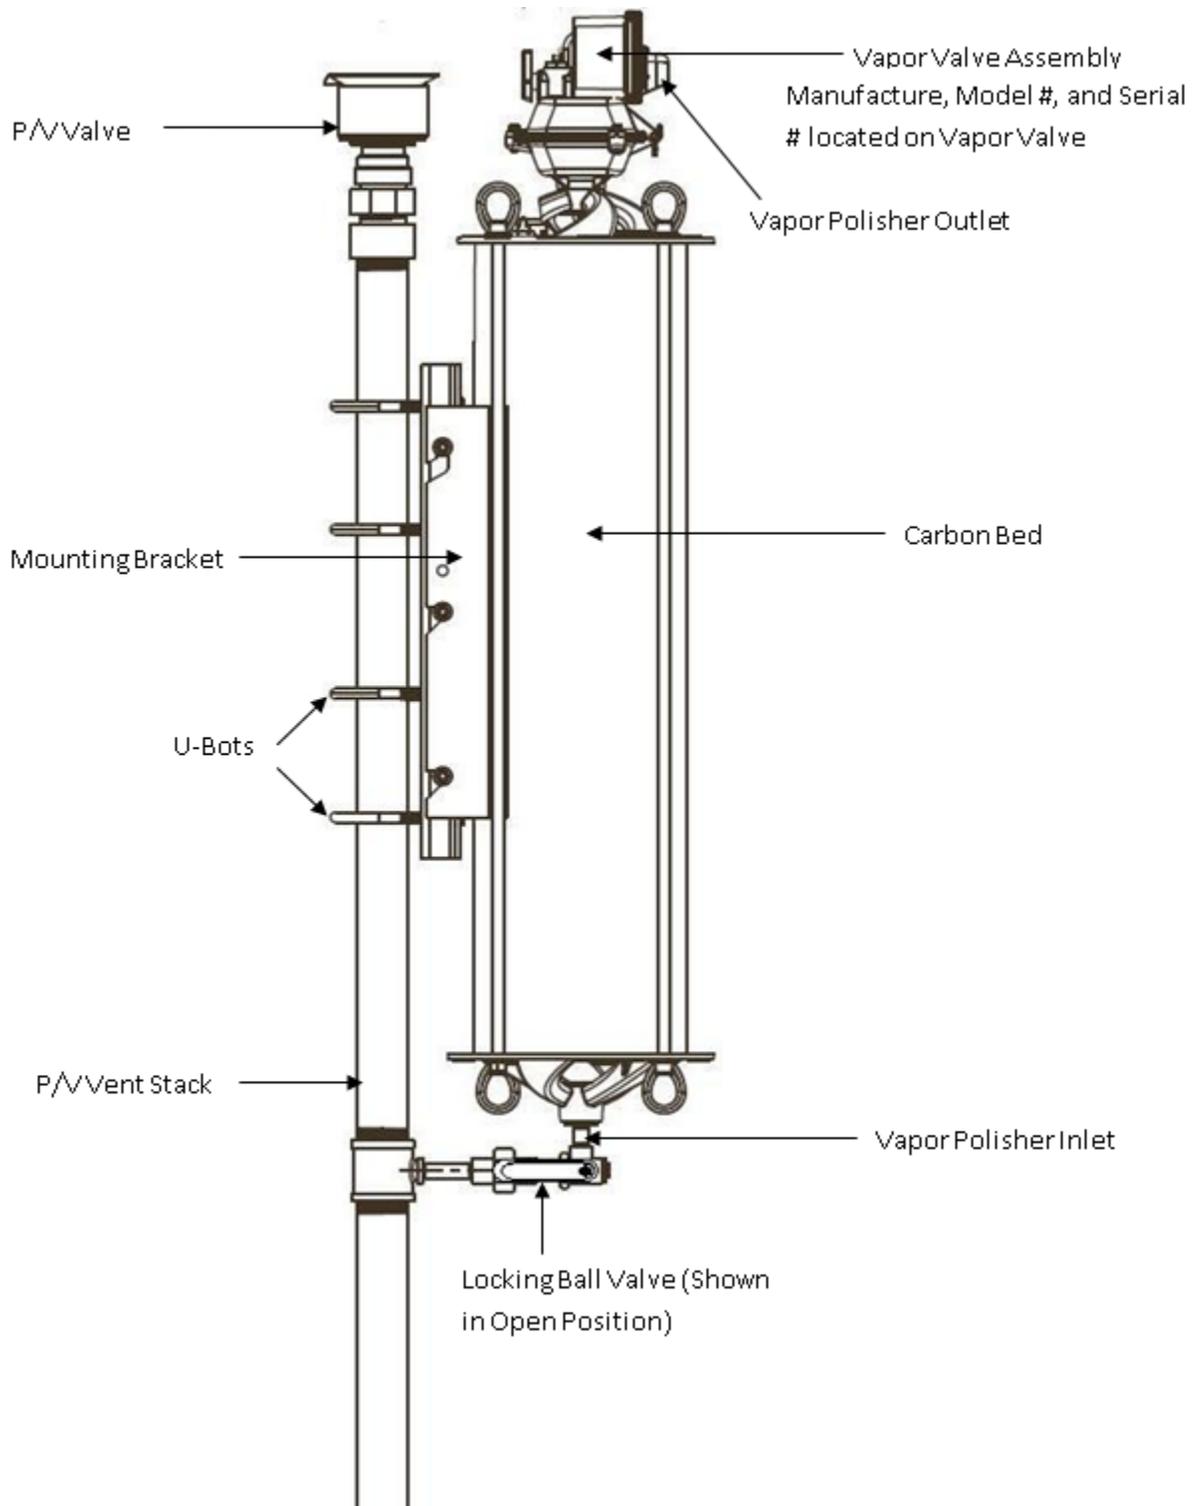

Franklin Fueling System Clean Air Separator Installed

1. Prior to conducting TP-201.3, all four ball valves on the CAS shall be closed, as shown in Figure 3 or Figure 3H, to isolate it from the UST system to permit the pressurization of the UST system.
2. After conducting TP-201.3, the four ball valves on the Healy Clean Air Separator (CAS) shall be locked in their normal operating positions as shown in Figure 2B-16 or Figure 2B-16H, Exhibit 2.

Required Steps	Verification (please circle)
1. All four CAS ball valves closed before conducting TP-201.3	Yes No
2. All four CAS ball valves in normal operating positions after conducting TP-201.3.	Yes No

Test Company: _____ Facility Name: _____

Print Name (Technician)

Signature

Date

Technician Certification Number and Expiration Date
(ICC or District Training Certification, as applicable)

Figure 3

Configuration of Healy Clean Air Separator to Conduct TP-201.3


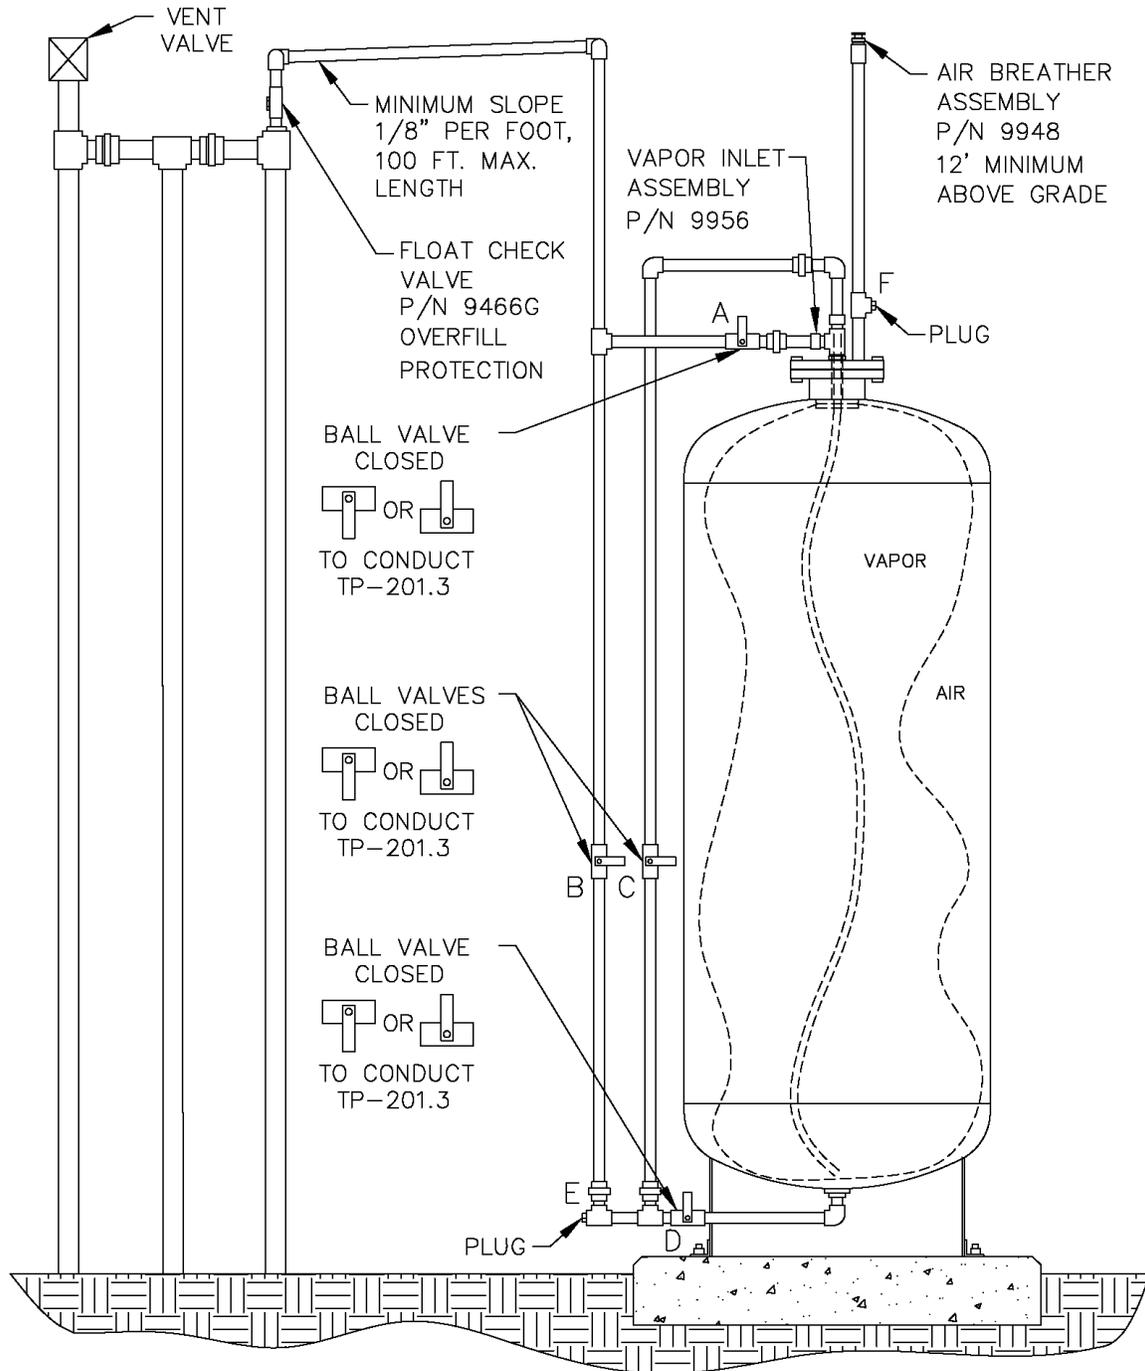


Figure 3H

Configuration of Healy Clean Air Separator to Conduct TP-201.3

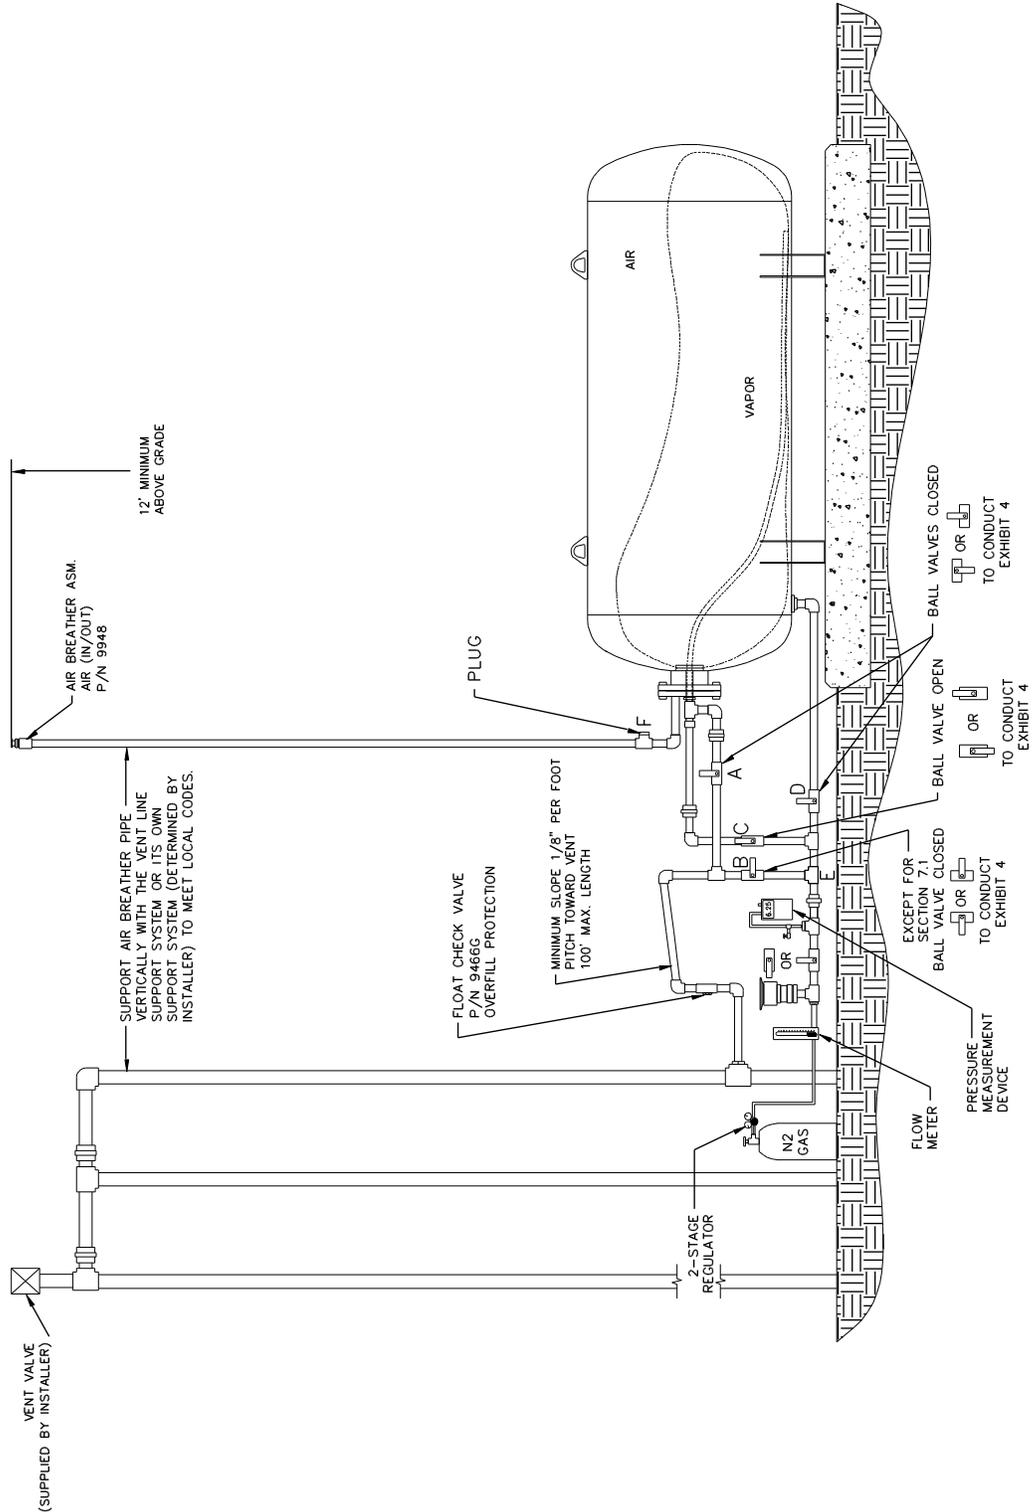

Hirt VCS 100 Thermal Oxidizer Installed

1. Prior to conducting TP-201.3, the ball valve on the inlet of the Hirt VCS 100 processor shall be Open (Open to UST Ullage), as shown in Figure 4. At the Hirt Indicator Panel, turn the Power Switch to the “Off” position.
2. After conducting TP-201.3, turn the Power Switch to the “On” position.
3. The ball valve on the inlet of the Hirt VCS 100 processor shall remain opened and locked.

Required Steps	Verification (please circle)	
1. Inlet ball valve is open and Power Switch is in “Off” position before conducting TP-201.3?	Yes	No
2. Power Switch is in “On” position after conducting TP-201.3?	Yes	No
3. Inlet ball valve is in the open locked position after conducting TP-201.3?	Yes	No

Test Company: _____ Facility Name: _____

Print Name (Technician)

Signature

Date

Technician Certification Number and Expiration Date
(ICC or District Training Certification, as applicable)

Note: The Hirt Processor Operability Test (if required by the local District), shall be performed prior to conducting Exhibit 4.

Figure 4

Configuration of Hirt VCS 100 Thermal Oxidizer to Conduct TP-201.3

