Executive Order VR-208-A
Emco Phase II EVR System with Hirt Thermal Oxidizer Including INCON ISD

Exhibit 4
Required Items in Conducting TP-201.3[1,2]

The instructions below are required when conducting TP-201.3 for the Emco Phase II EVR system with Hirt VCS 100 processor. The tester shall document that each step was followed as indicated below and shall include this page of the Exhibit with the submission of TP-201.3 test results. **See footnote regarding testing of pressure/vacuum vent valve**. Note that districts may require use of an alternate form to meet these requirements, provided the alternate form includes the same minimum parameters.

Hirt VCS 100 Thermal Oxidizer Installed

1. Prior to conducting TP-201.3, the ball valve on the inlet of the Hirt VCS 100 processor shall be Open (Open to UST Ullage), as shown in Figure 1. At the Hirt Indicator Panel, turn the Power Switch to the "Off" position.

2. After conducting TP-201.3, turn the Power Switch to the "On" position.

3. The ball valve on the inlet of the Hirt VCS 100 processor shall remain opened and locked.

Required Steps	Verification (please circle)
1. Inlet ball valve is open and Power Switch is in "Off" position before conducting TP-201.3?	Yes No
2. Power Switch is in "On" position after conducting TP-201.3?	Yes No
3. Inlet ball valve is in the open locked position after conducting TP-201.3?	Yes No

Test Company: _____ Facility Name:_____

_____
Print Name (Technician) Signature Date

_____
Technician Certification Number and Expiration Date
(ICC or District Training Certification, as applicable)

[1] Note: If the pressure/vacuum (P/V) vent valve is required to be tested by the local District, then the P/V vent valve shall be tested prior to conducting Exhibit 4.
[2] If Exhibit 8 Testing is to be conducted following completion of this test, at least 24 hours must have elapsed before conducting Exhibit 8.
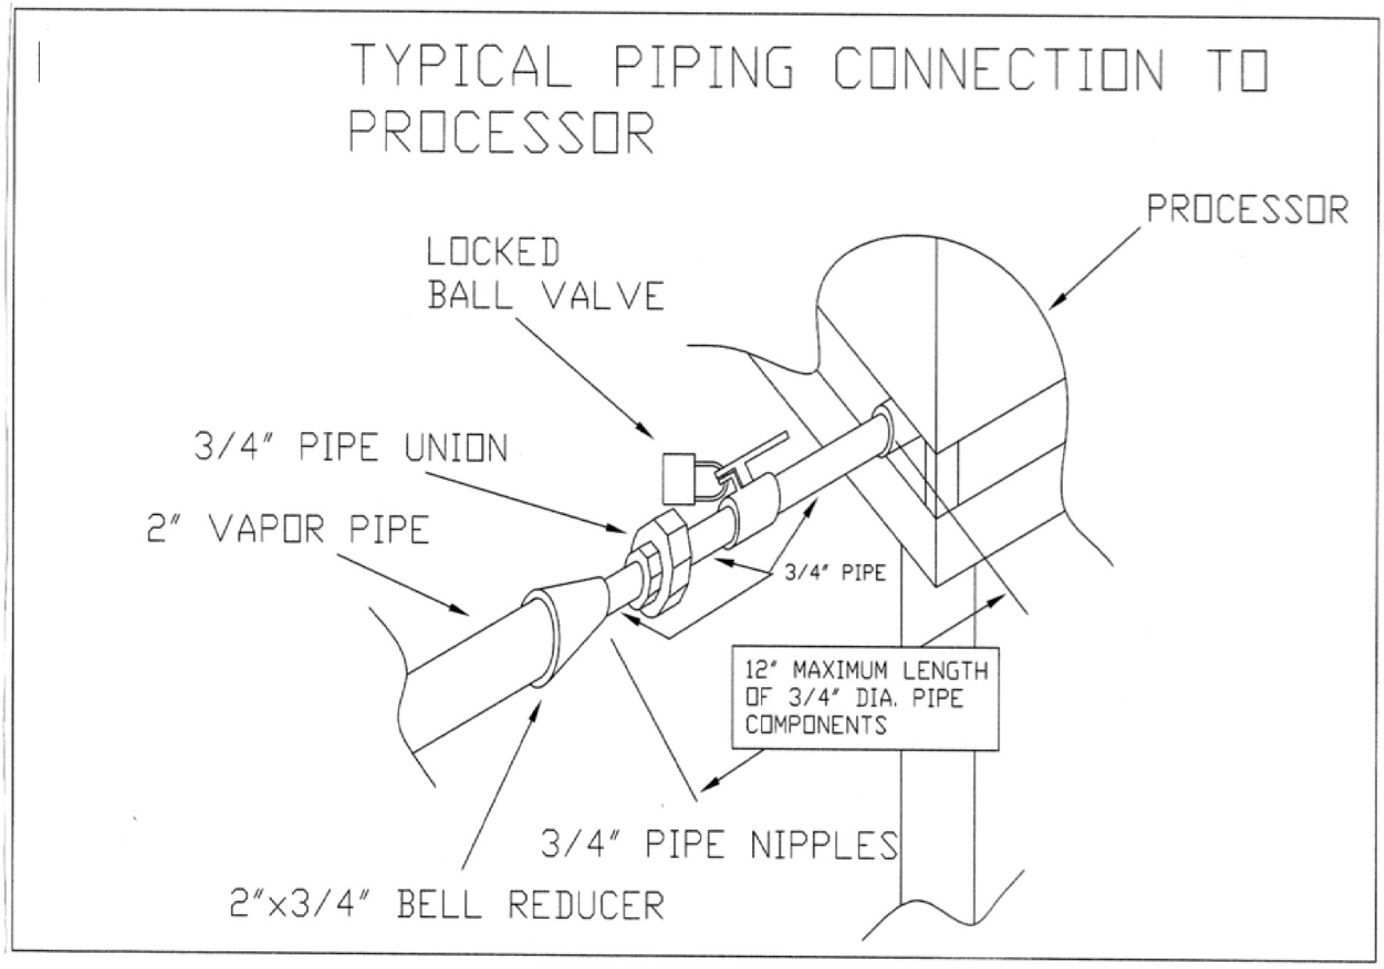
Figure 1
Configuration of Hirt VCS 100 Thermal Oxidizer to Conduct TP-201.3