Executive Order VR-209-A
VST Phase II EVR System with Clean Air Separator

Exhibit 8
Required Items in Conducting TP-201.3[1]

The instructions below are required when conducting TP-201.3 for the VST Phase II EVR system with Clean Air Separator (CAS). The tester shall document that each step was followed as indicated below and shall include this page of the Exhibit with the submission of TP-201.3 test results. **See footnote regarding testing of the P/V vent valve.** Note that districts may require use of an alternate form to meet these requirements, provided the alternate form includes the same minimum parameters.

1. Prior to conducting TP-201.3, all four ball valves on the CAS shall be closed, as shown in Figure 1 or Figure 1H, to isolate it from the UST system to permit the pressurization of the UST system.

2. After conducting TP-201.3, the four ball valves on the Healy Clean Air Separator (CAS) shall be locked in their normal operating positions as shown in Figure 2B-2 or Figure 2B-2H, Exhibit 2 of Executive Order VR-209-A.

Required Steps	Verification (please circle)
1. All four CAS ball valves closed before conducting TP-201.3	Yes No
2. All four CAS ball valves in normal operating positions after conducting TP-201.3.	Yes No

Test Company: _____ Facility Name:_____

_____
Print Name (Technician) Signature Date

_____
Technician Certification Number and Expiration Date
(If required to meet the requirements of the local district)

[1] **Note: If the P/V vent valve is required to be tested by the local District, then the P/V vent valve shall be tested prior to conducting Exhibit 8.**

Figure 1

Configuration of Healy Clean Air Separator to Conduct TP-201.3

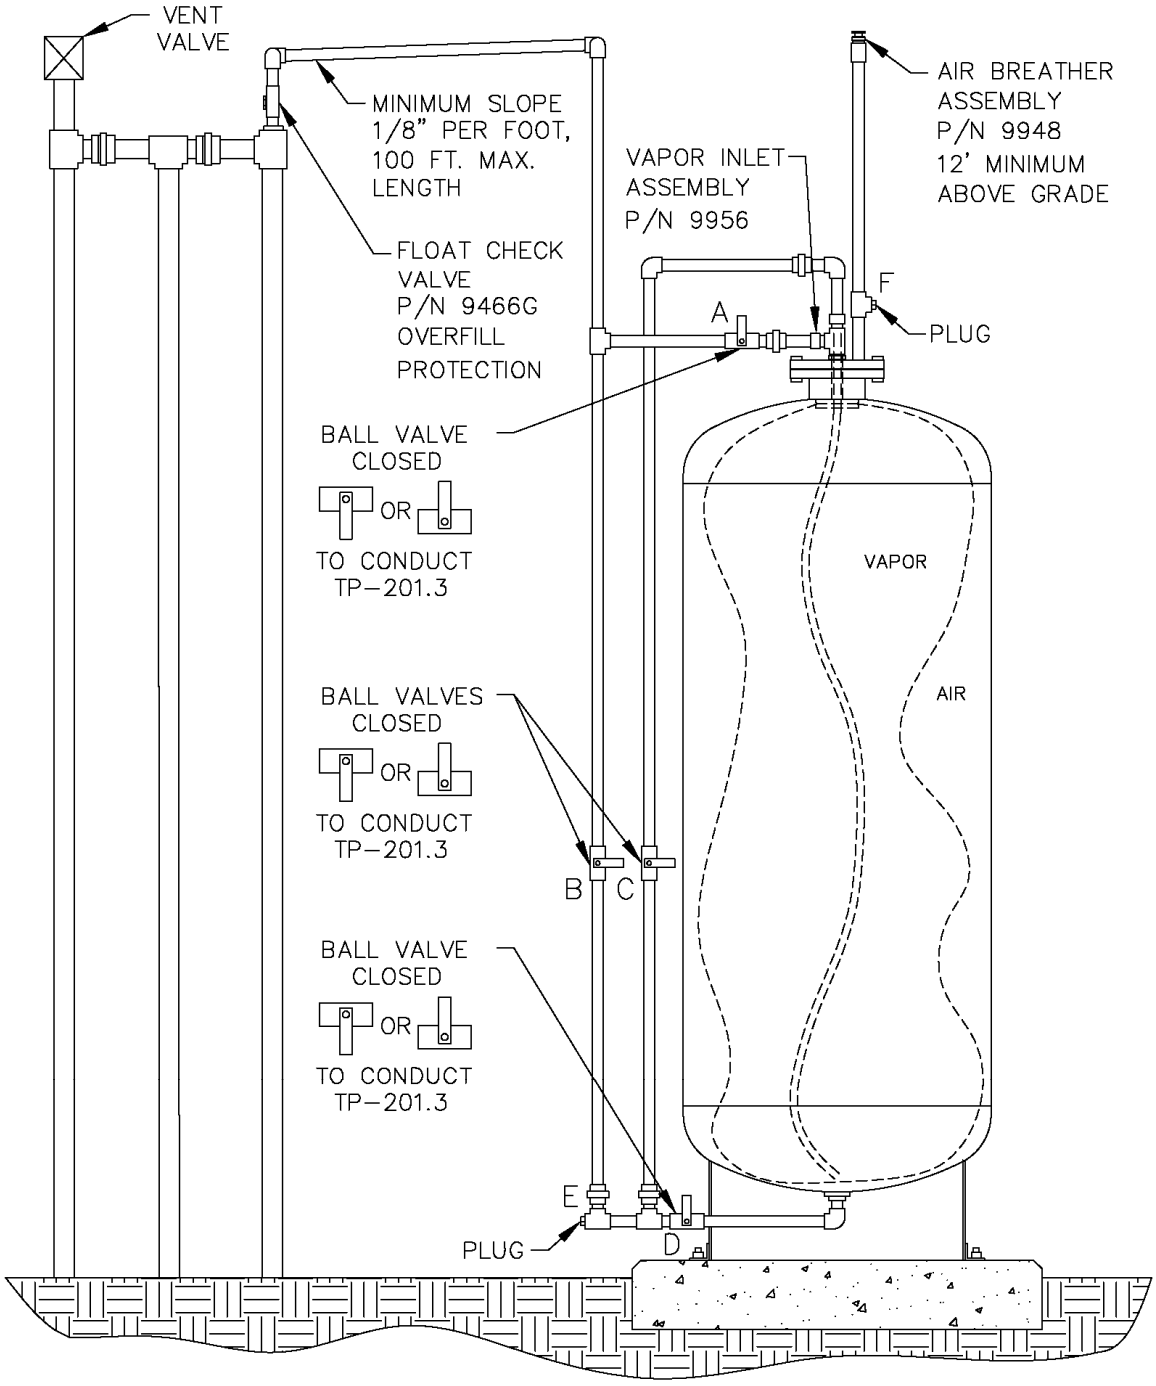

Figure 1H
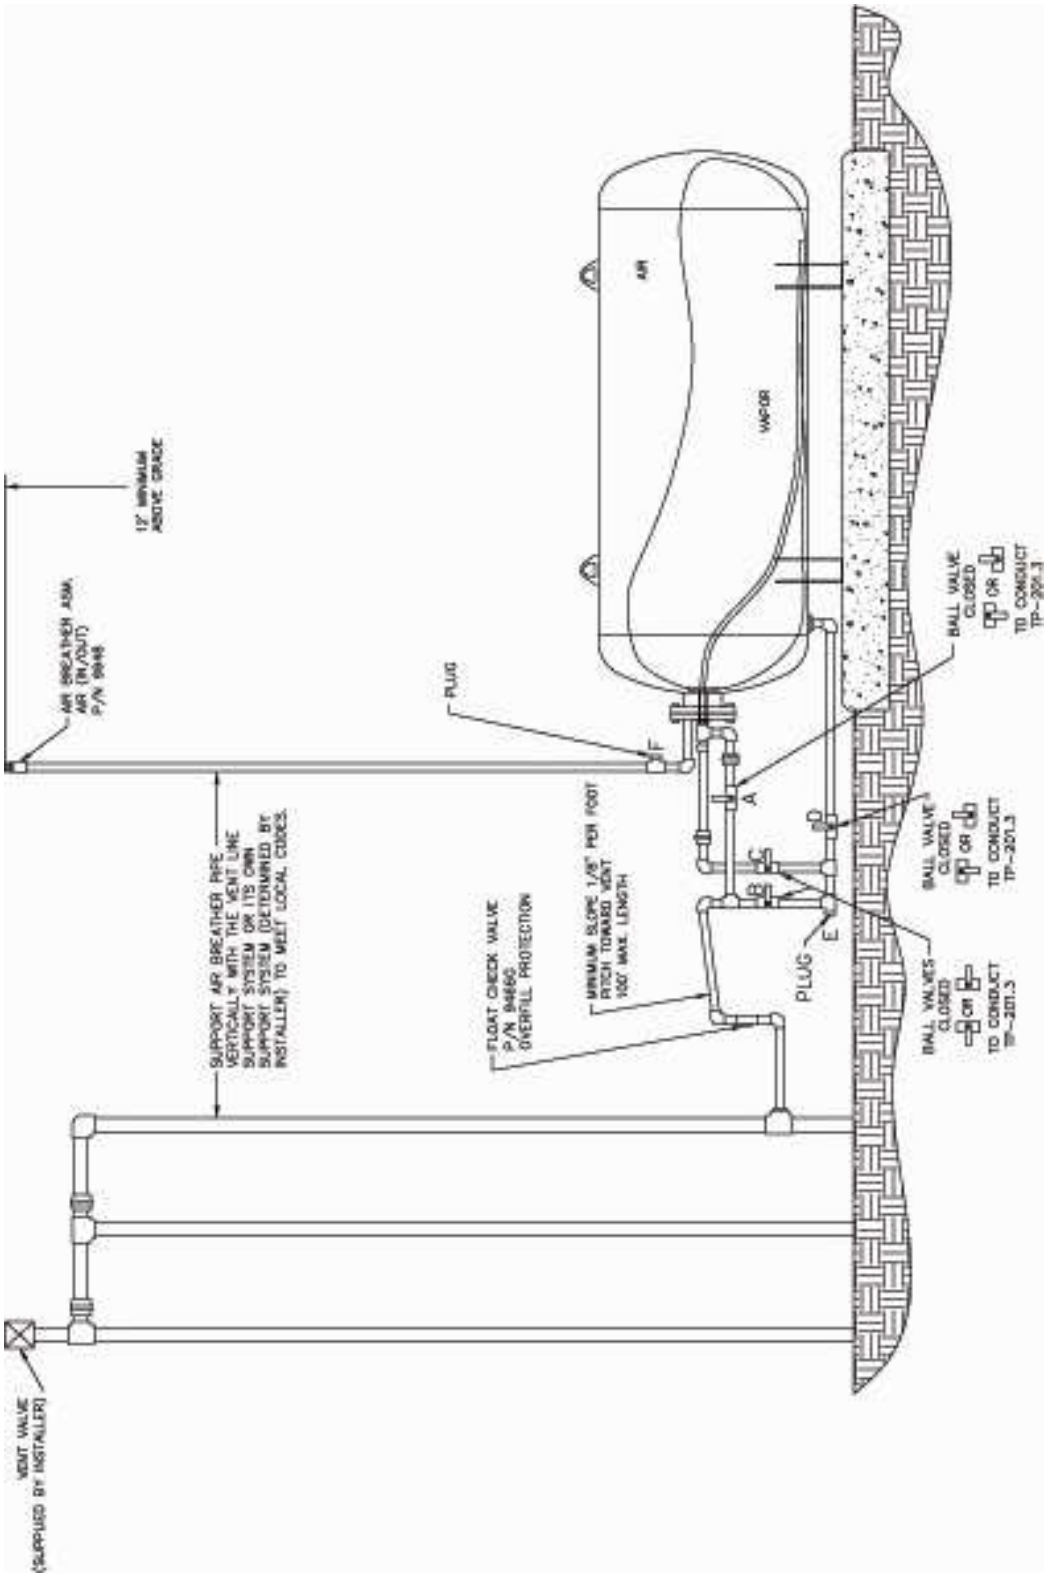
Configuration of Healy Clean Air Separator to Conduct TP-201.3